

Building A · GROUND FLOOR (Light scene 1)

Room list



Building A · GROUND FLOOR (Light scene 1)

Room list

101 STAIRS

P_{total}
76.0 W

A_{Room}
5.88 m²

Lighting power density
12.94 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

102 CORRIDOR / LOBBY

P_{total}
892.0 W

A_{Room}
45.50 m²

Lighting power density
19.61 W/m² = 3.90 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$ (Working plane)
503 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
2	Philips		2x36W	76.0 W	4663 lm
5	Philips		4x36W SLB	148.0 W	8268 lm

103 TOILET

P_{total}
76.0 W

A_{Room}
3.03 m²

Lighting power density
25.05 W/m² = 12.01 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$ (Working plane)
209 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

104 TOLIET

P_{total} 76.0 W	A_{Room} 2.93 m ²	Lighting power density 25.97 W/m ² = 12.45 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 209 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

105 TOILET DISABLE

P_{total} 76.0 W	A_{Room} 4.88 m ²	Lighting power density 15.57 W/m ² = 8.50 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 183 lx
------------------------------------	--	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

106 MEETING

P_{total} 296.0 W	A_{Room} 12.47 m ²	Lighting power density 23.73 W/m ² = 3.80 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 625 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	Philips		4x36W SLB	148.0 W	8268 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

107 MEETING

P_{total} 296.0 W	A_{Room} 12.34 m ²	Lighting power density 23.99 W/m ² = 3.72 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 644 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	Philips		4x36W SLB	148.0 W	8268 lm

108 CORRIDOR

P_{total} 896.0 W	A_{Room} 52.09 m ²	Lighting power density 17.20 W/m ² = 4.61 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 373 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm
4	Philips		4x36W SLB	148.0 W	8268 lm

109 MAIL

P_{total} 296.0 W	A_{Room} 12.41 m ²	Lighting power density 23.85 W/m ² = 3.88 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 615 lx
-------------------------------------	---	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	Philips		4x36W SLB	148.0 W	8268 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

110 OFFICE

P_{total}
592.0 W

A_{Room}
21.42 m²

Lighting power density
 $27.63 \text{ W/m}^2 = 3.31 \text{ W/m}^2/100 \text{ lx (Space)}$

$\bar{E}_{\text{perpendicular (Working plane)}}$
836 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		4x36W SLB	148.0 W	8268 lm

111 CAD

P_{total}
592.0 W

A_{Room}
24.72 m²

Lighting power density
 $23.95 \text{ W/m}^2 = 3.22 \text{ W/m}^2/100 \text{ lx (Space)}$

$\bar{E}_{\text{perpendicular (Working plane)}}$
743 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		4x36W SLB	148.0 W	8268 lm

112 CAD

P_{total}
888.0 W

A_{Room}
25.80 m²

Lighting power density
 $34.42 \text{ W/m}^2 = 3.16 \text{ W/m}^2/100 \text{ lx (Space)}$

$\bar{E}_{\text{perpendicular (Working plane)}}$
1088 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
6	Philips		4x36W SLB	148.0 W	8268 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

113 OFFICE

P_{total}
444.0 W

A_{Room}
18.60 m²

Lighting power density
23.88 W/m² = 3.21 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
743 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
3	Philips		4x36W SLB	148.0 W	8268 lm

114 VISITORS

P_{total}
444.0 W

A_{Room}
12.61 m²

Lighting power density
35.20 W/m² = 3.69 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
954 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
3	Philips		4x36W SLB	148.0 W	8268 lm

Building A · GROUND FLOOR

Luminaire list Φ_{total}

336010 lm

 P_{total}

5940.0 W


Luminous efficacy

56.6 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
10	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W
35	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

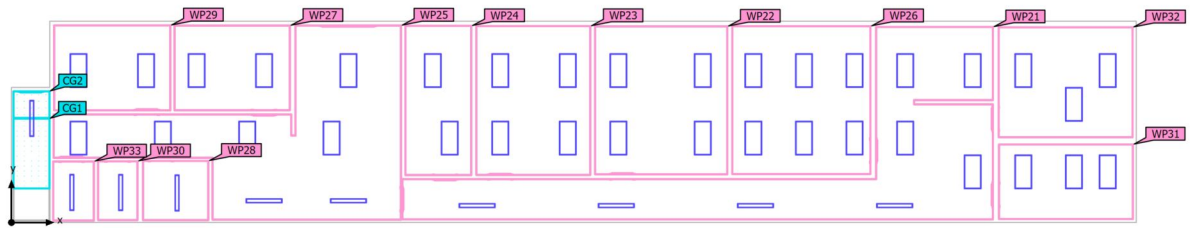

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (102 CORRIDOR / LOBBY) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	503 lx (≥ 500 lx) ✓	232 lx	691 lx	0.46 (≥ 0.60) ✗	0.34	WP25
Working plane (103 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	209 lx (≥ 500 lx) ✗	188 lx	226 lx	0.90 (≥ 0.60) ✓	0.83	WP33
Working plane (104 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	209 lx (≥ 500 lx) ✗	186 lx	223 lx	0.89 (≥ 0.60) ✓	0.83	WP30
Working plane (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	183 lx (≥ 500 lx) ✗	154 lx	201 lx	0.84 (≥ 0.60) ✓	0.77	WP28
Working plane (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	625 lx (≥ 500 lx) ✓	363 lx	840 lx	0.58 (≥ 0.60) ✗	0.43	WP29
Working plane (107 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	644 lx (≥ 500 lx) ✓	379 lx	855 lx	0.59 (≥ 0.60) ✗	0.44	WP27
Working plane (108 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	373 lx (≥ 500 lx) ✗	66.3 lx	725 lx	0.18 (≥ 0.60) ✗	0.091	WP21
Working plane (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	615 lx (≥ 500 lx) ✓	306 lx	821 lx	0.50 (≥ 0.60) ✗	0.37	WP24
Working plane (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	836 lx (≥ 500 lx) ✓	428 lx	1035 lx	0.51 (≥ 0.60) ✗	0.41	WP23
Working plane (111 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	743 lx (≥ 500 lx) ✓	403 lx	923 lx	0.54 (≥ 0.60) ✗	0.44	WP22
Working plane (112 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	1088 lx (≥ 500 lx) ✓	542 lx	1389 lx	0.50 (≥ 0.60) ✗	0.39	WP26

Building A · GROUND FLOOR (Light scene 1)

Calculation objects


Working plane (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	743 lx (≥ 500 lx) ✓	308 lx	1119 lx	0.41 (≥ 0.60) ✗	0.28	WP32
Working plane (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	954 lx (≥ 500 lx) ✓	478 lx	1343 lx	0.50 (≥ 0.60) ✗	0.36	WP31

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	267 lx	109 lx	438 lx	0.41	0.25	CG1
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	226 lx	198 lx	244 lx	0.88	0.81	CG2

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Summary

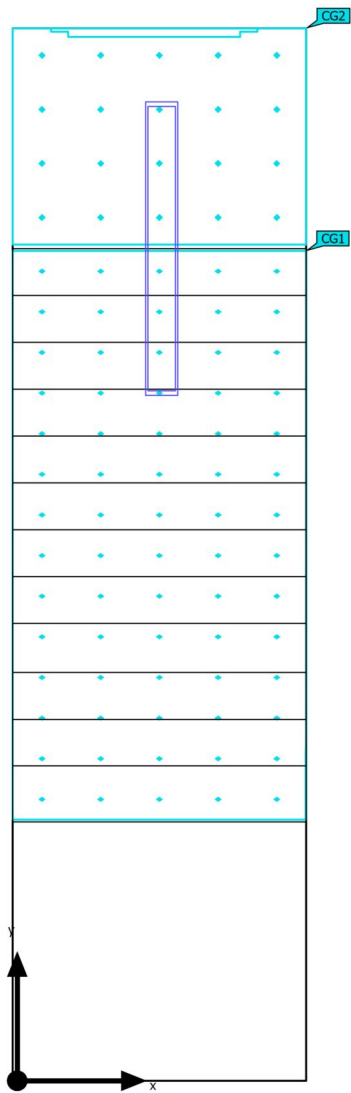

Ground area	5.88 m ²		
Reflection factors	Ceiling: 55.8 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	2.700 m
Maintenance factor	0.76 (fixed)	Mounting height	2.700 m

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	24	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 250 kWh/a	✓	
Space	Lighting power density	12.94 W/m ²	–		

(1) Based on a rectangular space of 4.590 m x 1.280 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	24	76.0 W	4663 lm	61.4 lm/W

Building A · GROUND FLOOR · 101 STAIRS

Luminaire layout plan

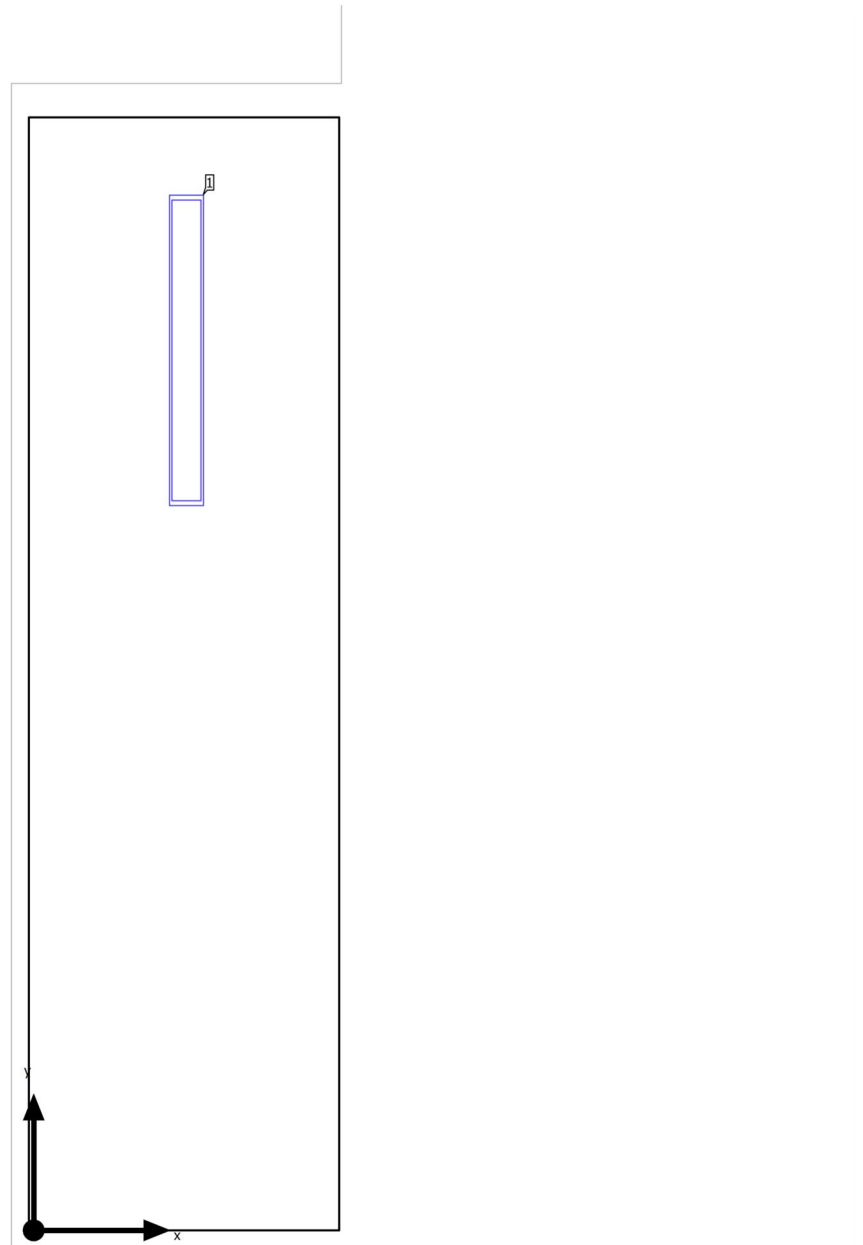

Building A · GROUND FLOOR · 101 STAIRS

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.630 m	3.629 m	2.700 m	1

Building A · GROUND FLOOR · 101 STAIRS


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Calculation objects

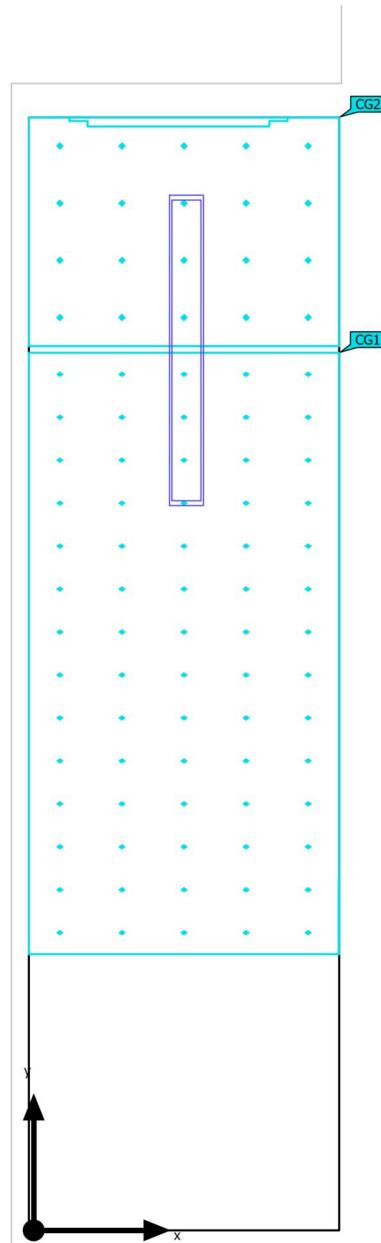

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	267 lx	109 lx	438 lx	0.41	0.25	CG1
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	226 lx	198 lx	244 lx	0.88	0.81	CG2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

101 Stairs

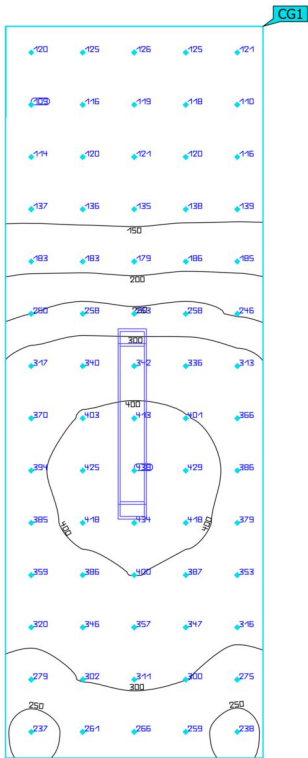


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	267 lx	109 lx	438 lx	0.41	0.25	CG1

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

101 Stairs Lower

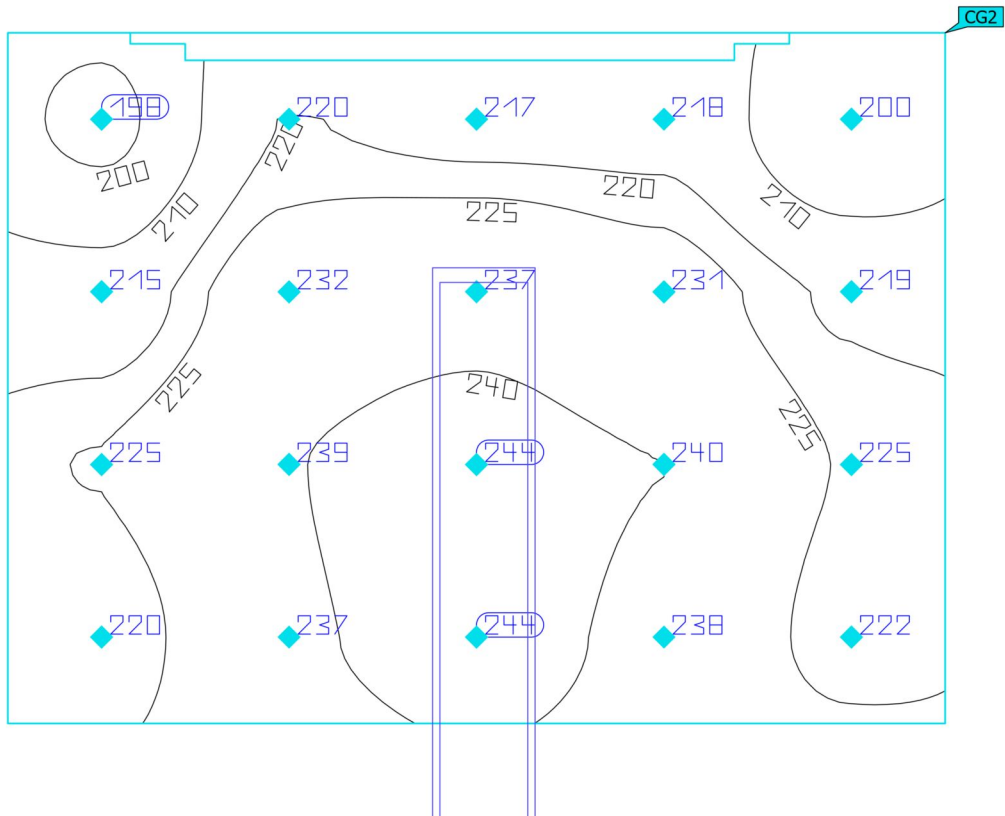


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	226 lx	198 lx	244 lx	0.88	0.81	CG2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Summary

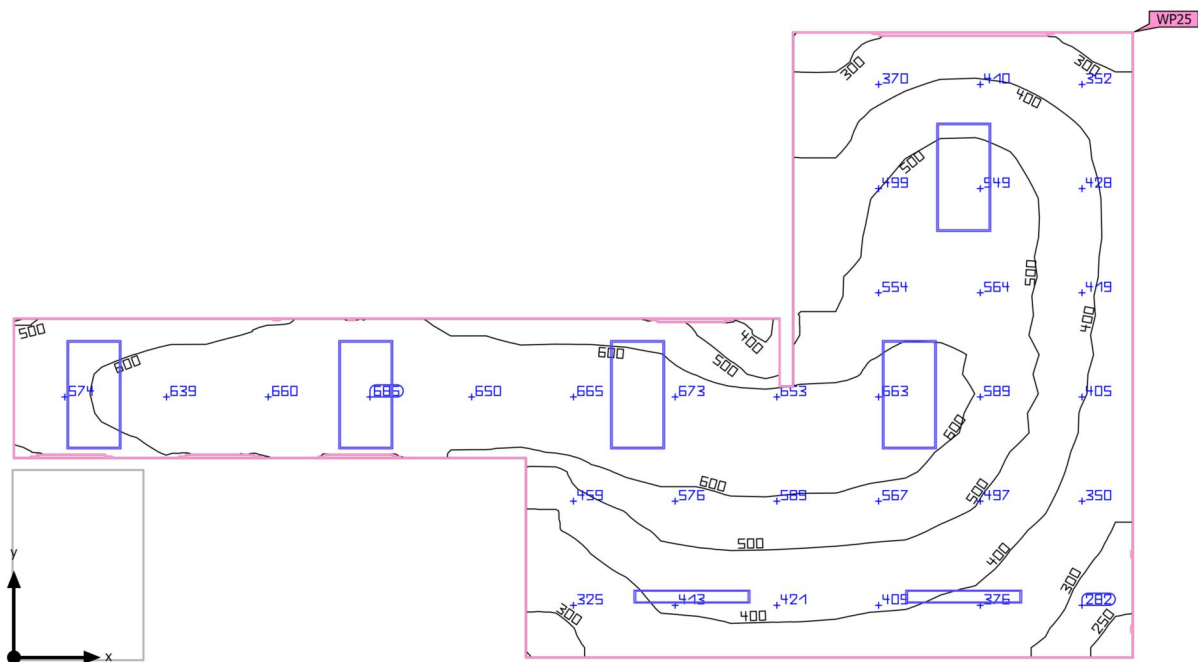

Ground area	45.50 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	503 lx	$\geq 500 \text{ lx}$	✓	WP25
	$U_o (g_1)$	0.46	≥ 0.60	✗	WP25
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	28	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	2208 kWh/a	max. 1600 kWh/a	✗	
Space	Lighting power density	19.61 W/m ²	–		
		3.90 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.900 m x 12.350 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		2x36W	28	76.0 W	4663 lm	61.4 lm/W
5	Philips		4x36W SLB	19	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY

Luminaire layout plan

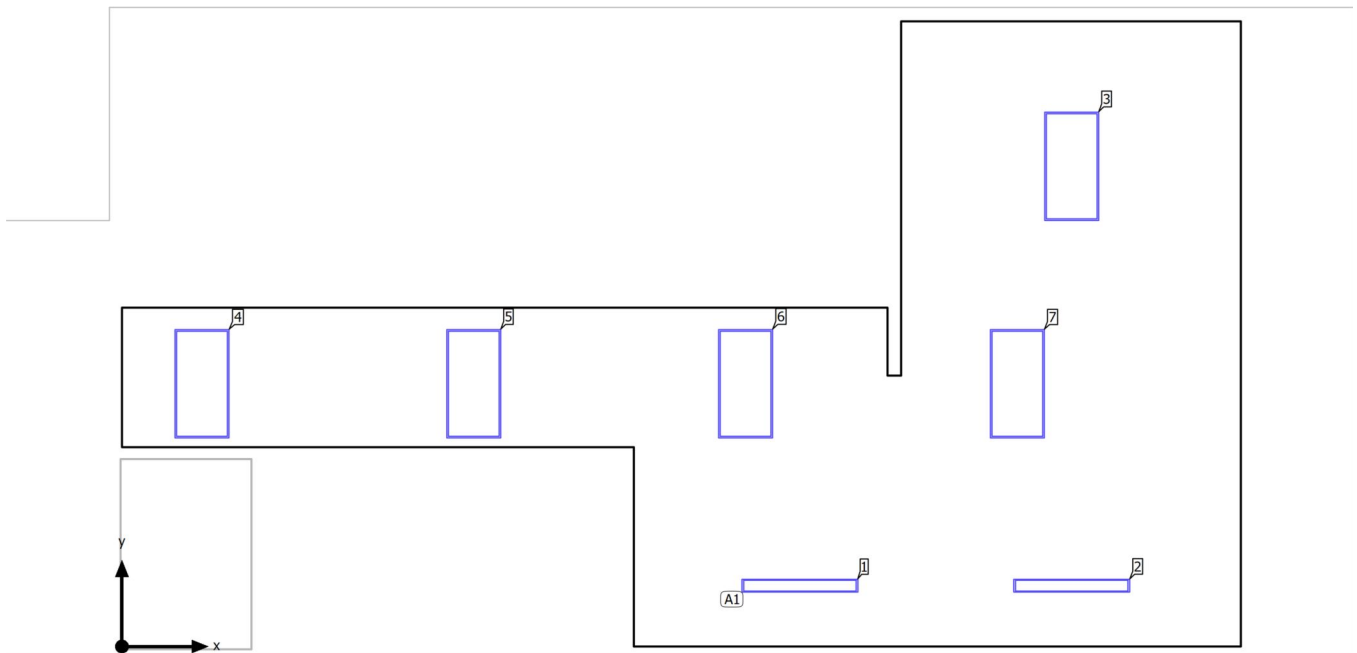

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY


Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

2 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	7.483 m / 0.671 m / 2.700 m	7.483 m	0.671 m	2.700 m	1
X-direction	2 pcs., Centre - centre, 3.000 m	10.483 m	0.671 m	2.700 m	2
Arrangement	A1				

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
10.483 m	5.300 m	2.700 m	3
0.883 m	2.900 m	2.700 m	4
3.883 m	2.900 m	2.700 m	5
6.883 m	2.900 m	2.700 m	6
9.883 m	2.900 m	2.700 m	7

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY

Luminaire list Φ_{total}

50666 lm

 P_{total}

892.0 W


Luminous efficacy

56.8 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W
5	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Calculation objects

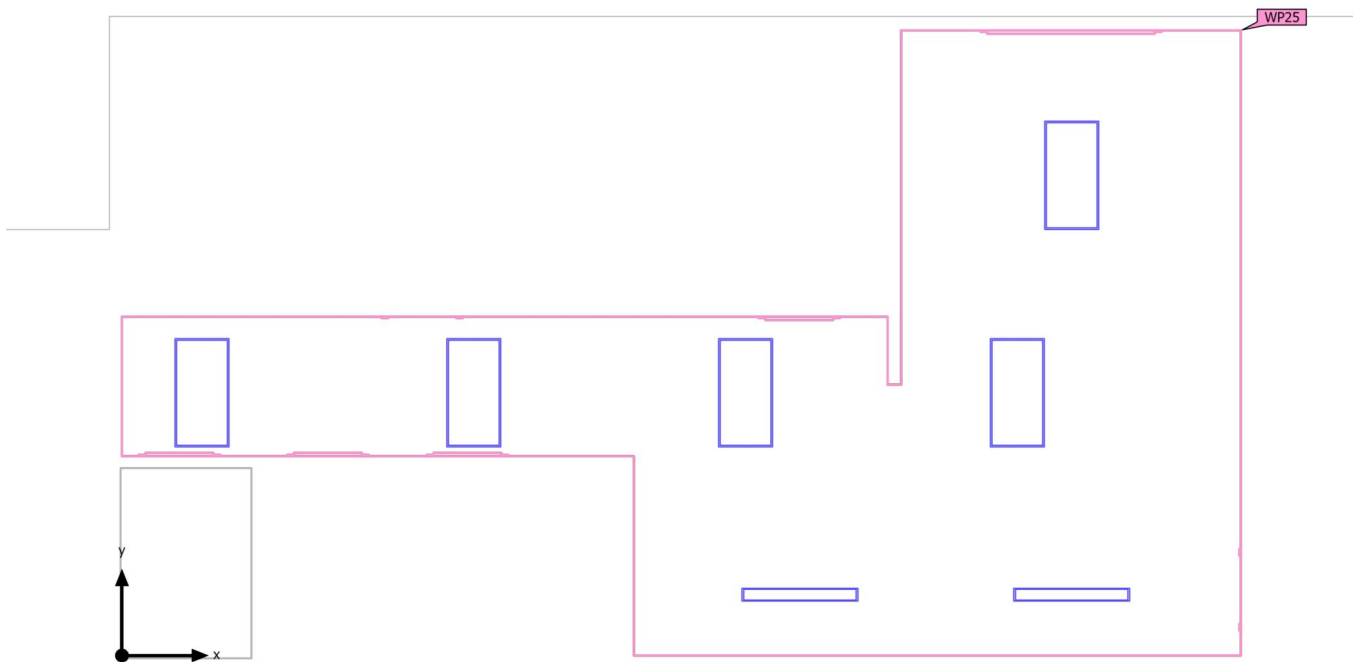

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (102 CORRIDOR / LOBBY)	503 lx	232 lx	691 lx	0.46	0.34	WP25
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Working plane (102 CORRIDOR / LOBBY)

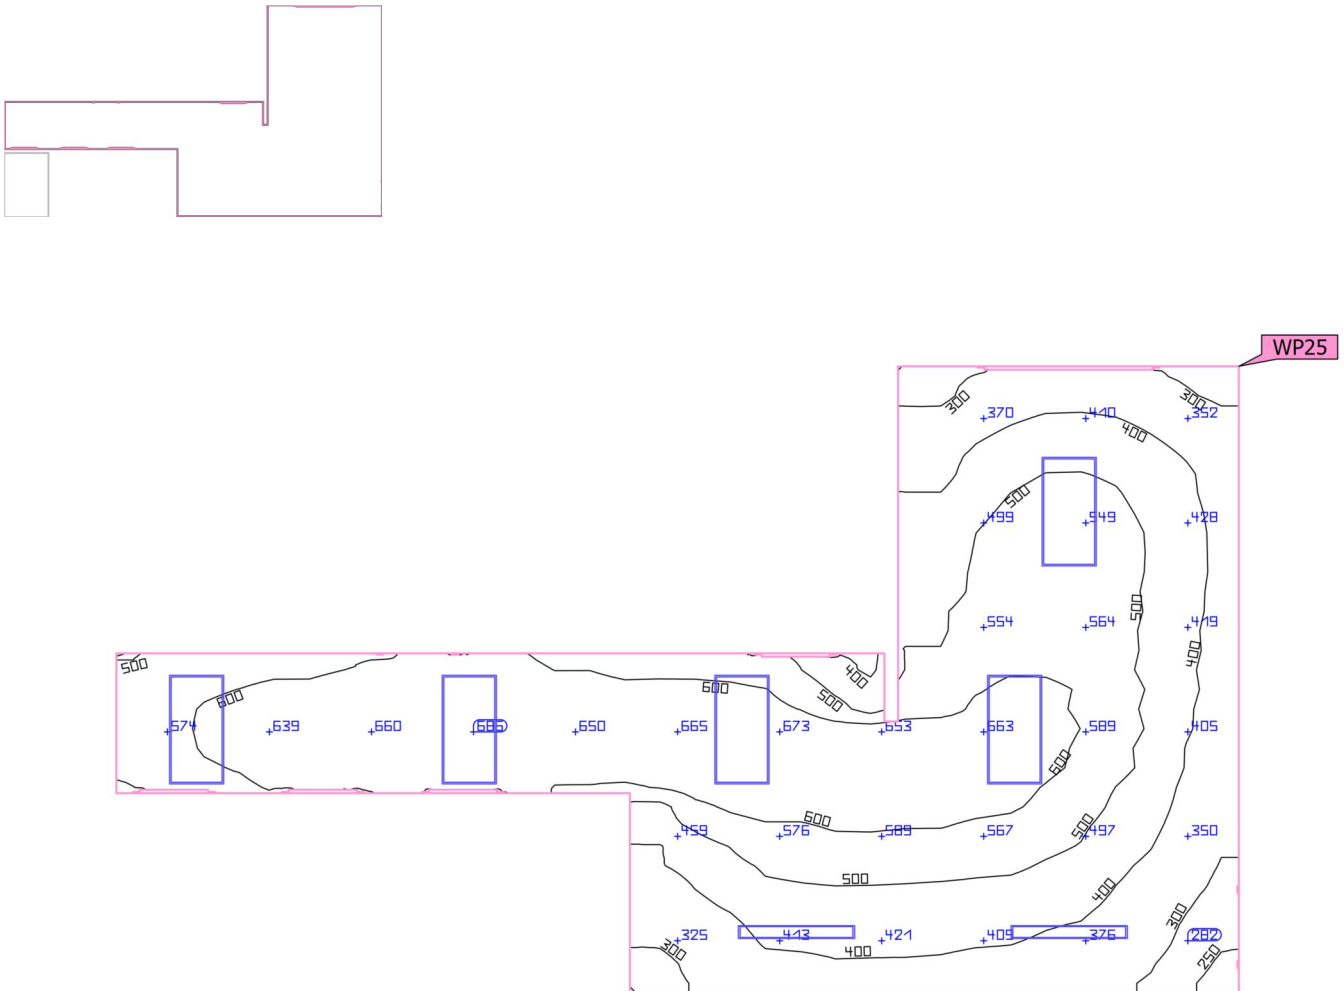


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (102 CORRIDOR / LOBBY)	503 lx	232 lx	691 lx	0.46	0.34	WP25
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.000 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Summary

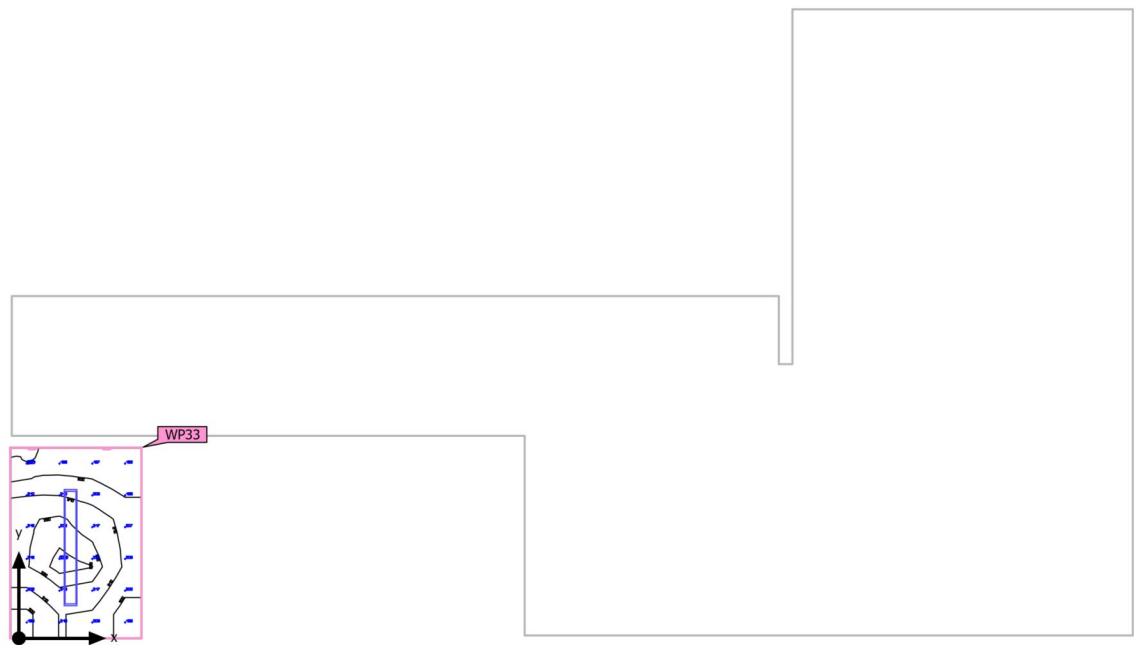

Ground area	3.03 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	209 lx	$\geq 500 \text{ lx}$	✗	WP33
	$U_o (g_1)$	0.90	≥ 0.60	✓	WP33
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 150 kWh/a	✗	
Space	Lighting power density	25.05 W/m ²	–		
		12.01 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.100 m x 1.445 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building A · GROUND FLOOR · 103 TOILET

Luminaire layout plan

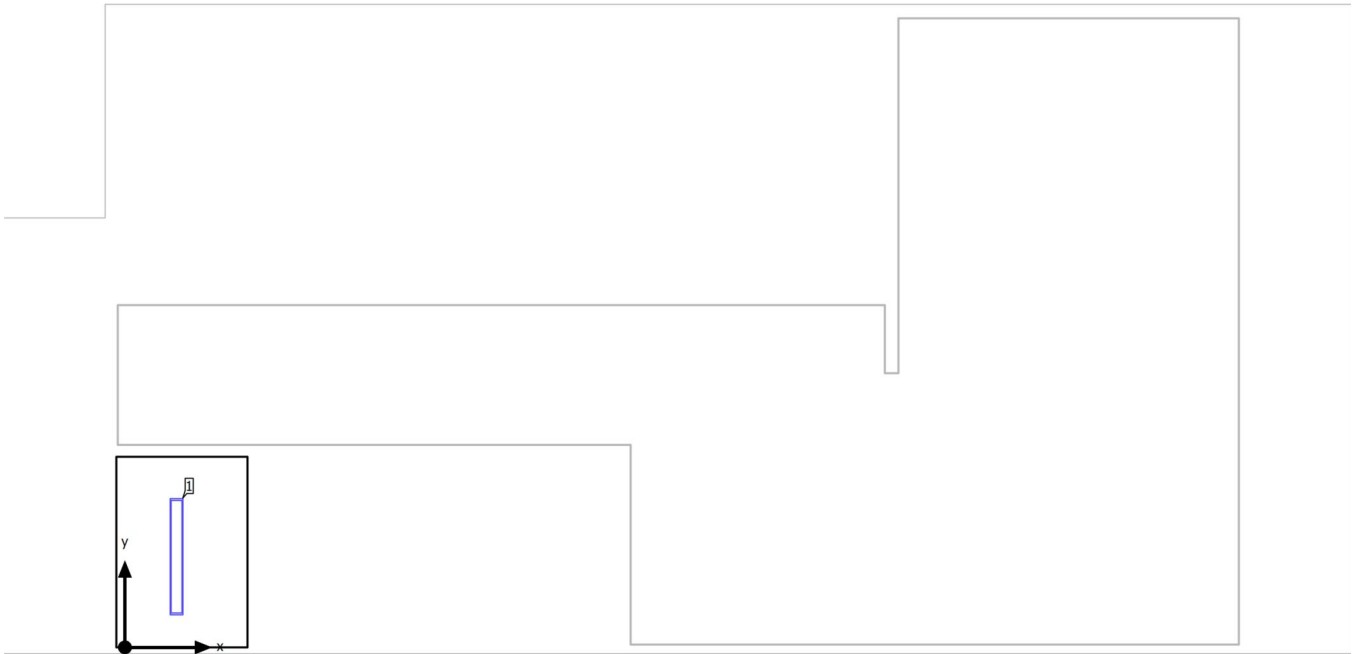

Building A · GROUND FLOOR · 103 TOILET

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.569 m	0.999 m	2.700 m	1

Building A · GROUND FLOOR · 103 TOILET


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Calculation objects

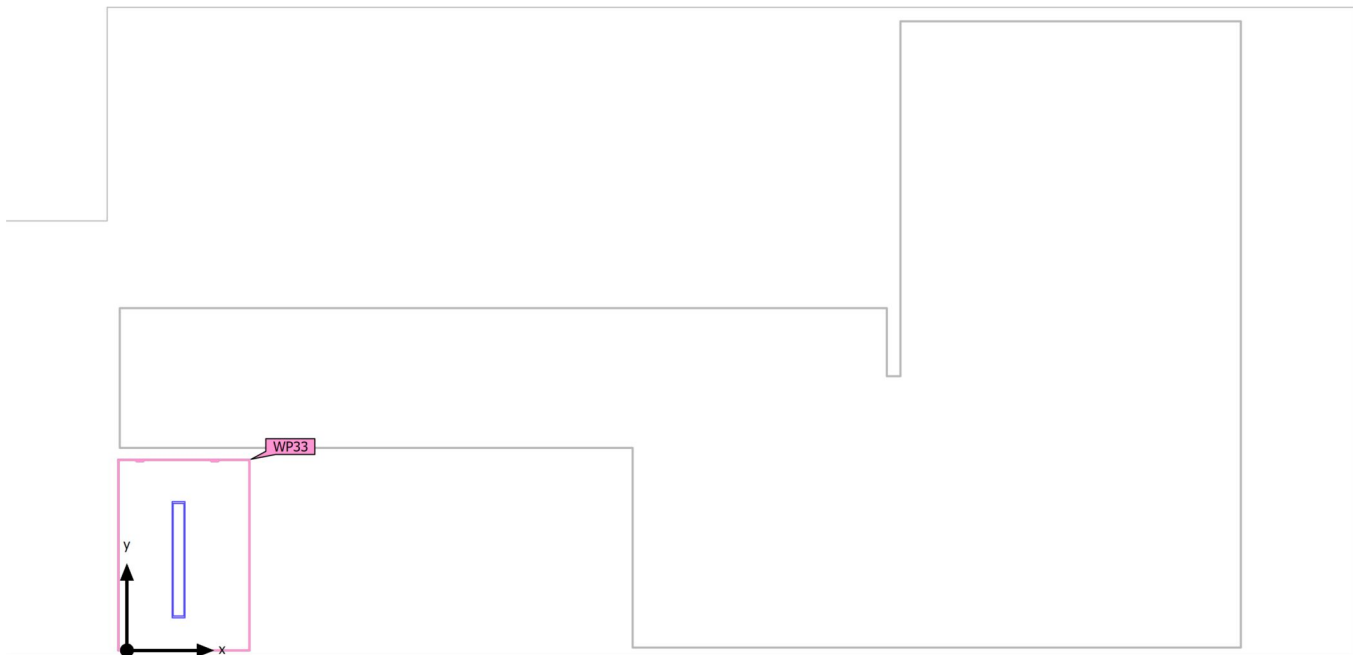

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (103 TOILET)	209 lx	188 lx	226 lx	0.90	0.83	WP33
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Working plane (103 TOILET)

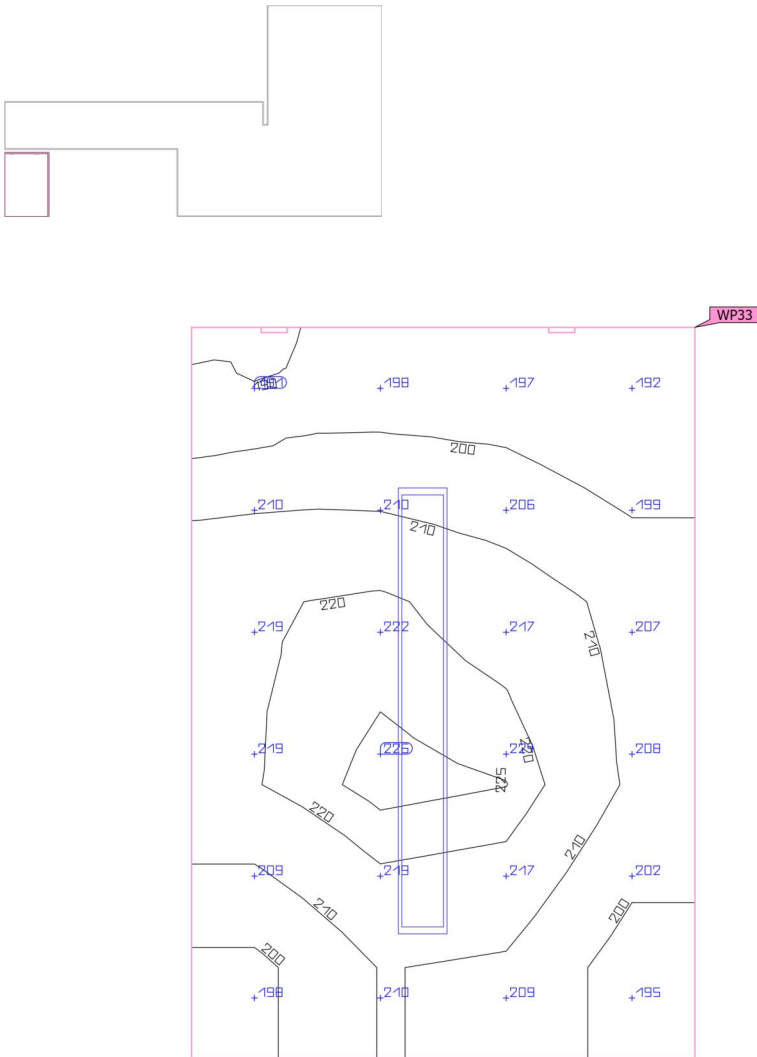


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (103 TOILET)	209 lx	188 lx	226 lx	0.90	0.83	WP33
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)

Summary

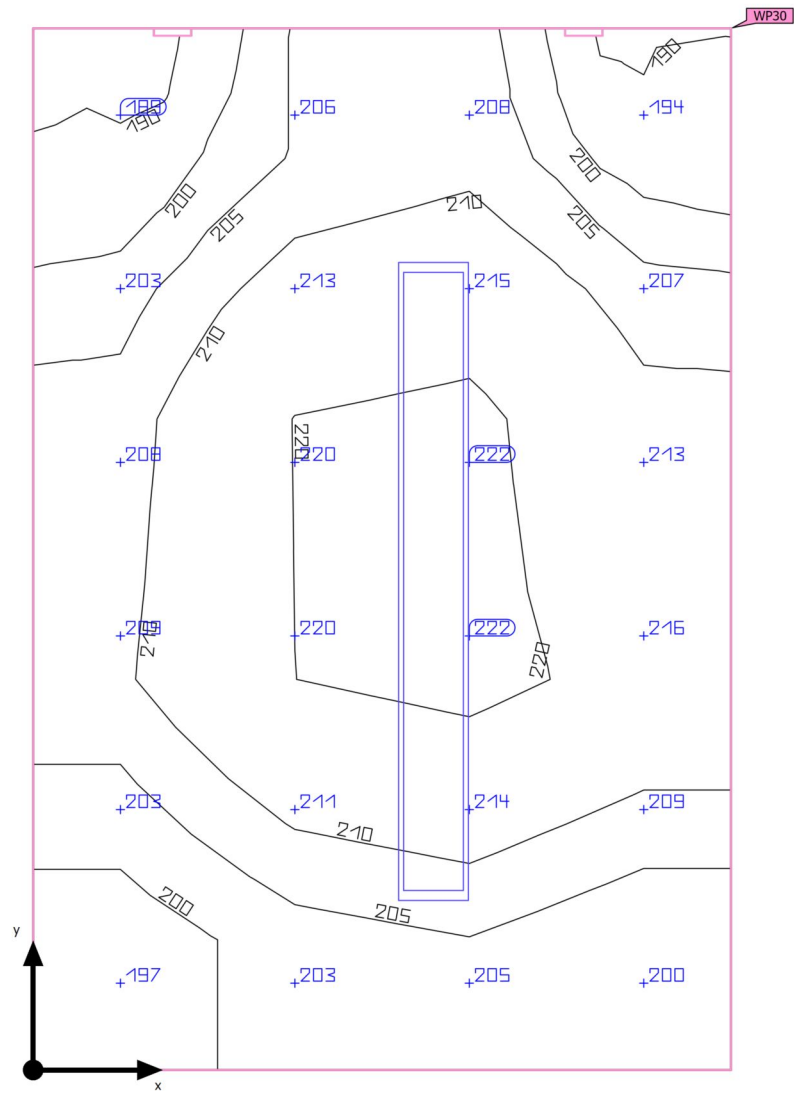

Ground area	2.93 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	209 lx	$\geq 500 \text{ lx}$	✗	WP30
	$U_o (g_1)$	0.89	≥ 0.60	✓	WP30
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 150 kWh/a	✗	
Space	Lighting power density	25.97 W/m ²	–		
		12.45 W/m ² /100 lx	–		

(1) Based on a rectangular space of 1.400 m x 2.090 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building A · GROUND FLOOR · 104 TOLIET

Luminaire layout plan

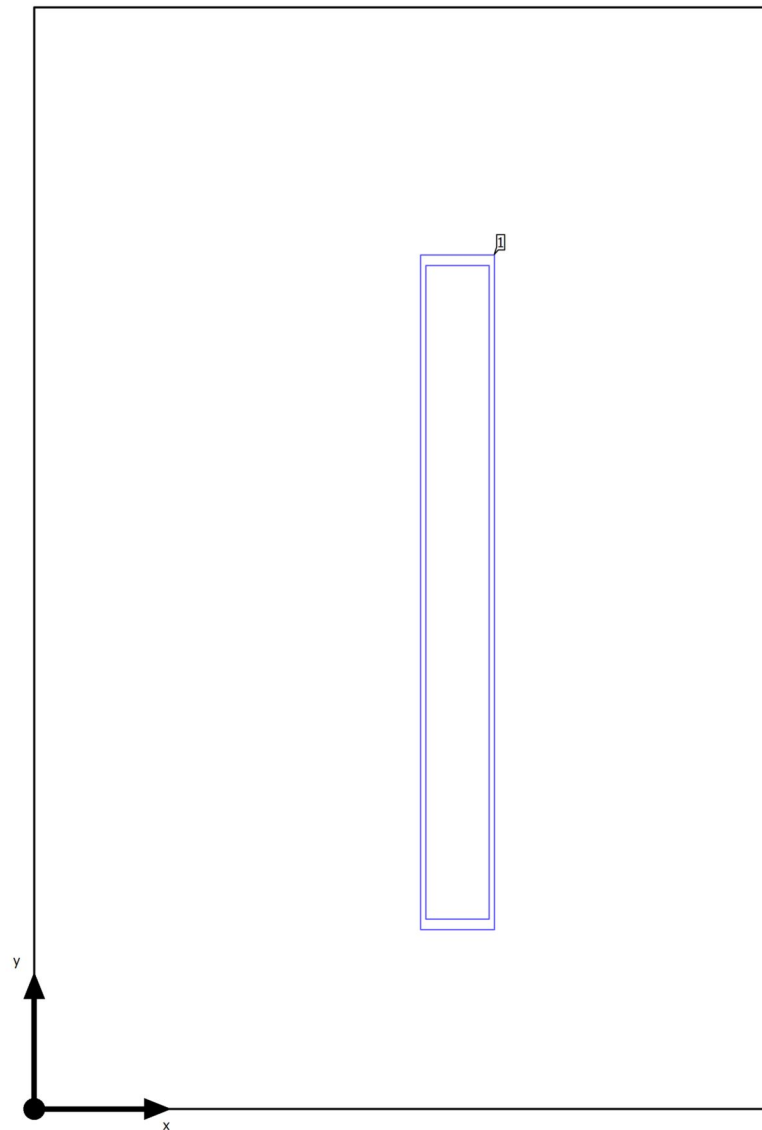

Building A · GROUND FLOOR · 104 TOLIET

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.803 m	0.980 m	2.700 m	1

Building A · GROUND FLOOR · 104 TOLIET


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
---------------------------	-----------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)

Calculation objects

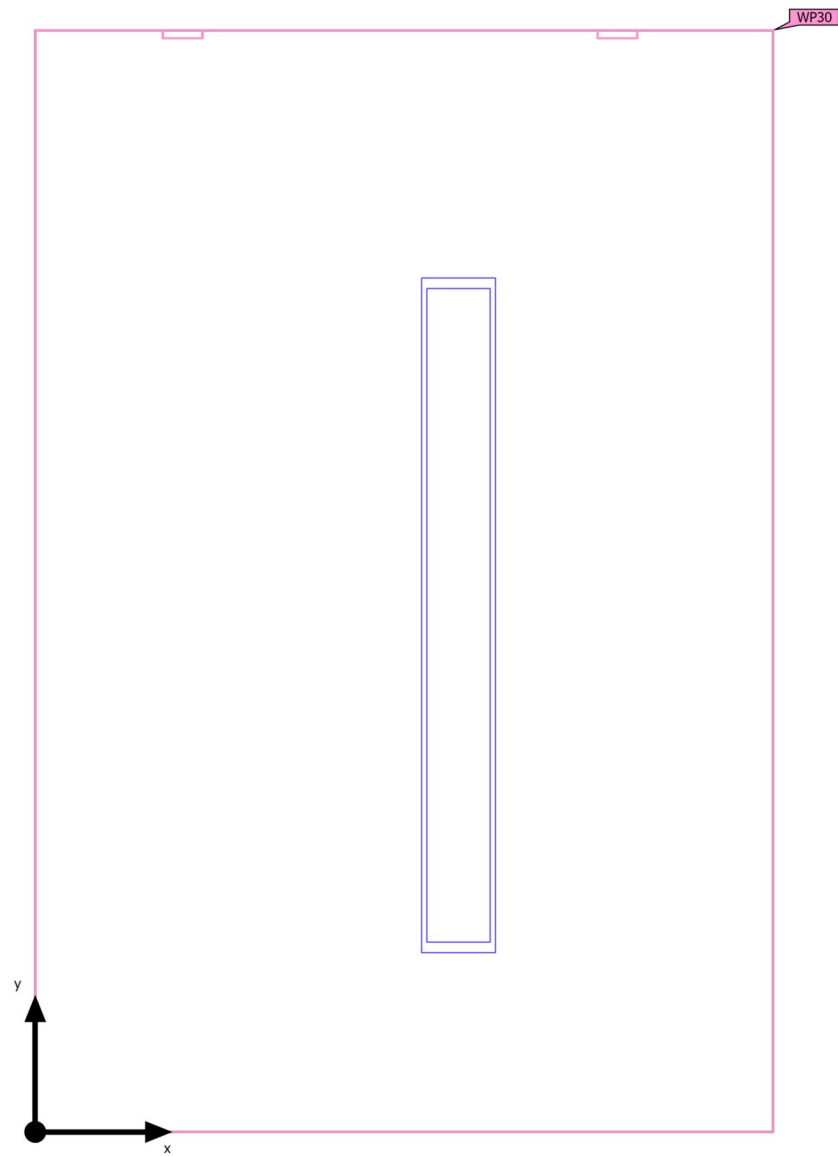

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (104 TOLIET)	209 lx	186 lx	223 lx	0.89	0.83	WP30
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Working plane (104 TOLIET)

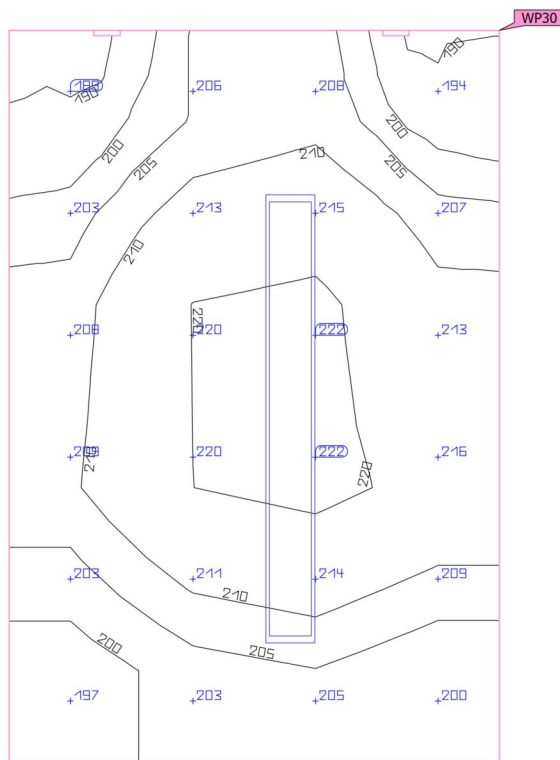


Properties	E (Target)	E _{min}	E _{max}	U _o (g ₁) (Target)	g ₂	Index
Working plane (104 TOLIET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	209 lx (≥ 500 lx) ✗	186 lx	223 lx	0.89 (≥ 0.60) ✓	0.83	WP30

44

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Summary

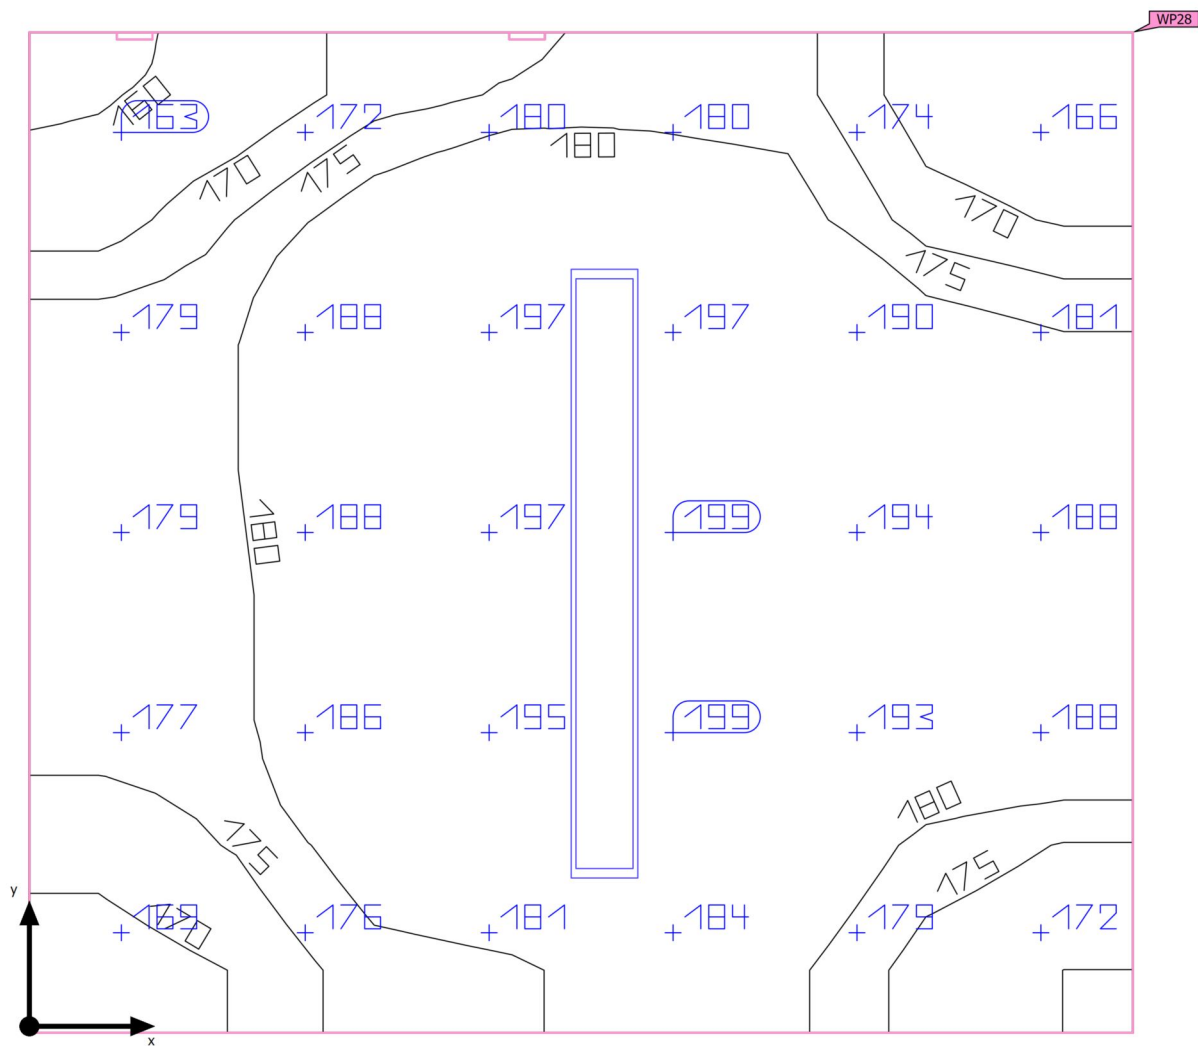

Ground area	4.88 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	183 lx	$\geq 500 \text{ lx}$	✗	WP28
	$U_o (g_1)$	0.84	≥ 0.60	✓	WP28
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 200 kWh/a	✓	
Space	Lighting power density	15.57 W/m ²	–		
		8.50 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.320 m x 2.104 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building A · GROUND FLOOR · 105 TOILET DISABLE

Luminaire layout plan

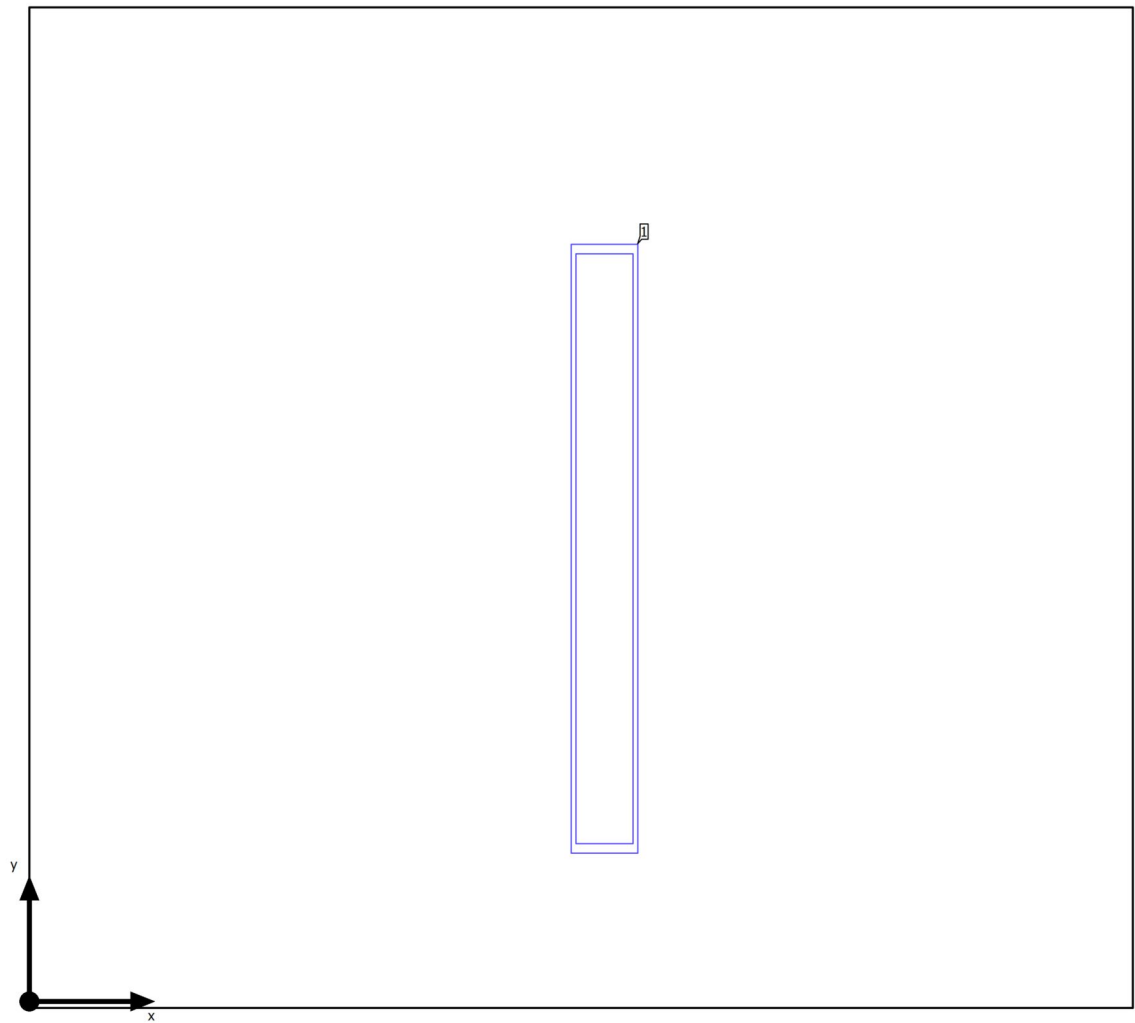

Building A · GROUND FLOOR · 105 TOILET DISABLE

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
1.209 m	0.952 m	2.700 m	1

Building A · GROUND FLOOR · 105 TOILET DISABLE


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
---------------------------	-----------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Calculation objects

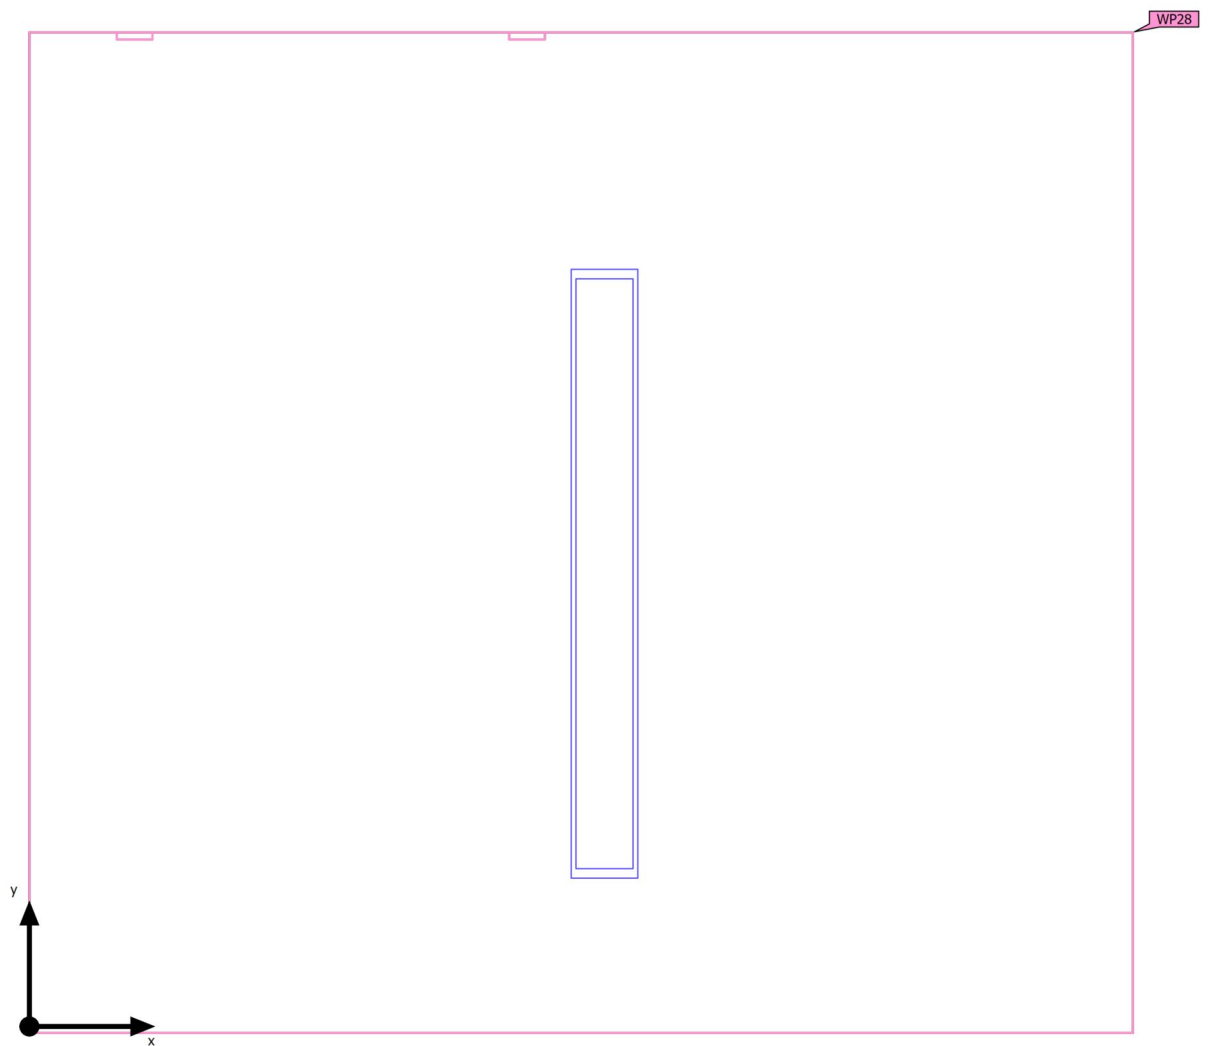

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	183 lx (≥ 500 lx) ✗	154 lx	201 lx	0.84 (≥ 0.60) ✓	0.77	WP28

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Working plane (105 TOILET DISABLE)

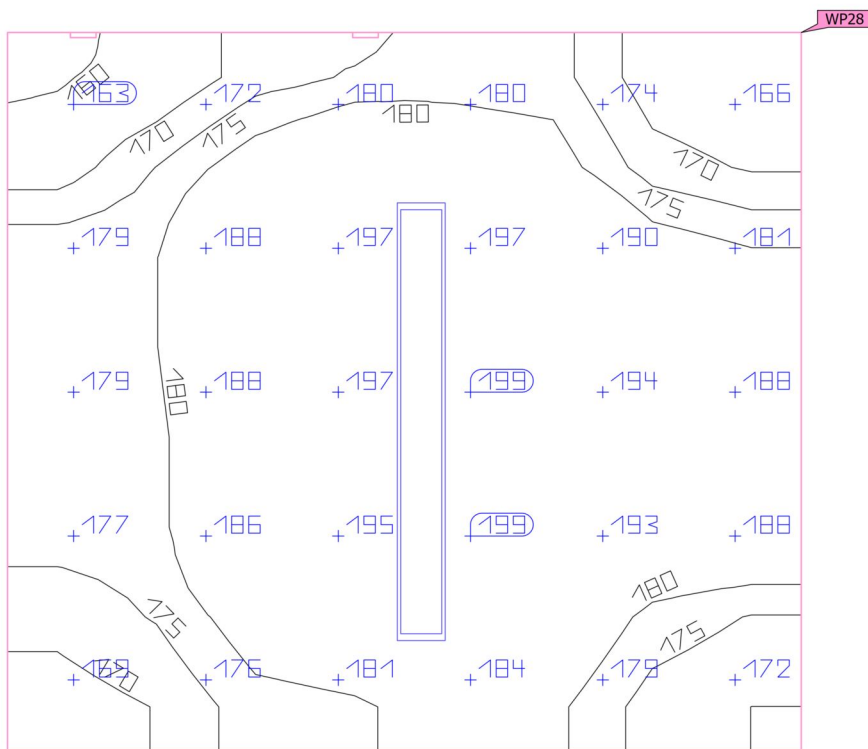


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (105 TOILET DISABLE)	183 lx	154 lx	201 lx	0.84	0.77	WP28
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Summary

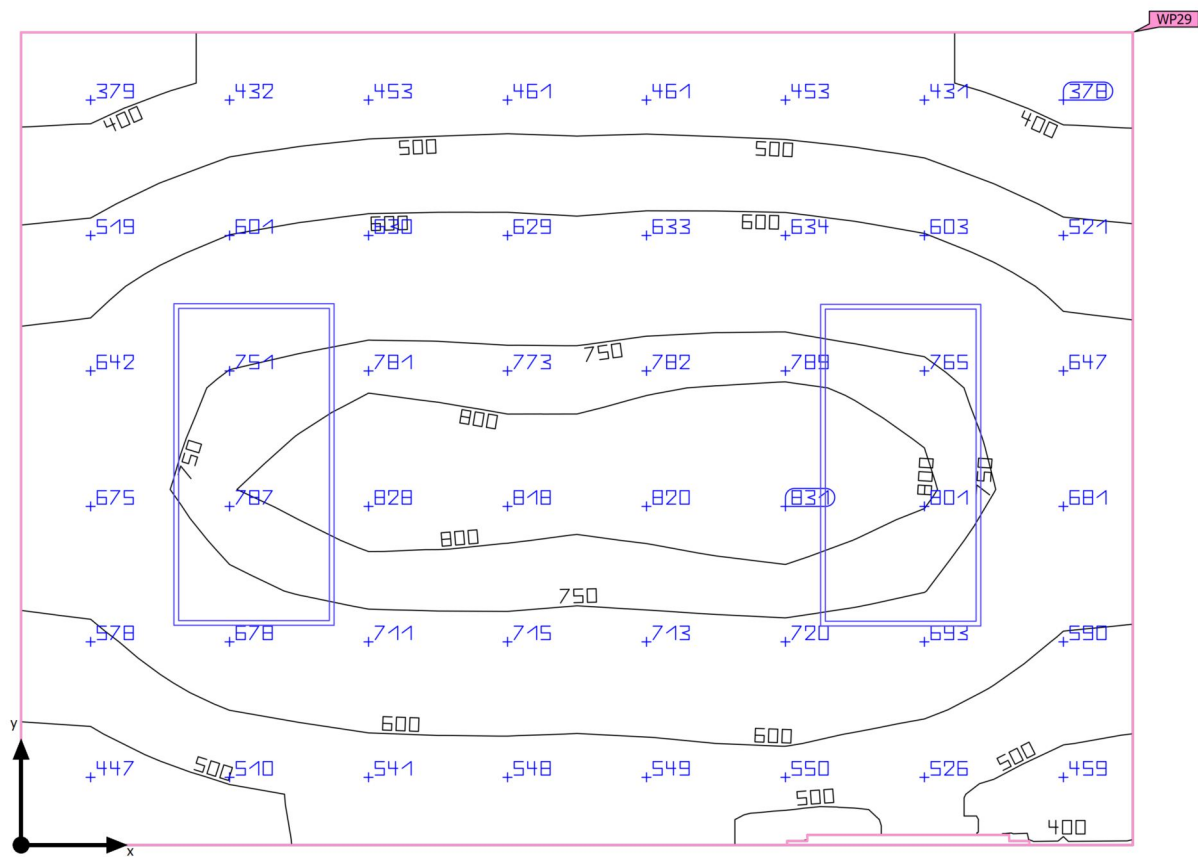

Ground area	12.47 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	625 lx	$\geq 500 \text{ lx}$	✓	WP29
	$U_o (g_1)$	0.58	≥ 0.60	✗	WP29
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	18	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[462 - 733] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	23.73 W/m ²	–		
		3.80 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.130 m x 3.020 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		4x36W SLB	18	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 106 MEETING

Luminaire layout plan

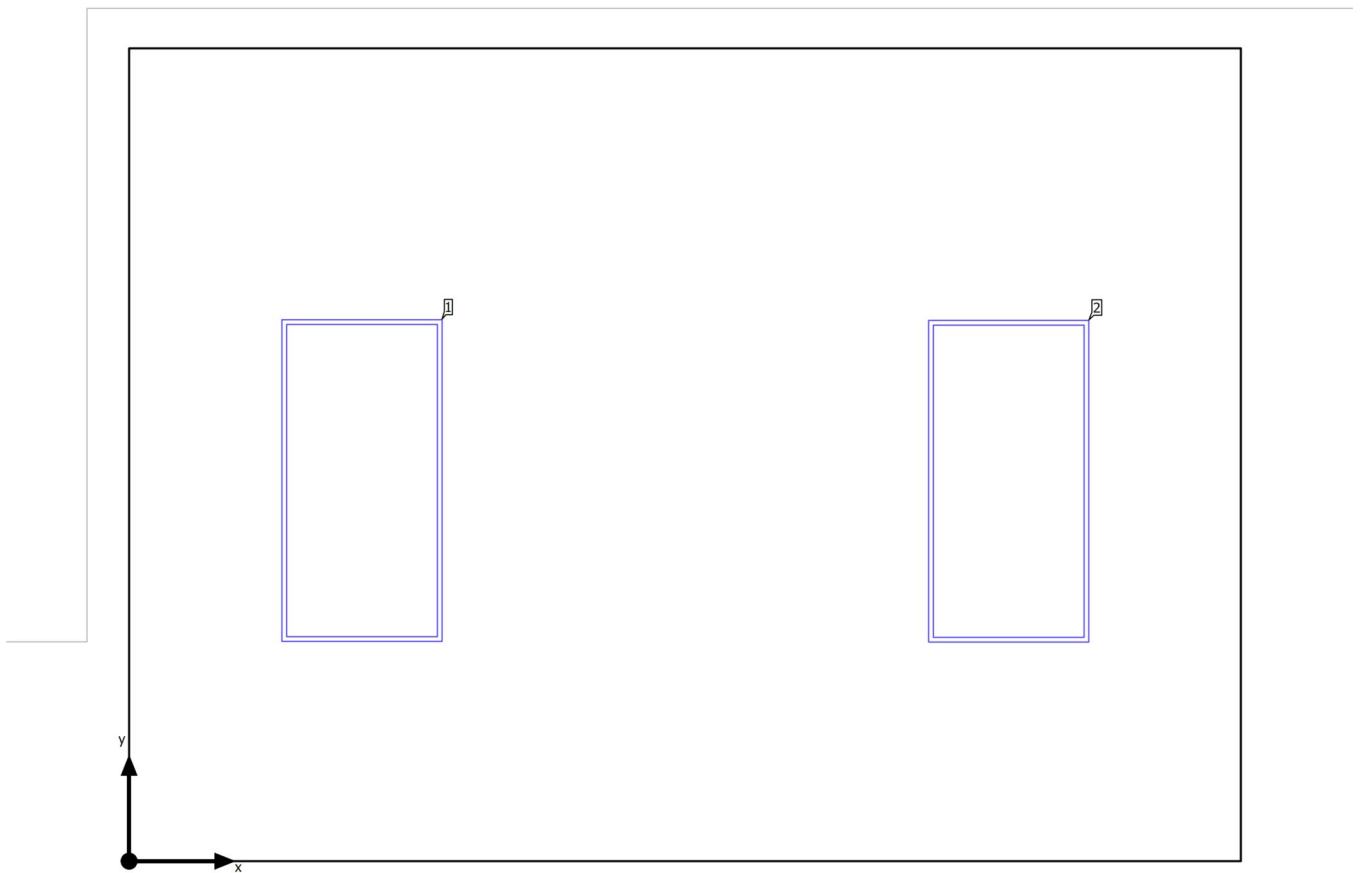

Building A · GROUND FLOOR · 106 MEETING

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.865 m	1.414 m	2.700 m	1
3.268 m	1.412 m	2.700 m	2

Building A · GROUND FLOOR · 106 MEETING

Luminaire list Φ_{total}

16536 lm

 P_{total}

296.0 W


Luminous efficacy

55.9 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Calculation objects

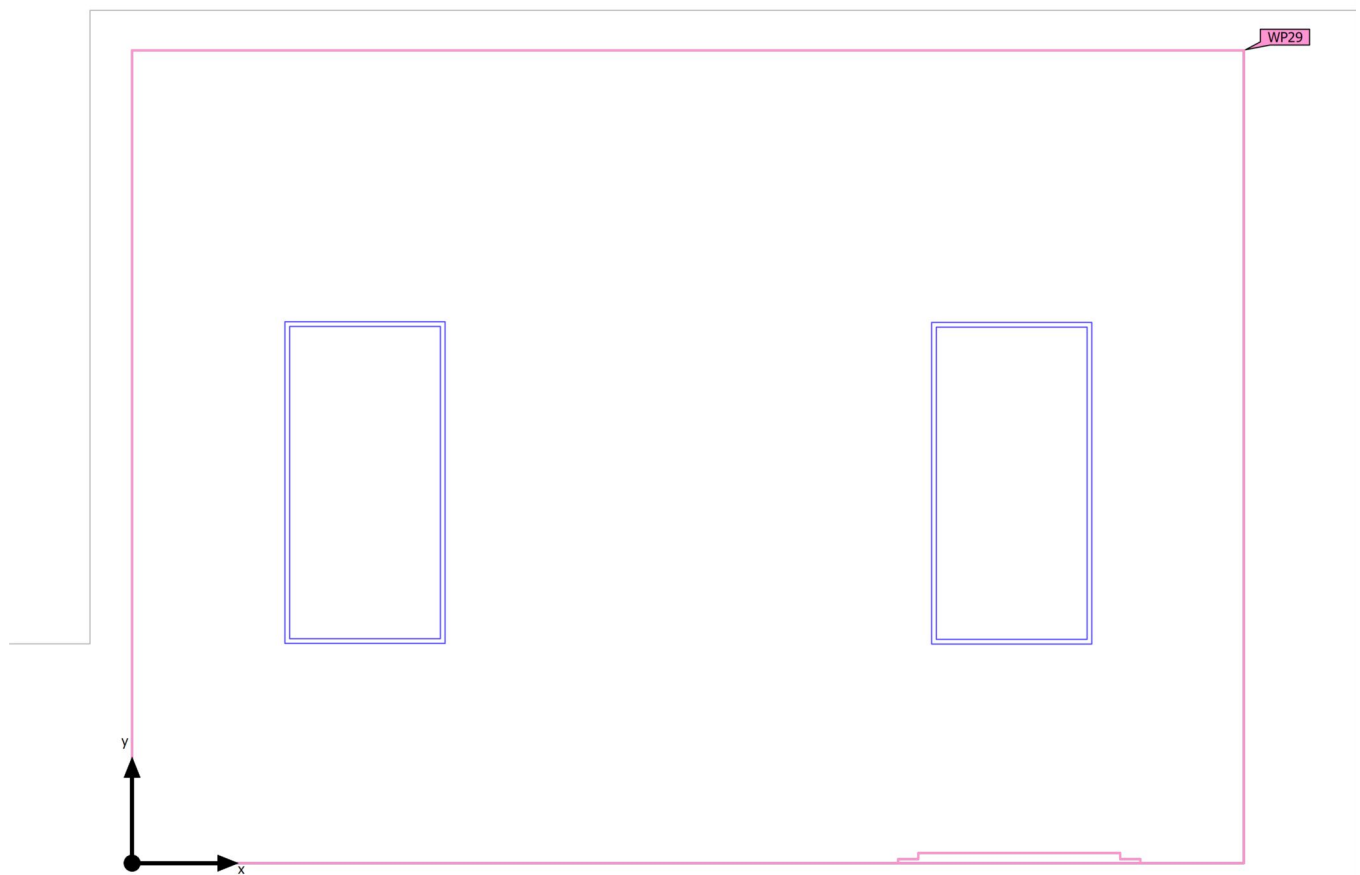

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	625 lx (≥ 500 lx) ✓	363 lx	840 lx	0.58 (≥ 0.60) ✗	0.43	WP29

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

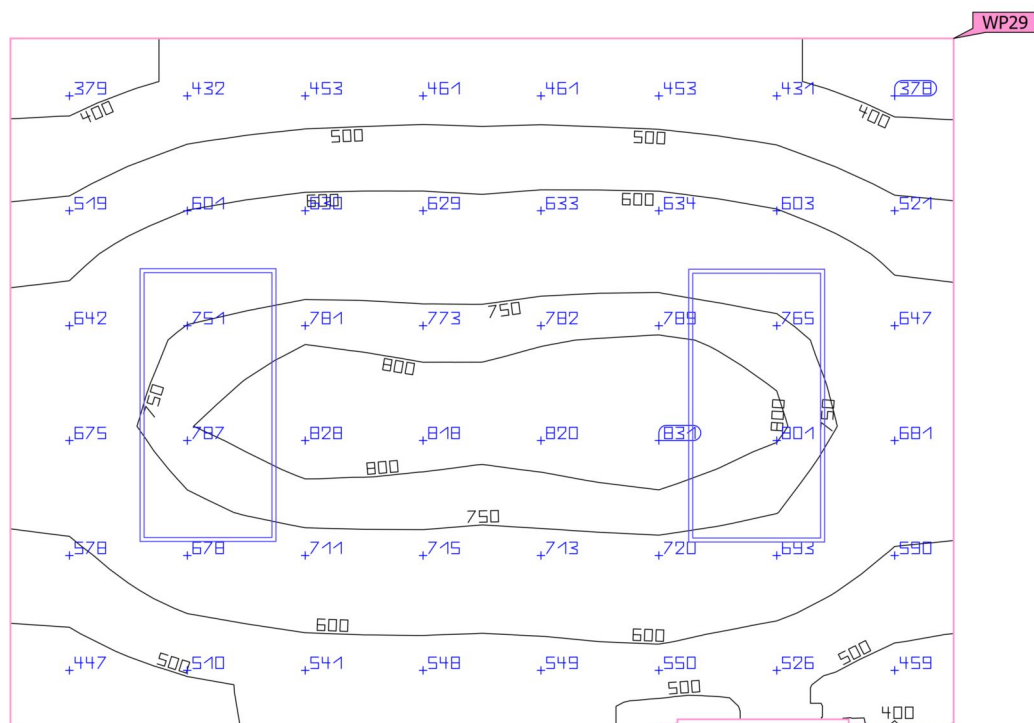
Working plane (106 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (106 MEETING)	625 lx	363 lx	840 lx	0.58	0.43	WP29
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Summary

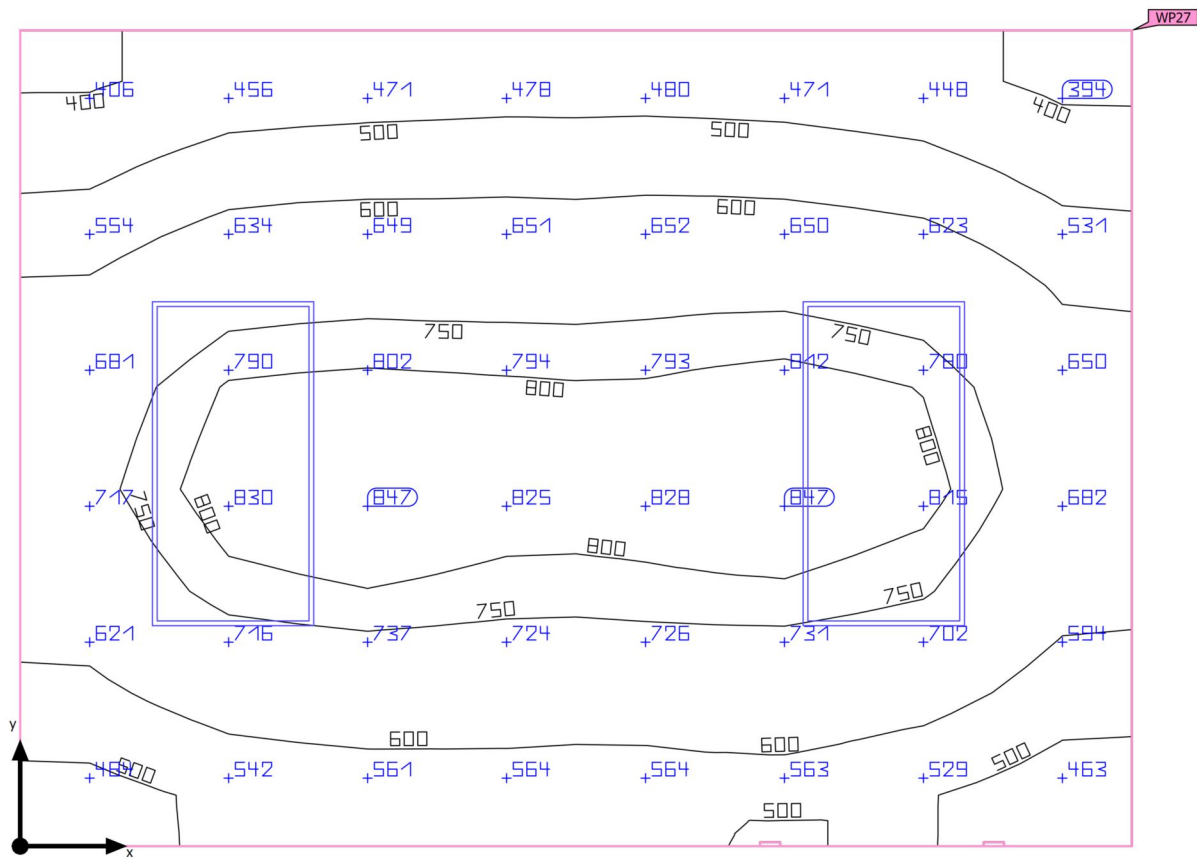

Ground area	12.34 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	644 lx	$\geq 500 \text{ lx}$	✓	WP27
	$U_o (g_1)$	0.59	≥ 0.60	✗	WP27
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	18	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[462 - 733] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	23.99 W/m ²	–		
		3.72 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.100 m x 3.010 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		4x36W SLB	18	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 107 MEETING

Luminaire layout plan

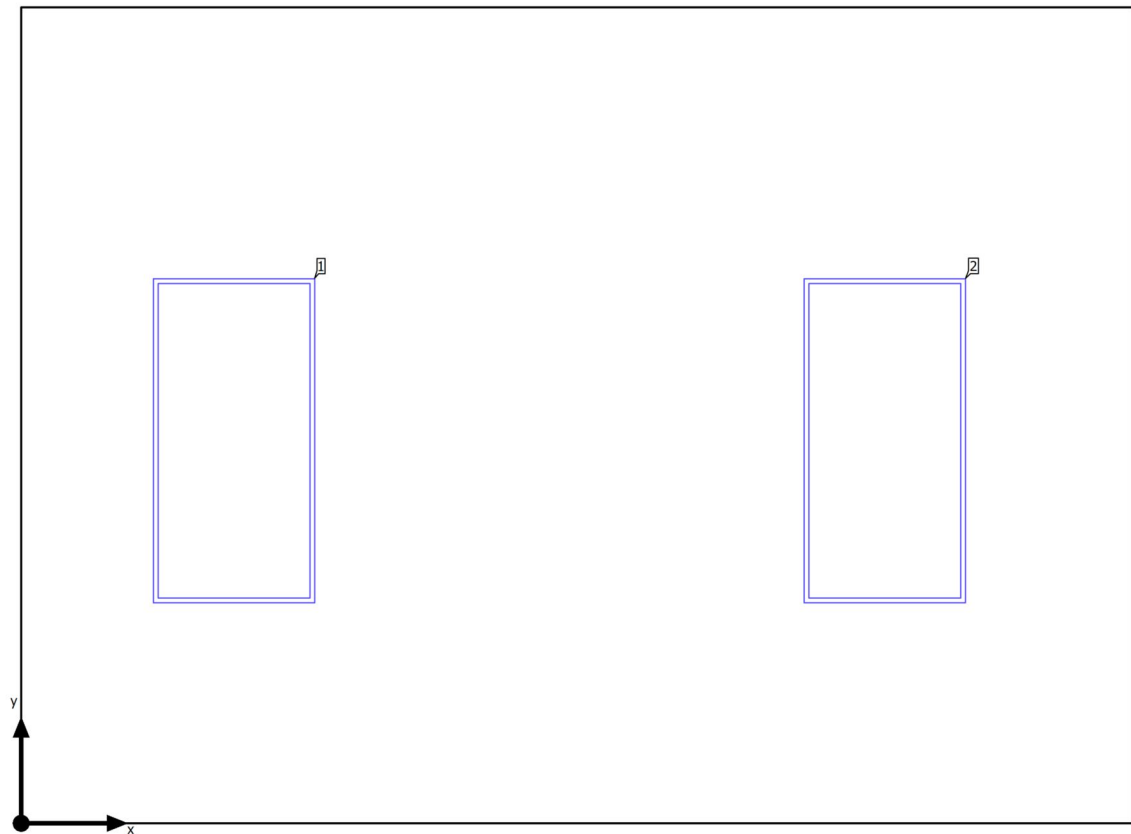

Building A · GROUND FLOOR · 107 MEETING

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.785 m	1.411 m	2.700 m	1
3.185 m	1.411 m	2.700 m	2

Building A · GROUND FLOOR · 107 MEETING


Luminaire list

Φ_{total} 16536 lm	P_{total} 296.0 W	Luminous efficacy 55.9 lm/W
----------------------------	------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Calculation objects

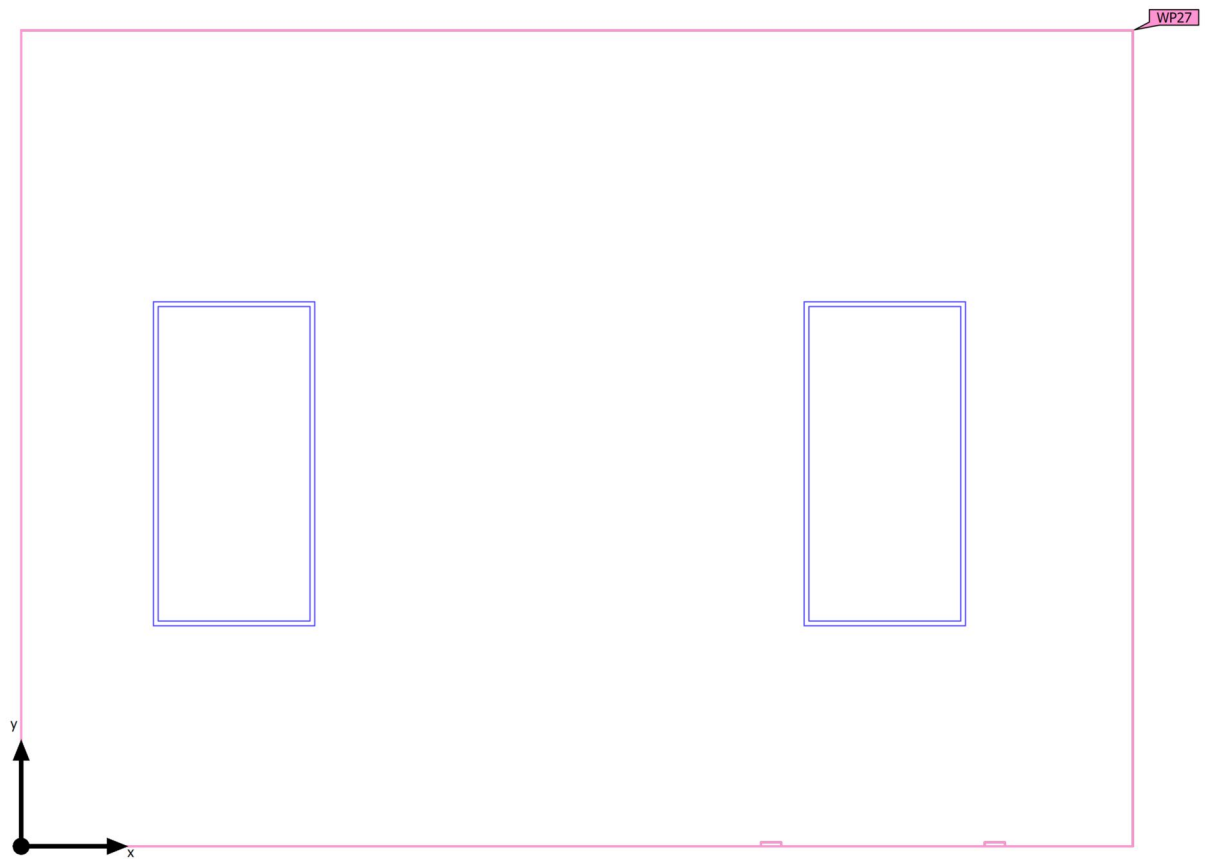

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (107 MEETING)	644 lx	379 lx	855 lx	0.59	0.44	WP27
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

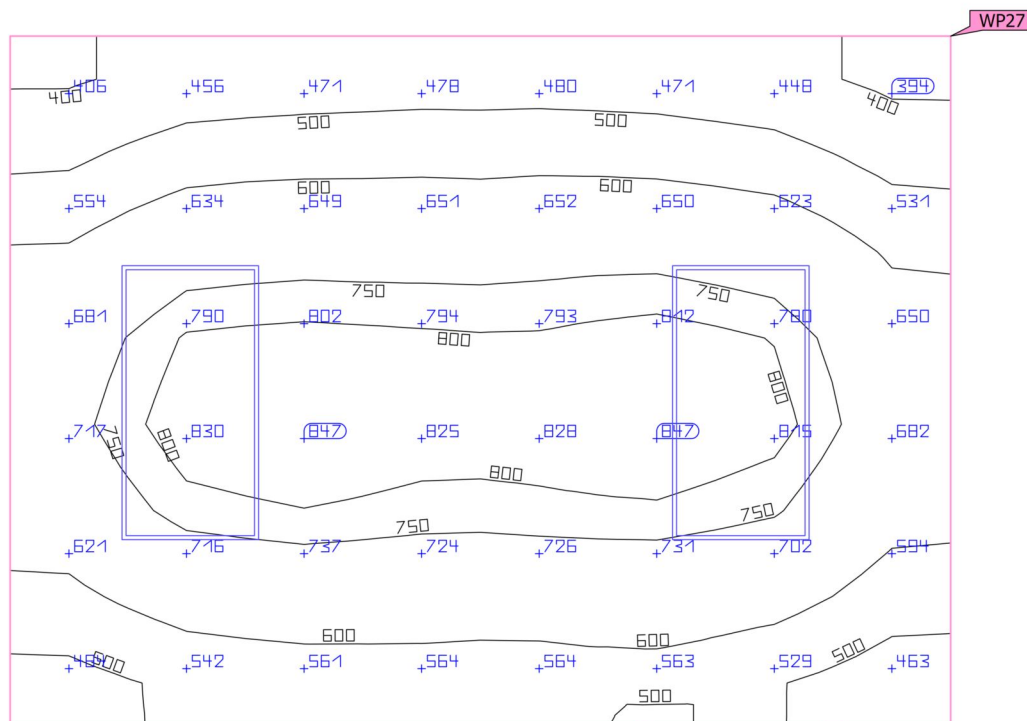
Working plane (107 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (107 MEETING)	644 lx	379 lx	855 lx	0.59	0.44	WP27
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Summary

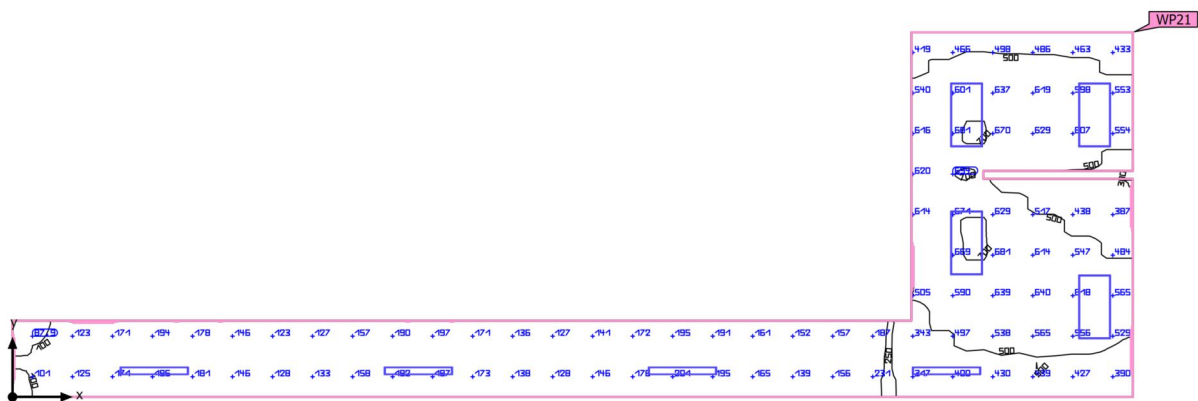

Ground area	52.09 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	373 lx	$\geq 500 \text{ lx}$	✗	WP21
	$U_o (g_1)$	0.18	≥ 0.60	✗	WP21
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	29	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[1606 - 2218] kWh/a	max. 1850 kWh/a	✗	
Space	Lighting power density	17.20 W/m ²	–		
		4.61 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.840 m x 21.000 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	29	76.0 W	4663 lm	61.4 lm/W
4	Philips		4x36W SLB	20	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 108 CORRIDOR

Luminaire layout plan

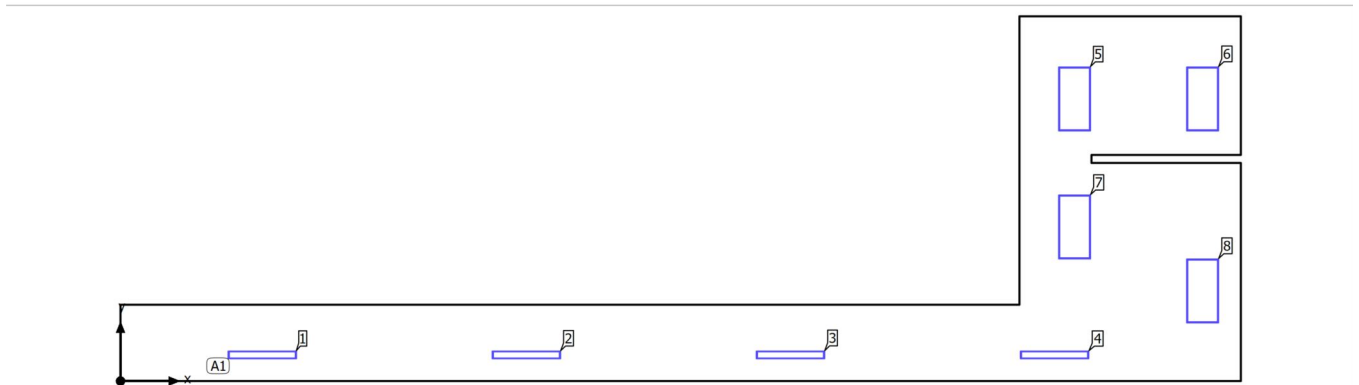

Building A · GROUND FLOOR · 108 CORRIDOR


Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

4 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	2.658 m / 0.490 m / 2.700 m	2.658 m	0.490 m	2.700 m	1
X-direction	4 pcs., Centre - centre, 4.950 m	7.608 m	0.490 m	2.700 m	2
		12.558 m	0.490 m	2.700 m	3
Arrangement	A1	17.508 m	0.490 m	2.700 m	4

Building A · GROUND FLOOR · 108 CORRIDOR

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
17.883 m	5.290 m	2.700 m	5
20.283 m	5.290 m	2.700 m	6
17.883 m	2.890 m	2.700 m	7
20.283 m	1.690 m	2.700 m	8

Building A · GROUND FLOOR · 108 CORRIDOR

Luminaire list Φ_{total}

51724 lm

 P_{total}

896.0 W


Luminous efficacy

57.7 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W
4	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Calculation objects

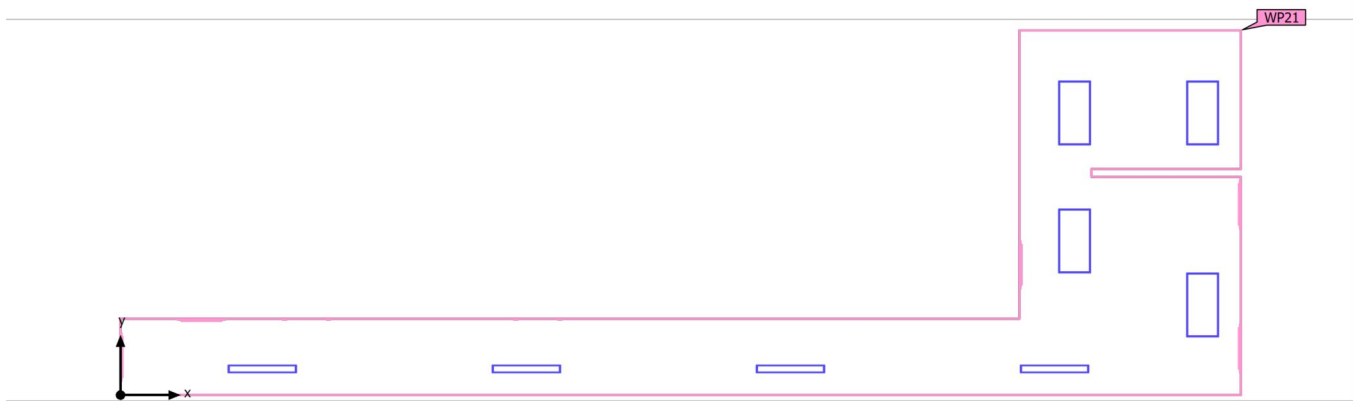

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (108 CORRIDOR)	373 lx	66.3 lx	725 lx	0.18	0.091	WP21
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Working plane (108 CORRIDOR)

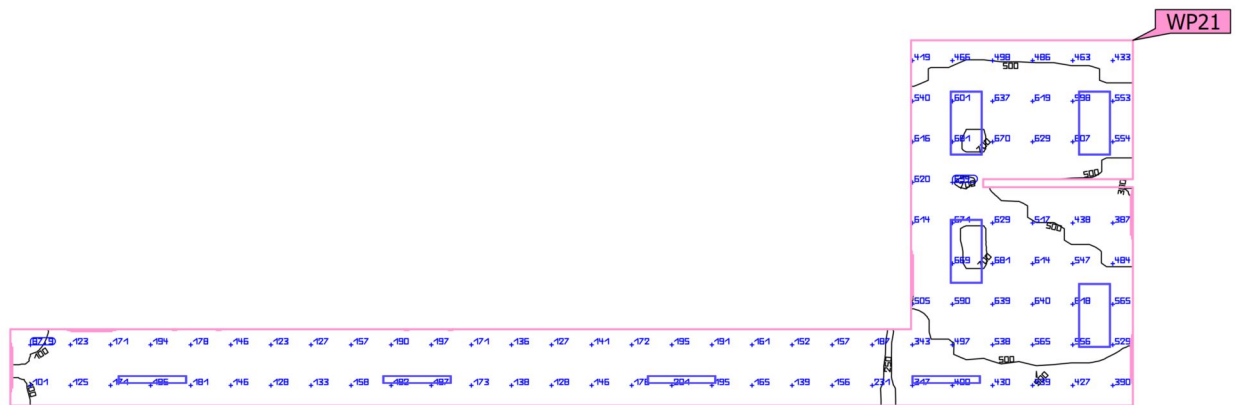


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (108 CORRIDOR)	373 lx	66.3 lx	725 lx	0.18	0.091	WP21
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Summary

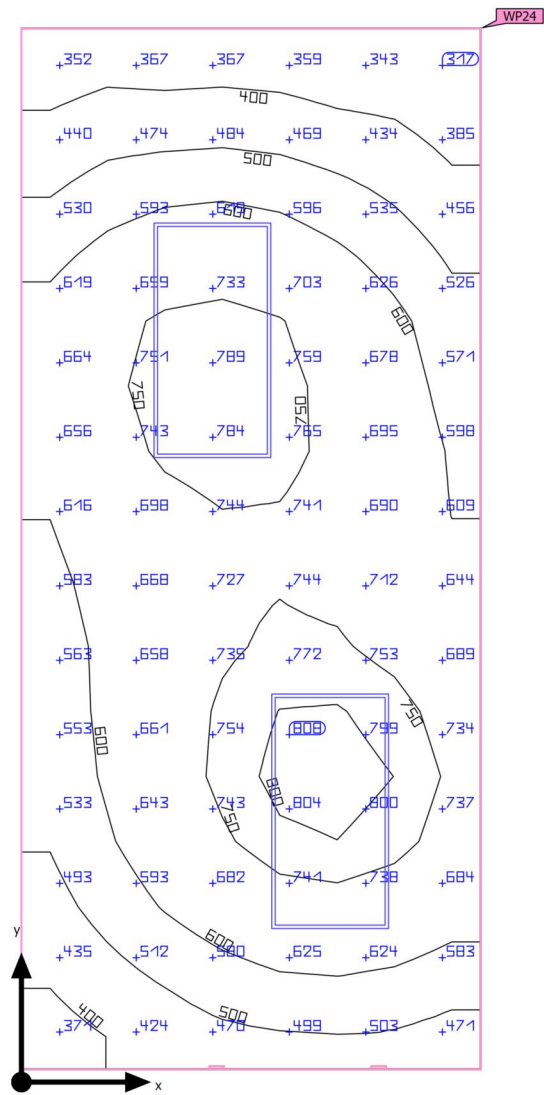

Ground area	12.41 m ²	Clearance height	2.700 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.700 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	615 lx	$\geq 500 \text{ lx}$	✓	WP24
	$U_o (g_1)$	0.50	≥ 0.60	✗	WP24
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	19	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[462 - 733] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	23.85 W/m ²	–		
		3.88 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.304 m x 2.340 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	Philips		4x36W SLB	19	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 109 MAIL

Luminaire layout plan

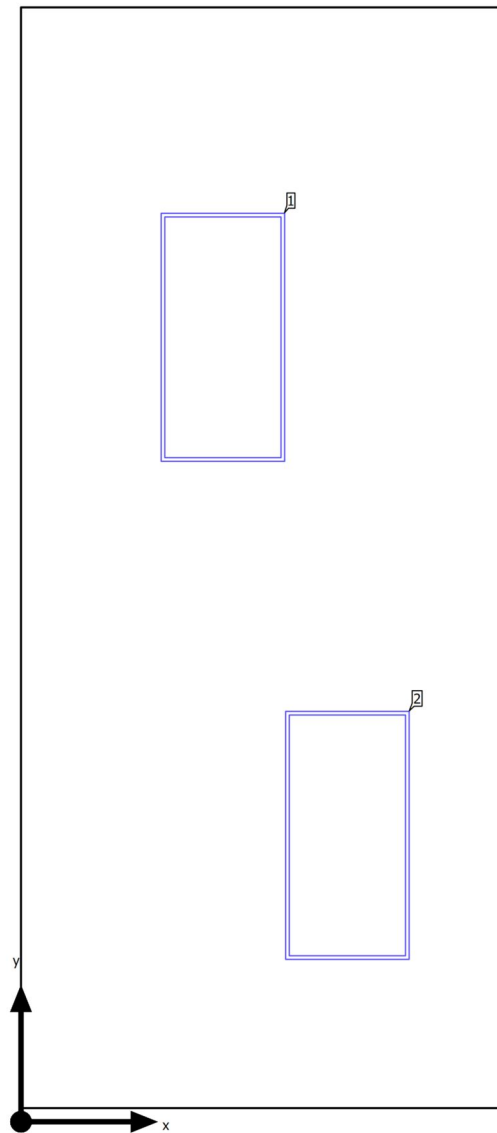

Building A · GROUND FLOOR · 109 MAIL

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.973 m	3.780 m	2.700 m	1
1.573 m	1.380 m	2.700 m	2

Building A · GROUND FLOOR · 109 MAIL


Luminaire list

Φ_{total} 16536 lm	P_{total} 296.0 W	Luminous efficacy 55.9 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Calculation objects

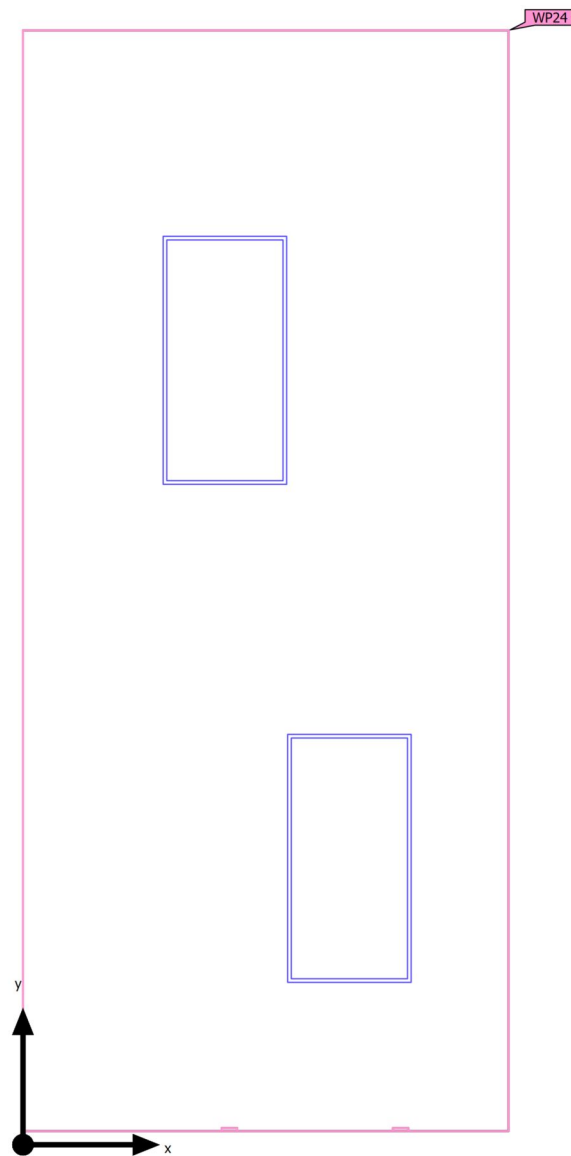

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	615 lx (≥ 500 lx) ✓	306 lx	821 lx	0.50 (≥ 0.60) ✗	0.37	WP24

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Working plane (109 MAIL)

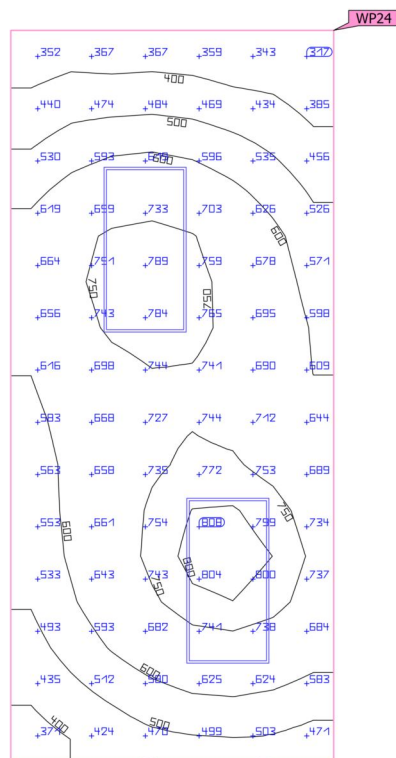


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (109 MAIL)	615 lx	306 lx	821 lx	0.50	0.37	WP24
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Summary

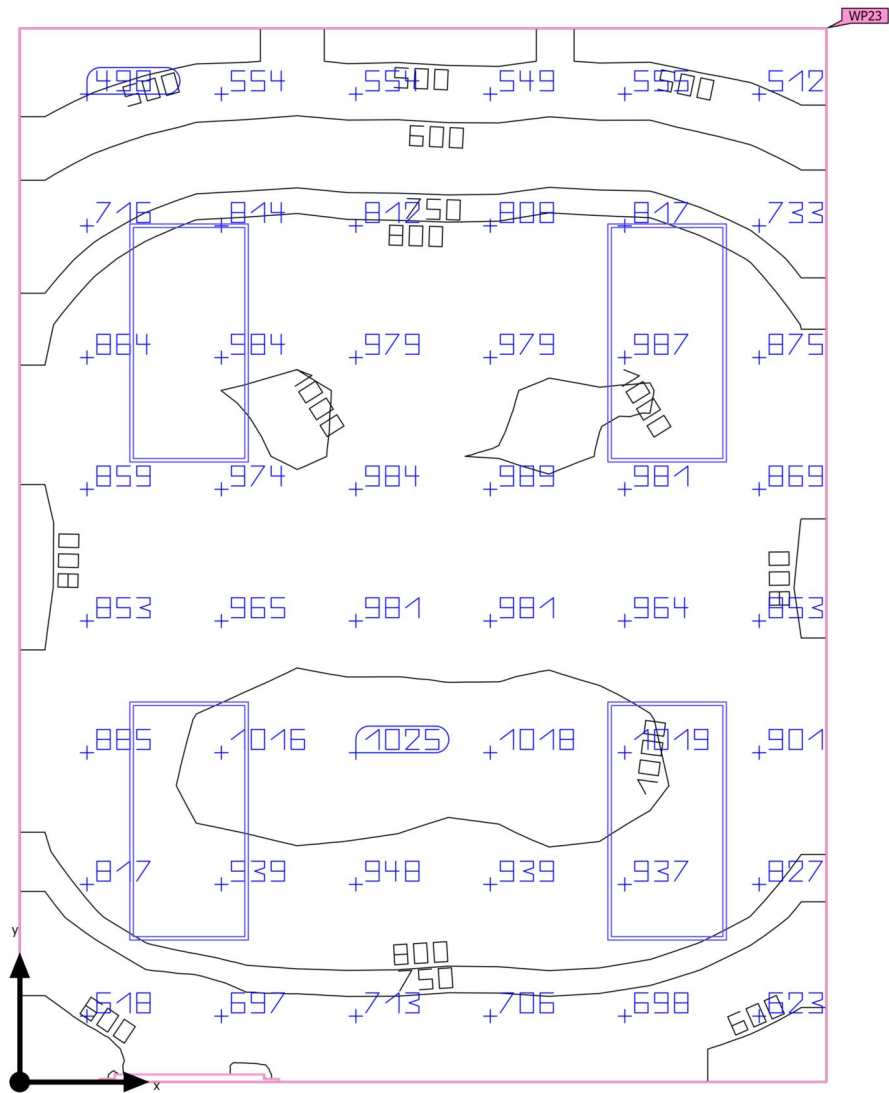

Ground area	21.42 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	836 lx	$\geq 500 \text{ lx}$	✓	WP23
	$U_o (g_1)$	0.51	≥ 0.60	✗	WP23
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	19	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[923 - 1465] kWh/a	max. 800 kWh/a	✗	
Space	Lighting power density	27.63 W/m ²	–		
		3.31 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.050 m x 5.290 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		4x36W SLB	19	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 110 OFFICE

Luminaire layout plan

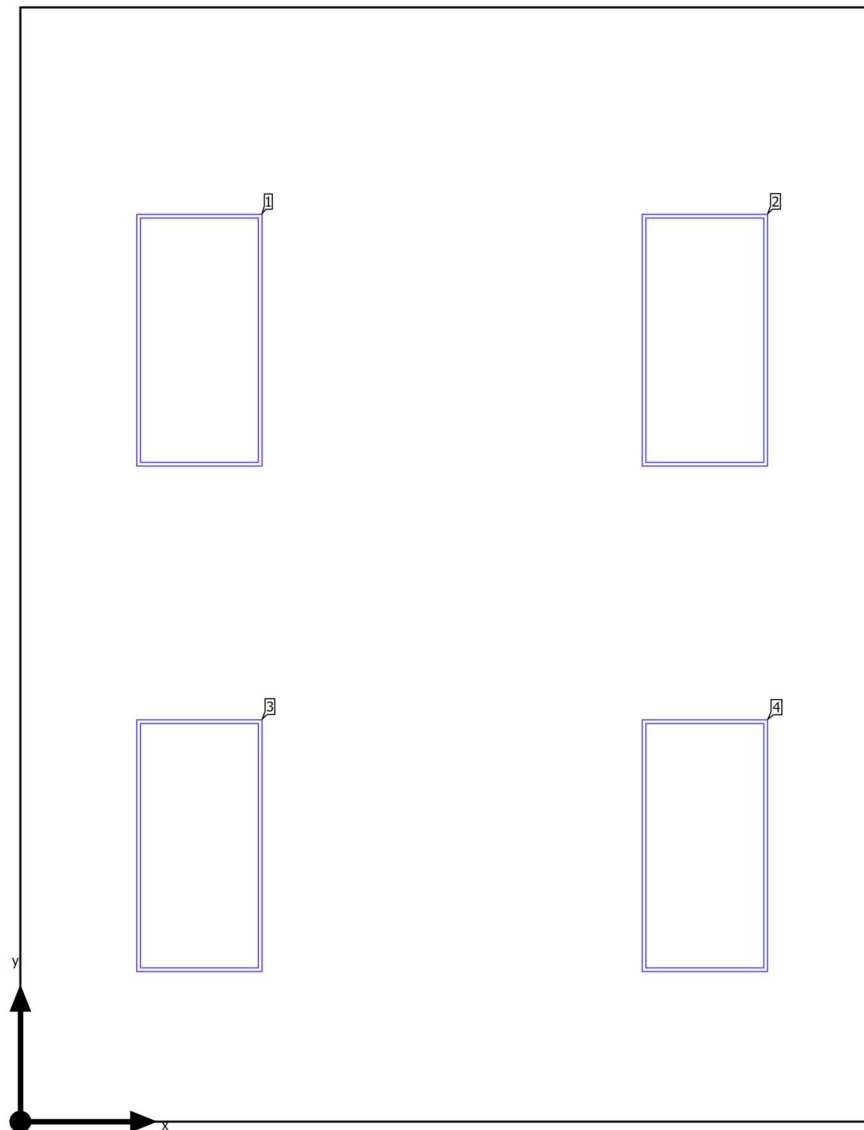

Building A · GROUND FLOOR · 110 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.850 m	3.710 m	2.700 m	1
3.250 m	3.710 m	2.700 m	2
0.850 m	1.310 m	2.700 m	3
3.250 m	1.310 m	2.700 m	4

Building A · GROUND FLOOR · 110 OFFICE


Luminaire list

Φ_{total} 33072 lm	P_{total} 592.0 W	Luminous efficacy 55.9 lm/W
----------------------------	------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Calculation objects

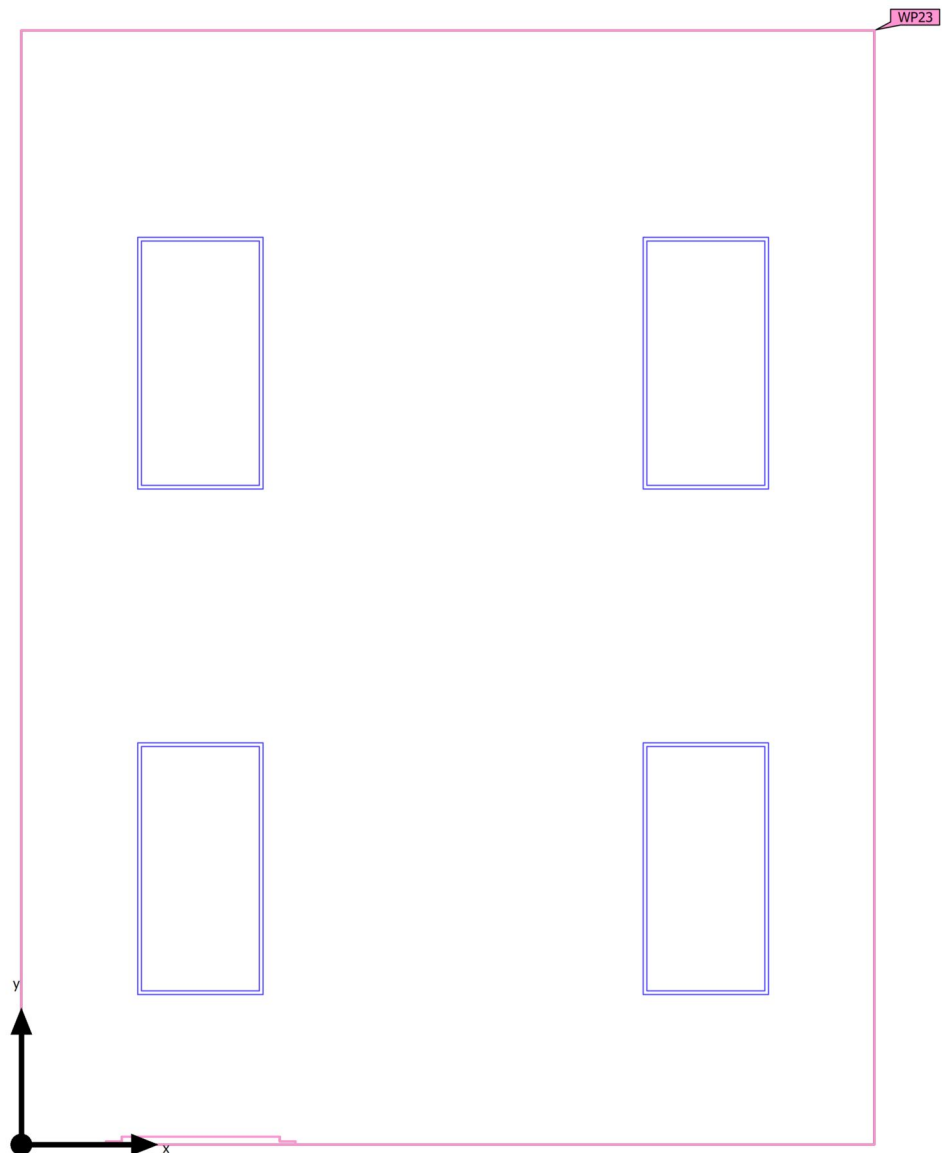

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	836 lx (≥ 500 lx) ✓	428 lx	1035 lx	0.51 (≥ 0.60) ✗	0.41	WP23

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

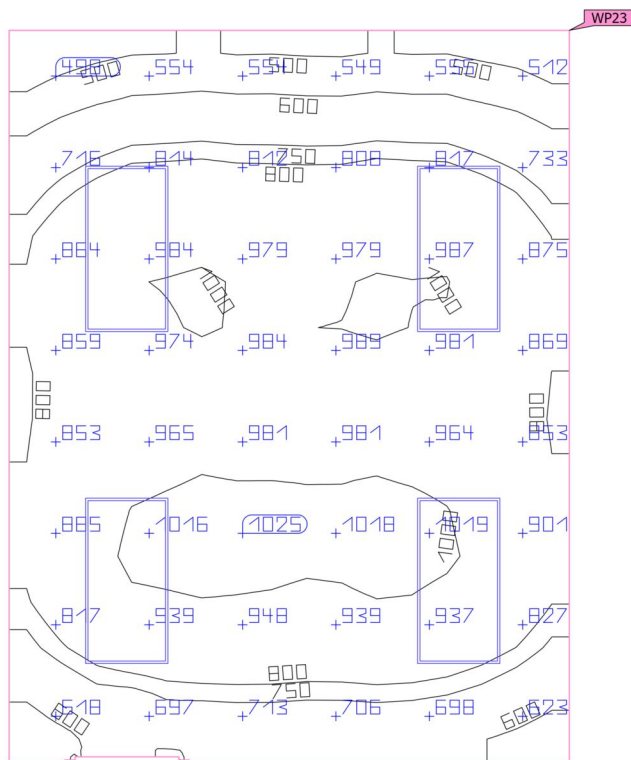
Working plane (110 OFFICE)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (110 OFFICE)	836 lx	428 lx	1035 lx	0.51	0.41	WP23
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Summary

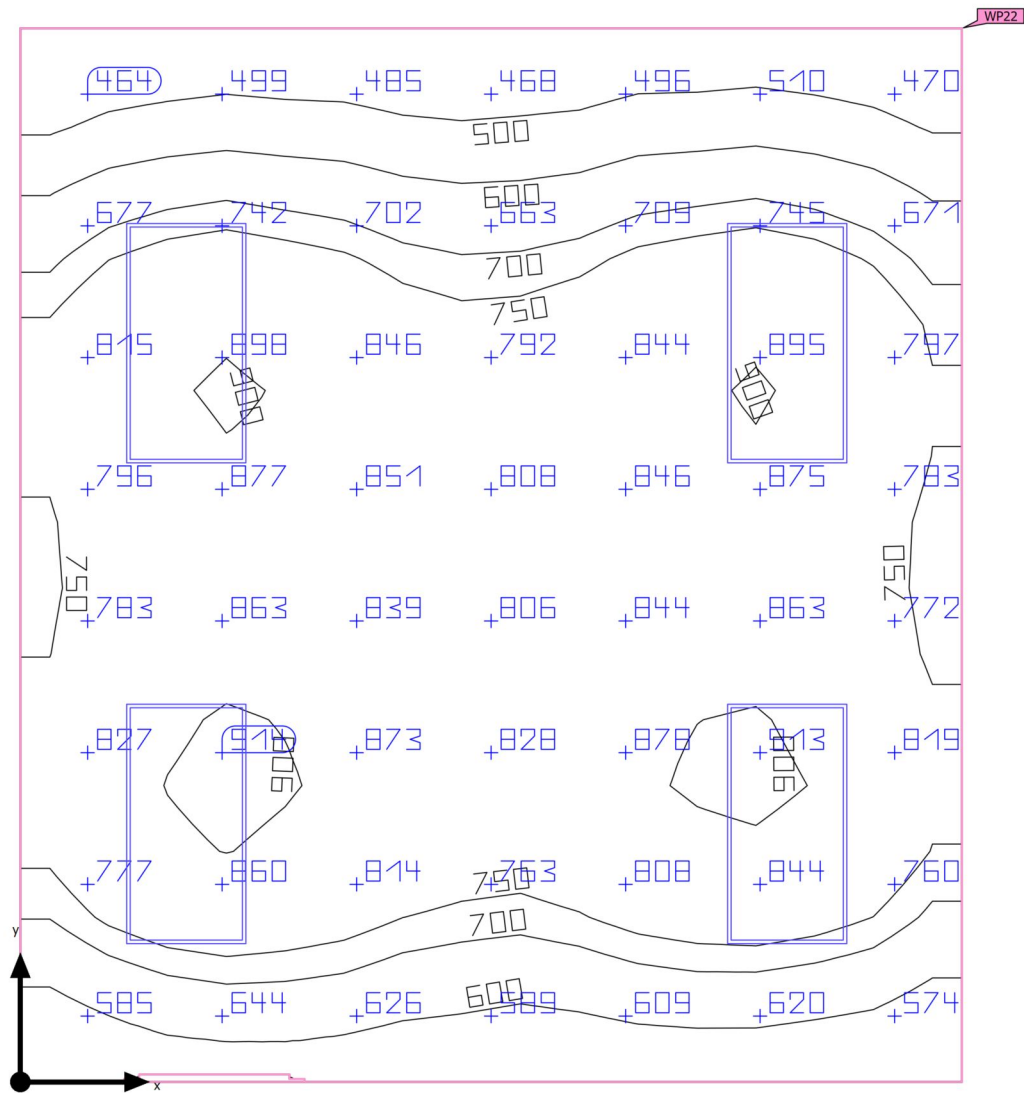

Ground area	24.72 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	743 lx	$\geq 500 \text{ lx}$	✓	WP22
	$U_o (g_1)$	0.54	≥ 0.60	✗	WP22
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	19	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[923 - 1465] kWh/a	max. 900 kWh/a	✗	
Space	Lighting power density	23.95 W/m ²	–		
		3.22 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.700 m x 5.260 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	Philips		4x36W SLB	19	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 111 CAD

Luminaire layout plan

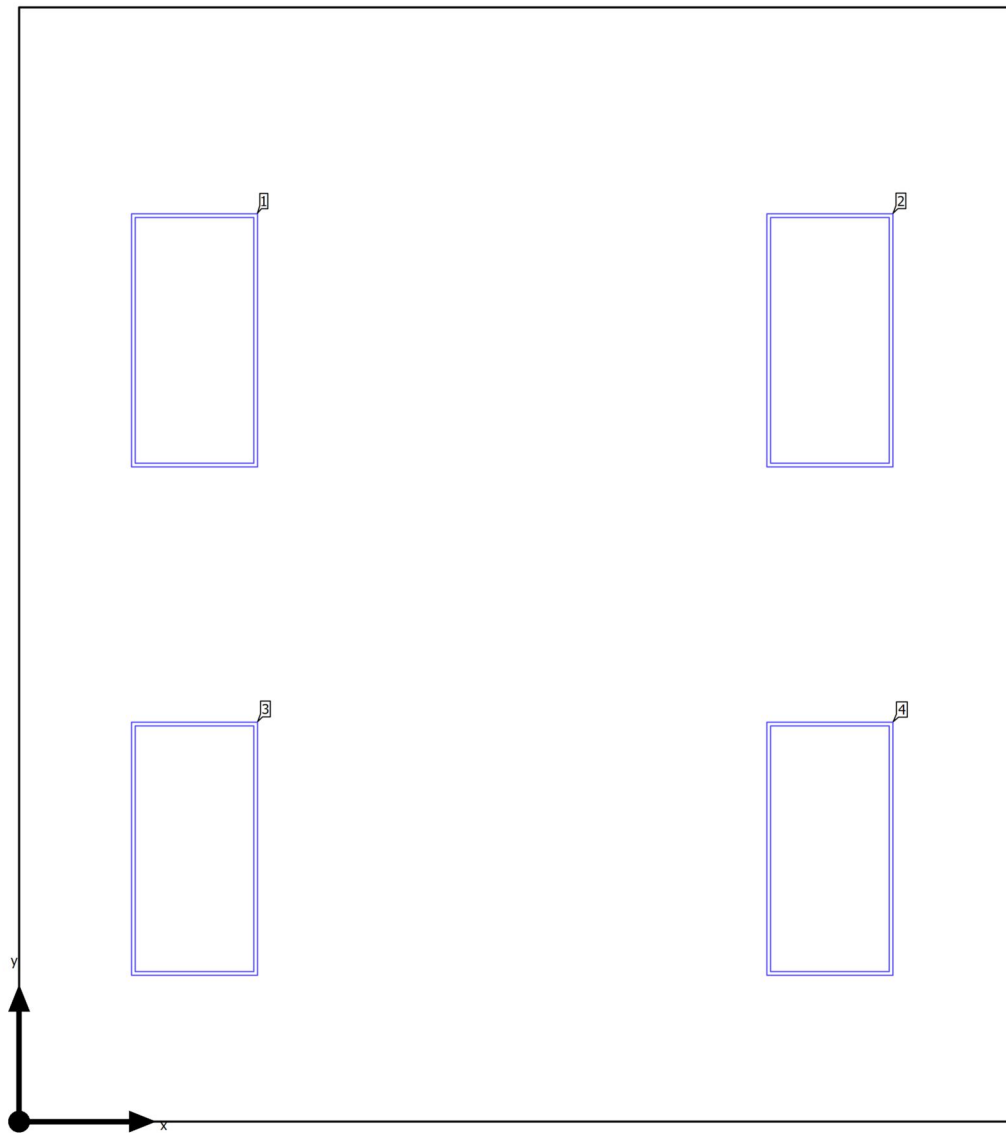

Building A · GROUND FLOOR · 111 CAD

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.828 m	3.688 m	2.700 m	1
3.828 m	3.688 m	2.700 m	2
0.828 m	1.288 m	2.700 m	3
3.828 m	1.288 m	2.700 m	4

Building A · GROUND FLOOR · 111 CAD


Luminaire list

Φ_{total} 33072 lm	P_{total} 592.0 W	Luminous efficacy 55.9 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Calculation objects

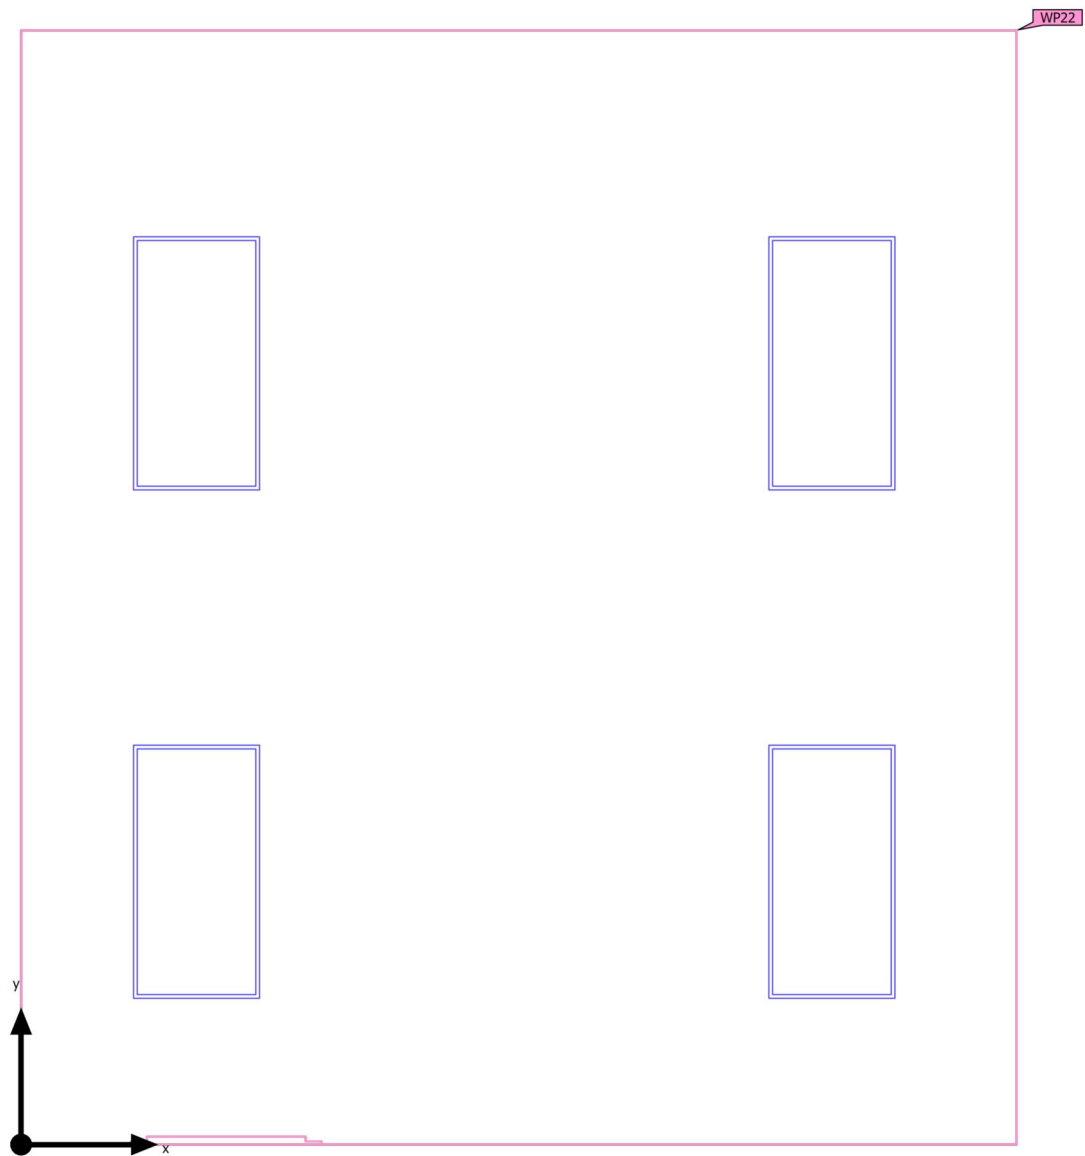

Building A · GROUND FLOOR · 111 CAD (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (111 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	743 lx (≥ 500 lx) ✓	403 lx	923 lx	0.54 (≥ 0.60) ✗	0.44	WP22

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

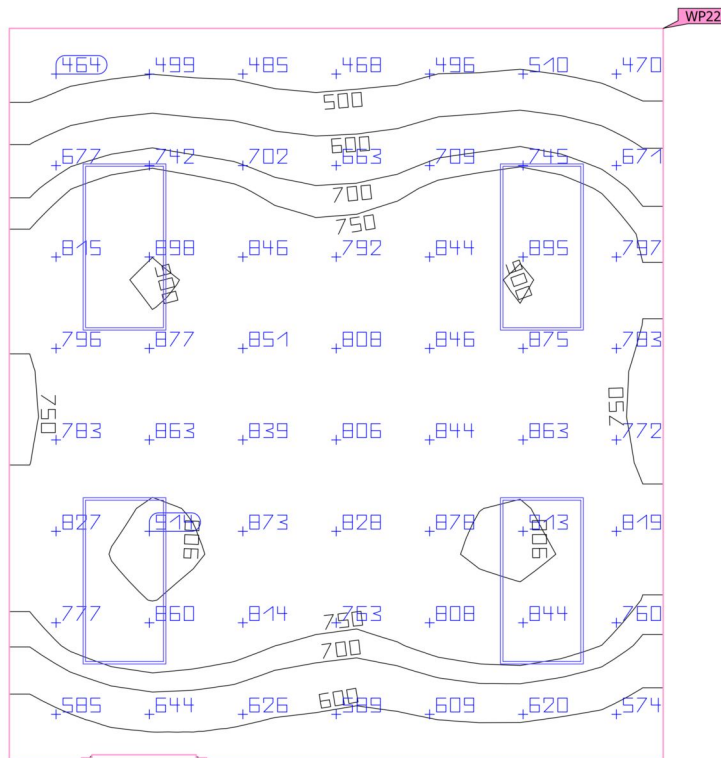
Working plane (111 CAD)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (111 CAD)	743 lx	403 lx	923 lx	0.54	0.44	WP22
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Summary

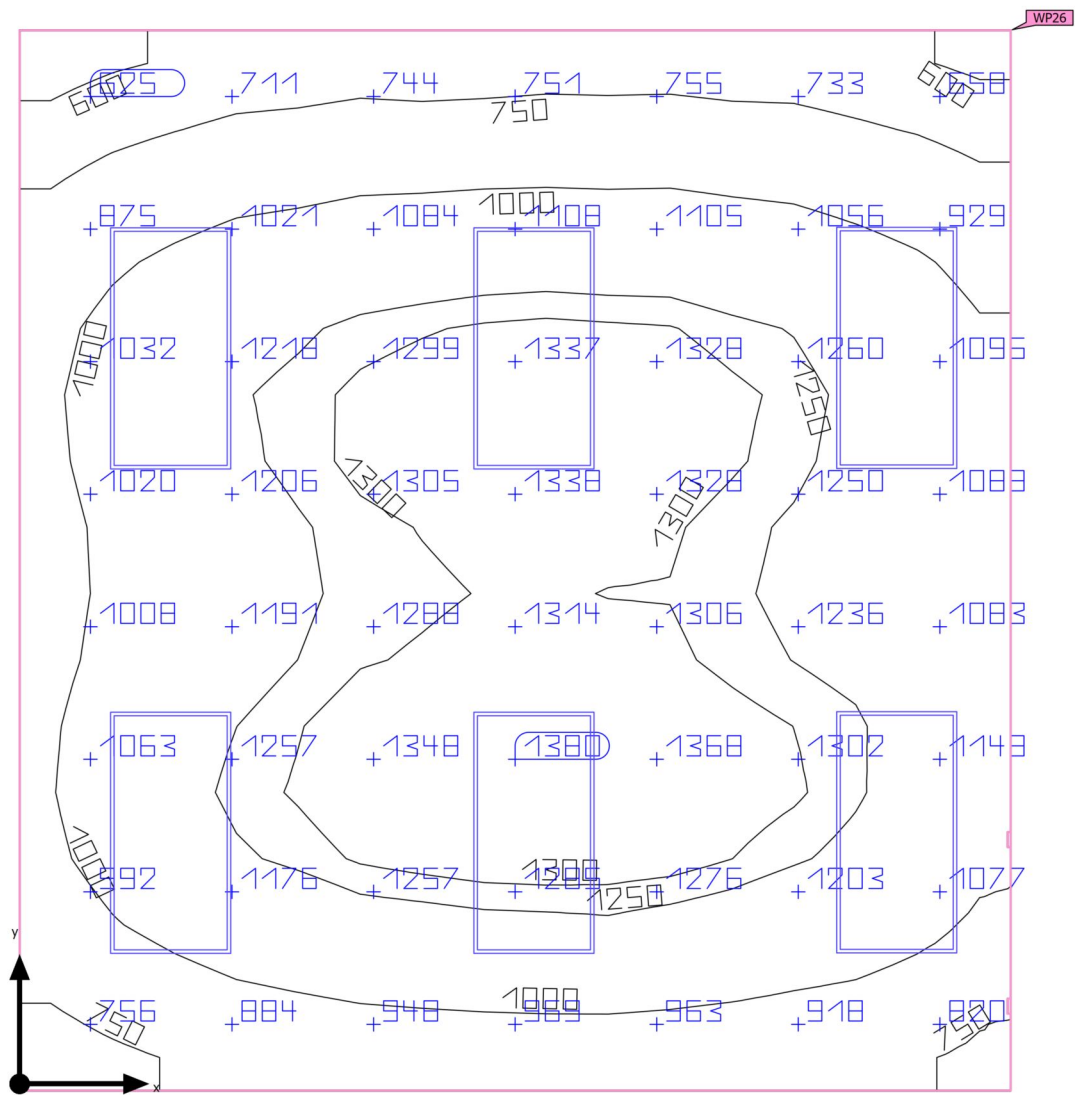

Ground area	25.80 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	1088 lx	$\geq 500 \text{ lx}$	✓	WP26
	$U_o (g_1)$	0.50	≥ 0.60	✗	WP26
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	19	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[1385 - 2198] kWh/a	max. 950 kWh/a	✗	
Space	Lighting power density	34.42 W/m ²	–		
		3.16 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.910 m x 5.254 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	Philips		4x36W SLB	19	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 112 CAD

Luminaire layout plan

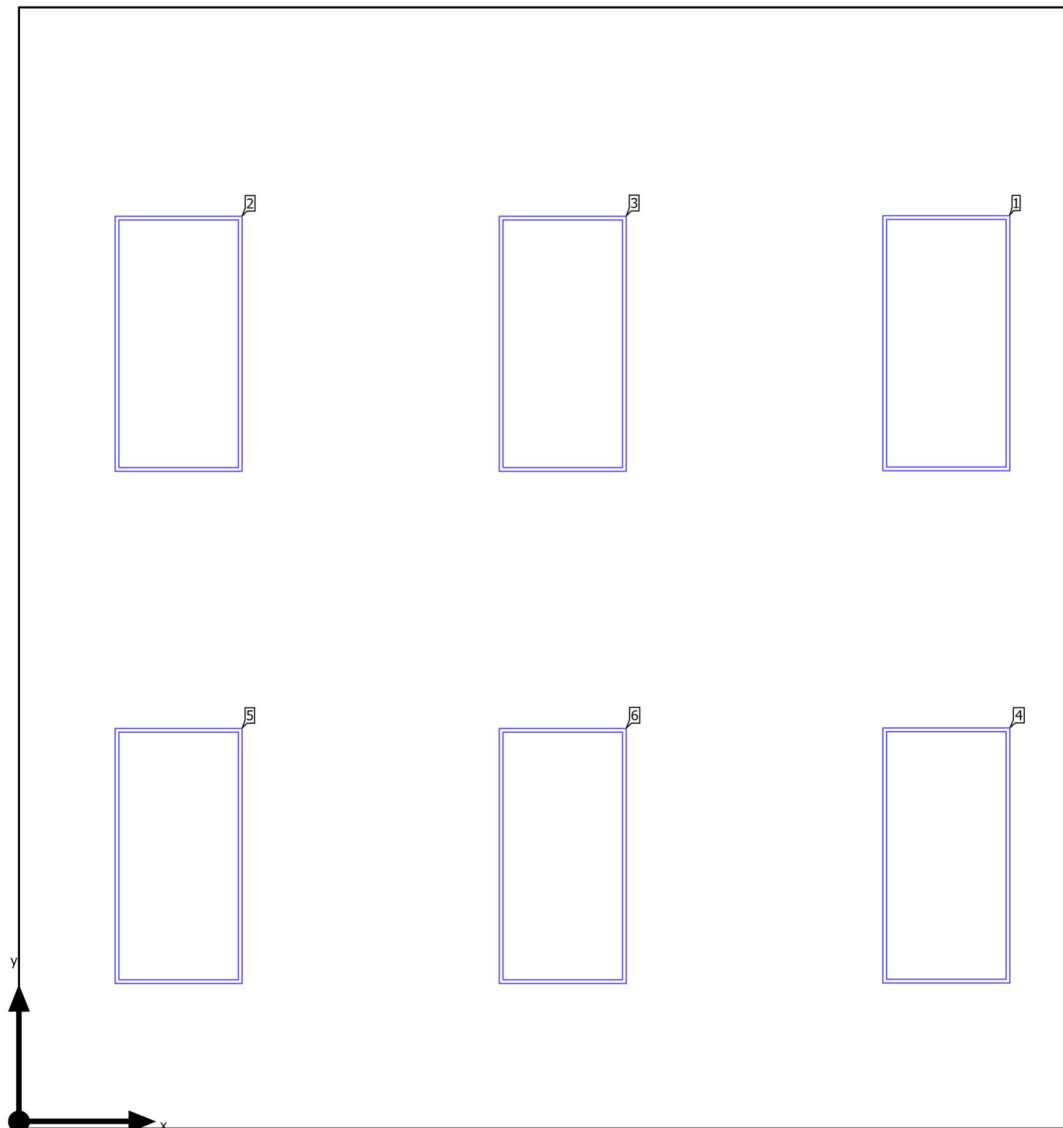

Building A · GROUND FLOOR · 112 CAD

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
4.346 m	3.646 m	2.700 m	1
0.748 m	3.644 m	2.700 m	2
2.548 m	3.644 m	2.700 m	3
4.346 m	1.246 m	2.700 m	4
0.748 m	1.244 m	2.700 m	5
2.548 m	1.244 m	2.700 m	6

Building A · GROUND FLOOR · 112 CAD

Luminaire list Φ_{total}

49608 lm

 P_{total}

888.0 W


Luminous efficacy

55.9 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
6	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects

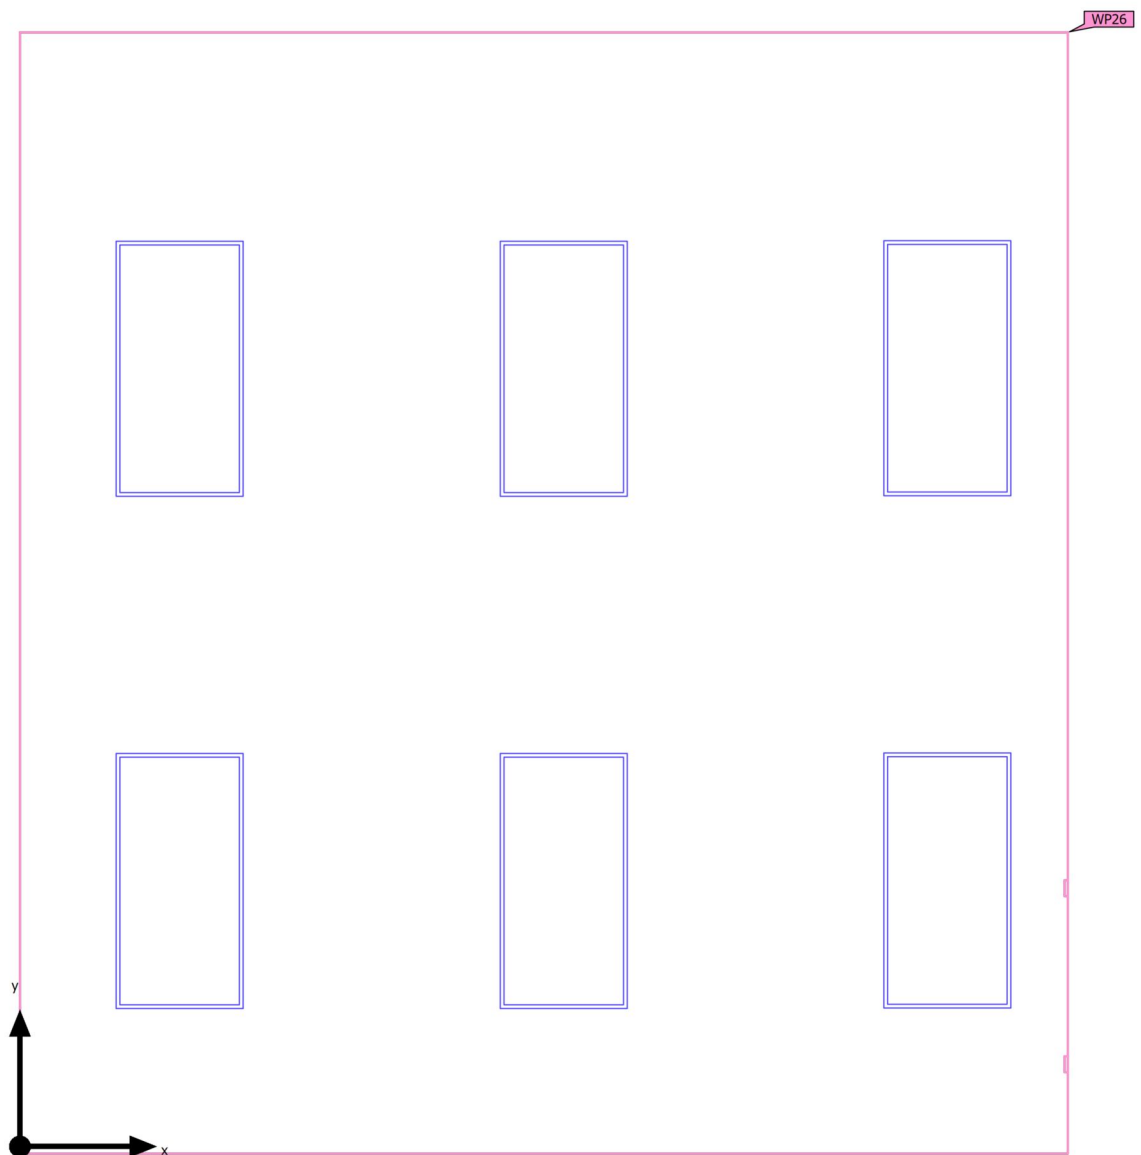

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (112 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	1088 lx (≥ 500 lx) ✓	542 lx	1389 lx	0.50 (≥ 0.60) ✗	0.39	WP26

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Working plane (112 CAD)

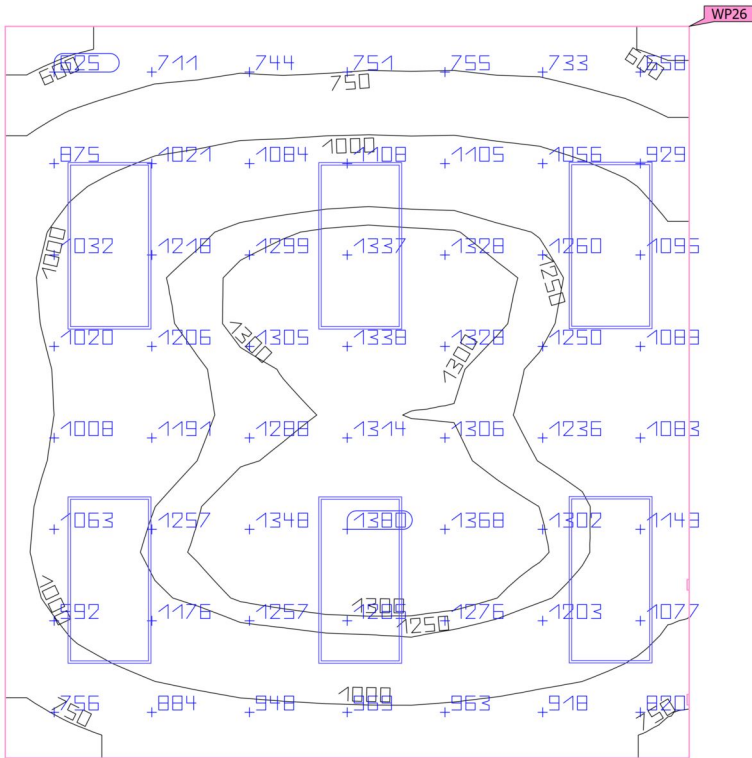


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (112 CAD)	1088 lx	542 lx	1389 lx	0.50	0.39	WP26
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Summary

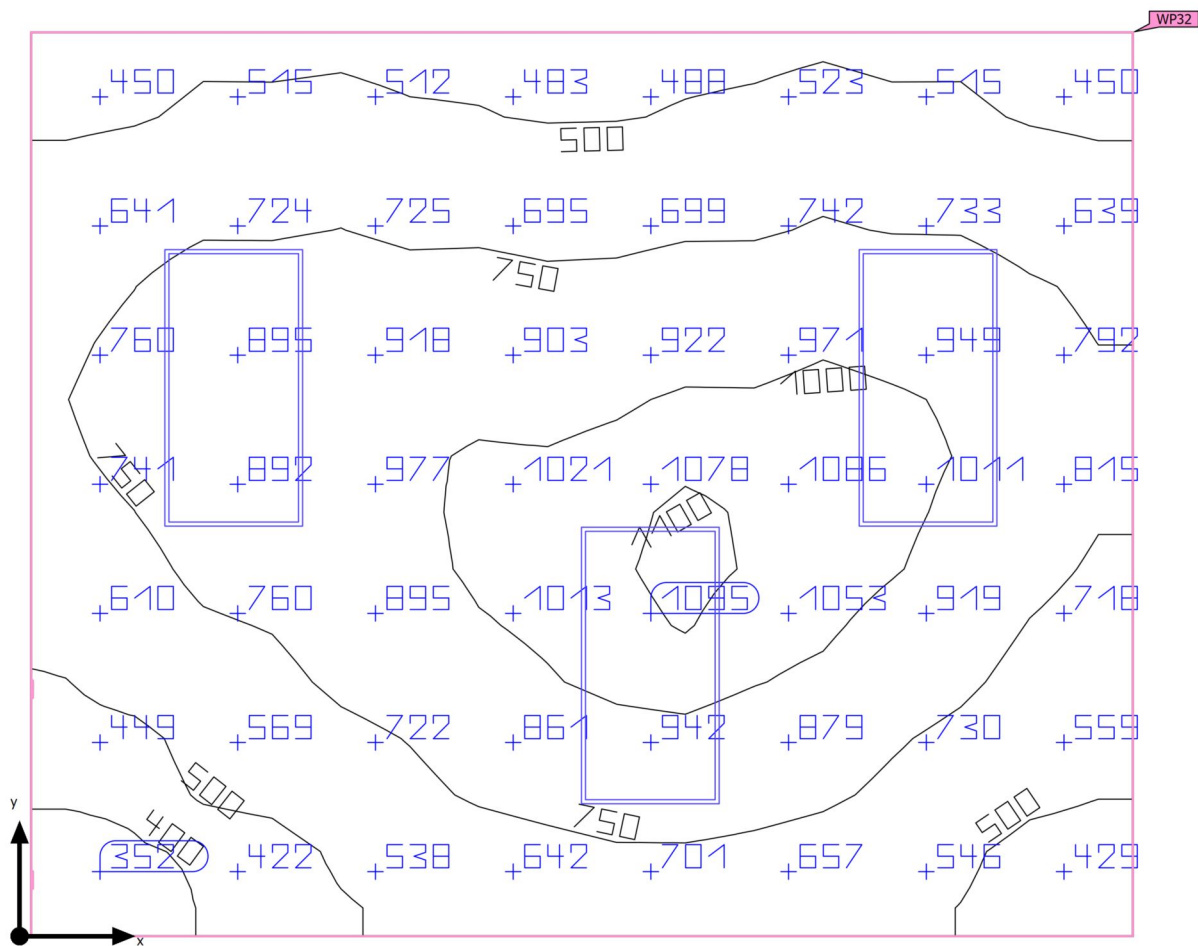

Ground area	18.60 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	743 lx	$\geq 500 \text{ lx}$	✓	WP32
	$U_o (g_1)$	0.41	≥ 0.60	✗	WP32
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	19	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[692 - 1099] kWh/a	max. 700 kWh/a	✗	
Space	Lighting power density	23.88 W/m ²	–		
		3.21 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.760 m x 3.907 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	Philips		4x36W SLB	19	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 113 OFFICE

Luminaire layout plan

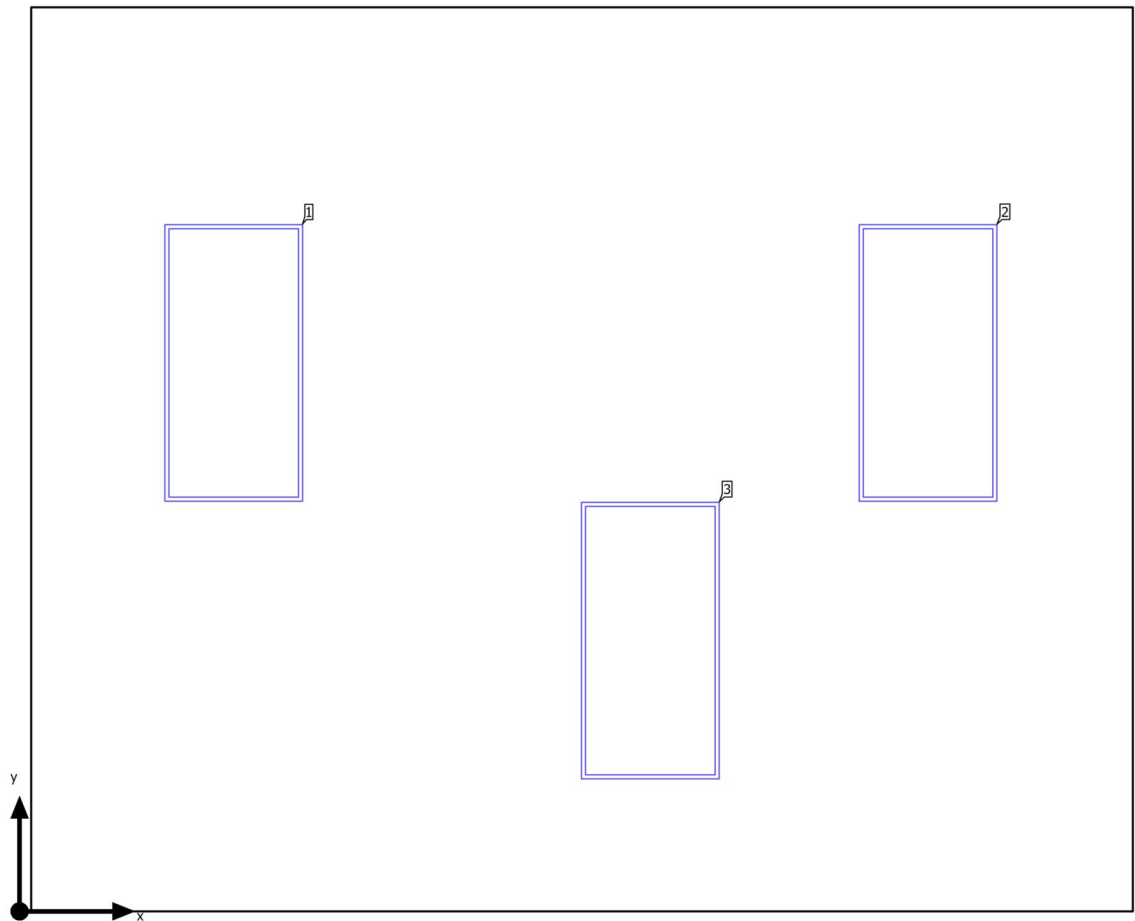

Building A · GROUND FLOOR · 113 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.925 m	2.370 m	2.700 m	1
3.925 m	2.370 m	2.700 m	2
2.725 m	1.170 m	2.700 m	3

Building A · GROUND FLOOR · 113 OFFICE

Luminaire list Φ_{total}

24804 lm

 P_{total}

444.0 W


Luminous efficacy

55.9 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
3	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Calculation objects

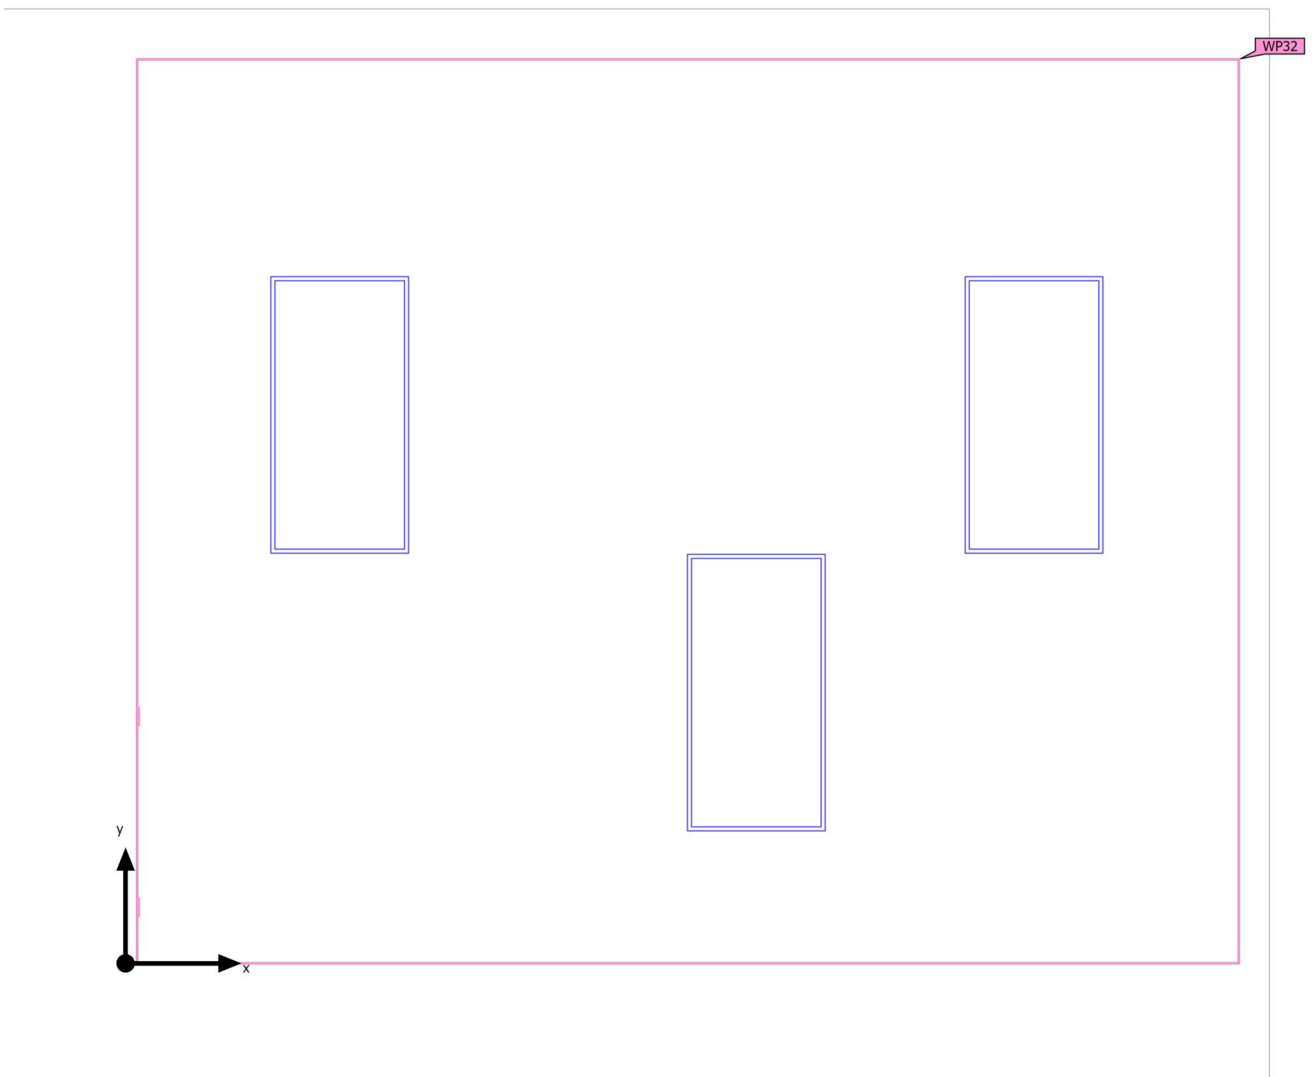

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	743 lx (≥ 500 lx) ✓	308 lx	1119 lx	0.41 (≥ 0.60) ✗	0.28	WP32

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

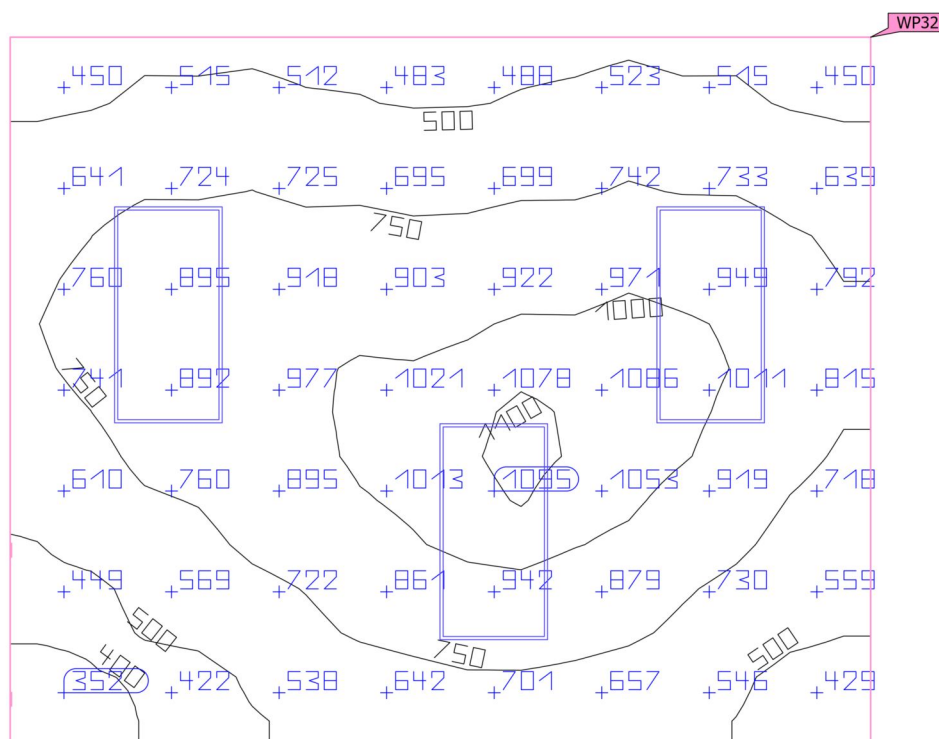
Working plane (113 OFFICE)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (113 OFFICE)	743 lx	308 lx	1119 lx	0.41	0.28	WP32
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✓			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Summary

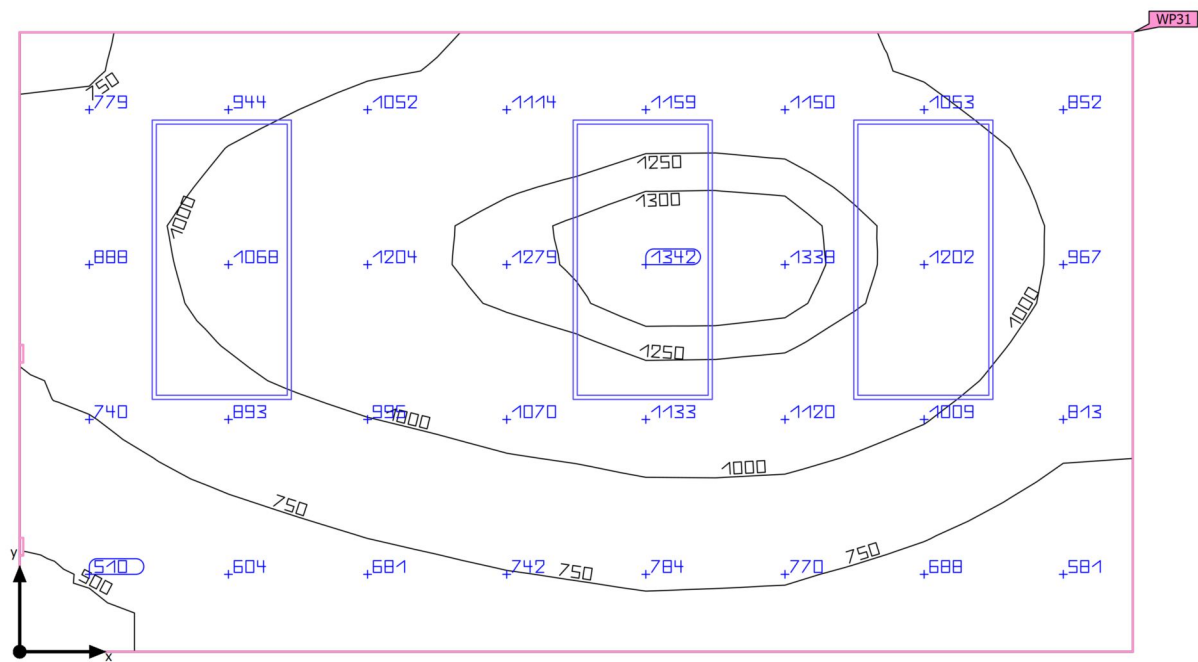

Ground area	12.61 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.700 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	954 lx	$\geq 500 \text{ lx}$	✓	WP31
	$U_o (g_1)$	0.50	≥ 0.60	✗	WP31
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	18	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	1099 kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	35.20 W/m ²	–		
		3.69 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.760 m x 2.650 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
3	Philips		4x36W SLB	18	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 114 VISITORS

Luminaire layout plan

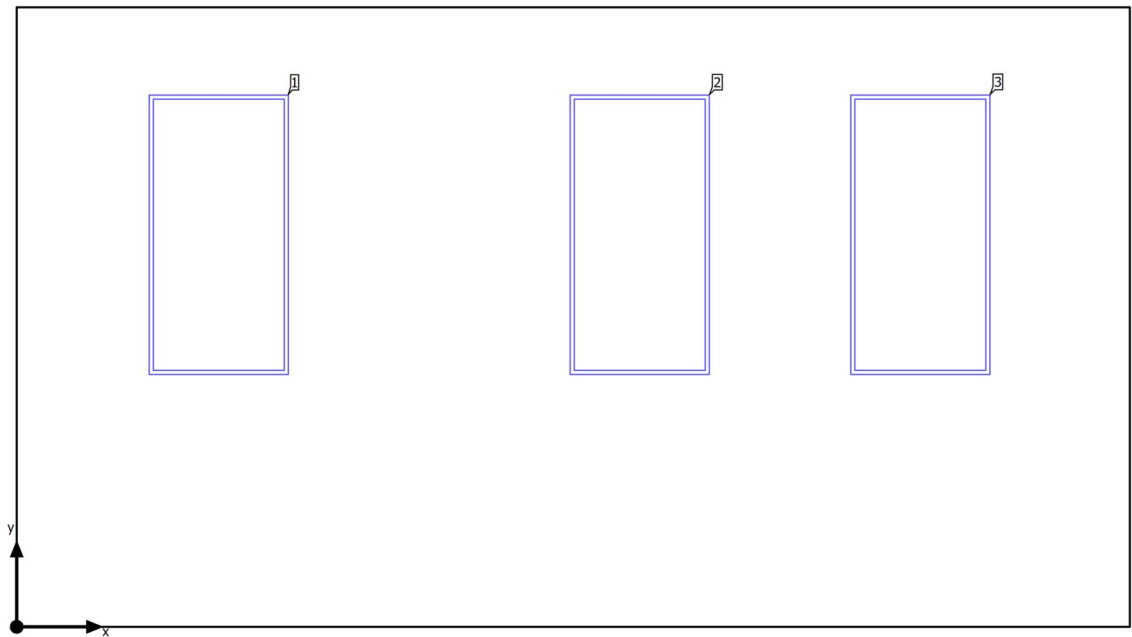

Building A · GROUND FLOOR · 114 VISITORS

Luminaire layout plan

Manufacturer	Philips	P	148.0 W
Article name	4x36W SLB	$\Phi_{\text{Luminaire}}$	8268 lm
Fitting	4x L36W/830		

Individual luminaires

X	Y	Mounting height	Luminaire
0.864 m	1.677 m	2.700 m	1
2.664 m	1.677 m	2.700 m	2
3.864 m	1.677 m	2.700 m	3

Building A · GROUND FLOOR · 114 VISITORS


Luminaire list

Φ_{total} 24804 lm	P_{total} 444.0 W	Luminous efficacy 55.9 lm/W
----------------------------	------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
3	Philips		4x36W SLB	148.0 W	8268 lm	55.9 lm/W

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Calculation objects

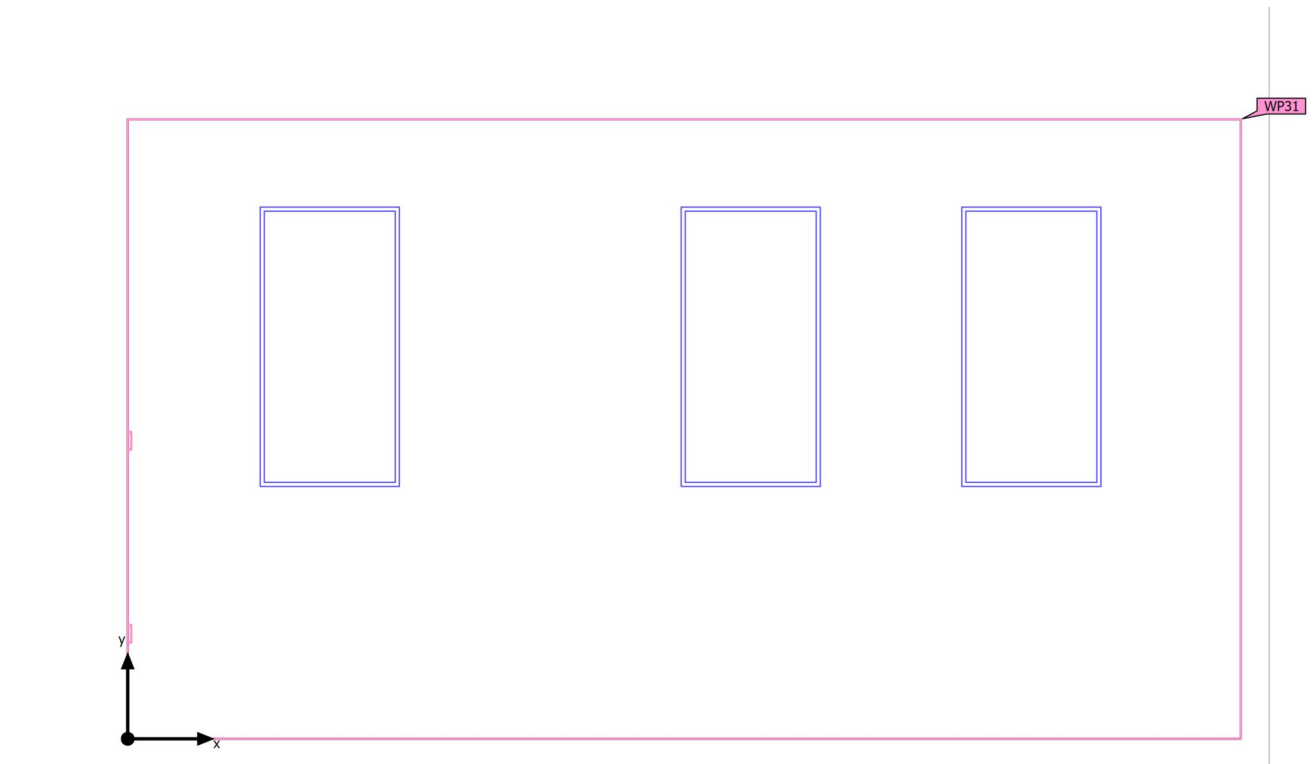

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	954 lx (≥ 500 lx) ✓	478 lx	1343 lx	0.50 (≥ 0.60) ✗	0.36	WP31

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Working plane (114 VISITORS)

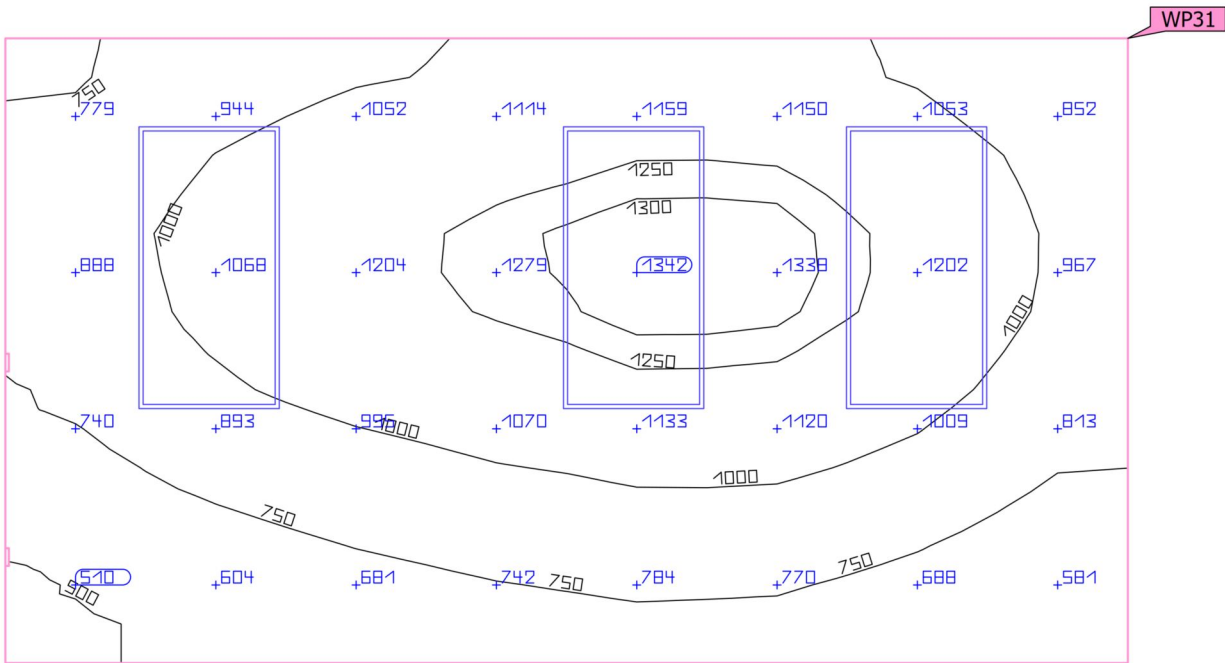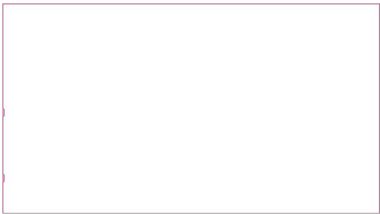

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	954 lx (≥ 500 lx) ✓	478 lx	1343 lx	0.50 (≥ 0.60) ✗	0.36	WP31

Utilisation profile: DIALux presetting (5.26.2 Standard (office))