

Building A

Luminaire list

Φ_{total} 164400 lm	P_{total} 1093.5 W	Luminous efficacy 150.3 lm/W	$\Phi_{\text{Emergency lighting}}$ 6000 lm	$P_{\text{Emergency lighting}}$ 46.2 W
------------------------------------	--------------------------------	---------------------------------	---	---

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
18	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)		0.9 W	280 lm (100 %)	-
12	ETAP	-	K9R243/1-AX1 (_LTRRevAB)		2.5 W	80 lm (100 %)	-
2	ETAP	-	U2B-M110-MI-830-025D (_LTRRevAD)		17.5 W	2495 lm	142.5 lm/W
11	ETAP	-	U2B-M110-MI-840-025D (_LTRRevAD)		17.0 W	2495 lm	146.7 lm/W
1	ETAP	-	U2B-M110-MI-840-045D (_LTRRevAD)		29.5 W	4490 lm	152.2 lm/W
2	ETAP	-	U2B-M210-MI-830-045D (_LTRRevAD)		30.5 W	4490 lm	147.2 lm/W
46	ETAP	-	U2B-M210-MI-840-025D (_LTRRevAD)		16.5 W	2495 lm	151.2 lm/W
2	Lena Lighting	284380	EXPO OPTIMA track 1700lm 60D bia ³ y mat struktura 935 11W		11.0 W	1700 lm	154.5 lm/W

Building A · GROUND FLOOR (Emergency light scene)

Room list



Building A · GROUND FLOOR (Emergency light scene)

Room list

101 STAIRS

P_{total}
3.4 W

A_{Room}
5.88 m²

Lighting power density
0.58 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	0.9 W	280 lm (100 %)
1	ETAP	-	K9R243/1-AX1 (_LTRevAB)	2.5 W	80 lm (100 %)

102 CORRIDOR / LOBBY

P_{total}
15.2 W

A_{Room}
45.50 m²

Lighting power density
0.33 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ
3	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	0.9 W	280 lm (100 %)
5	ETAP	-	K9R243/1-AX1 (_LTRevAB)	2.5 W	80 lm (100 %)

105 TOILET DISABLE

P_{total}
0.9 W

A_{Room}
4.88 m²

Lighting power density
0.18 W/m² (Space)

E_{min} (Anti panic surface)
4.94 lx

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	0.9 W	280 lm (100 %)

Building A · GROUND FLOOR (Emergency light scene)

Room list

106 MEETING

P_{total} 0.9 W	A_{Room} 12.47 m ²	Lighting power density 0.07 W/m ² (Space)	E_{min} (Anti panic surface) 4.75 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)	0.9 W	280 lm (100 %)

107 MEETING

P_{total} 0.9 W	A_{Room} 12.34 m ²	Lighting power density 0.07 W/m ² (Space)	E_{min} (Anti panic surface) 4.77 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)	0.9 W	280 lm (100 %)

108 CORRIDOR

P_{total} 19.5 W	A_{Room} 52.09 m ²	Lighting power density 0.37 W/m ² (Space)
------------------------------------	---	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
5	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)	0.9 W	280 lm (100 %)
6	ETAP	-	K9R243/1-AX1 (_LTRRevAB)	2.5 W	80 lm (100 %)

Building A · GROUND FLOOR (Emergency light scene)

Room list

109 MAIL

P_{total} 0.9 W	A_{Room} 12.41 m ²	Lighting power density 0.07 W/m ² (Space)	E_{min} (Anti panic surface) 5.32 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)	0.9 W	280 lm (100 %)

110 OFFICE

P_{total} 0.9 W	A_{Room} 21.42 m ²	Lighting power density 0.04 W/m ² (Space)	E_{min} (Anti panic surface) 3.59 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)	0.9 W	280 lm (100 %)

111 CAD

P_{total} 0.9 W	A_{Room} 24.72 m ²	Lighting power density 0.04 W/m ² (Space)	E_{min} (Anti panic surface) 1.97 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)	0.9 W	280 lm (100 %)

Building A · GROUND FLOOR (Emergency light scene)

Room list

112 CAD

P_{total} 0.9 W	A_{Room} 25.80 m ²	Lighting power density 0.03 W/m ² (Space)	E_{min} (Anti panic surface) 1.04 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	0.9 W	280 lm (100 %)

113 OFFICE

P_{total} 0.9 W	A_{Room} 18.60 m ²	Lighting power density 0.05 W/m ² (Space)	E_{min} (Anti panic surface) 3.87 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	0.9 W	280 lm (100 %)

114 VISITORS

P_{total} 0.9 W	A_{Room} 12.61 m ²	Lighting power density 0.07 W/m ² (Space)	E_{min} (Anti panic surface) 5.14 lx
-----------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	0.9 W	280 lm (100 %)

Building A · GROUND FLOOR (Light scene 1)

Room list



Building A · GROUND FLOOR (Light scene 1)

Room list

101 STAIRS

P_{total} 29.5 W	A_{Room} 5.88 m ²	Lighting power density 5.02 W/m ² (Space)
------------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	ETAP	-	U2B-M110-MI-840-045D (_LTRevAD)	29.5 W	4490 lm

102 CORRIDOR / LOBBY

P_{total} 175.0 W	A_{Room} 45.50 m ²	Lighting power density 3.85 W/m ² = 1.26 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 305 lx
-------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
9	ETAP	-	U2B-M110-MI-840-025D (_LTRevAD)	17.0 W	2495 lm
2	Lena Lighting	284380	EXPO OPTIMA track 1700lm 60D biały mat struktura 935 11W	11.0 W	1700 lm

103 TOILET

P_{total} 16.5 W	A_{Room} 3.03 m ²	Lighting power density 5.44 W/m ² = 2.73 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 199 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	16.5 W	2495 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

104 TOLIET

P_{total} 16.5 W	A_{Room} 2.93 m ²	Lighting power density 5.64 W/m ² = 2.96 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 191 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	ETAP	-	U2B-M210-MI-840-025D (_LRevAD)	16.5 W	2495 lm

105 TOILET DISABLE

P_{total} 16.5 W	A_{Room} 4.88 m ²	Lighting power density 3.38 W/m ² = 1.94 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 174 lx
------------------------------------	--	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	ETAP	-	U2B-M210-MI-840-025D (_LRevAD)	16.5 W	2495 lm

106 MEETING

P_{total} 66.0 W	A_{Room} 12.47 m ²	Lighting power density 5.29 W/m ² = 1.25 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 422 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	ETAP	-	U2B-M210-MI-840-025D (_LRevAD)	16.5 W	2495 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

107 MEETING

P_{total} 66.0 W	A_{Room} 12.34 m ²	Lighting power density 5.35 W/m ² = 1.23 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 434 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	16.5 W	2495 lm

108 CORRIDOR

P_{total} 217.5 W	A_{Room} 52.09 m ²	Lighting power density 4.18 W/m ² = 1.18 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 353 lx
-------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	ETAP	-	U2B-M110-MI-830-025D (_LTRevAD)	17.5 W	2495 lm
2	ETAP	-	U2B-M110-MI-840-025D (_LTRevAD)	17.0 W	2495 lm
9	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	16.5 W	2495 lm

109 MAIL

P_{total} 66.0 W	A_{Room} 12.41 m ²	Lighting power density 5.32 W/m ² = 1.24 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 429 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	16.5 W	2495 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

110 OFFICE

P_{total} 99.0 W	A_{Room} 21.42 m ²	Lighting power density 4.62 W/m ² = 1.09 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 422 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
6	ETAP	-	U2B-M210-MI-840-025D (_LTRRevAD)	16.5 W	2495 lm

111 CAD

P_{total} 99.0 W	A_{Room} 24.72 m ²	Lighting power density 4.00 W/m ² = 1.02 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 392 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
6	ETAP	-	U2B-M210-MI-840-025D (_LTRRevAD)	16.5 W	2495 lm

112 CAD

P_{total} 99.0 W	A_{Room} 25.80 m ²	Lighting power density 3.84 W/m ² = 1.00 W/m ² /100 lx (Space)	E_{perpendicular} (Working plane) 382 lx
------------------------------------	---	--	--

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
6	ETAP	-	U2B-M210-MI-840-025D (_LTRRevAD)	16.5 W	2495 lm

Building A · GROUND FLOOR (Light scene 1)

Room list

113 OFFICE

P_{total}
66.0 W

A_{Room}
18.60 m²

Lighting power density
3.55 W/m² = 1.12 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
317 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	16.5 W	2495 lm

114 VISITORS

P_{total}
61.0 W

A_{Room}
12.61 m²

Lighting power density
4.84 W/m² = 1.14 W/m²/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$
425 lx

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
2	ETAP	-	U2B-M210-MI-830-045D (_LTRevAD)	30.5 W	4490 lm

Building A · GROUND FLOOR


Luminaire list

Φ_{total} 164400 lm	P_{total} 1093.5 W	Luminous efficacy 150.3 lm/W	$\Phi_{\text{Emergency lighting}}$ 6000 lm	$P_{\text{Emergency lighting}}$ 46.2 W
------------------------------------	--------------------------------	---------------------------------	---	---

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
18	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)		0.9 W	280 lm (100 %)	-
12	ETAP	-	K9R243/1-AX1 (_LTRRevAB)		2.5 W	80 lm (100 %)	-
2	ETAP	-	U2B-M110-MI-830-025D (_LTRRevAD)		17.5 W	2495 lm	142.5 lm/W
11	ETAP	-	U2B-M110-MI-840-025D (_LTRRevAD)		17.0 W	2495 lm	146.7 lm/W
1	ETAP	-	U2B-M110-MI-840-045D (_LTRRevAD)		29.5 W	4490 lm	152.2 lm/W
2	ETAP	-	U2B-M210-MI-830-045D (_LTRRevAD)		30.5 W	4490 lm	147.2 lm/W
46	ETAP	-	U2B-M210-MI-840-025D (_LTRRevAD)		16.5 W	2495 lm	151.2 lm/W
2	Lena Lighting	284380	EXPO OPTIMA track 1700lm 60D bia ³ y mat struktura 935 11W		11.0 W	1700 lm	154.5 lm/W

Building A · GROUND FLOOR (Emergency light scene)

Calculation objects

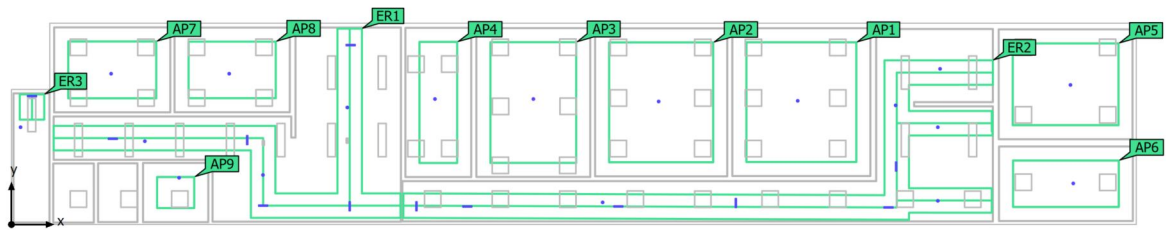

Building A · GROUND FLOOR (Emergency light scene)

Calculation objects

Anti panic surfaces

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m	4.94 lx (≥ 0.50 lx) ✓	9.71 lx	0.51 (≥ 0.025) ✓	AP9
Anti panic surface (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.75 lx (≥ 0.50 lx) ✓	9.67 lx	0.49 (≥ 0.025) ✓	AP7
Anti panic surface (107 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.77 lx (≥ 0.50 lx) ✓	9.66 lx	0.49 (≥ 0.025) ✓	AP8
Anti panic surface (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.000 m	5.32 lx (≥ 0.50 lx) ✓	9.64 lx	0.55 (≥ 0.025) ✓	AP4
Anti panic surface (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.59 lx (≥ 0.50 lx) ✓	9.66 lx	0.37 (≥ 0.025) ✓	AP3
Anti panic surface (111 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.97 lx (≥ 0.50 lx) ✓	9.71 lx	0.20 (≥ 0.025) ✓	AP2
Anti panic surface (112 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.04 lx (≥ 0.50 lx) ✓	9.71 lx	0.11 (≥ 0.025) ✓	AP1
Anti panic surface (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.87 lx (≥ 0.50 lx) ✓	9.67 lx	0.40 (≥ 0.025) ✓	AP5
Anti panic surface (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.000 m	5.14 lx (≥ 0.50 lx) ✓	9.68 lx	0.53 (≥ 0.025) ✓	AP6

Building A · GROUND FLOOR (Emergency light scene)

Calculation objects

Escape routes


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
101 Stairs Lower Emergency route Perpendicular illuminance (adaptive) Height: 0.000 m	10.2 lx (≥ 0.50 lx) ✓	11.4 lx	10.4 lx (≥ 1.00 lx) ✓	11.1 lx	0.94 (≥ 0.025) ✓	ER3
102 Corridor/Lobby Emergency route Perpendicular illuminance (adaptive) Height: 0.000 m	2.34 lx (≥ 0.50 lx) ✓	23.0 lx	2.69 lx (≥ 1.00 lx) ✓	22.9 lx	0.12 (≥ 0.025) ✓	ER1
108 Corridor Emergency route Perpendicular illuminance (adaptive) Height: 0.000 m	7.75 lx (≥ 0.50 lx) ✓	26.4 lx	9.51 lx (≥ 1.00 lx) ✓	26.4 lx	0.36 (≥ 0.025) ✓	ER2

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

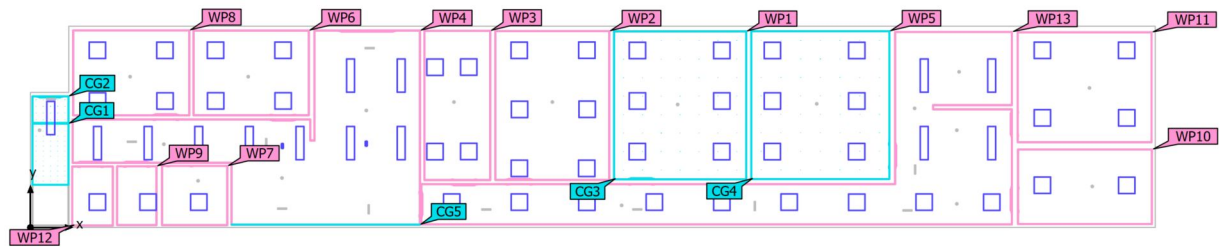

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (102 CORRIDOR / LOBBY) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	305 lx (≥ 500 lx) ✗	128 lx	404 lx	0.42 (≥ 0.60) ✗	0.32	WP4
Working plane (103 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	199 lx (≥ 500 lx) ✗	156 lx	221 lx	0.78 (≥ 0.60) ✓	0.71	WP12
Working plane (104 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	191 lx (≥ 500 lx) ✗	147 lx	216 lx	0.77 (≥ 0.60) ✓	0.68	WP9
Working plane (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	174 lx (≥ 500 lx) ✗	119 lx	205 lx	0.68 (≥ 0.60) ✓	0.58	WP7
Working plane (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	422 lx (≥ 500 lx) ✗	287 lx	497 lx	0.68 (≥ 0.60) ✓	0.58	WP8
Working plane (107 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	434 lx (≥ 500 lx) ✗	299 lx	500 lx	0.69 (≥ 0.60) ✓	0.60	WP6
Working plane (108 CORRIDOR) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	353 lx (≥ 500 lx) ✗	126 lx	467 lx	0.36 (≥ 0.60) ✗	0.27	WP13
Working plane (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	429 lx (≥ 500 lx) ✗	225 lx	577 lx	0.52 (≥ 0.60) ✗	0.39	WP3
Working plane (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	422 lx (≥ 500 lx) ✗	290 lx	477 lx	0.69 (≥ 0.60) ✓	0.61	WP2
Working plane (111 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	392 lx (≥ 500 lx) ✗	225 lx	491 lx	0.57 (≥ 0.60) ✗	0.46	WP1
Working plane (112 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	382 lx (≥ 500 lx) ✗	208 lx	487 lx	0.54 (≥ 0.60) ✗	0.43	WP5

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

Working plane (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	317 lx (≥ 500 lx) ✗	222 lx	382 lx	0.70 (≥ 0.60) ✓	0.58	WP11
Working plane (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	425 lx (≥ 500 lx) ✗	235 lx	600 lx	0.55 (≥ 0.60) ✗	0.39	WP10

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	331 lx	57.6 lx	581 lx	0.17	0.099	CG1
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	350 lx	305 lx	381 lx	0.87	0.80	CG2
Art Wall Perpendicular illuminance Height: 1.350 m	199 lx	53.9 lx	280 lx	0.27	0.19	CG5
Art Wall Horizontal illuminance Height: 1.350 m	90.3 lx	16.3 lx	166 lx	0.18	0.098	CG5

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

111 CAD Glare Surface (RUG)

Strongest glare at	135°
max	15.3
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG3

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

111 CAD Glare Surface (RUG)



Building A · GROUND FLOOR (Light scene 1)

Calculation objects

112 CAD Glare Surface (RUG)

Strongest glare at	120°
max	16.0
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG4

Building A · GROUND FLOOR (Light scene 1)

Calculation objects

112 CAD Glare Surface (RUG)




Building A · GROUND FLOOR (Light scene 1)

Calculation objects


112 CAD Glare Surface (R_G)

Strongest glare at	135°
max	> 90
Target	-
Viewing sector	0° - 360°
Step width	15°
Angle of inclination	-2°
Height	1.200 m
Index	CG4
Method	Simplified calculation according to EN 12464

Building A · GROUND FLOOR (Light scene 1)

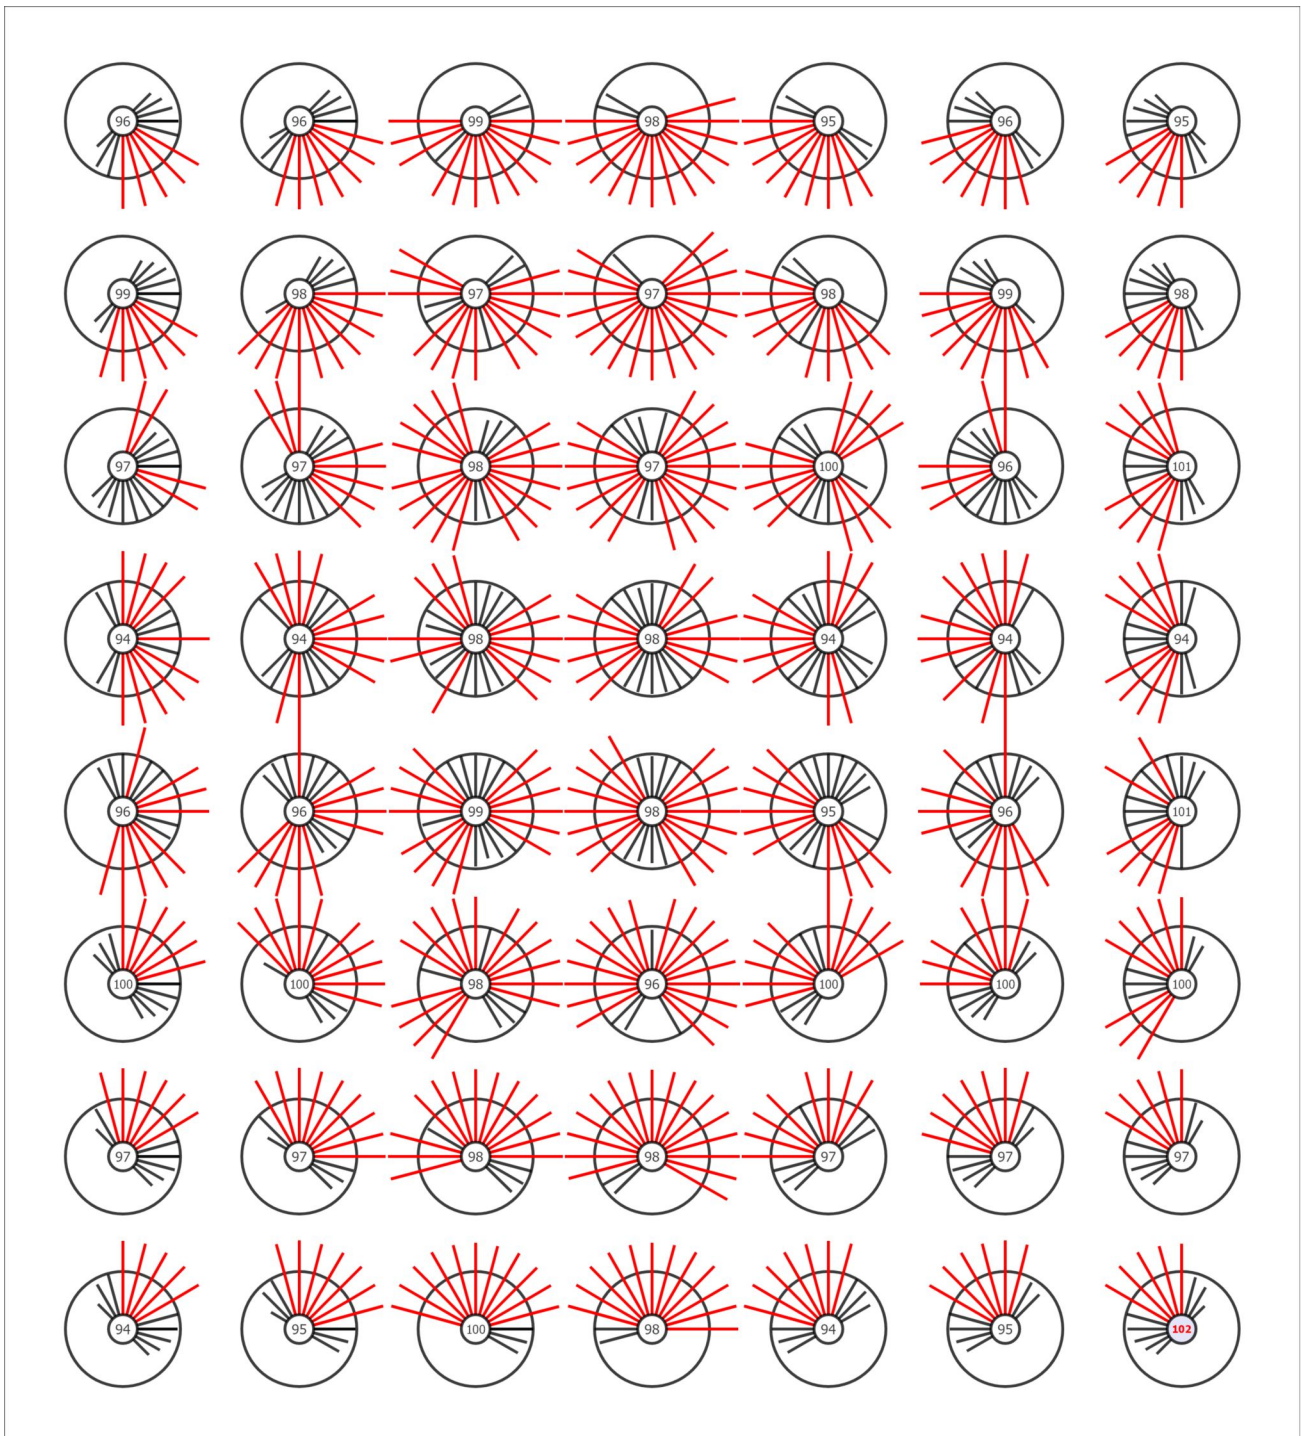Calculation objects112 CAD Glare Surface (R_G)

Building A · GROUND FLOOR (Emergency light scene)

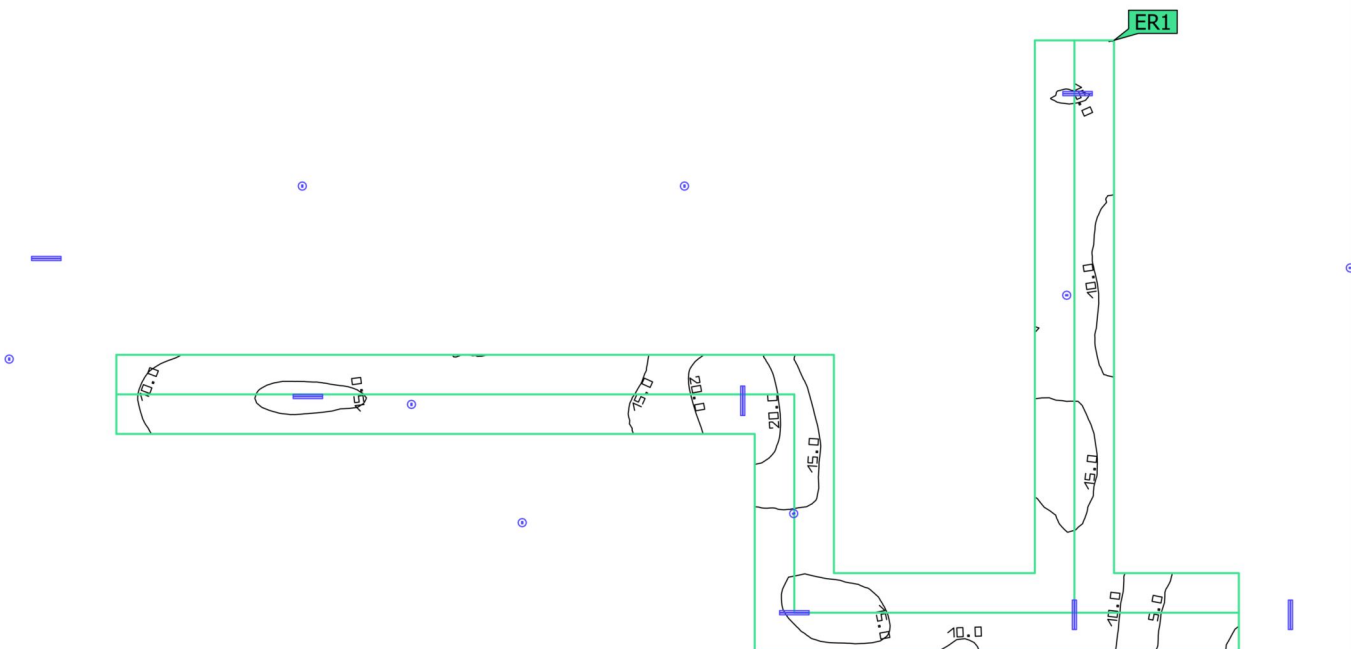102 Corridor/Lobby Emergency route


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
102 Corridor/Lobby Emergency route	2.34 lx	23.0 lx	2.69 lx	22.9 lx	0.12	ER1
Perpendicular illuminance (adaptive)	≥ 0.50 lx		≥ 1.00 lx		≥ 0.025	
Height: 0.000 m	✓		✓		✓	

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR (Emergency light scene)


108 Corridor Emergency route

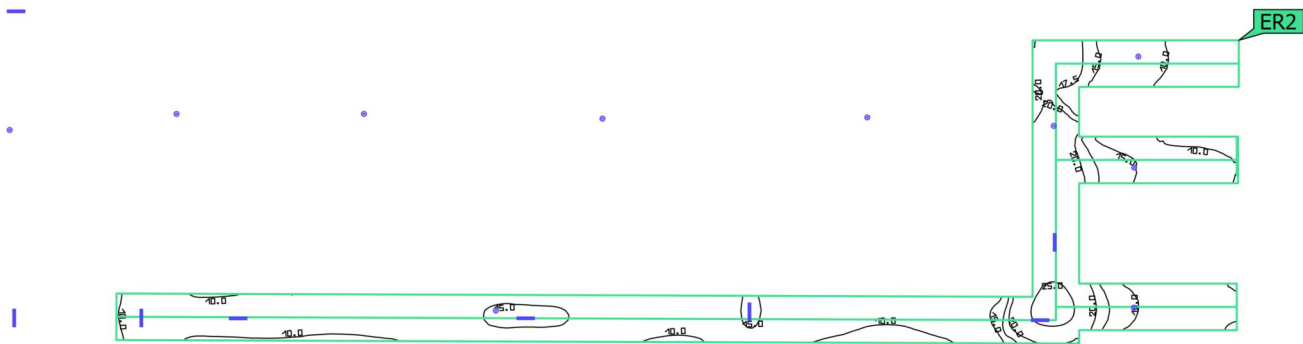

Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
108 Corridor Emergency route Perpendicular illuminance (adaptive) Height: 0.000 m	7.75 lx (≥ 0.50 lx) ✓	26.4 lx	9.51 lx (≥ 1.00 lx) ✓	26.4 lx	0.36 (≥ 0.025) ✓	ER2

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR (Emergency light scene)

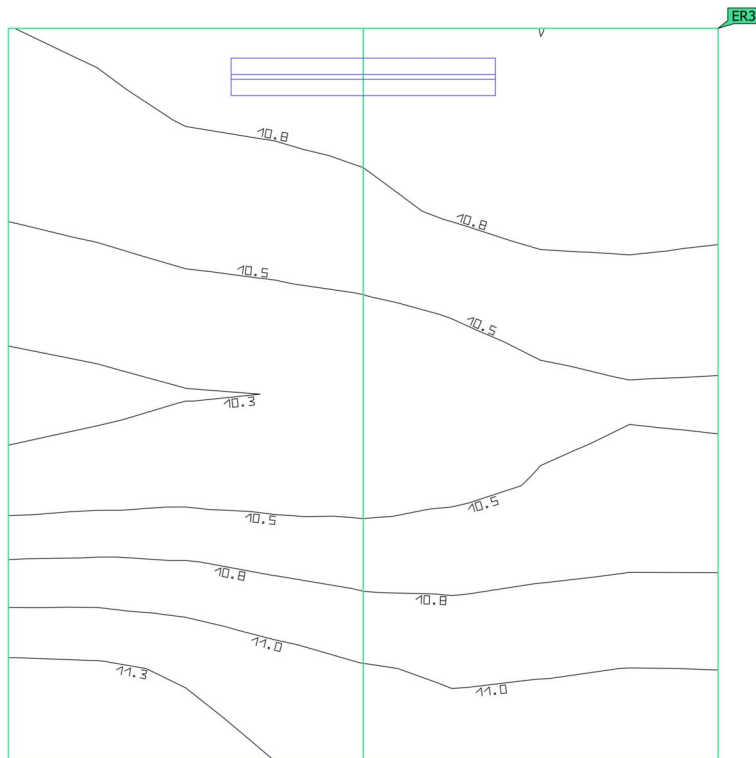101 Stairs Lower Emergency route


Properties	E_{min} Middle area (Target)	E_{max} Middle area	E_{min} Centerline (Target)	E_{max} Centerline	U_d (Target)	Index
101 Stairs Lower Emergency route Perpendicular illuminance (adaptive) Height: 0.000 m	10.2 lx (≥ 0.50 lx) ✓	11.4 lx	10.4 lx (≥ 1.00 lx) ✓	11.1 lx	0.94 (≥ 0.025) ✓	ER3

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 101 STAIRS (Emergency light scene)

Summary

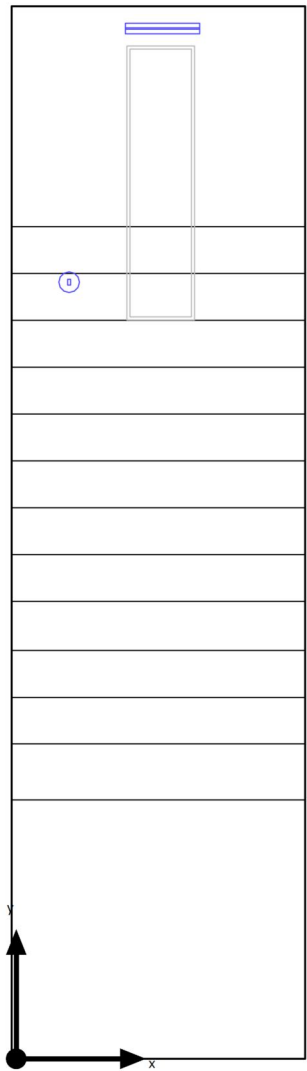

Ground area	5.88 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	2.700 m
Maintenance factor	0.76 (fixed)	Mounting height	2.758 m – 2.768 m

Building A · GROUND FLOOR · 101 STAIRS (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.58 W/m ²	–		

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)		0.9 W	280 lm (100 %)	–
1	ETAP	-	K9R243/1-AX1 (_LTRRevAB)		2.5 W	80 lm (100 %)	–

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Summary

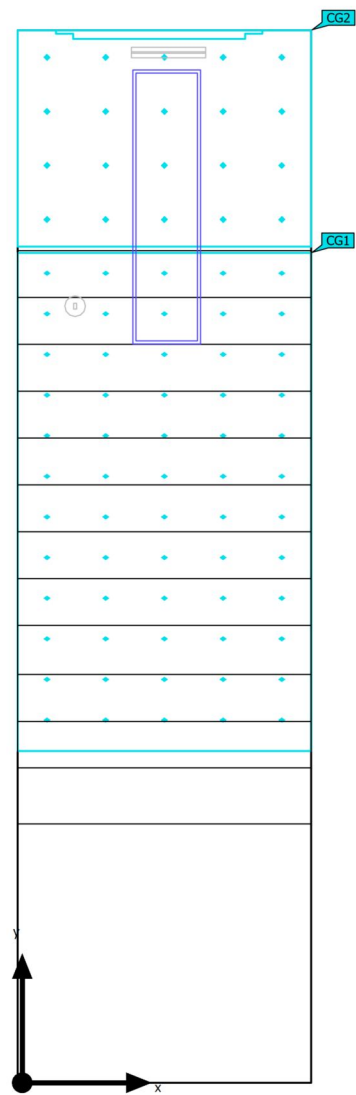

Ground area	5.88 m ²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	2.700 m
Maintenance factor	0.76 (fixed)	Mounting height	2.776 m

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	17	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	73.0 kWh/a	max. 250 kWh/a	✓	
Space	Lighting power density	5.02 W/m ²	–		

(1) Based on a rectangular space of 4.590 m x 1.280 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	ETAP	-	U2B-M110-MI-840-045D (LTRRevAD)	17	29.5 W	4490 lm	152.2 lm/W

Building A · GROUND FLOOR · 101 STAIRS

Luminaire layout plan

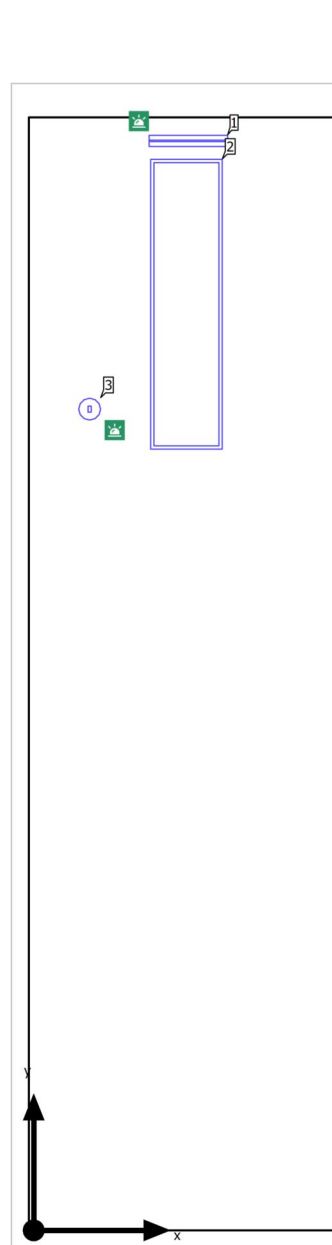

Building A · GROUND FLOOR · 101 STAIRS


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
0.231 m	3.387 m	2.768 m	3

Building A · GROUND FLOOR · 101 STAIRS


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	2.5 W
Article name	K9R243/1-AX1 (_LTRevAB)	Φ _{Luminaire}	0 lm
Fitting	1x sign with picto	Φ _{Emergency lighting}	80 lm
		ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
0.638 m	4.493 m	2.758 m	1

Building A · GROUND FLOOR · 101 STAIRS

Luminaire layout plan

Manufacturer	ETAP	P	29.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4490 lm
Article name	U2B-M110-MI-840-045D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.630 m	3.819 m	2.776 m	2

Building A · GROUND FLOOR · 101 STAIRS


Luminaire list

Φ_{total} 4500 lm	P_{total} 29.5 W	Luminous efficacy 152.5 lm/W	$\Phi_{\text{Emergency lighting}}$ 360 lm	$P_{\text{Emergency lighting}}$ 3.4 W
----------------------------------	------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)		0.9 W	280 lm (100 %)	-
1	ETAP	-	K9R243/1-AX1 (_LTRevAB)		2.5 W	80 lm (100 %)	-
1	ETAP	-	U2B-M110-MI-840-045D (_LTRevAD)		29.5 W	4490 lm	152.2 lm/W

Building A · GROUND FLOOR · 101 STAIRS (Emergency light scene)

Calculation objects

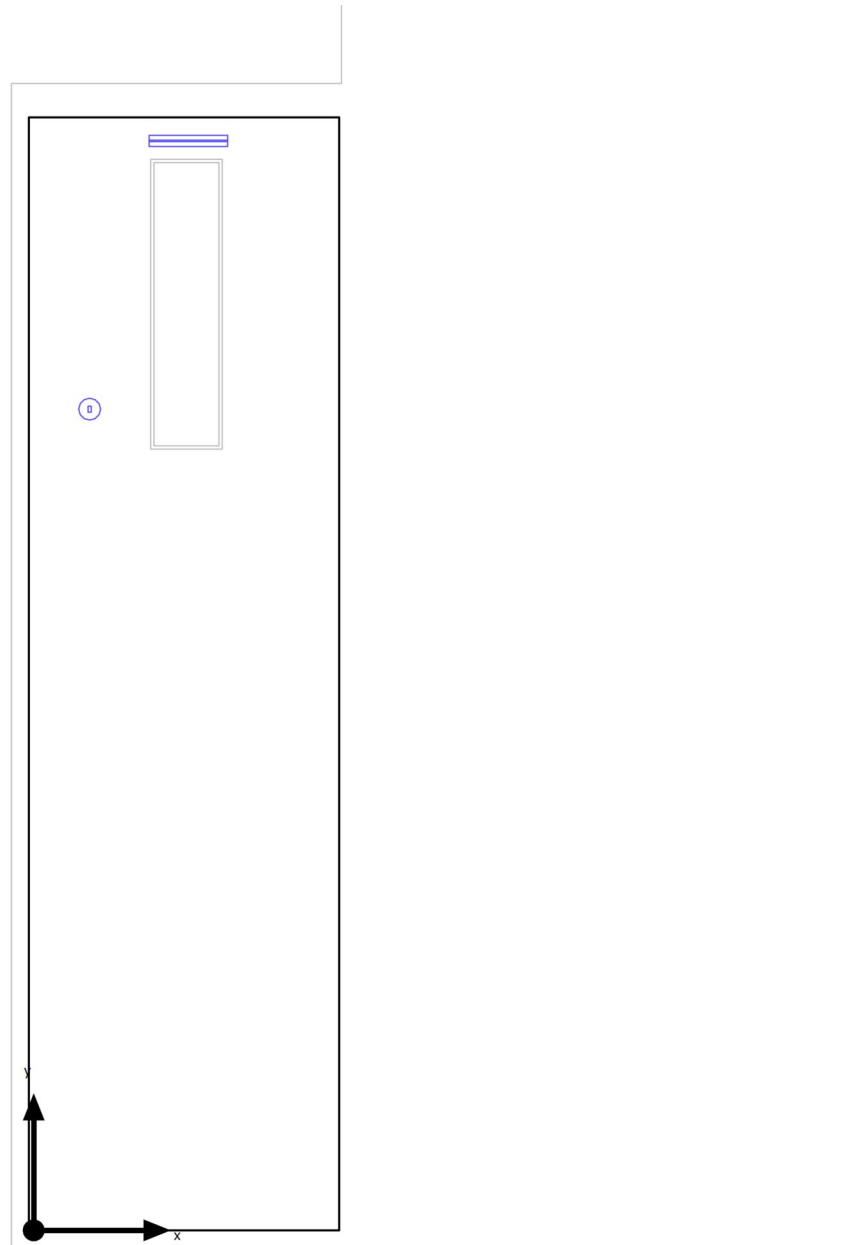

Building A · GROUND FLOOR · 101 STAIRS (Emergency light scene)


Calculation objects

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Calculation objects

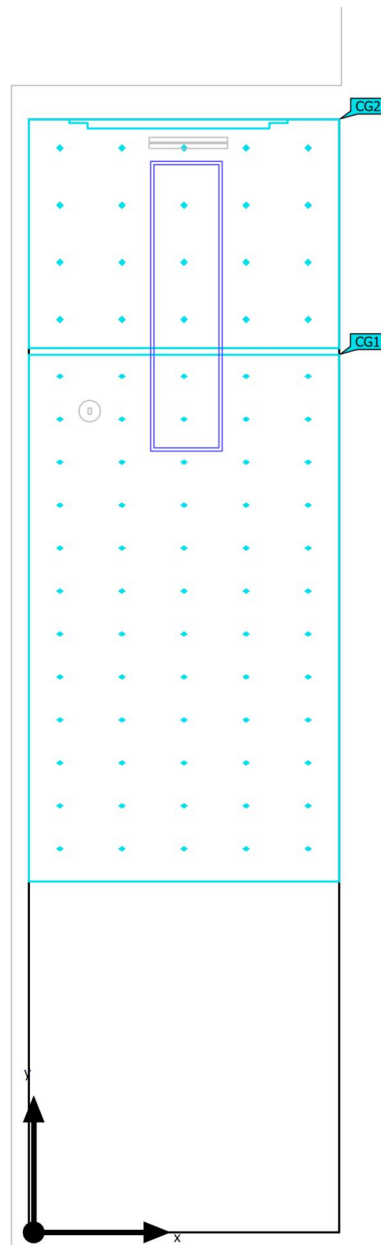

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	331 lx	57.6 lx	581 lx	0.17	0.099	CG1
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	350 lx	305 lx	381 lx	0.87	0.80	CG2


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 101 STAIRS (Emergency light scene)

101 Stairs



CG1

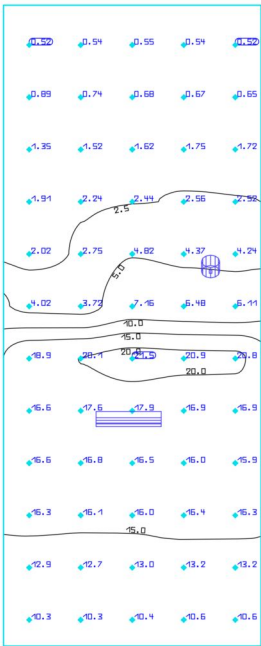


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	9.00 lx	0.52 lx	21.5 lx	0.058	0.024	CG1

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 101 STAIRS (Emergency light scene)

101 Stairs Lower

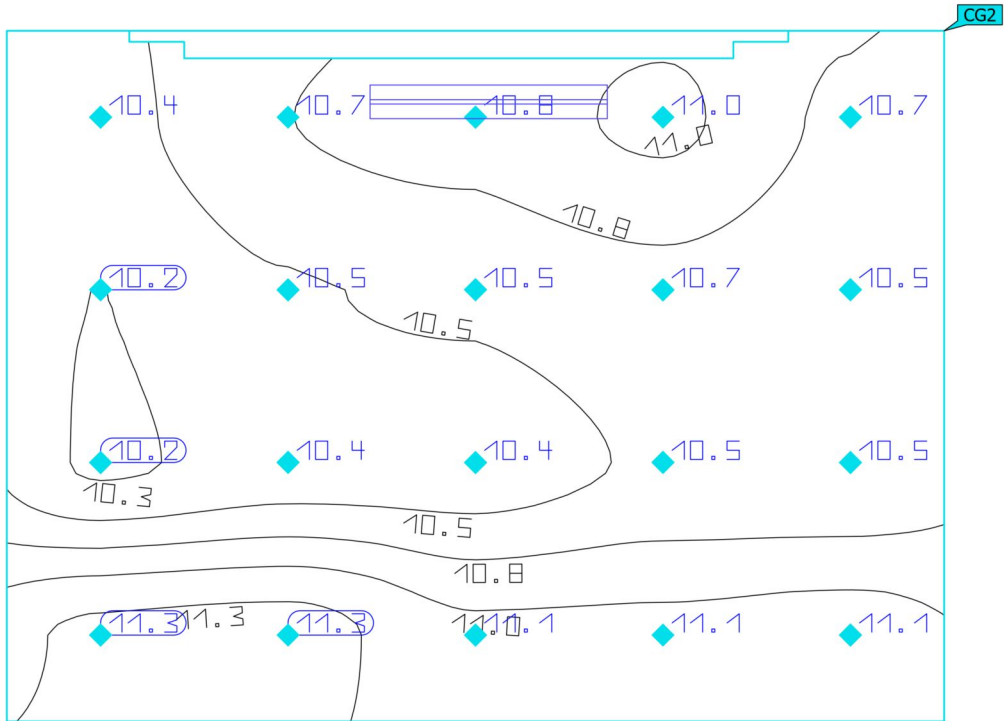

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	10.7 lx	10.2 lx	11.3 lx	0.95	0.90	CG2


Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

101 Stairs



CG1

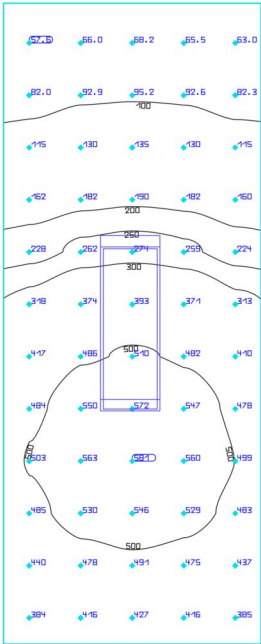


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Perpendicular illuminance Height: 1.700 m	331 lx	57.6 lx	581 lx	0.17	0.099	CG1

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 101 STAIRS (Light scene 1)

101 Stairs Lower

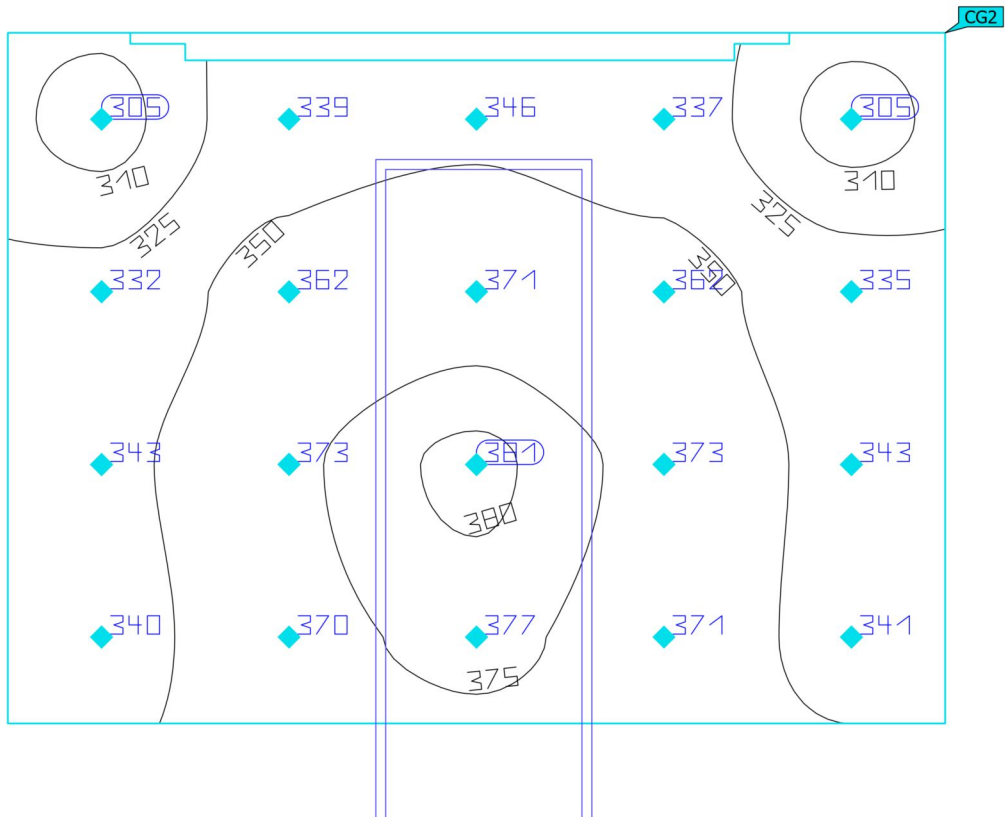


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
101 Stairs Lower Perpendicular illuminance Height: 0.000 m	350 lx	305 lx	381 lx	0.87	0.80	CG2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Emergency light scene)

Summary

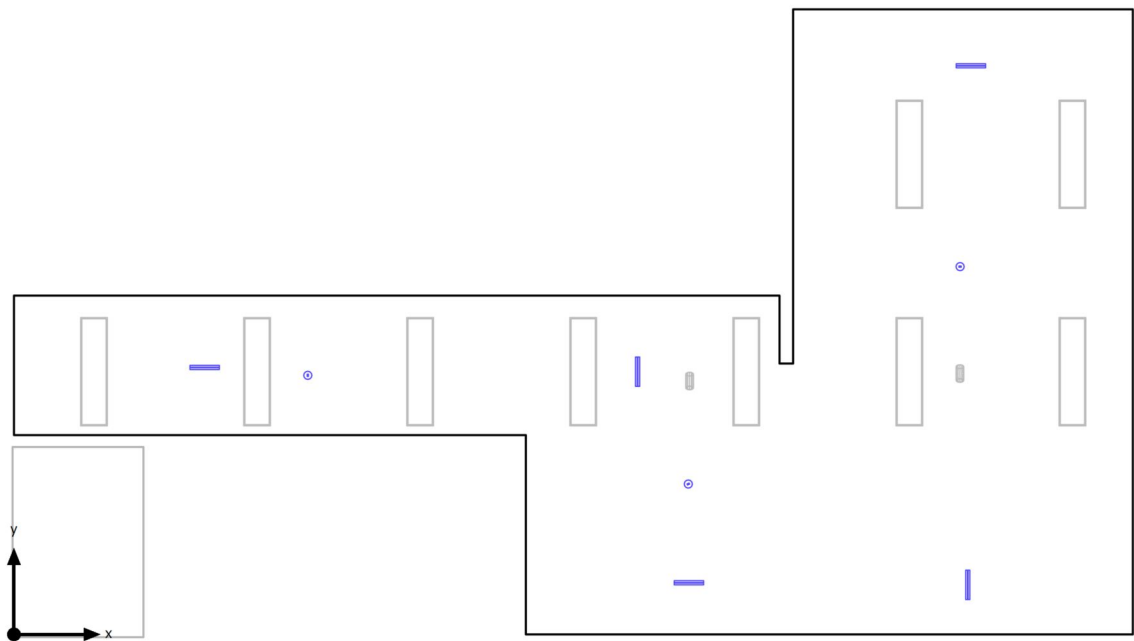

Ground area	45.50 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.758 m – 2.768 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.33 W/m ²	–		

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
3	ETAP	-	K9R212/3-AX1-D800A25 (_LTRRevAB)		0.9 W	280 lm (100 %)	–
5	ETAP	-	K9R243/1-AX1 (_LTRRevAB)		2.5 W	80 lm (100 %)	–

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Summary

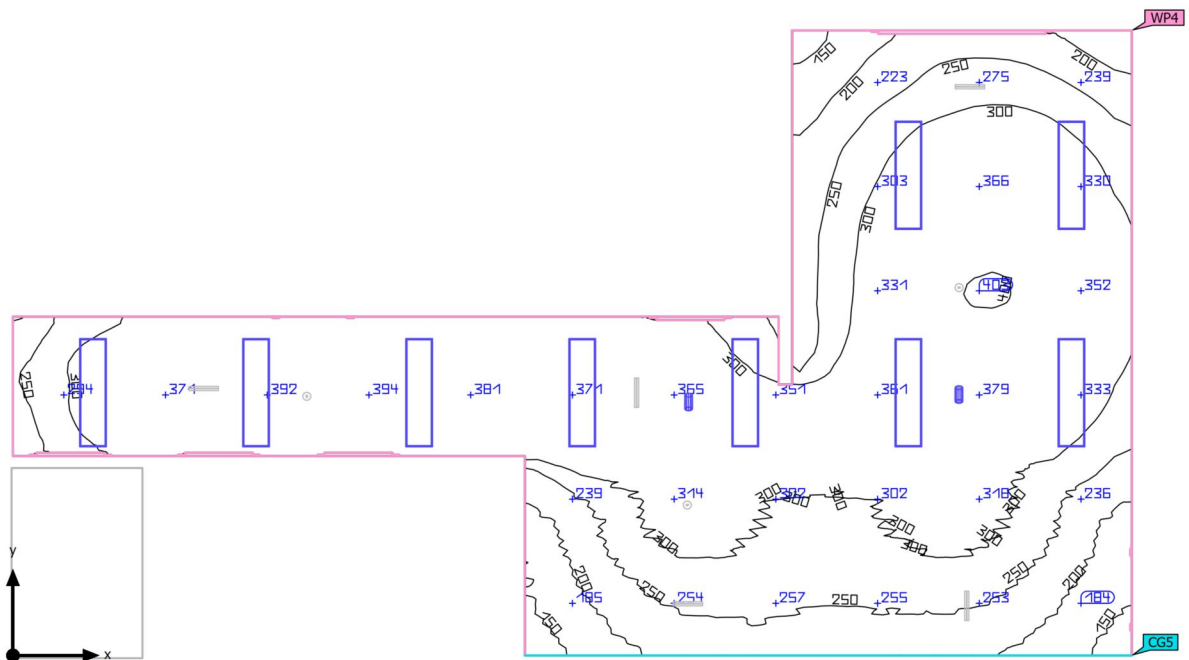

Ground area	45.50 m²	Clearance height	2.700 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.600 m – 2.776 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.000 m
		Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	305 lx	$\geq 500 \text{ lx}$	✗	WP4
	$U_o (g_1)$	0.42	≥ 0.60	✗	WP4
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	433 kWh/a	max. 1600 kWh/a	✓	
Space	Lighting power density	3.85 W/m ²	–		
		1.26 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.900 m x 12.350 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
9	ETAP	-	U2B-M110-MI-840-025D (_LTRevAD)	16	17.0 W	2495 lm	146.7 lm/W
2	Lena Lighting	284380	EXPO OPTIMA track 1700lm 60D biały mat struktura 935 11W	21	11.0 W	1700 lm	154.5 lm/W

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY

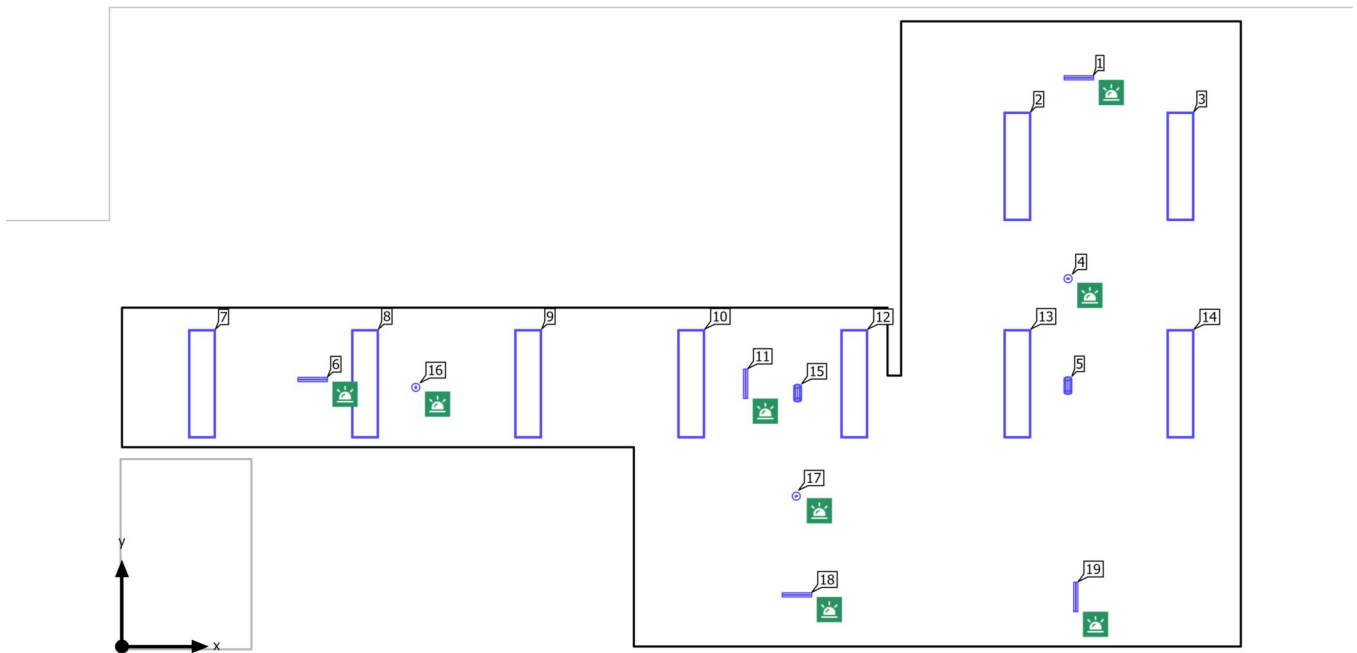Luminaire layout plan

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
10.443 m	4.060 m	2.768 m	4
3.243 m	2.860 m	2.768 m	16
7.443 m	1.660 m	2.768 m	17

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	2.5 W
Article name	K9R243/1-AX1 (_LTRevAB)	Φ _{Luminaire}	0 lm
Fitting	1x sign with picto	Φ _{Emergency lighting}	80 lm
		ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
10.562 m	6.277 m	2.758 m	1
2.105 m	2.947 m	2.758 m	6
6.883 m	2.900 m	2.758 m	11
7.450 m	0.570 m	2.758 m	18
10.528 m	0.547 m	2.758 m	19

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY


Luminaire layout plan

Manufacturer	ETAP	P	17.0 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M110-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
9.883 m	5.300 m	2.776 m	2
11.683 m	5.300 m	2.776 m	3
0.883 m	2.900 m	2.776 m	7
2.683 m	2.900 m	2.776 m	8
4.483 m	2.900 m	2.776 m	9
6.283 m	2.900 m	2.776 m	10
8.083 m	2.900 m	2.776 m	12
9.883 m	2.900 m	2.776 m	13
11.683 m	2.900 m	2.776 m	14

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY

Luminaire layout plan

Manufacturer	Lena Lighting	P	11.0 W
Article No.	284380	Φ _{Luminaire}	1700 lm
Article name	EXPO OPTIMA track 1700lm 60D bia ³ y mat struktura 935 11W		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
10.441 m	2.955 m	2.600 m	5
7.457 m	2.873 m	2.600 m	15

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY


Luminaire list

Φ_{total} 25900 lm	P_{total} 175.0 W	Luminous efficacy 148.0 lm/W	$\Phi_{\text{Emergency lighting}}$ 1240 lm	$P_{\text{Emergency lighting}}$ 15.2 W
-----------------------------------	-------------------------------	---------------------------------	---	---

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
3	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)		0.9 W	280 lm (100 %)	-
5	ETAP	-	K9R243/1-AX1 (_LTRevAB)		2.5 W	80 lm (100 %)	-
9	ETAP	-	U2B-M110-MI-840-025D (_LTRevAD)		17.0 W	2495 lm	146.7 lm/W
2	Lena Lighting	284380	EXPO OPTIMA track 1700lm 60D biały mat struktura 935 11W		11.0 W	1700 lm	154.5 lm/W

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Emergency light scene)

Calculation objects

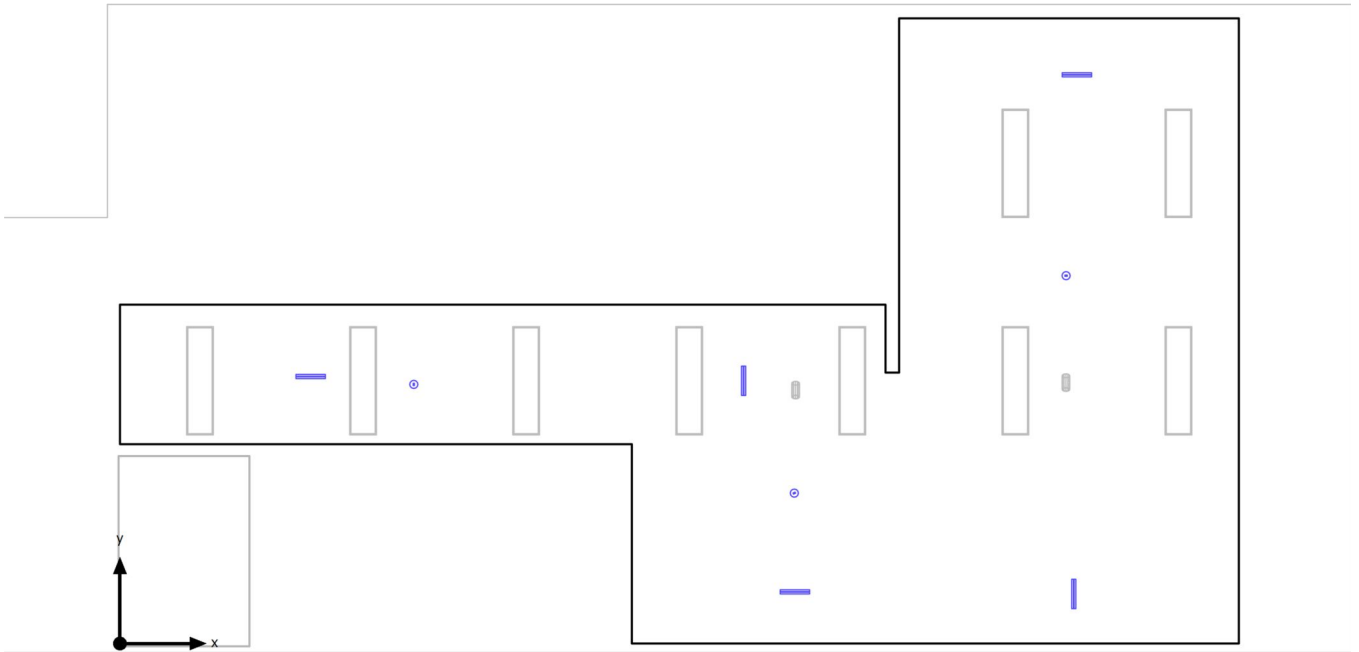

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Emergency light scene)


Calculation objects

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Calculation objects

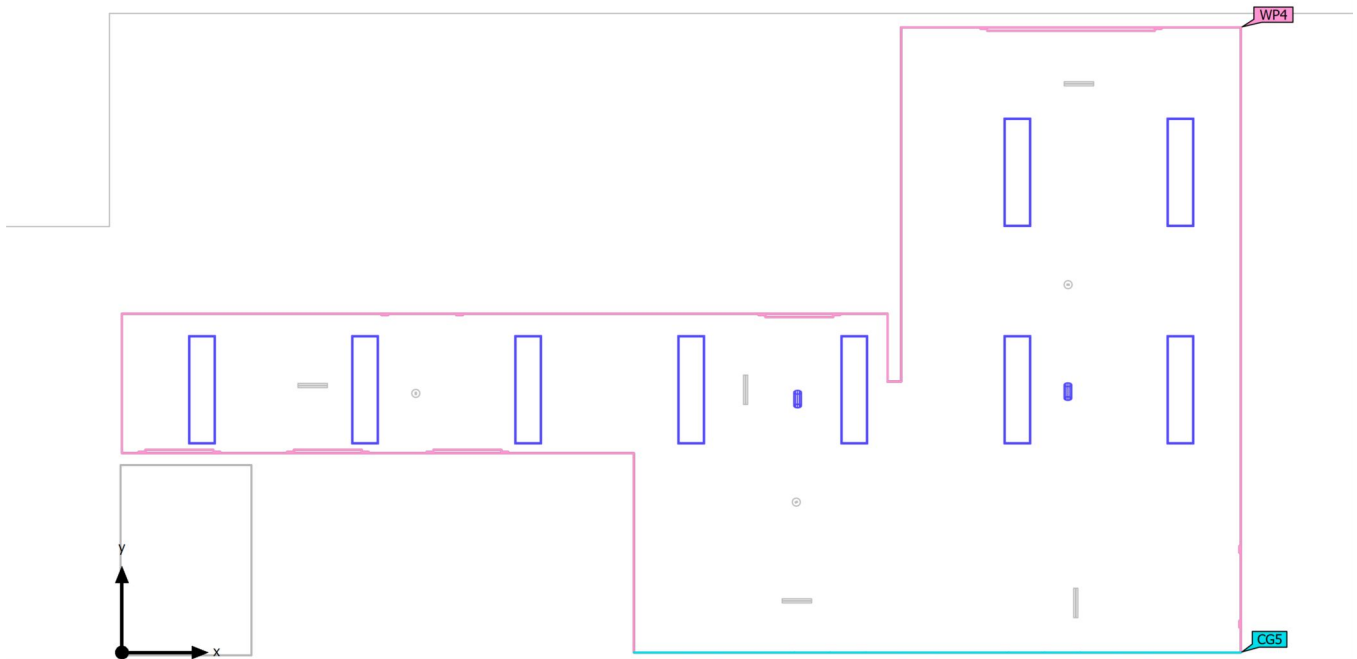

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (102 CORRIDOR / LOBBY) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	305 lx (≥ 500 lx) ✗	128 lx	404 lx	0.42 (≥ 0.60) ✗	0.32	WP4



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
Art Wall Perpendicular illuminance Height: 1.350 m	199 lx	53.9 lx	280 lx	0.27	0.19	CG5
Art Wall Horizontal illuminance Height: 1.350 m	90.3 lx	16.3 lx	166 lx	0.18	0.098	CG5

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Emergency light scene)

Art Wall

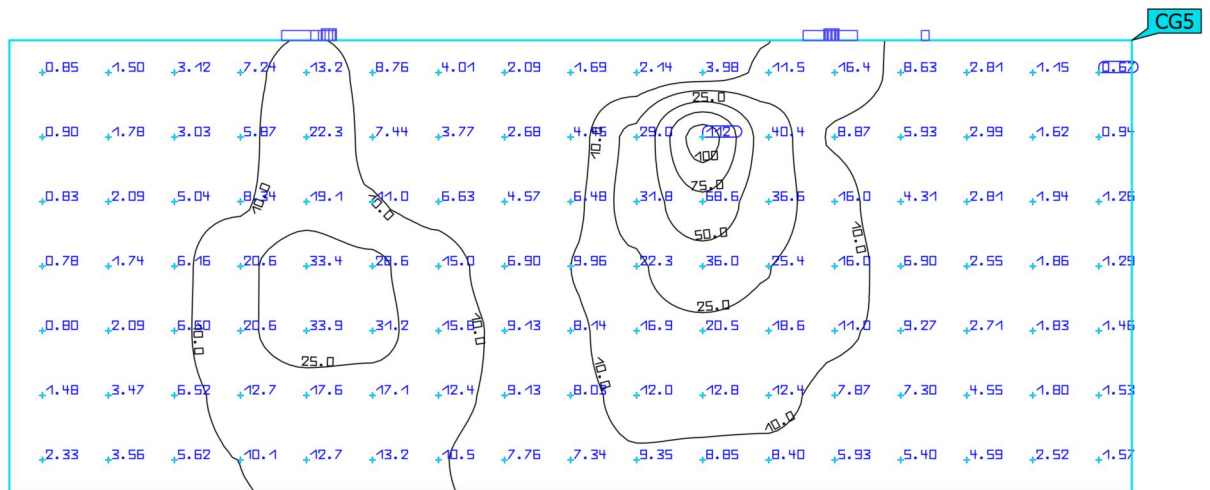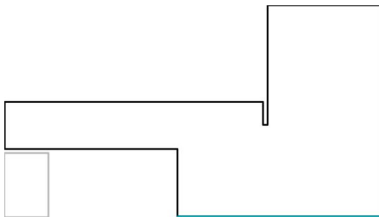



Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
Art Wall	10.8 lx	0.67 lx	112 lx	0.062	0.006	CG5
Perpendicular illuminance						
Height: 1.350 m						

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Emergency light scene)

Art Wall

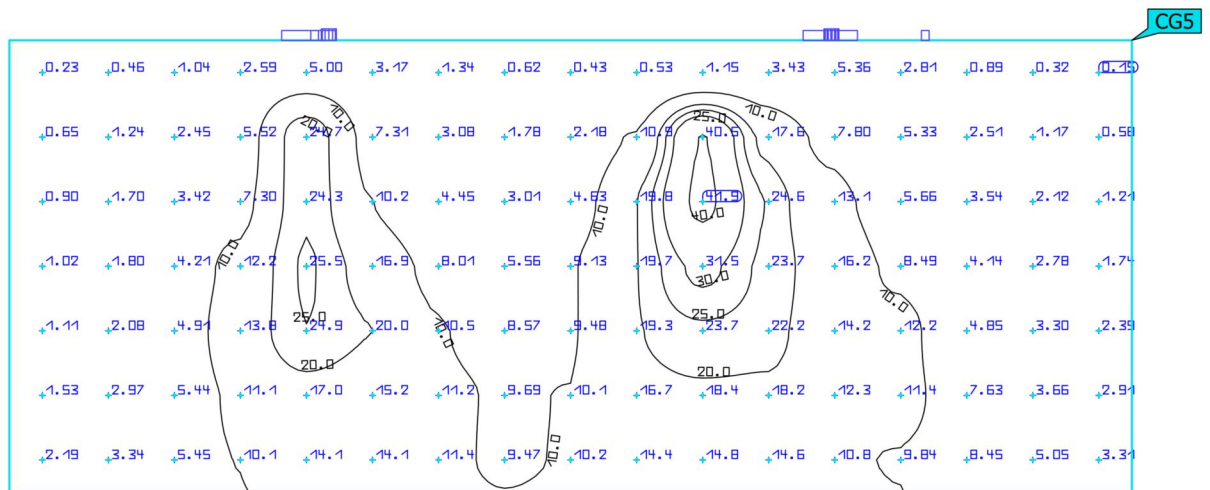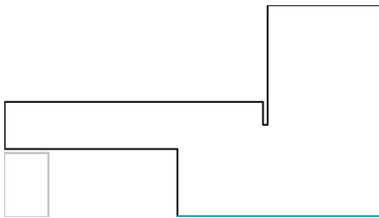


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
Art Wall	8.94 lx	0.15 lx	41.9 lx	0.017	0.004	CG5
Horizontal illuminance						
Height: 1.350 m						

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

Working plane (102 CORRIDOR / LOBBY)


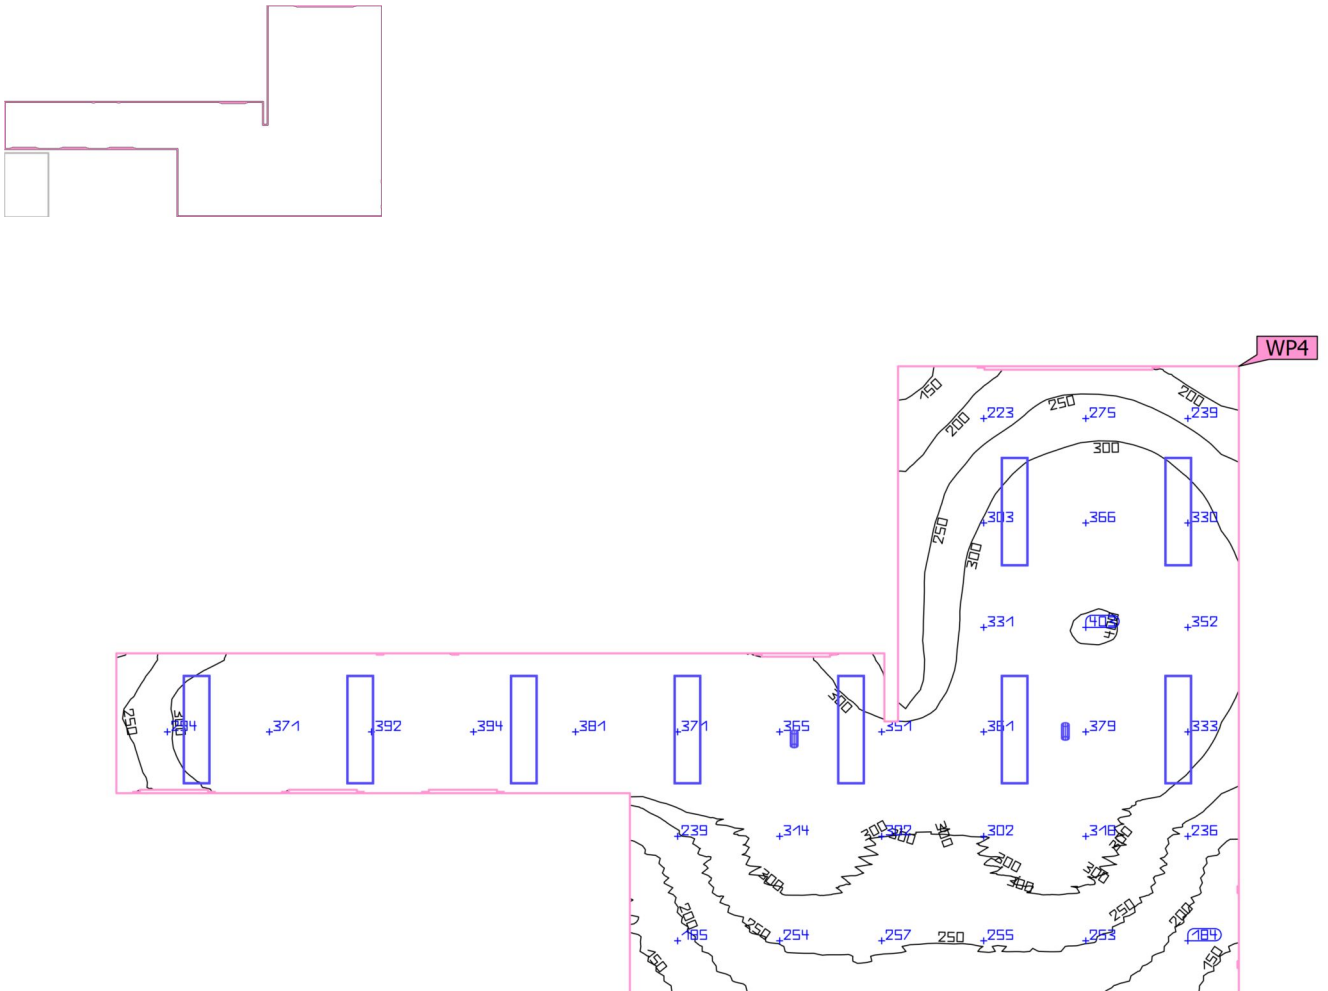


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (102 CORRIDOR / LOBBY)	305 lx	128 lx	404 lx	0.42	0.32	WP4
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.000 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)



Art Wall

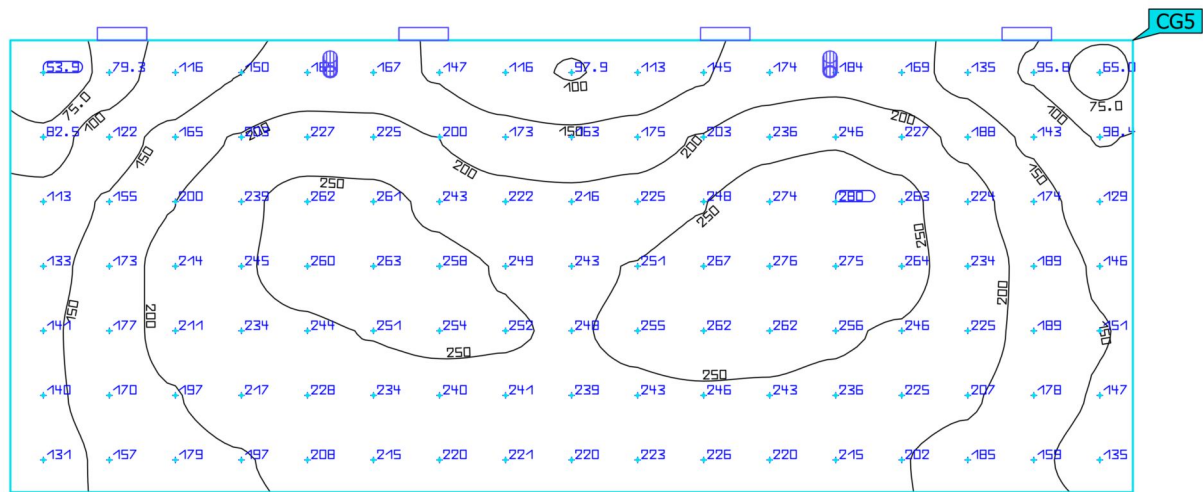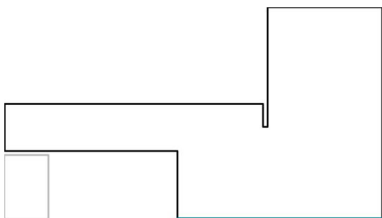

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
Art Wall Perpendicular illuminance Height: 1.350 m	199 lx	53.9 lx	280 lx	0.27	0.19	CG5

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 102 CORRIDOR / LOBBY (Light scene 1)

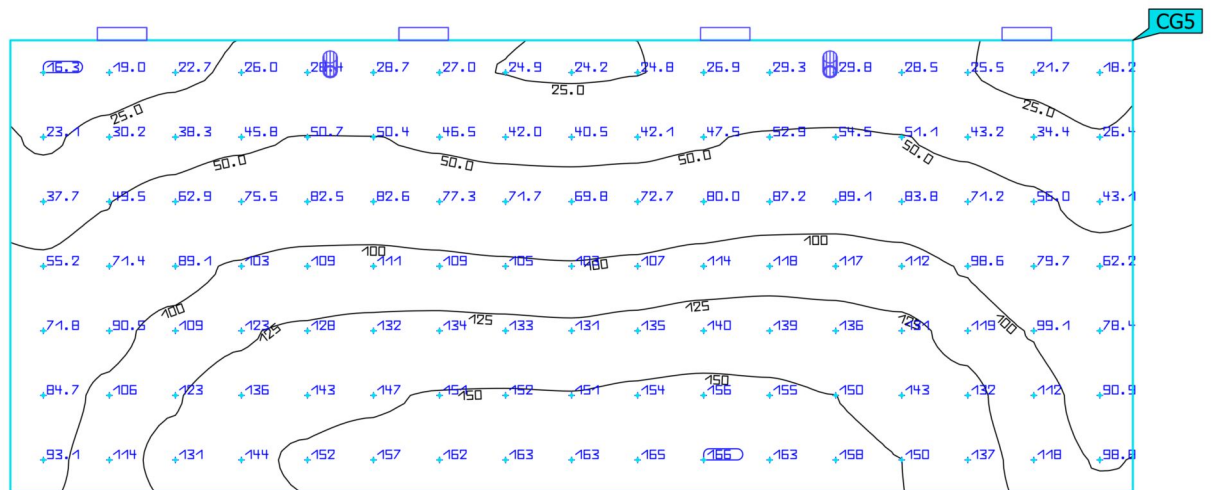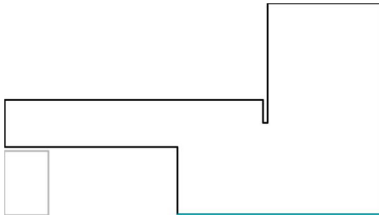
Art Wall

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
Art Wall	90.3 lx	16.3 lx	166 lx	0.18	0.098	CG5
Horizontal illuminance						
Height: 1.350 m						

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Summary

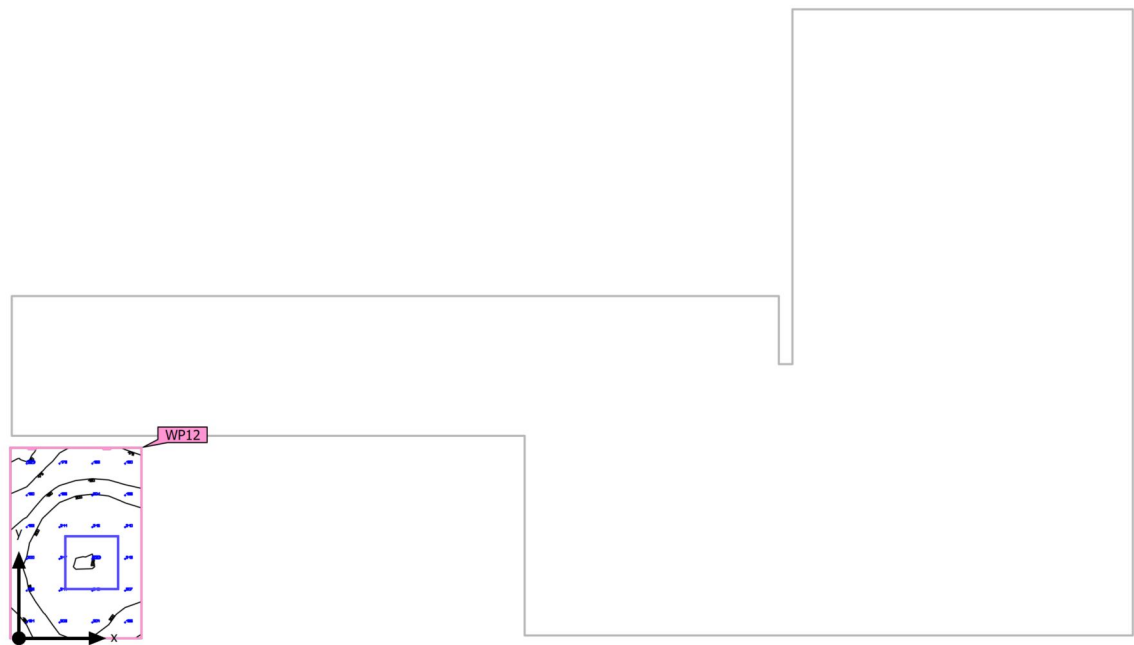

Ground area	3.03 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	199 lx	$\geq 500 \text{ lx}$	✗	WP12
	$U_o (g_1)$	0.78	≥ 0.60	✓	WP12
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	14	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	40.8 kWh/a	max. 150 kWh/a	✓	
Space	Lighting power density	5.44 W/m ²	–		
		2.73 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.100 m x 1.445 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	14	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 103 TOILET

Luminaire layout plan

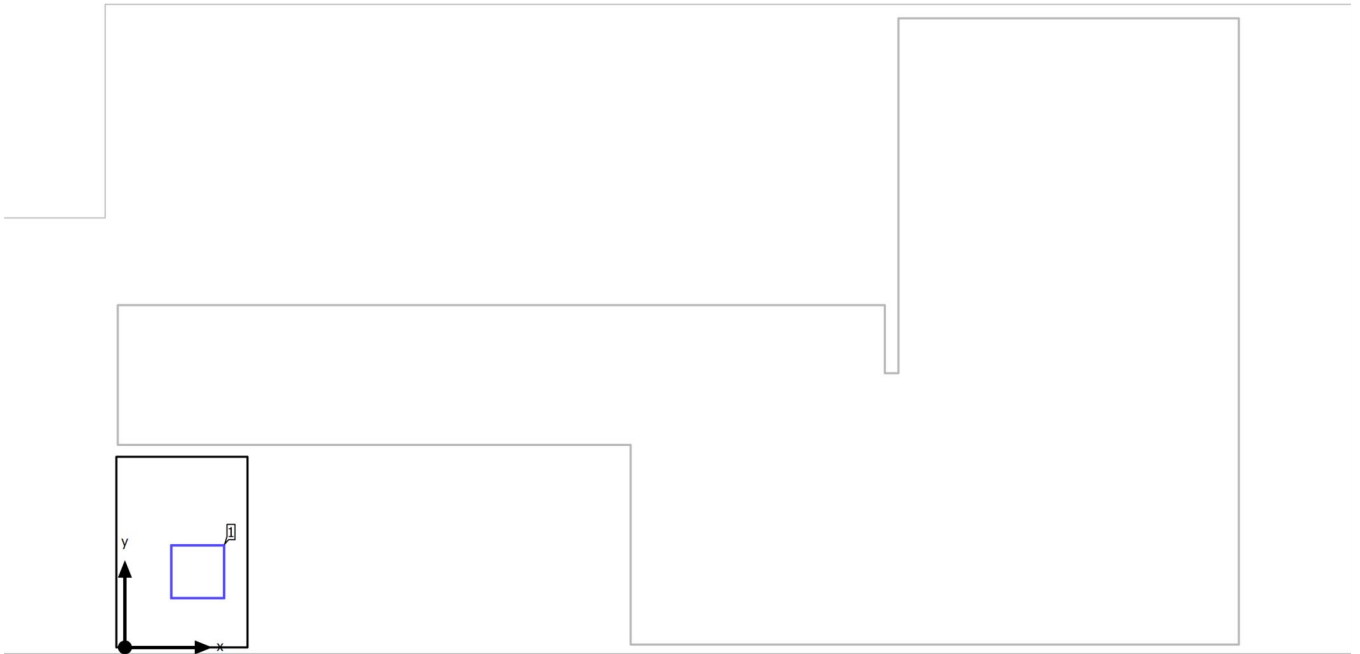

Building A · GROUND FLOOR · 103 TOILET

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.802 m	0.833 m	2.776 m	1

Building A · GROUND FLOOR · 103 TOILET


Luminaire list

Φ_{total} 2500 lm	P_{total} 16.5 W	Luminous efficacy 151.5 lm/W
----------------------------------	------------------------------	---------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	U2B-M210-MI-840-025D (LTRRevAD)	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Calculation objects

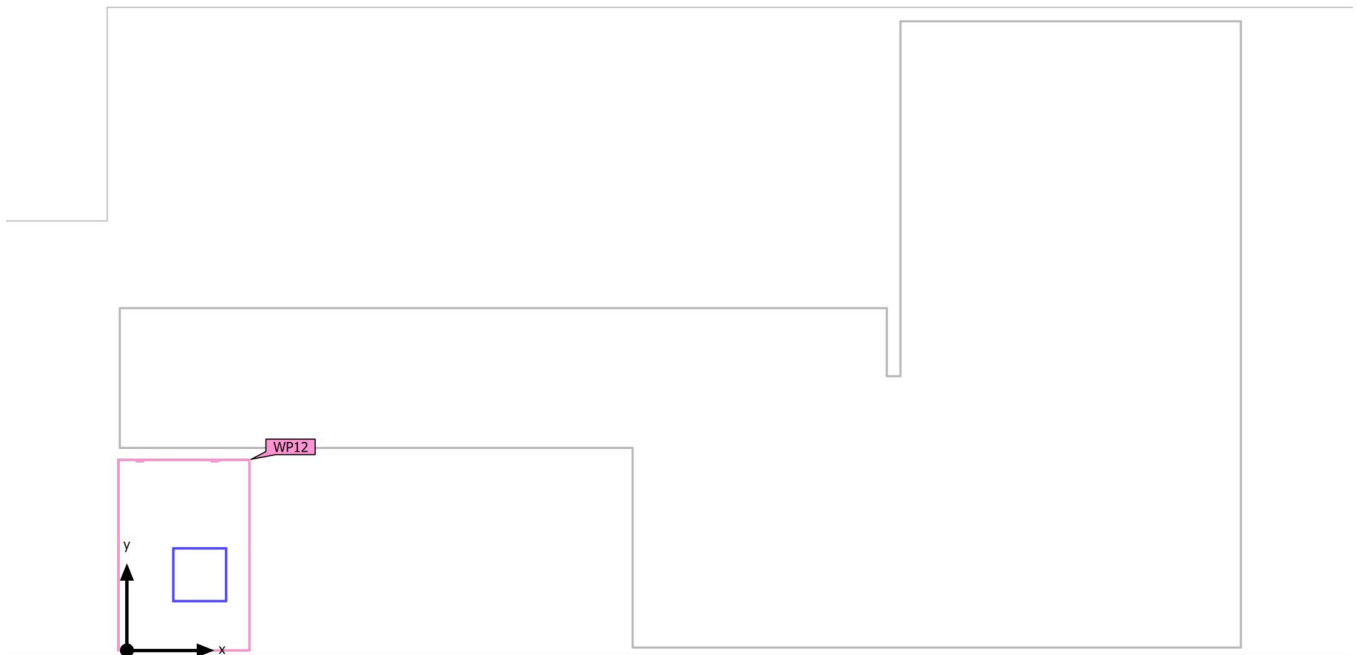

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (103 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	199 lx (≥ 500 lx) ✗	156 lx	221 lx	0.78 (≥ 0.60) ✓	0.71	WP12

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 103 TOILET (Light scene 1)

Working plane (103 TOILET)

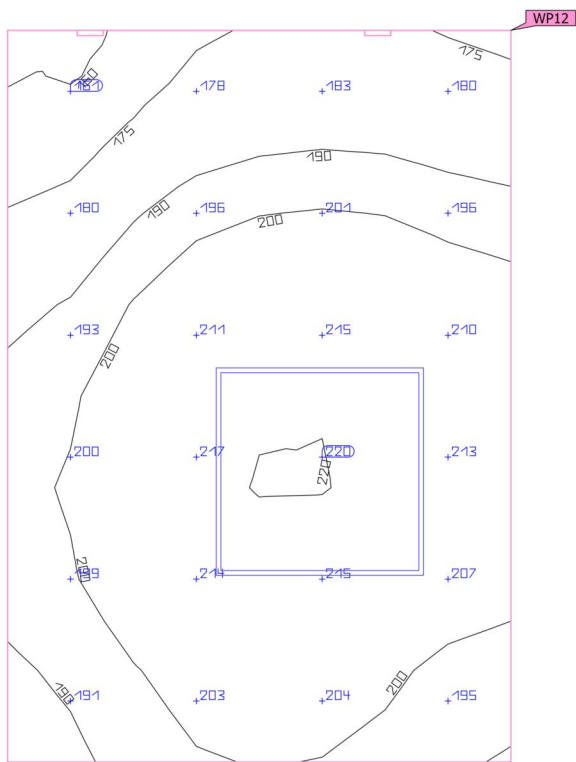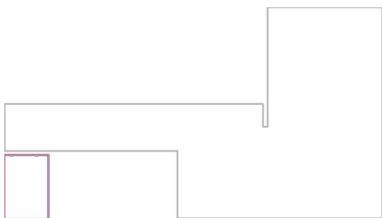


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (103 TOILET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	199 lx (≥ 500 lx) ✗	156 lx	221 lx	0.78 (≥ 0.60) ✓	0.71	WP12

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)

Summary

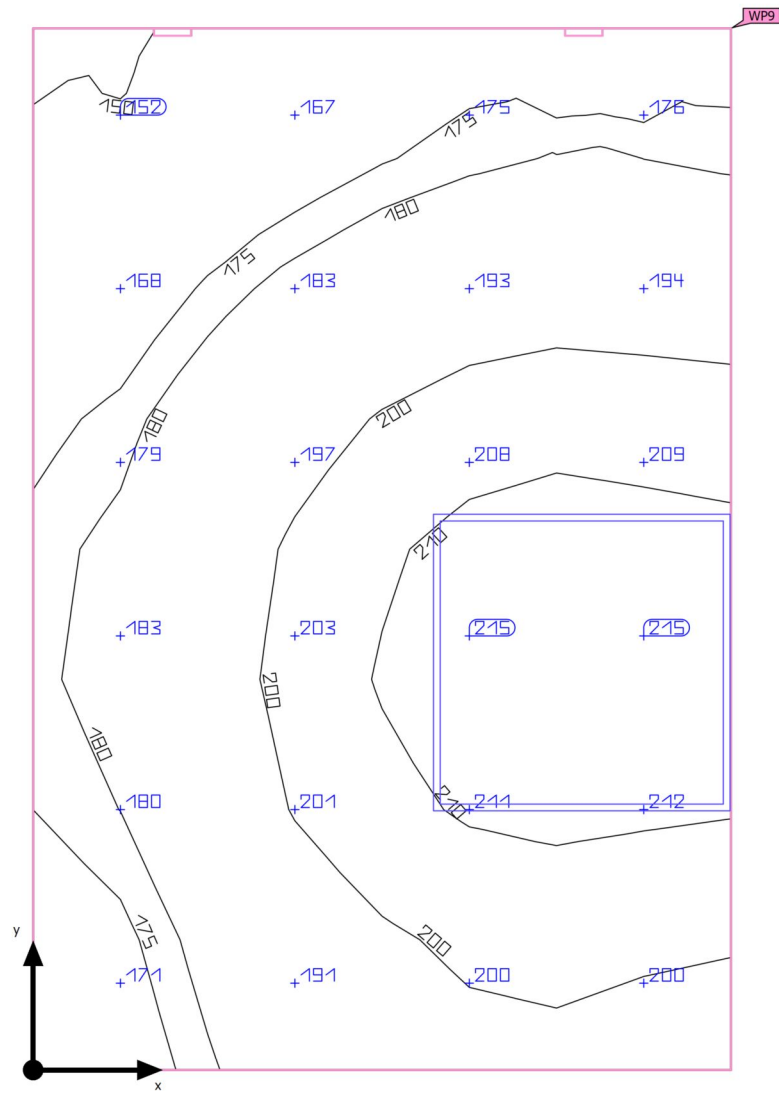

Ground area	2.93 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	191 lx	$\geq 500 \text{ lx}$	✗	WP9
	$U_o (g_1)$	0.77	≥ 0.60	✓	WP9
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	14	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	40.8 kWh/a	max. 150 kWh/a	✓	
Space	Lighting power density	5.64 W/m ²	–		
		2.96 W/m ² /100 lx	–		

(1) Based on a rectangular space of 1.400 m x 2.090 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	14	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 104 TOLIET

Luminaire layout plan

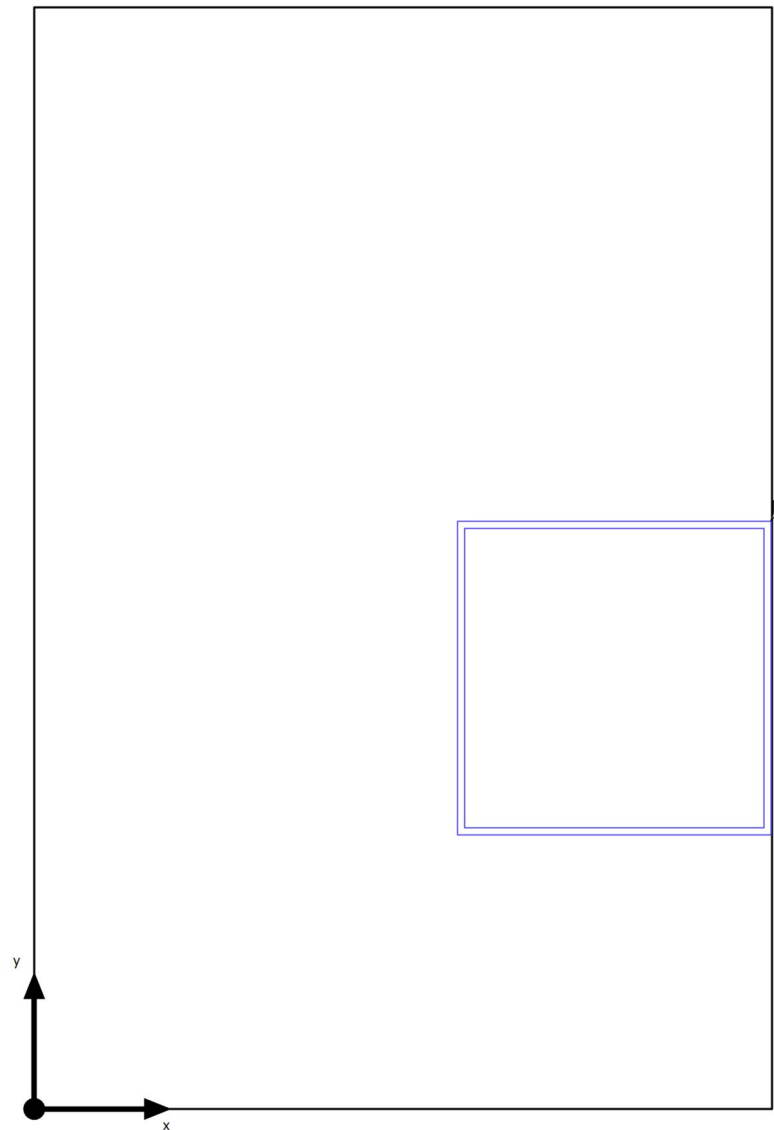

Building A · GROUND FLOOR · 104 TOLIET

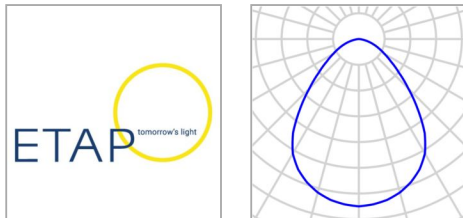Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
1.101 m	0.817 m	2.776 m	1

Building A · GROUND FLOOR · 104 TOLIET


Luminaire list

Φ_{total} 2500 lm	P_{total} 16.5 W	Luminous efficacy 151.5 lm/W
----------------------------------	------------------------------	---------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	U2B-M210-MI-840-025D (LTRRevAD)	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)

Calculation objects

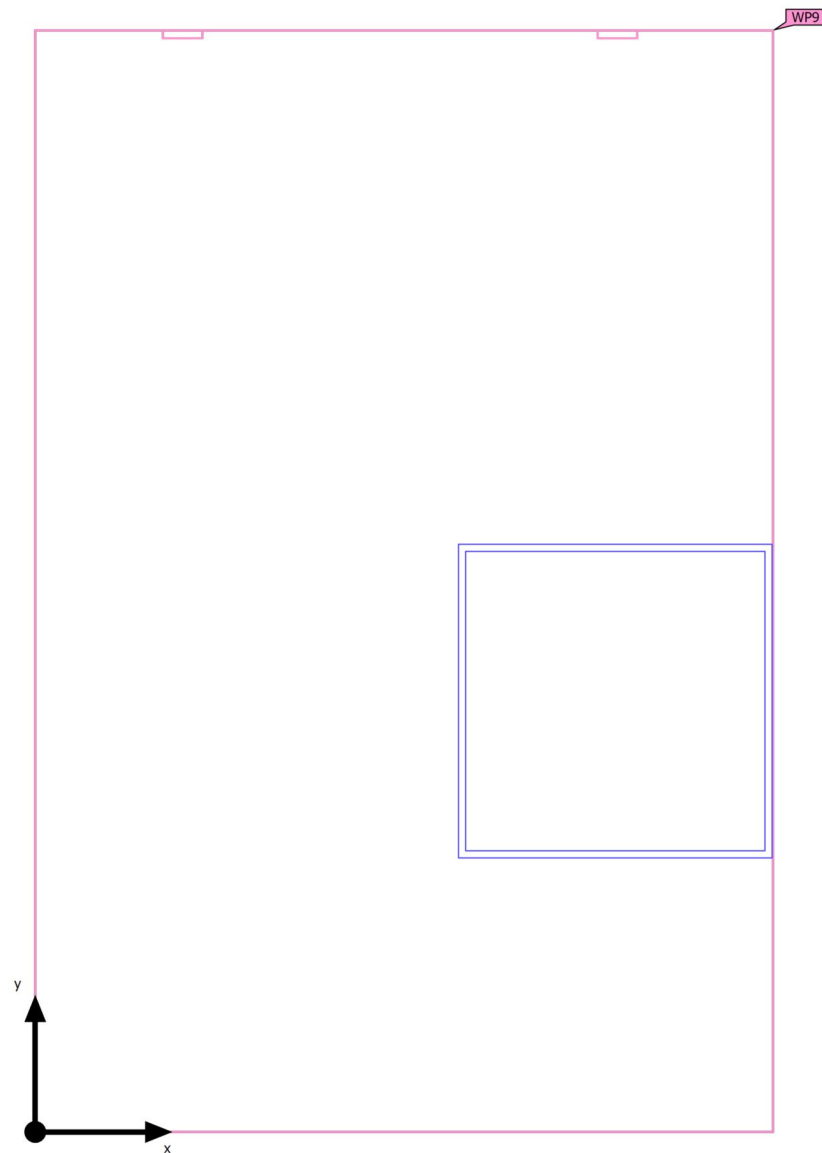

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (104 TOLIET)	191 lx	147 lx	216 lx	0.77	0.68	WP9
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.000 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 104 TOLIET (Light scene 1)
Working plane (104 TOLIET)

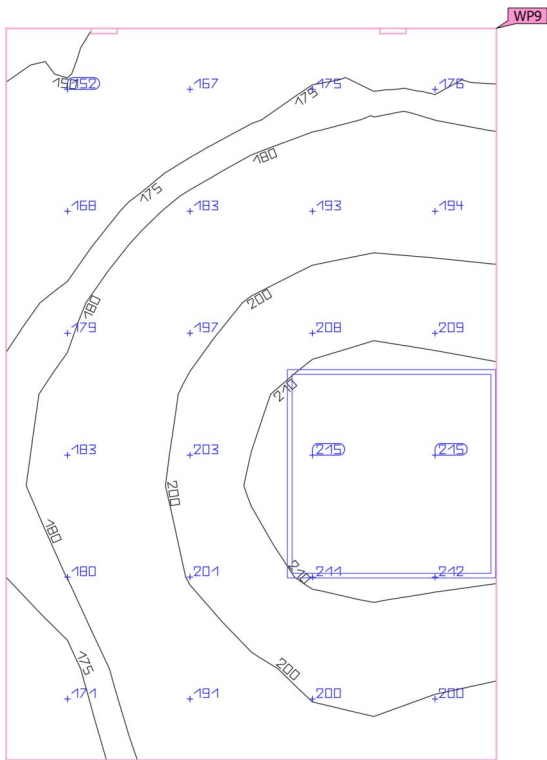


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (104 TOLIET) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	191 lx (≥ 500 lx) ✗	147 lx	216 lx	0.77 (≥ 0.60) ✓	0.68	WP9

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 105 TOILET DISABLE (Emergency light scene)

Summary

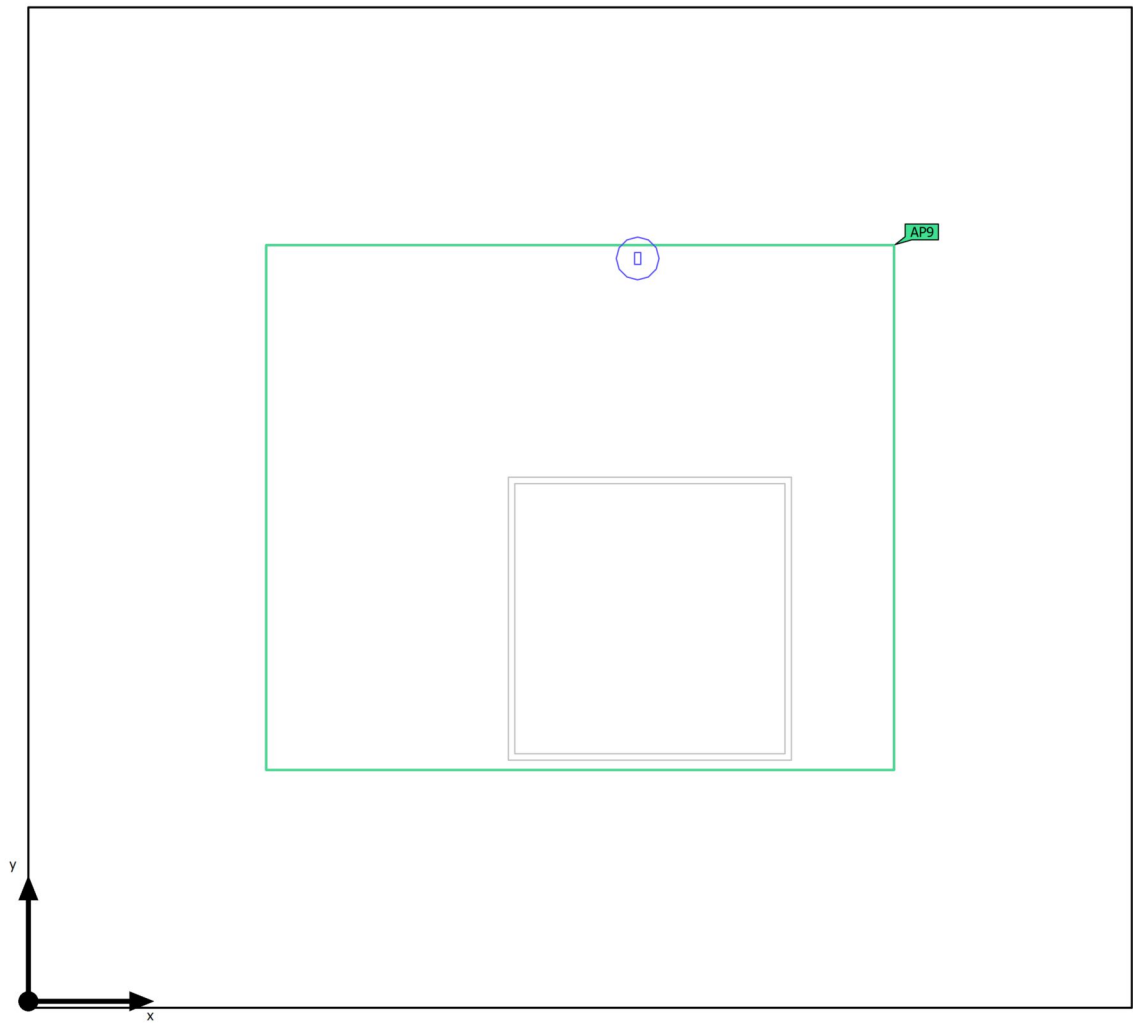

Ground area	4.88 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 105 TOILET DISABLE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.18 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m	4.94 lx (≥ 0.50 lx) ✓	9.71 lx	0.51 (≥ 0.025) ✓	AP9

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Summary

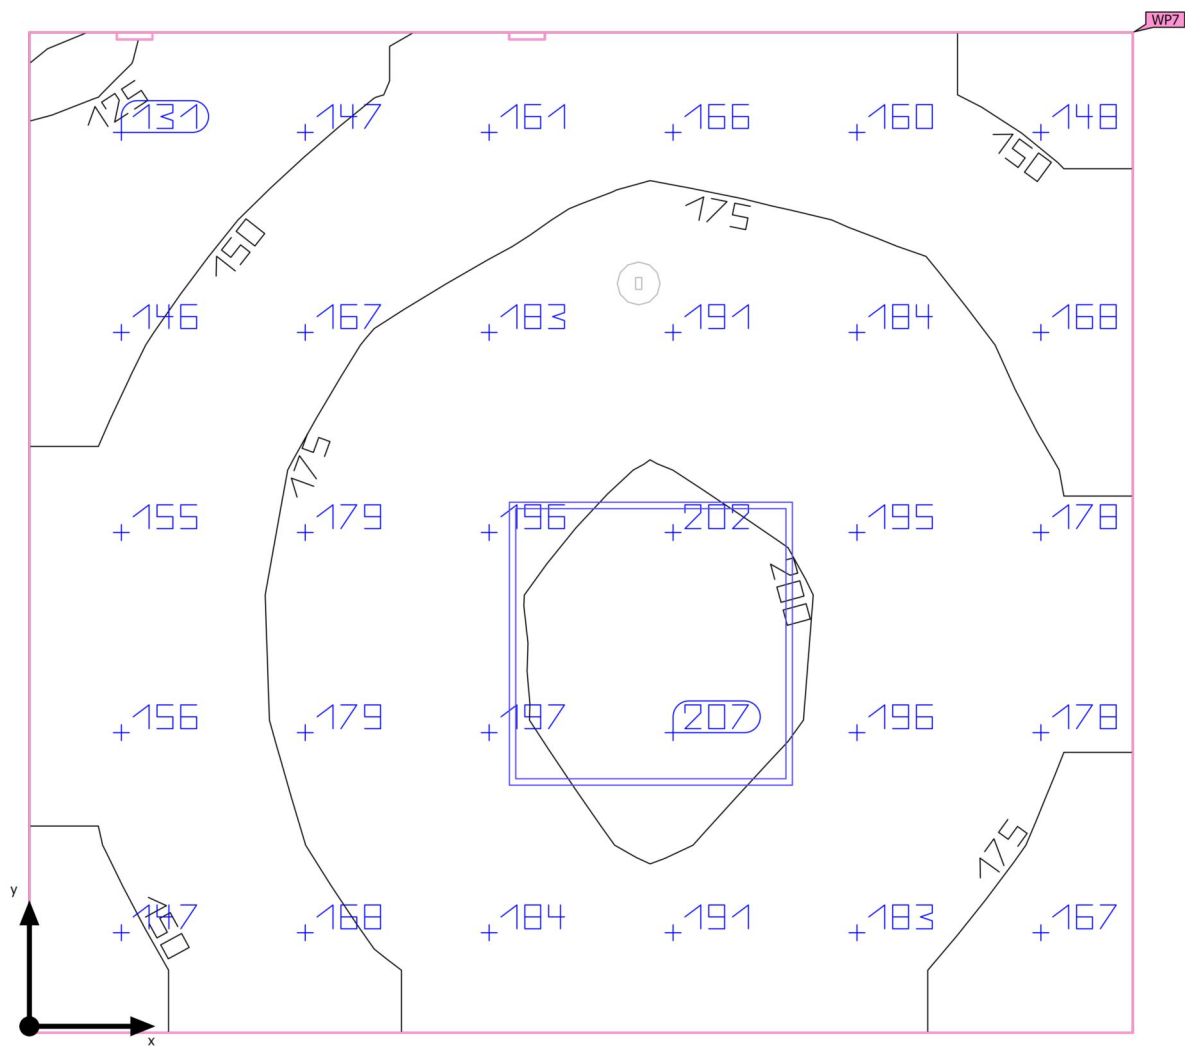

Ground area	4.88 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.000 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	174 lx	$\geq 500 \text{ lx}$	✗	WP7
	$U_o (g_1)$	0.68	≥ 0.60	✓	WP7
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	14	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	40.8 kWh/a	max. 200 kWh/a	✓	
Space	Lighting power density	3.38 W/m ²	–		
		1.94 W/m ² /100 lx	–		

(1) Based on a rectangular space of 2.320 m x 2.104 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
1	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	14	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 105 TOILET DISABLE

Luminaire layout plan

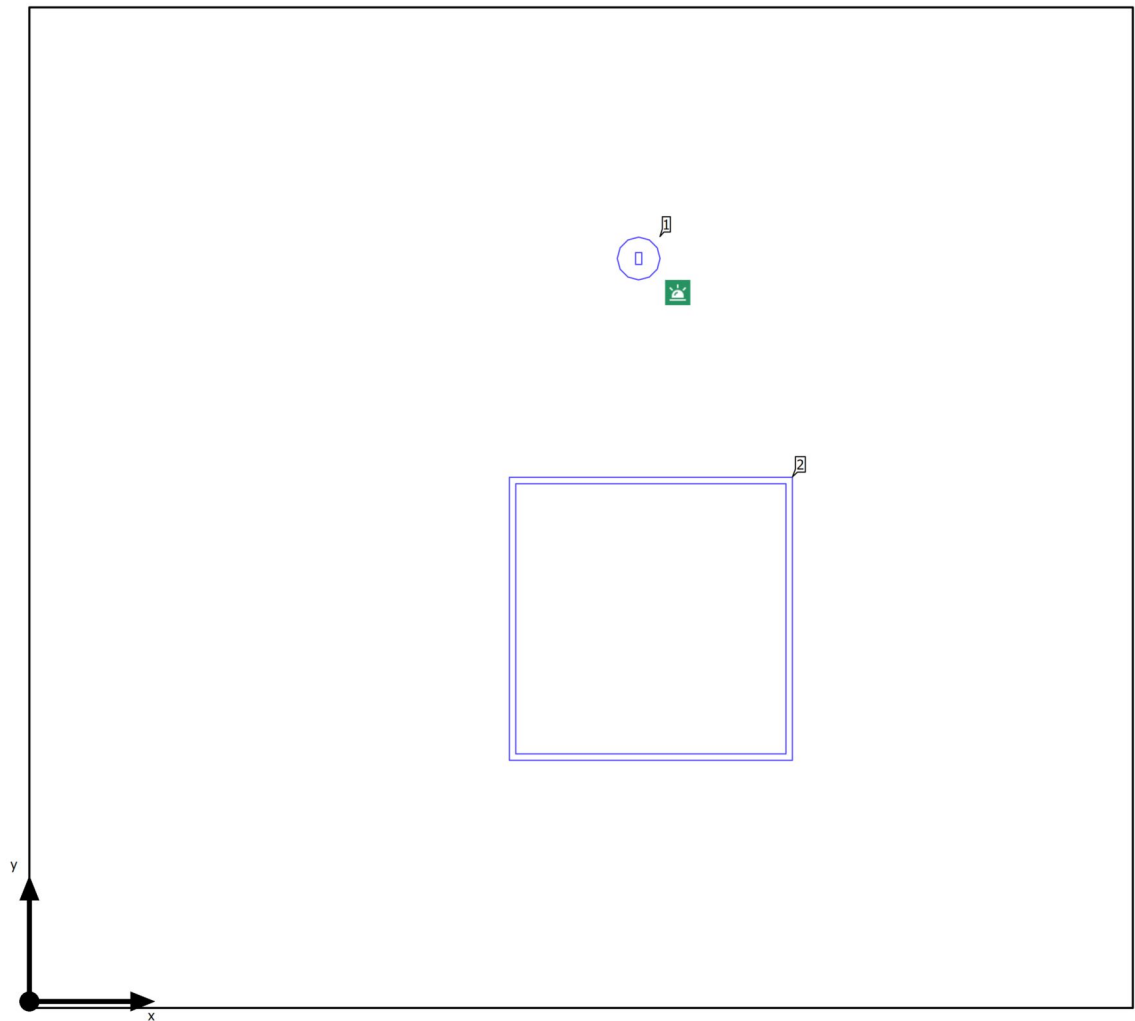

Building A · GROUND FLOOR · 105 TOILET DISABLE


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
1.281 m	1.562 m	2.768 m	1

Building A · GROUND FLOOR · 105 TOILET DISABLE

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
1.307 m	0.804 m	2.776 m	2

Building A · GROUND FLOOR · 105 TOILET DISABLE


Luminaire list

Φ_{total} 2500 lm	P_{total} 16.5 W	Luminous efficacy 151.5 lm/W	$\Phi_{\text{Emergency lighting}}$ 280 lm	$P_{\text{Emergency lighting}}$ 0.9 W
----------------------------------	------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)		0.9 W	280 lm (100 %)	-
1	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)		16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 105 TOILET DISABLE (Emergency light scene)

Calculation objects

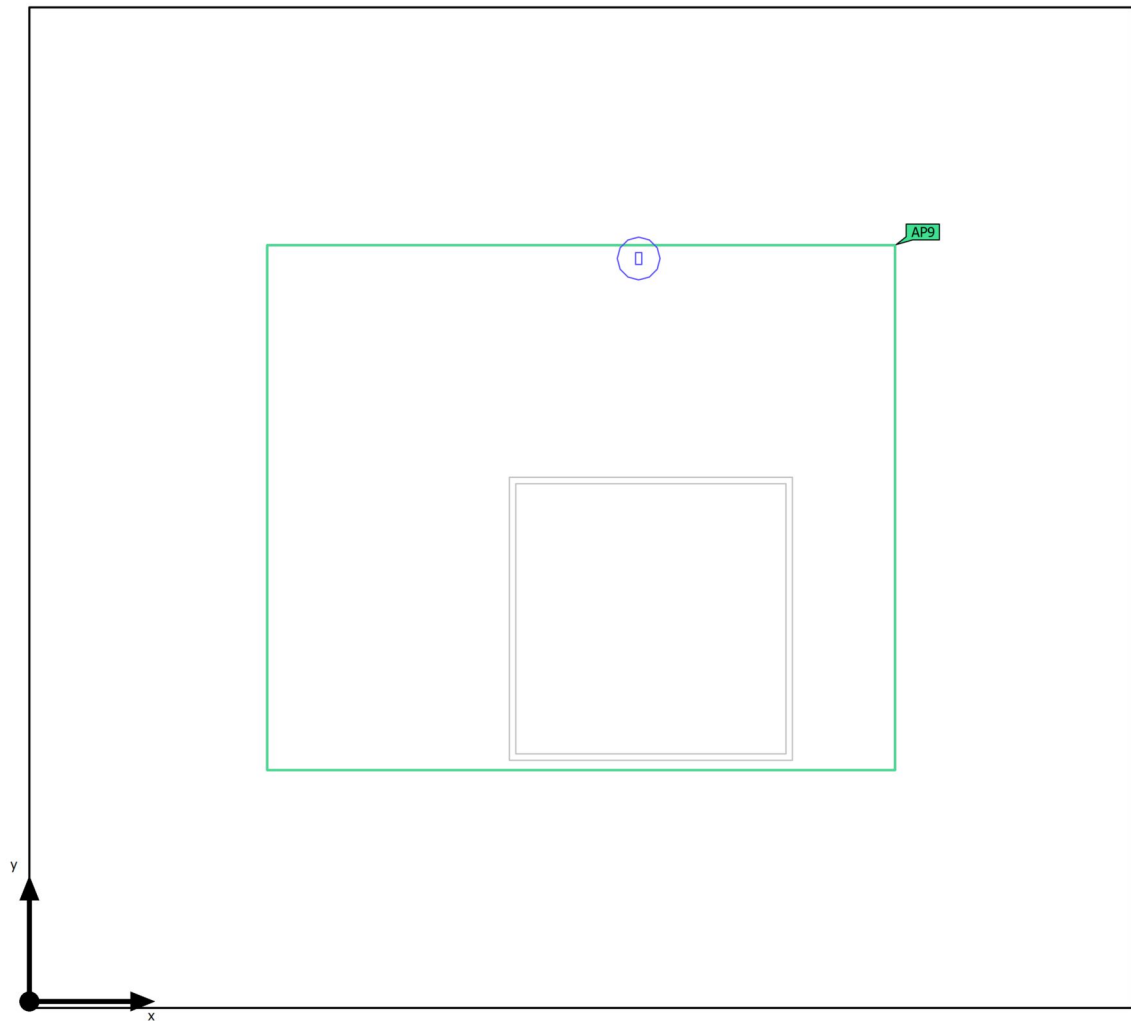

Building A · GROUND FLOOR · 105 TOILET DISABLE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m	4.94 lx (≥ 0.50 lx) ✓	9.71 lx	0.51 (≥ 0.025) ✓	AP9

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Calculation objects

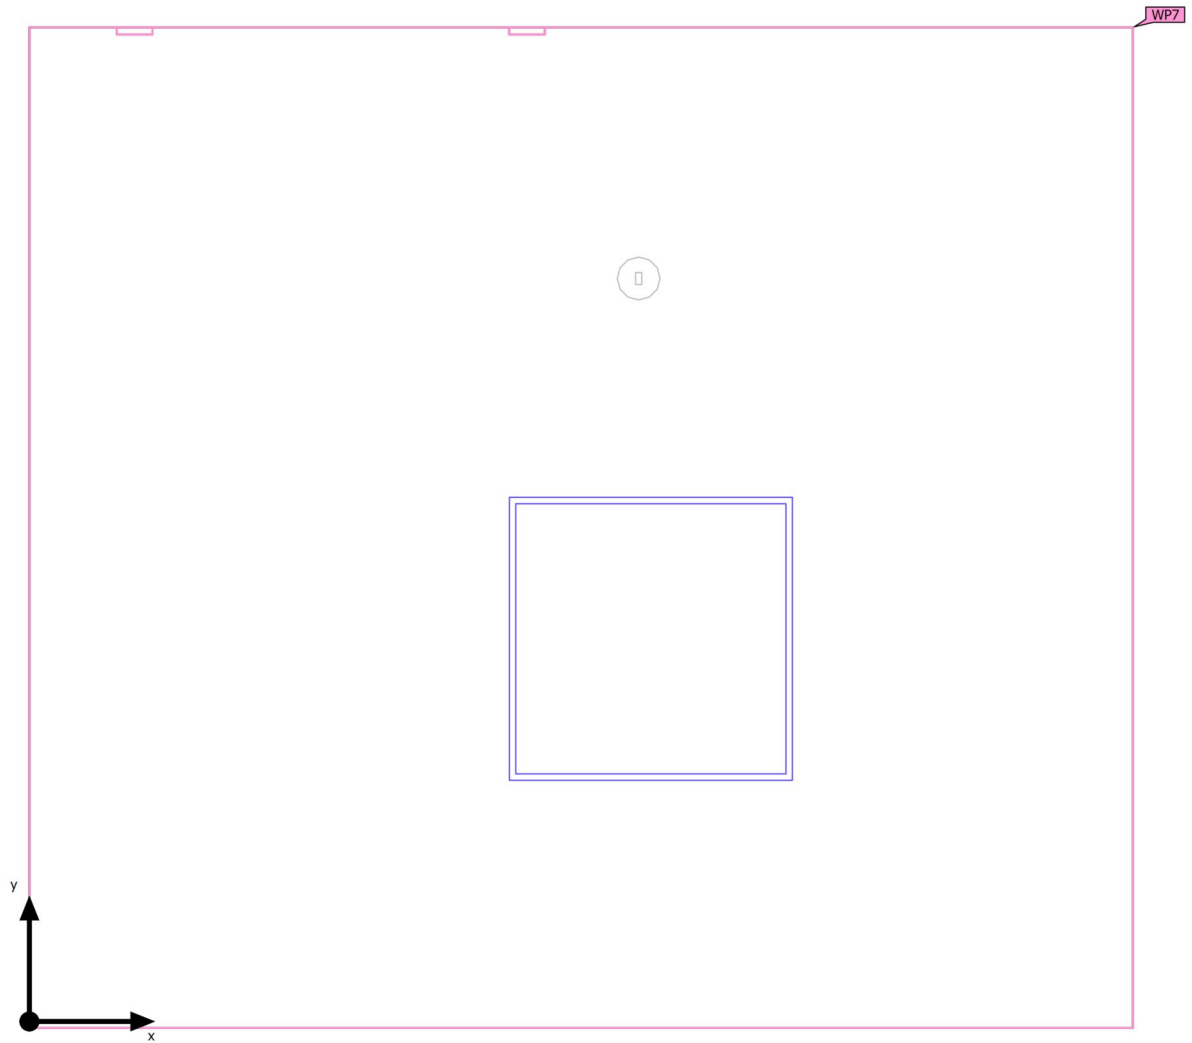

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	174 lx (≥ 500 lx) ✗	119 lx	205 lx	0.68 (≥ 0.60) ✓	0.58	WP7

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 105 TOILET DISABLE (Emergency light scene)
Anti panic surface (105 TOILET DISABLE)

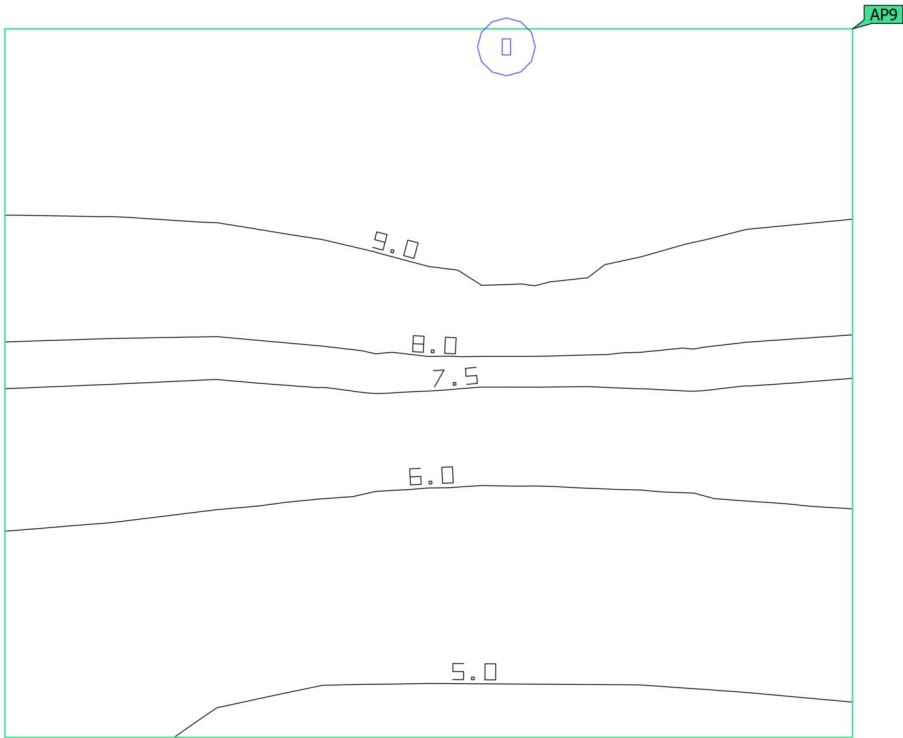



Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m	4.94 lx (≥ 0.50 lx) ✓	9.71 lx	0.51 (≥ 0.025) ✓	AP9

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 105 TOILET DISABLE (Light scene 1)

Working plane (105 TOILET DISABLE)

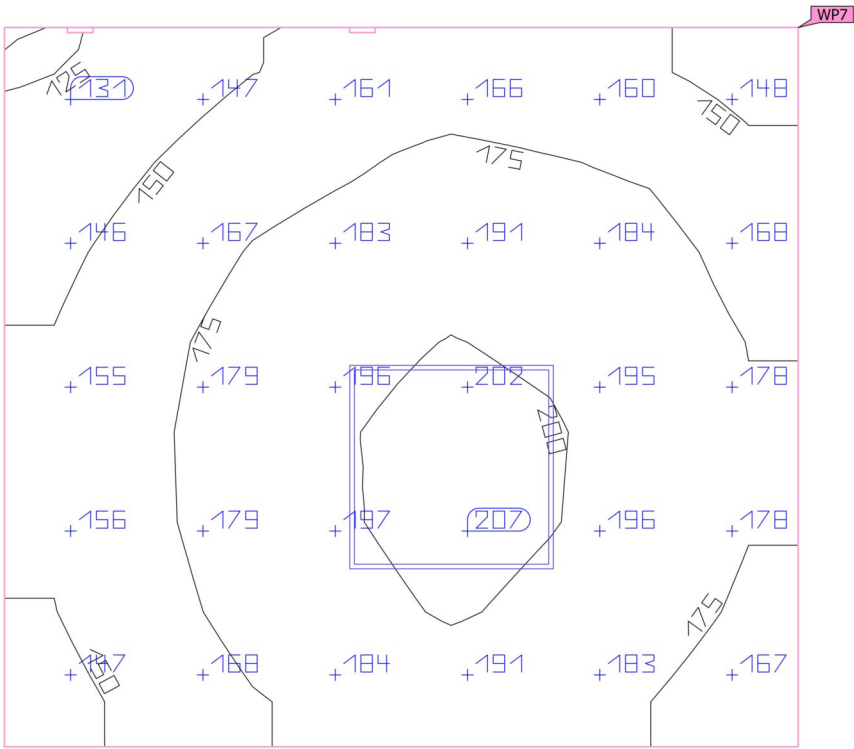


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (105 TOILET DISABLE) Perpendicular illuminance (adaptive) Height: 0.000 m, Wall zone: 0.000 m	174 lx (≥ 500 lx) ✗	119 lx	205 lx	0.68 (≥ 0.60) ✓	0.58	WP7

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 106 MEETING (Emergency light scene)

Summary

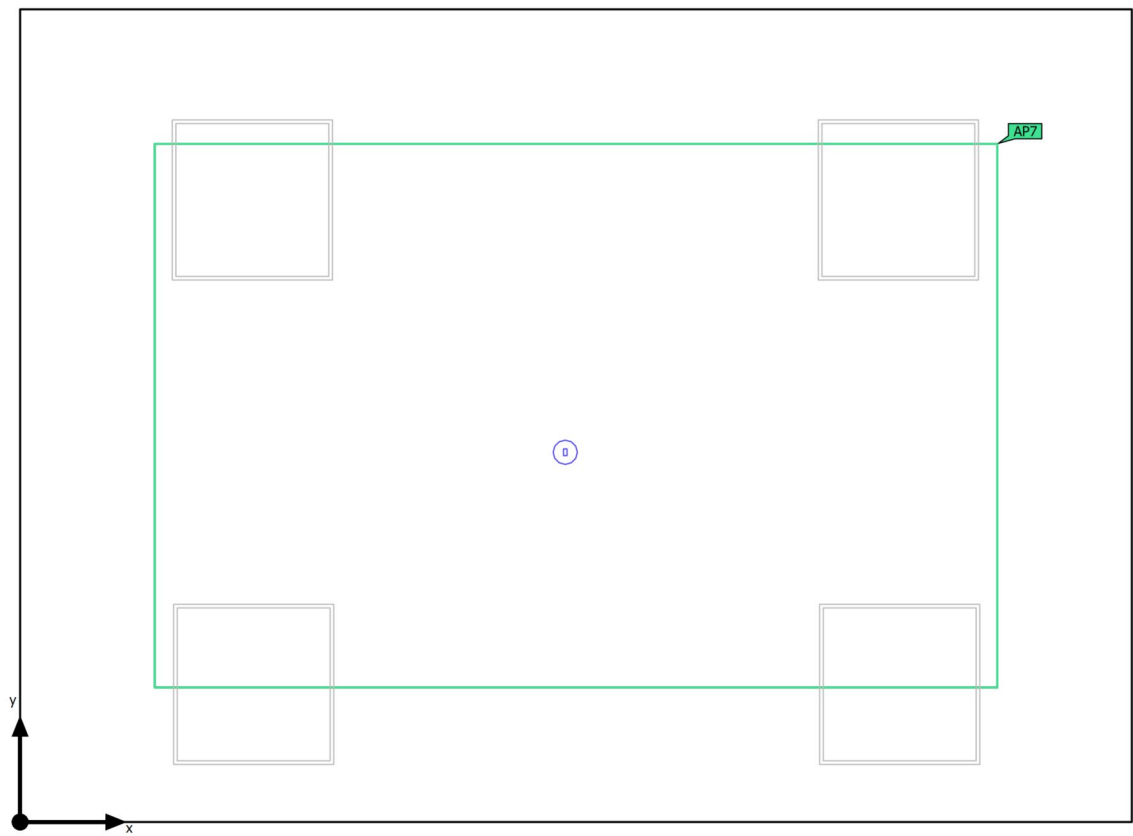

Ground area	12.47 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 106 MEETING (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.07 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.75 lx (≥ 0.50 lx) ✓	9.67 lx	0.49 (≥ 0.025) ✓	AP7

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Summary

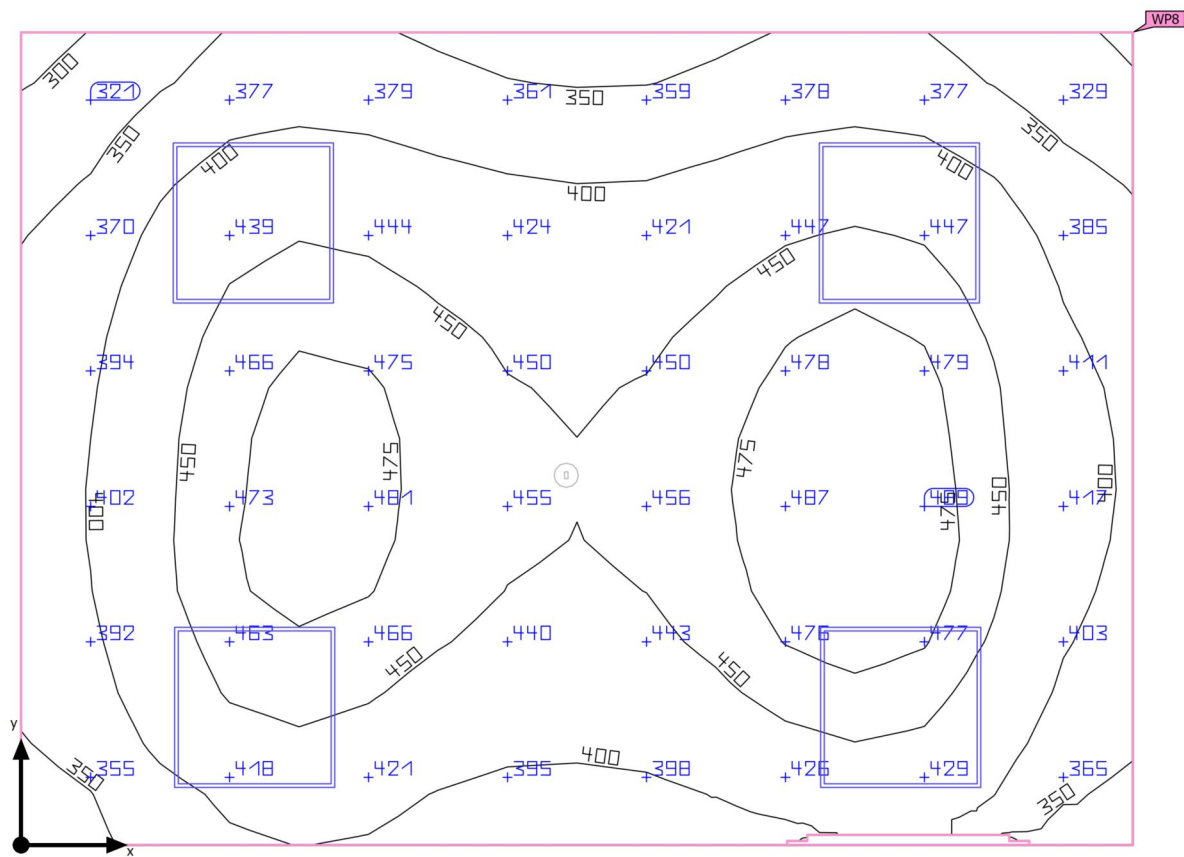

Ground area	12.47 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	422 lx	$\geq 500 \text{ lx}$	✗	WP8
	$U_o (g_1)$	0.68	≥ 0.60	✓	WP8
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[103 - 163] kWh/a	max. 450 kWh/a	✓	
Space	Lighting power density	5.29 W/m ²	–		
		1.25 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.130 m x 3.020 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 106 MEETING

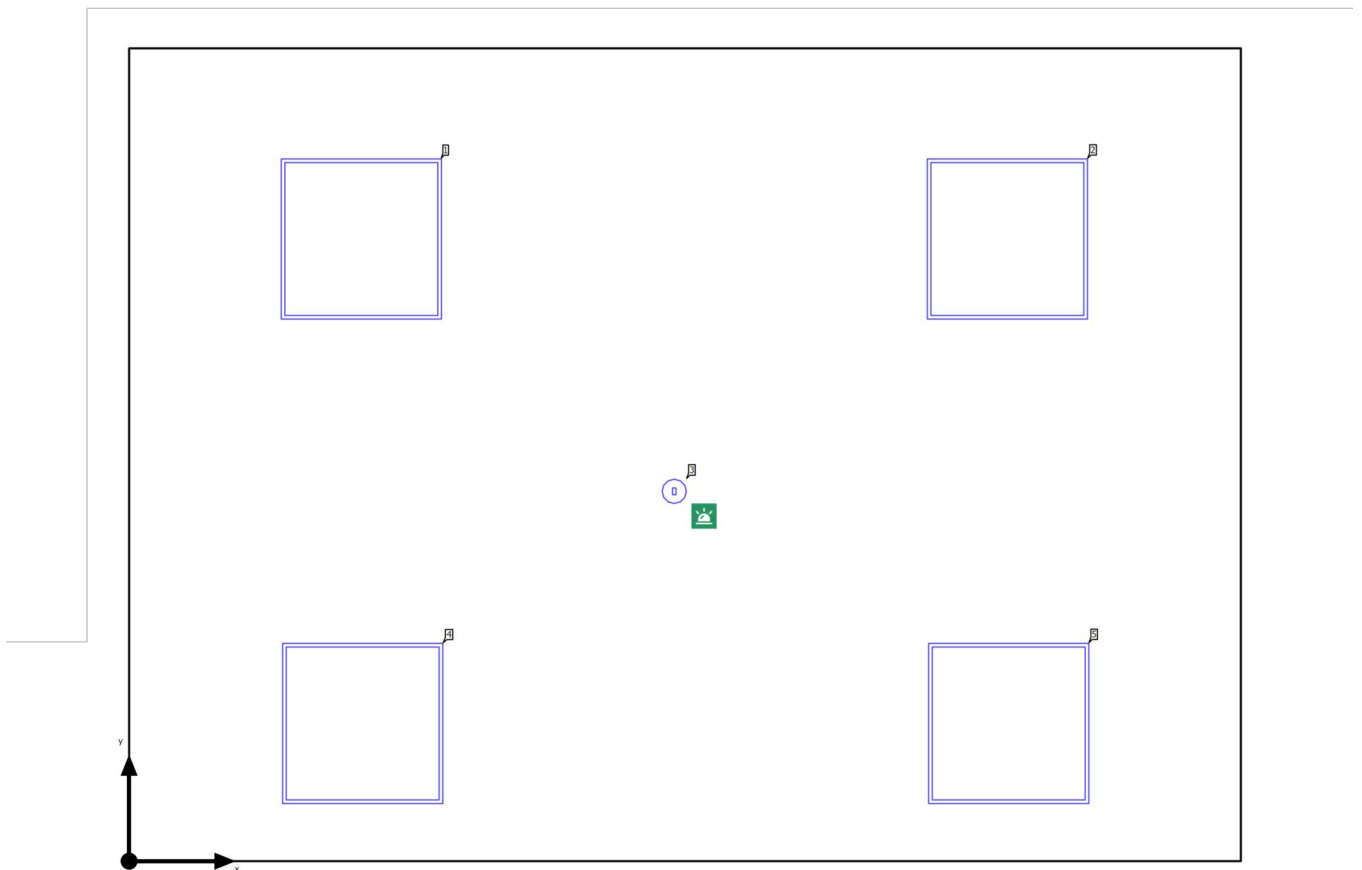Luminaire layout plan

Building A · GROUND FLOOR · 106 MEETING


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.025 m	1.374 m	2.768 m	3

Building A · GROUND FLOOR · 106 MEETING

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.863 m	2.312 m	2.776 m	1
3.263 m	2.312 m	2.776 m	2
0.868 m	0.512 m	2.776 m	4
3.268 m	0.512 m	2.776 m	5

Building A · GROUND FLOOR · 106 MEETING


Luminaire list

Φ_{total} 10000 lm	P_{total} 66.0 W	Luminous efficacy 151.5 lm/W	$\Phi_{\text{Emergency lighting}}$ 280 lm	$P_{\text{Emergency lighting}}$ 0.9 W
-----------------------------------	------------------------------	---------------------------------	--	--

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)		0.9 W	280 lm (100 %)	-
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)		16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 106 MEETING (Emergency light scene)

Calculation objects

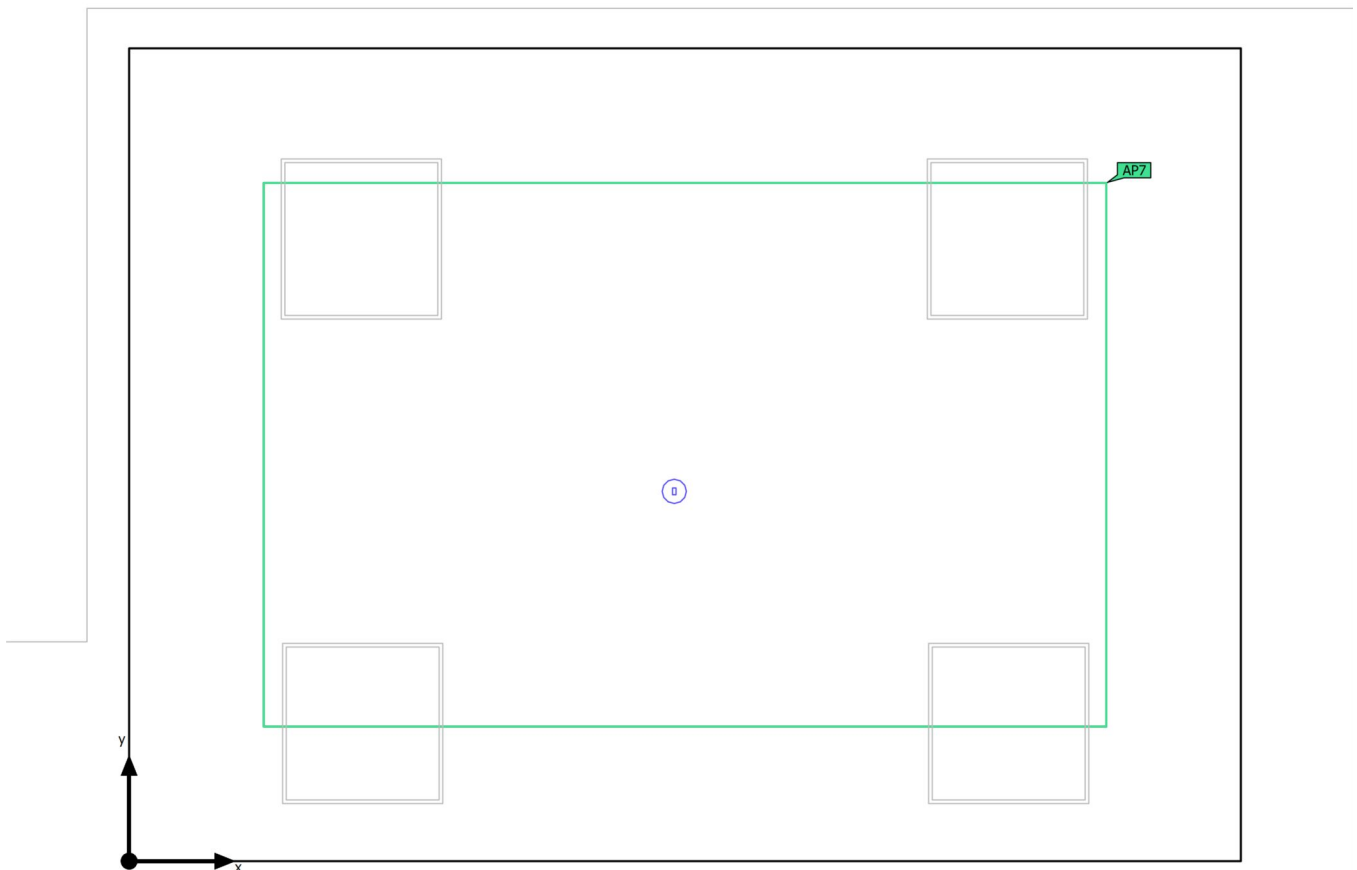

Building A · GROUND FLOOR · 106 MEETING (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.75 lx (≥ 0.50 lx) ✓	9.67 lx	0.49 (≥ 0.025) ✓	AP7

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Calculation objects

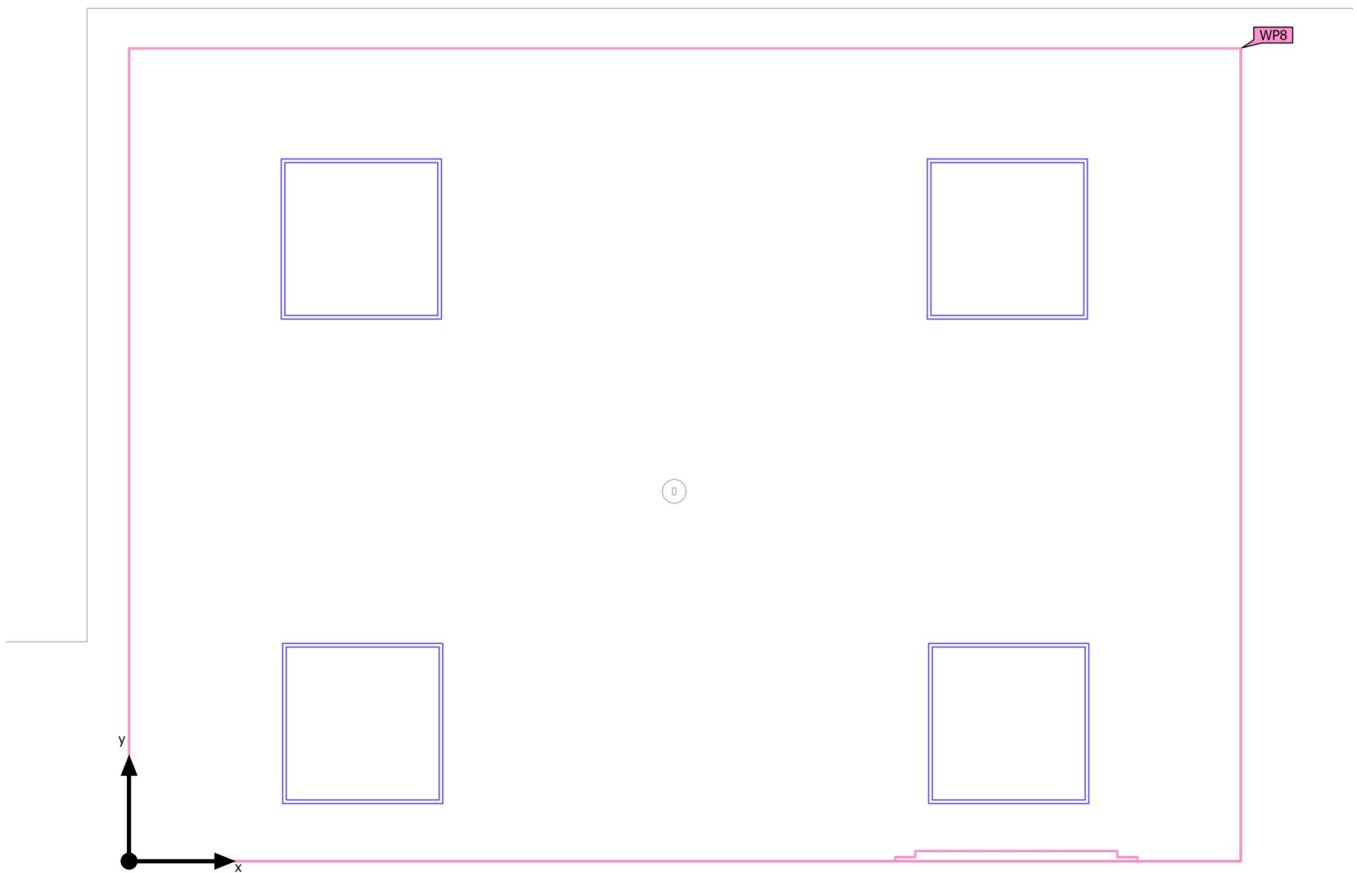

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	422 lx (≥ 500 lx) ✗	287 lx	497 lx	0.68 (≥ 0.60) ✓	0.58	WP8

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 106 MEETING (Emergency light scene)



Anti panic surface (106 MEETING)

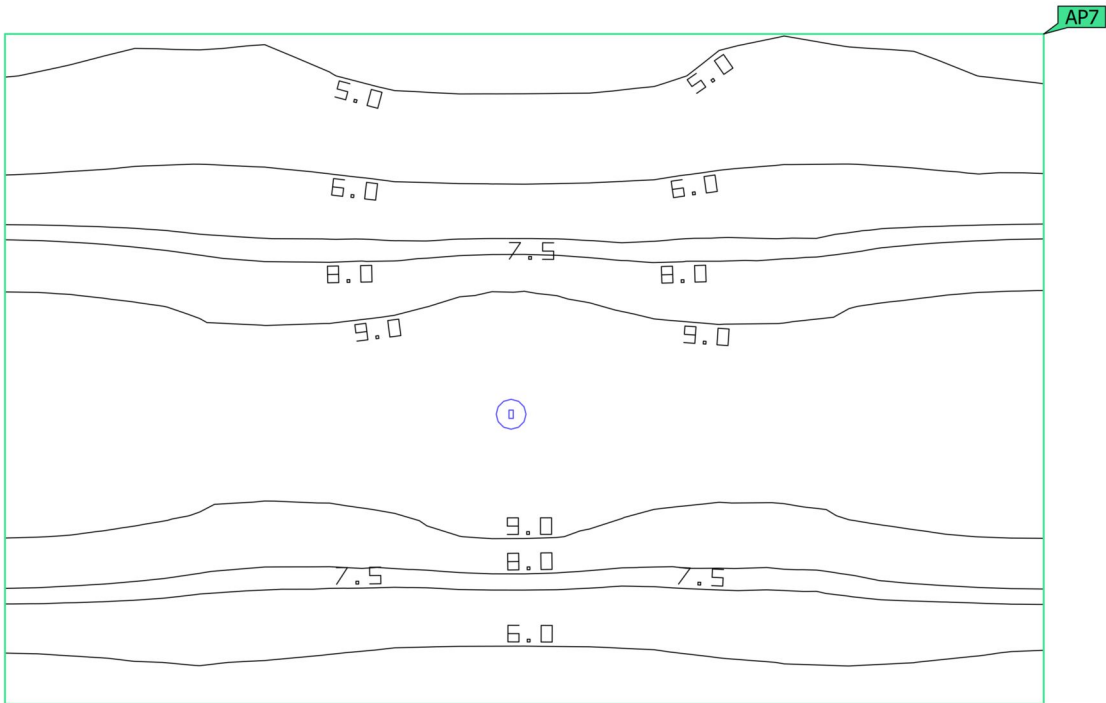

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (106 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.75 lx (≥ 0.50 lx) ✓	9.67 lx	0.49 (≥ 0.025) ✓	AP7

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 106 MEETING (Light scene 1)

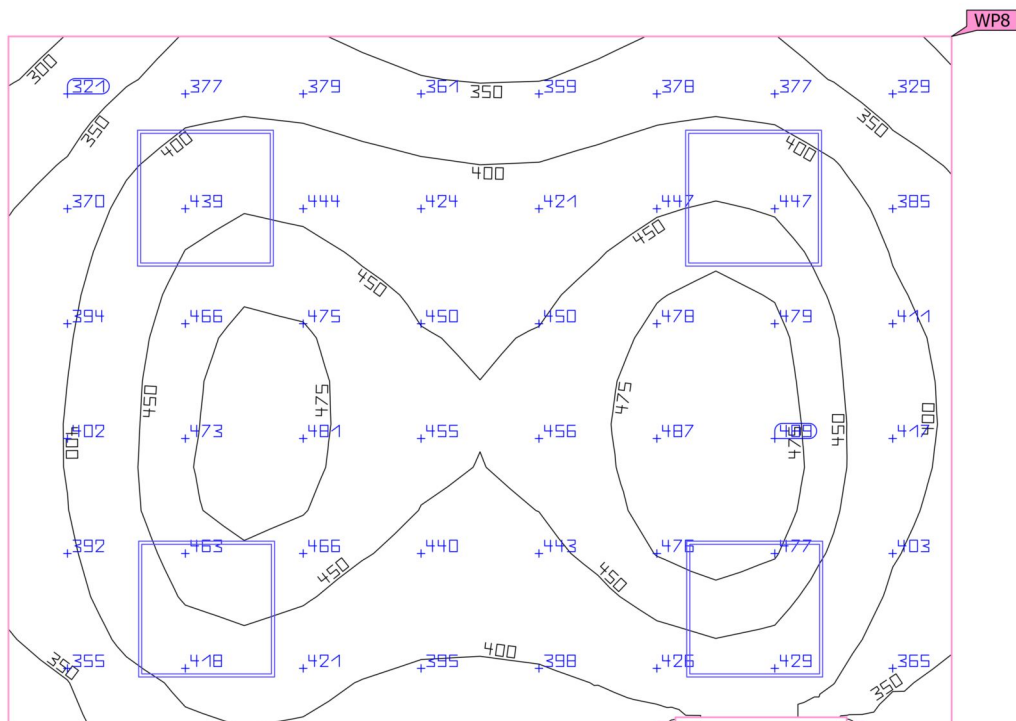
Working plane (106 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (106 MEETING)	422 lx	287 lx	497 lx	0.68	0.58	WP8
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 107 MEETING (Emergency light scene)

Summary

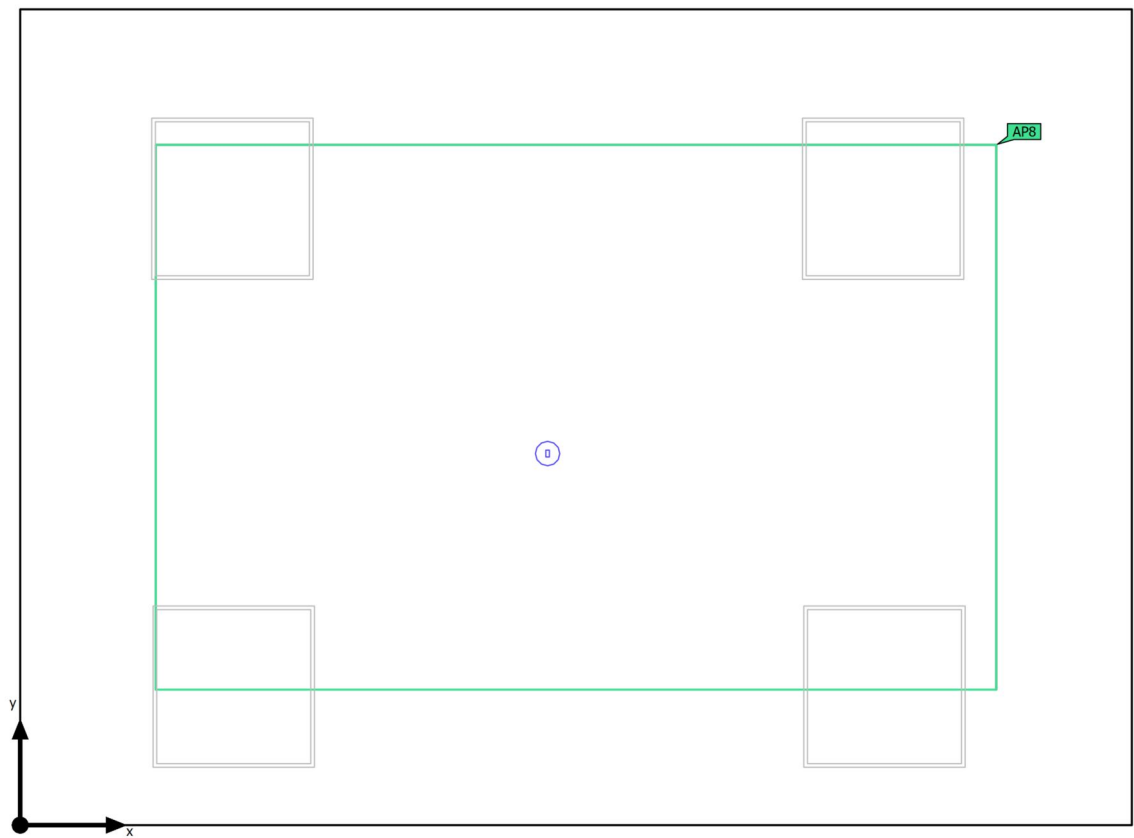

Ground area	12.34 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 107 MEETING (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.07 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (107 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.77 lx (≥ 0.50 lx) ✓	9.66 lx	0.49 (≥ 0.025) ✓	AP8

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Summary

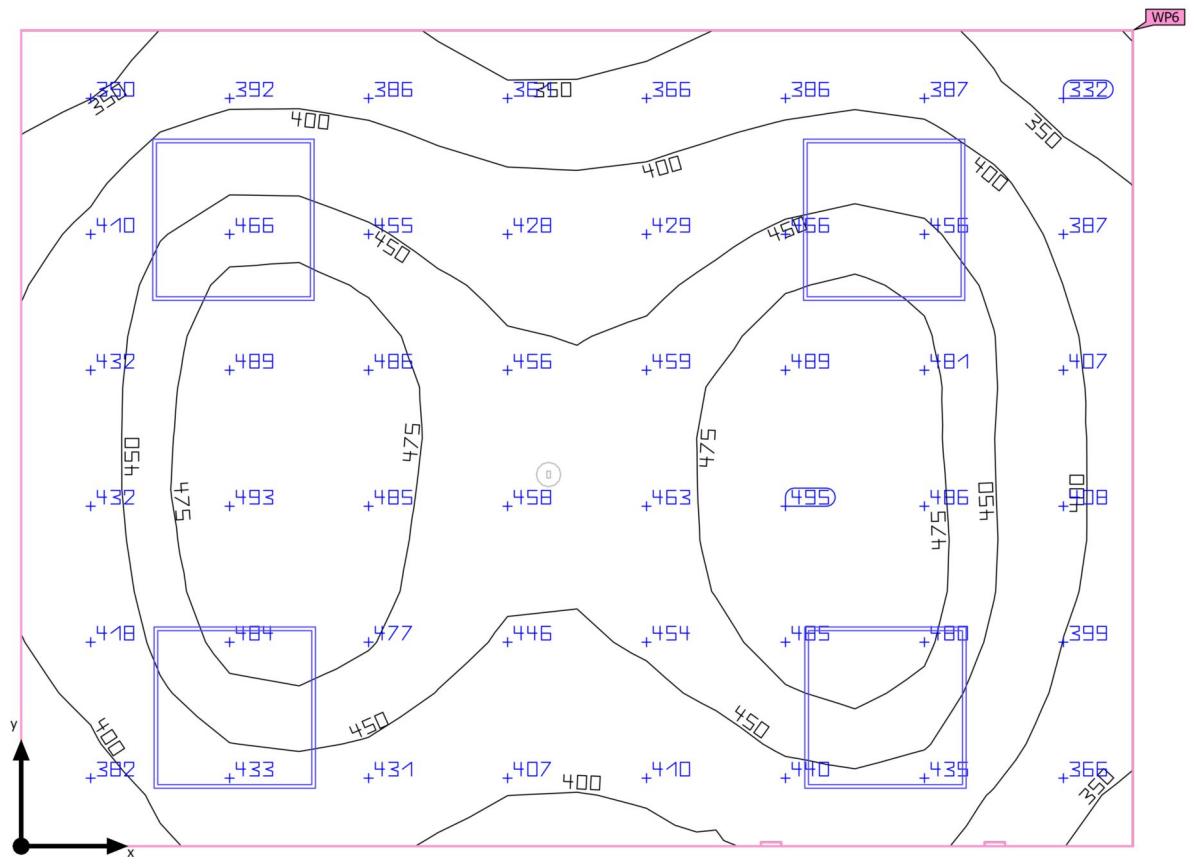

Ground area	12.34 m²	Clearance height	2.700 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.776 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	434 lx	$\geq 500 \text{ lx}$	✗	WP6
	$U_o (g_1)$	0.69	≥ 0.60	✓	WP6
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[103 - 163] kWh/a	max. 450 kWh/a	✓	
Space	Lighting power density	5.35 W/m ²	–		
		1.23 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.100 m x 3.010 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 107 MEETING

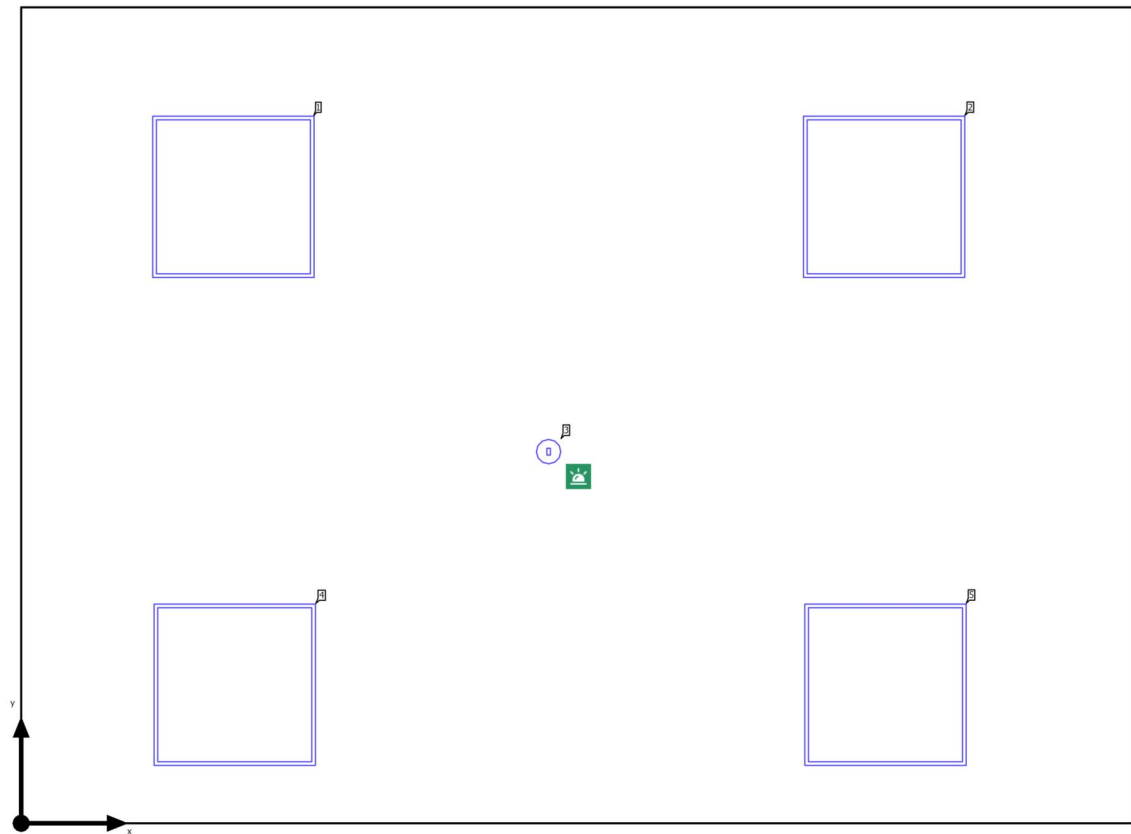Luminaire layout plan

Building A · GROUND FLOOR · 107 MEETING


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
1.945 m	1.371 m	2.768 m	3

Building A · GROUND FLOOR · 107 MEETING

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.783 m	2.311 m	2.776 m	1
3.183 m	2.311 m	2.776 m	2
0.788 m	0.511 m	2.776 m	4
3.188 m	0.511 m	2.776 m	5


Building A · GROUND FLOOR · 107 MEETING

Luminaire list

Φ_{total} 10000 lm		P_{total} 66.0 W		Luminous efficacy 151.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25	(_LTRevAB)		0.9 W	280 lm (100 %)	-	
4	ETAP	-	U2B-M210-MI-840-025D	(_LTRevAD)		16.5 W	2495 lm	151.2 lm/W	

Building A · GROUND FLOOR · 107 MEETING (Emergency light scene)

Calculation objects

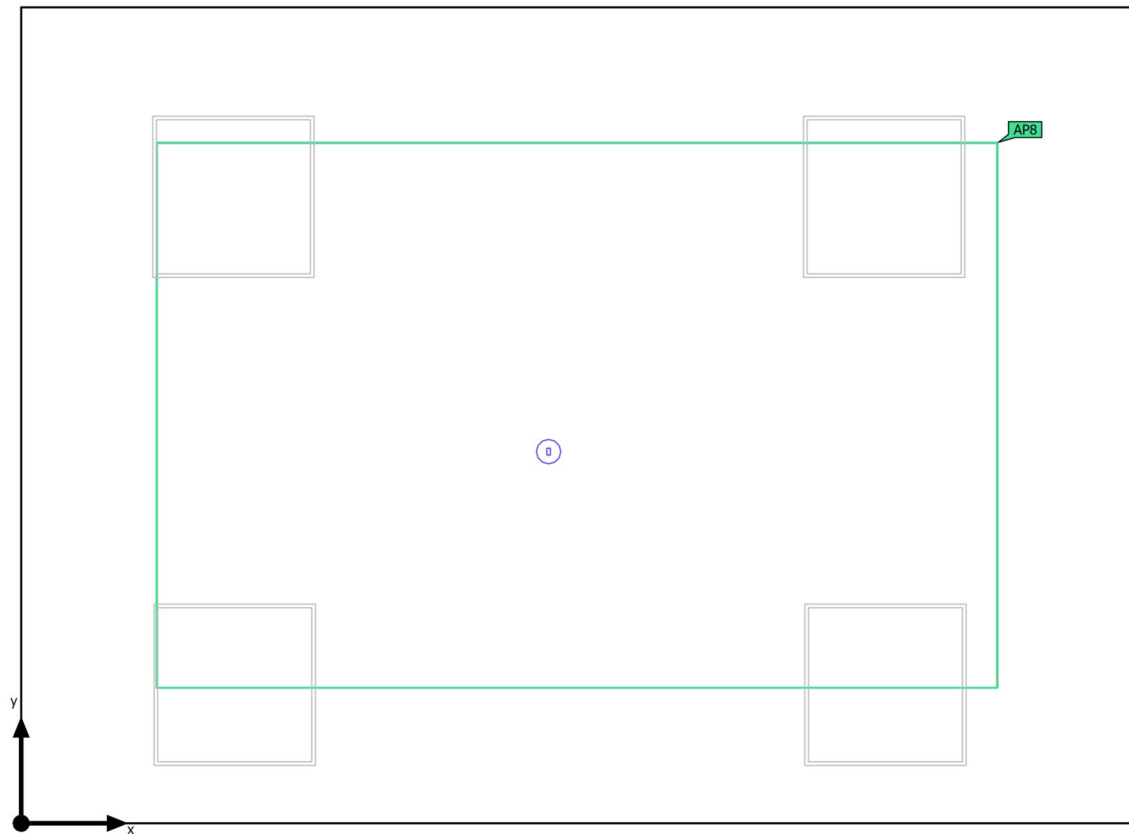

Building A · GROUND FLOOR · 107 MEETING (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (107 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.77 lx (≥ 0.50 lx) ✓	9.66 lx	0.49 (≥ 0.025) ✓	AP8

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Calculation objects

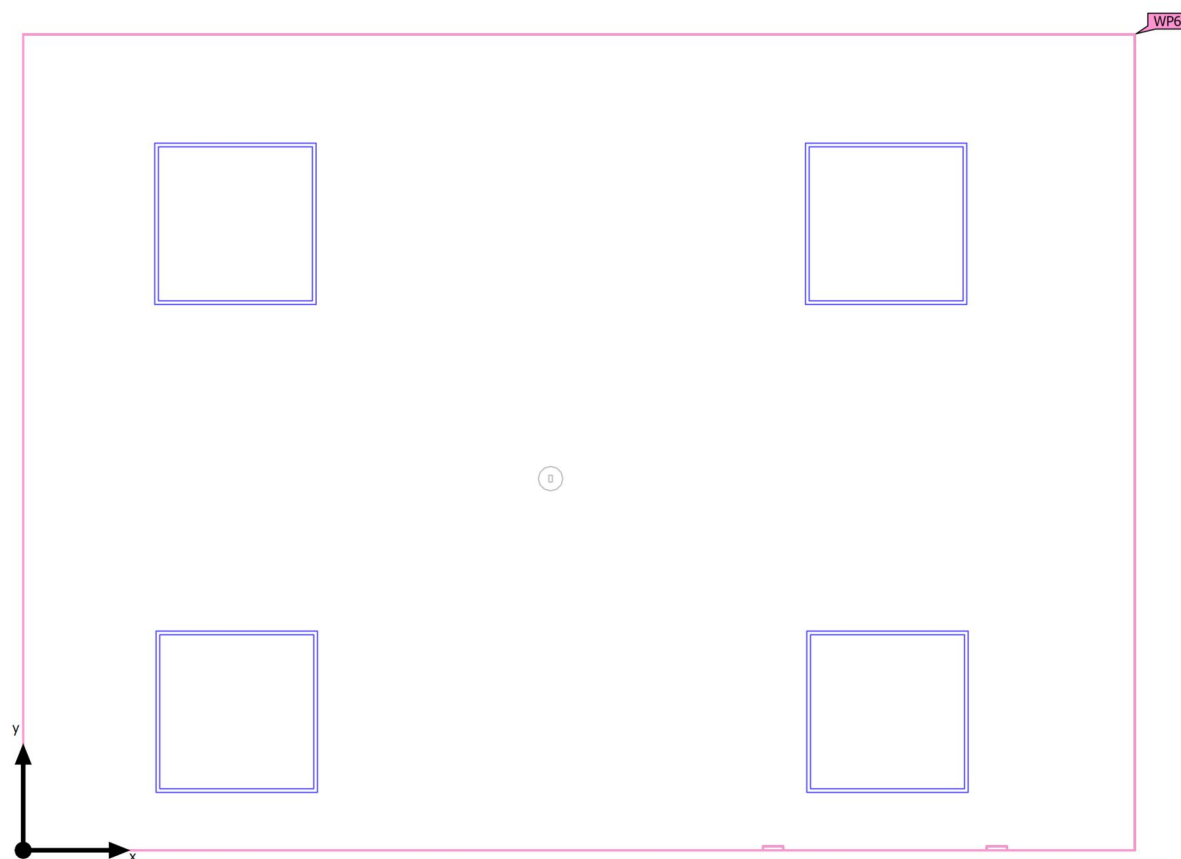

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (107 MEETING)	434 lx	299 lx	500 lx	0.69	0.60	WP6
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 107 MEETING (Emergency light scene)


Anti panic surface (107 MEETING)

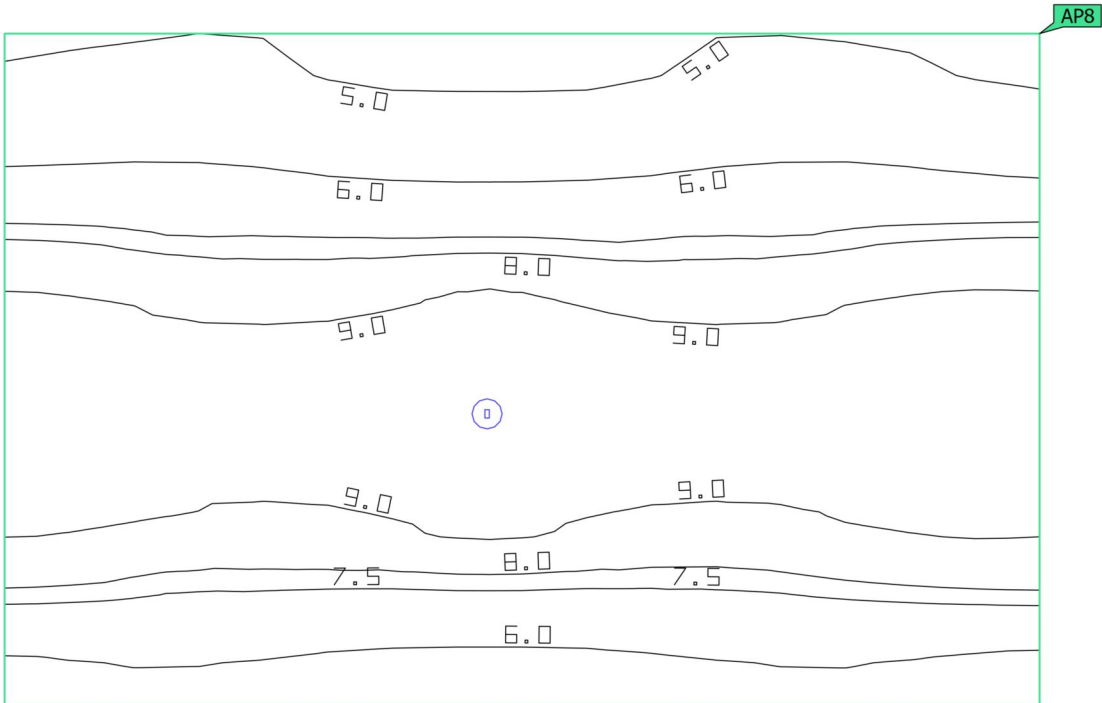

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (107 MEETING) Perpendicular illuminance (adaptive) Height: 0.000 m	4.77 lx (≥ 0.50 lx) ✓	9.66 lx	0.49 (≥ 0.025) ✓	AP8

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 107 MEETING (Light scene 1)

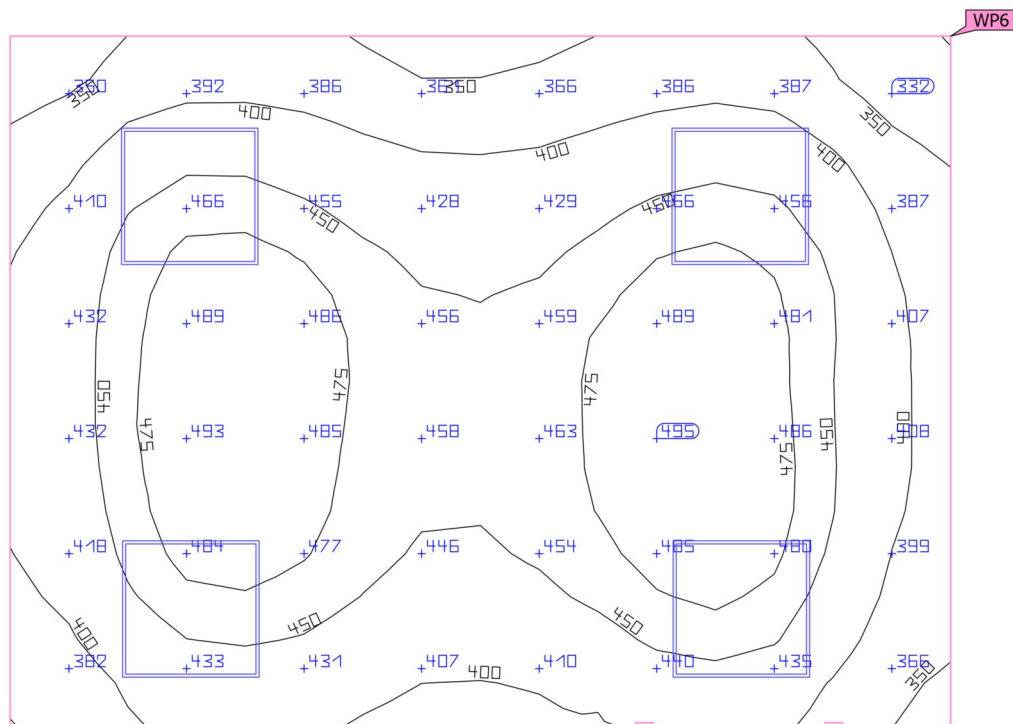
Working plane (107 MEETING)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (107 MEETING)	434 lx	299 lx	500 lx	0.69	0.60	WP6
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Summary

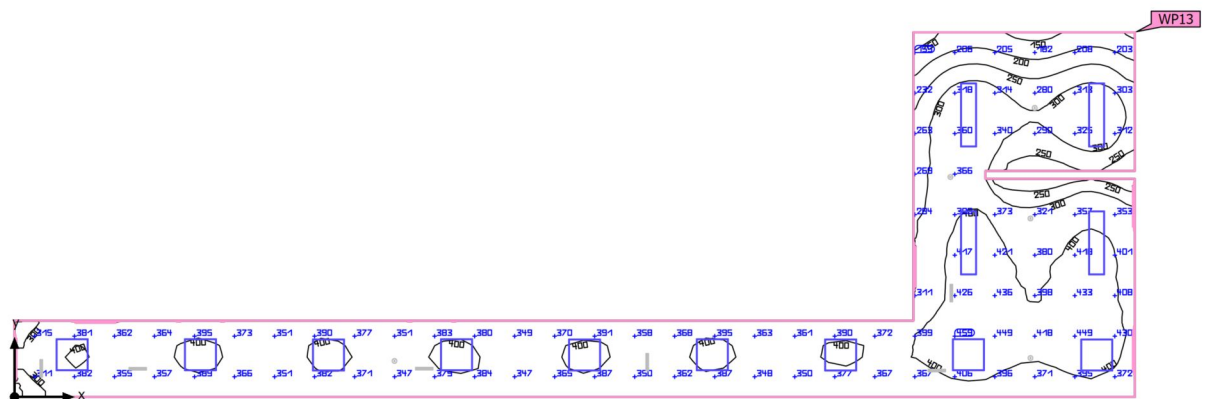

Ground area	52.09 m²	Clearance height	2.700 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.776 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	353 lx	$\geq 500 \text{ lx}$	✗	WP13
	$U_o (g_1)$	0.36	≥ 0.60	✗	WP13
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	16	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[445 - 538] kWh/a	max. 1850 kWh/a	✓	
Space	Lighting power density	4.18 W/m ²	–		
		1.18 W/m ² /100 lx	–		

(1) Based on a rectangular space of 6.840 m x 21.000 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	ETAP	-	U2B-M110-MI-830-025D (_LTRevAD)	16	17.5 W	2495 lm	142.5 lm/W
2	ETAP	-	U2B-M110-MI-840-025D (_LTRevAD)	16	17.0 W	2495 lm	146.7 lm/W
9	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	16	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 108 CORRIDOR

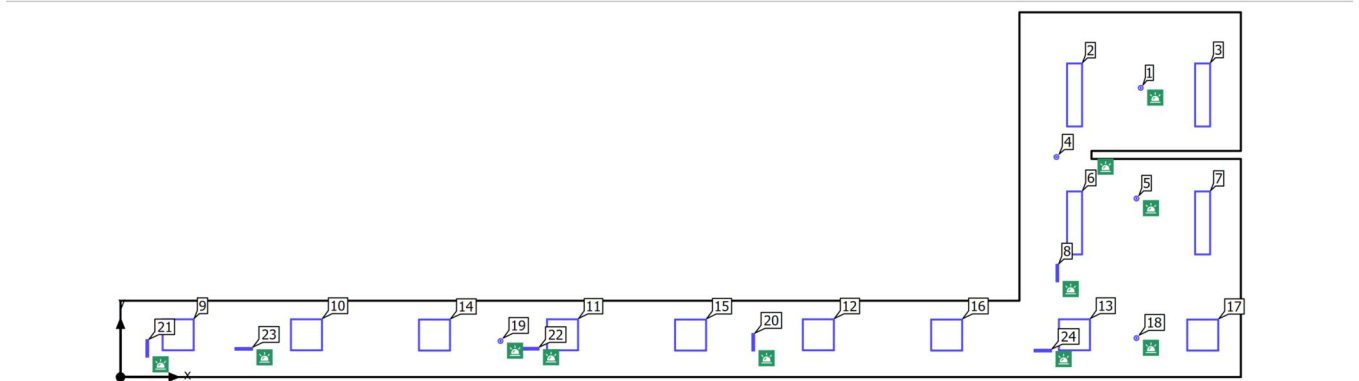Luminaire layout plan

Building A · GROUND FLOOR · 108 CORRIDOR


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
19.123 m	5.422 m	2.768 m	1
17.543 m	4.126 m	2.768 m	4
19.043 m	3.348 m	2.768 m	5
19.043 m	0.730 m	2.768 m	18
7.123 m	0.676 m	2.768 m	19

Building A · GROUND FLOOR · 108 CORRIDOR


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	2.5 W
Article name	K9R243/1-AX1 (_LTRevAB)	Φ _{Luminaire}	0 lm
Fitting	1x sign with picto	Φ _{Emergency lighting}	80 lm
		ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
17.560 m	1.950 m	2.758 m	8
11.860 m	0.652 m	2.758 m	20
0.502 m	0.537 m	2.758 m	21
7.681 m	0.531 m	2.758 m	22
2.310 m	0.529 m	2.758 m	23
17.288 m	0.496 m	2.758 m	24

Building A · GROUND FLOOR · 108 CORRIDOR


Luminaire layout plan

Manufacturer	ETAP	P	17.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M110-MI-830-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
17.883 m	5.290 m	2.776 m	2
20.283 m	5.290 m	2.776 m	3

Building A · GROUND FLOOR · 108 CORRIDOR


Luminaire layout plan

Manufacturer	ETAP	P	17.0 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M110-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
17.883 m	2.890 m	2.776 m	6
20.283 m	2.890 m	2.776 m	7

Building A · GROUND FLOOR · 108 CORRIDOR

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
1.081 m	0.792 m	2.776 m	9
3.486 m	0.792 m	2.776 m	10
8.286 m	0.792 m	2.776 m	11
13.081 m	0.792 m	2.776 m	12
17.881 m	0.792 m	2.776 m	13
5.886 m	0.788 m	2.776 m	14
10.686 m	0.788 m	2.776 m	15
15.486 m	0.788 m	2.776 m	16
20.286 m	0.788 m	2.776 m	17

Building A · GROUND FLOOR · 108 CORRIDOR

Luminaire list

Φ_{total} 32500 lm	P_{total} 217.5 W	Luminous efficacy 149.4 lm/W	$\Phi_{\text{Emergency lighting}}$ 1880 lm	$P_{\text{Emergency lighting}}$ 19.5 W
-----------------------------------	-------------------------------	---------------------------------	---	---

pcs.	Manufacturer	Article No.	Article name		P	Φ	Luminous efficacy
5	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)		0.9 W	280 lm (100 %)	-
6	ETAP	-	K9R243/1-AX1 (_LTRevAB)		2.5 W	80 lm (100 %)	-
2	ETAP	-	U2B-M110-MI-830-025D (_LTRevAD)		17.5 W	2495 lm	142.5 lm/W
2	ETAP	-	U2B-M110-MI-840-025D (_LTRevAD)		17.0 W	2495 lm	146.7 lm/W
9	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)		16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

Calculation objects



Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)


Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (108 CORRIDOR)	353 lx	126 lx	467 lx	0.36	0.27	WP13
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 108 CORRIDOR (Light scene 1)

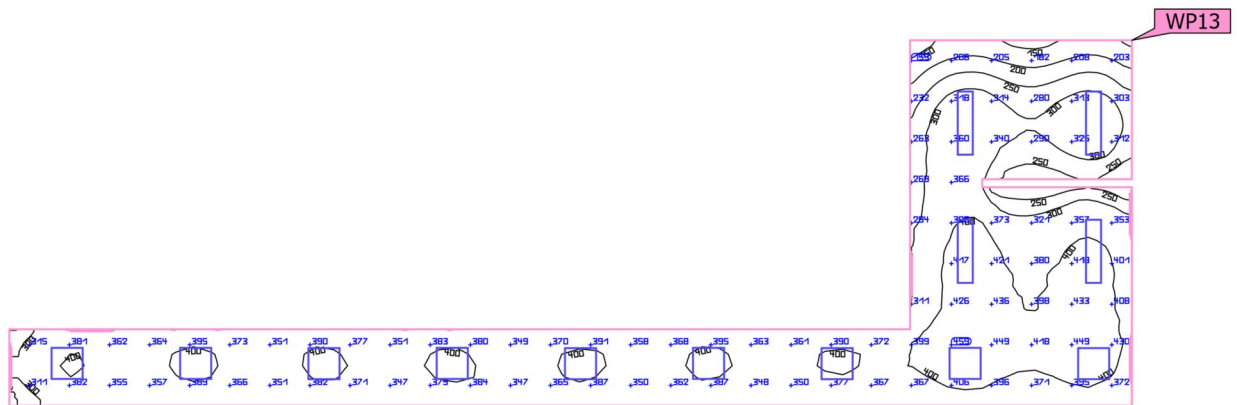
Working plane (108 CORRIDOR)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (108 CORRIDOR)	353 lx	126 lx	467 lx	0.36	0.27	WP13
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 109 MAIL (Emergency light scene)

Summary

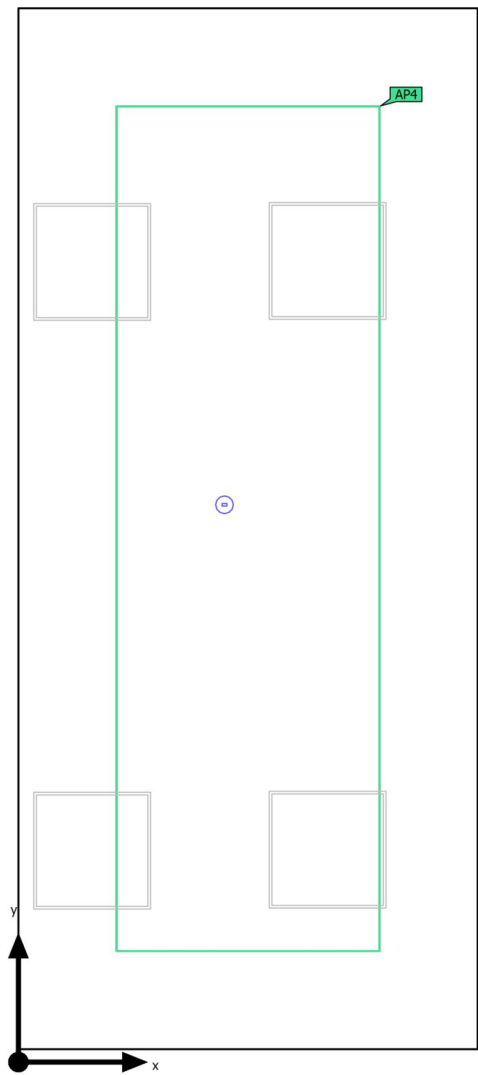

Ground area	12.41 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 109 MAIL (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.07 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.000 m	5.32 lx (≥ 0.50 lx) ✓	9.64 lx	0.55 (≥ 0.025) ✓	AP4

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Summary

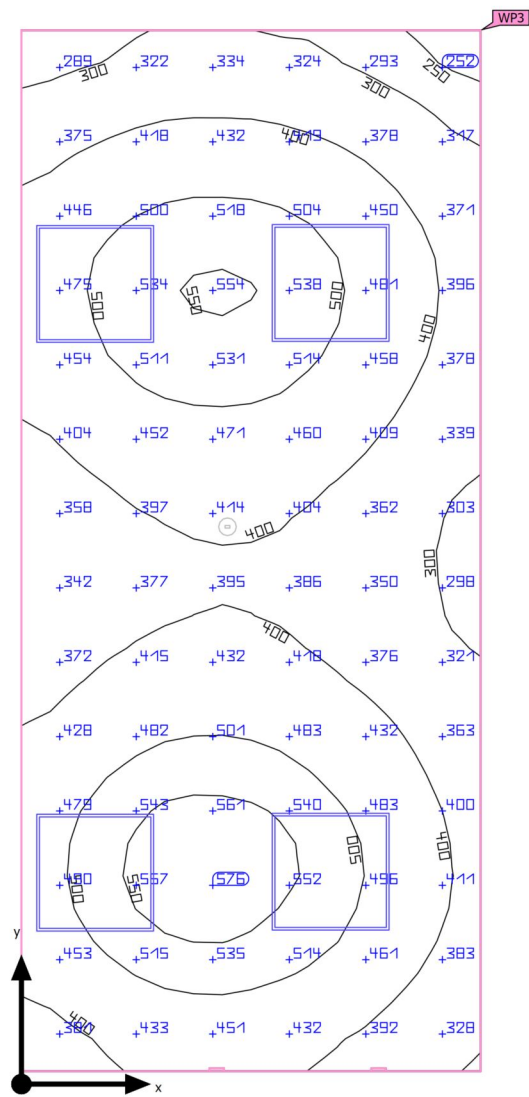

Ground area	12.41 m²	Clearance height	2.700 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.776 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	429 lx	$\geq 500 \text{ lx}$	✗	WP3
	$U_o (g_1)$	0.52	≥ 0.60	✗	WP3
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[103 - 163] kWh/a	max. 450 kWh/a	✓	
Space	Lighting power density	5.32 W/m ²	–		
		1.24 W/m ² /100 lx	–		

(1) Based on a rectangular space of 5.304 m x 2.340 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 109 MAIL

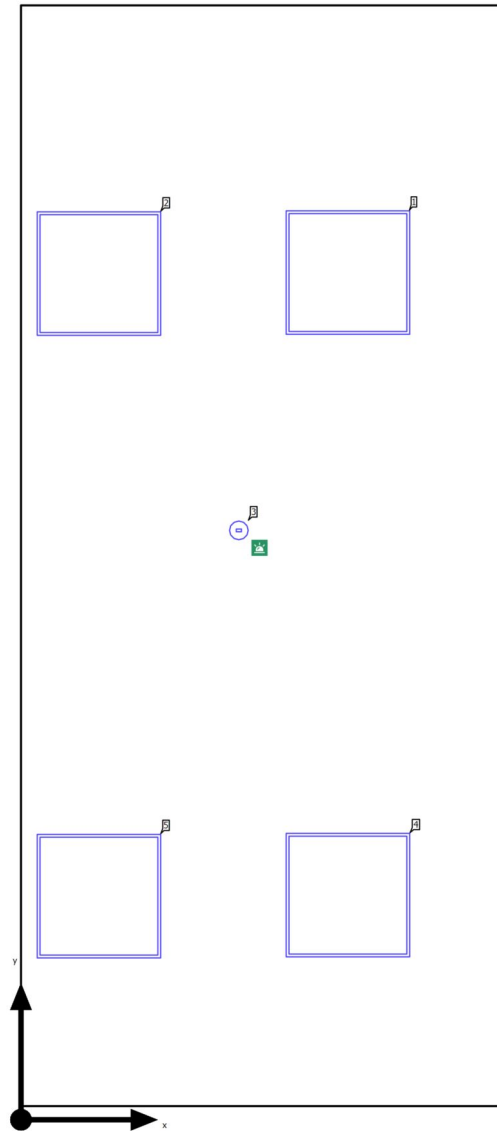Luminaire layout plan

Building A · GROUND FLOOR · 109 MAIL


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
1.050 m	2.840 m	2.768 m	3

Building A · GROUND FLOOR · 109 MAIL

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
1.576 m	4.082 m	2.776 m	1
0.376 m	4.078 m	2.776 m	2
1.576 m	1.082 m	2.776 m	4
0.376 m	1.078 m	2.776 m	5


Building A · GROUND FLOOR · 109 MAIL

Luminaire list

Φ_{total} 10000 lm		P_{total} 66.0 W		Luminous efficacy 151.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)			0.9 W	280 lm (100 %)	-	
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)			16.5 W	2495 lm	151.2 lm/W	

Building A · GROUND FLOOR · 109 MAIL (Emergency light scene)

Calculation objects

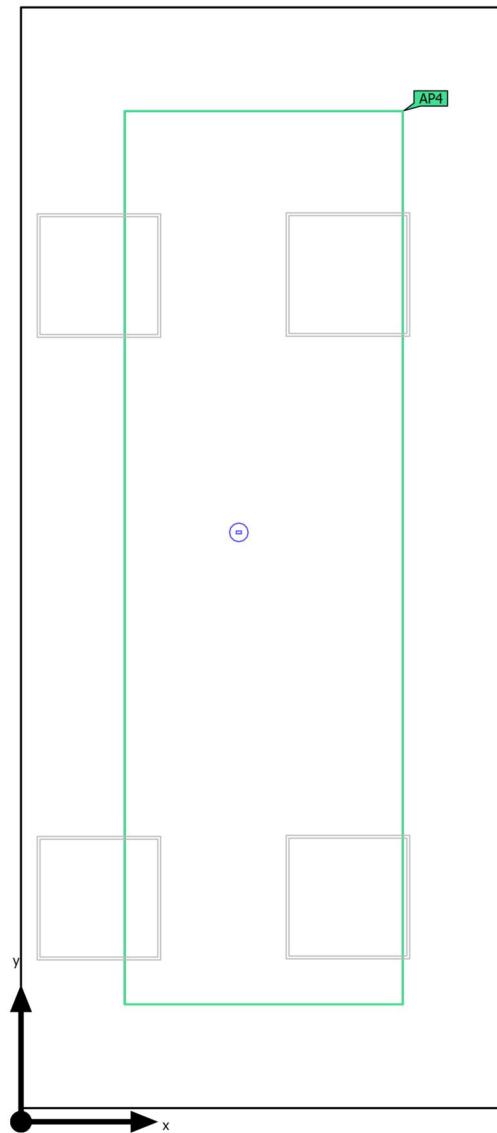

Building A · GROUND FLOOR · 109 MAIL (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.000 m	5.32 lx (≥ 0.50 lx) ✓	9.64 lx	0.55 (≥ 0.025) ✓	AP4

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

Calculation objects

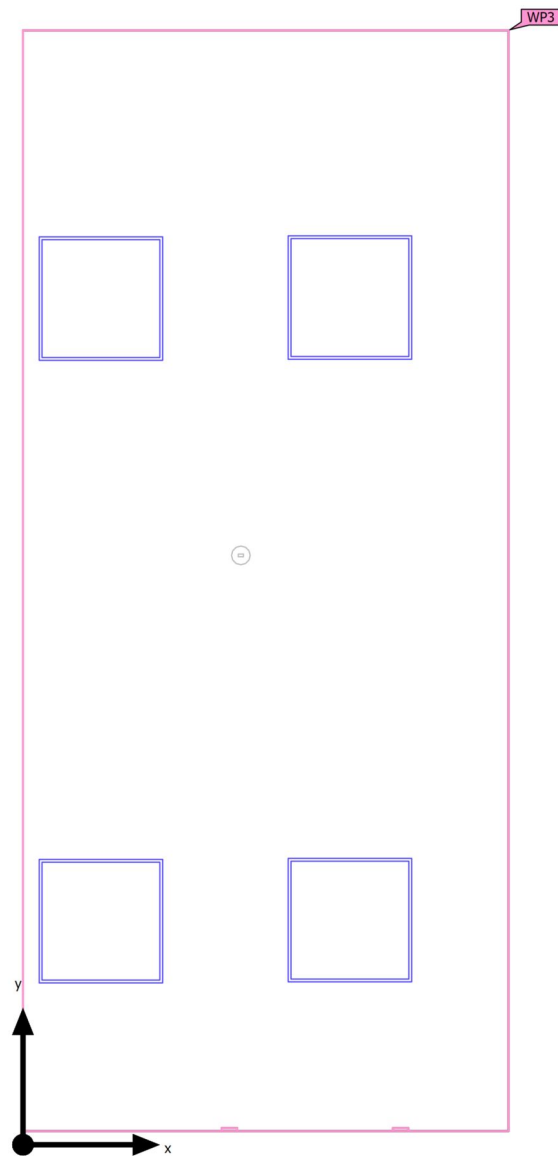

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)



Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (109 MAIL)	429 lx	225 lx	577 lx	0.52	0.39	WP3
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Building A · GROUND FLOOR · 109 MAIL (Emergency light scene)
Anti panic surface (109 MAIL)

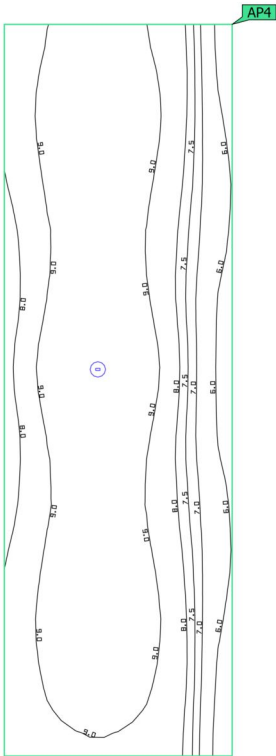

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (109 MAIL) Perpendicular illuminance (adaptive) Height: 0.000 m	5.32 lx (≥ 0.50 lx) ✓	9.64 lx	0.55 (≥ 0.025) ✓	AP4

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 109 MAIL (Light scene 1)

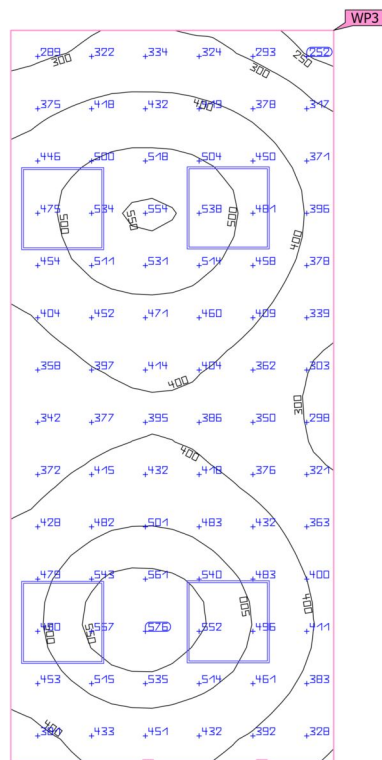
Working plane (109 MAIL)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (109 MAIL)	429 lx	225 lx	577 lx	0.52	0.39	WP3
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 110 OFFICE (Emergency light scene)

Summary

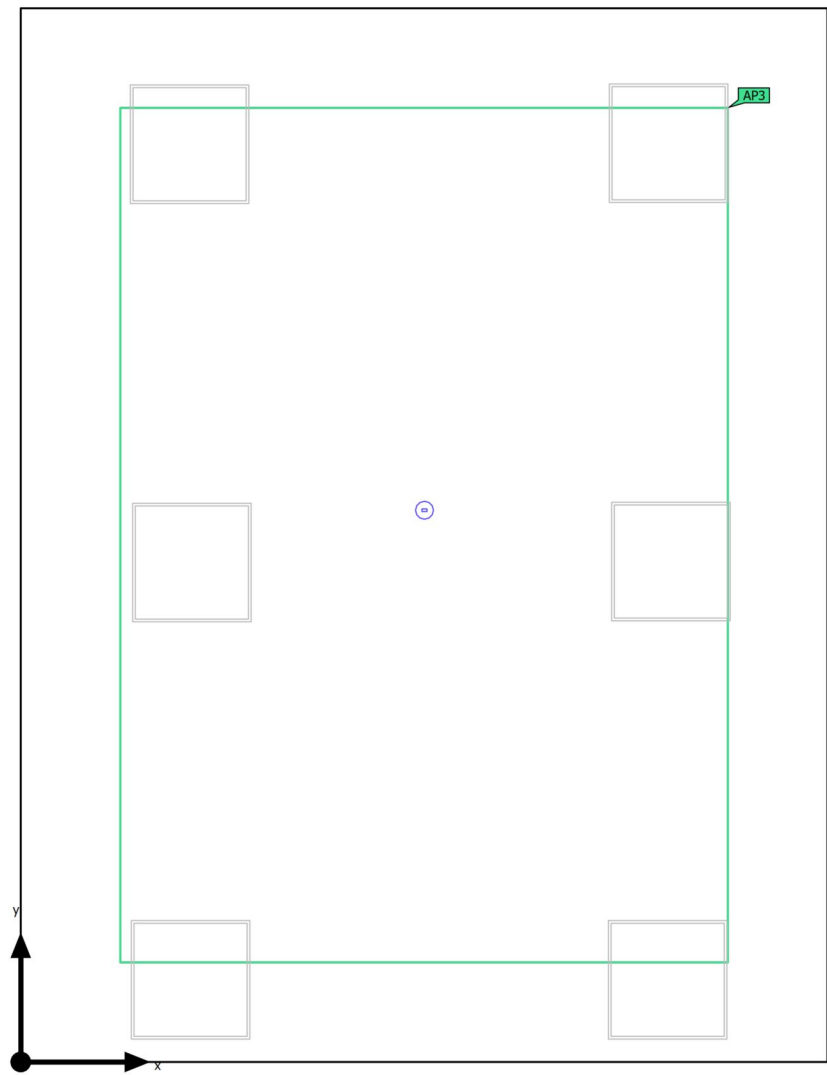

Ground area	21.42 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 110 OFFICE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.04 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.59 lx (≥ 0.50 lx) ✓	9.66 lx	0.37 (≥ 0.025) ✓	AP3

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Summary

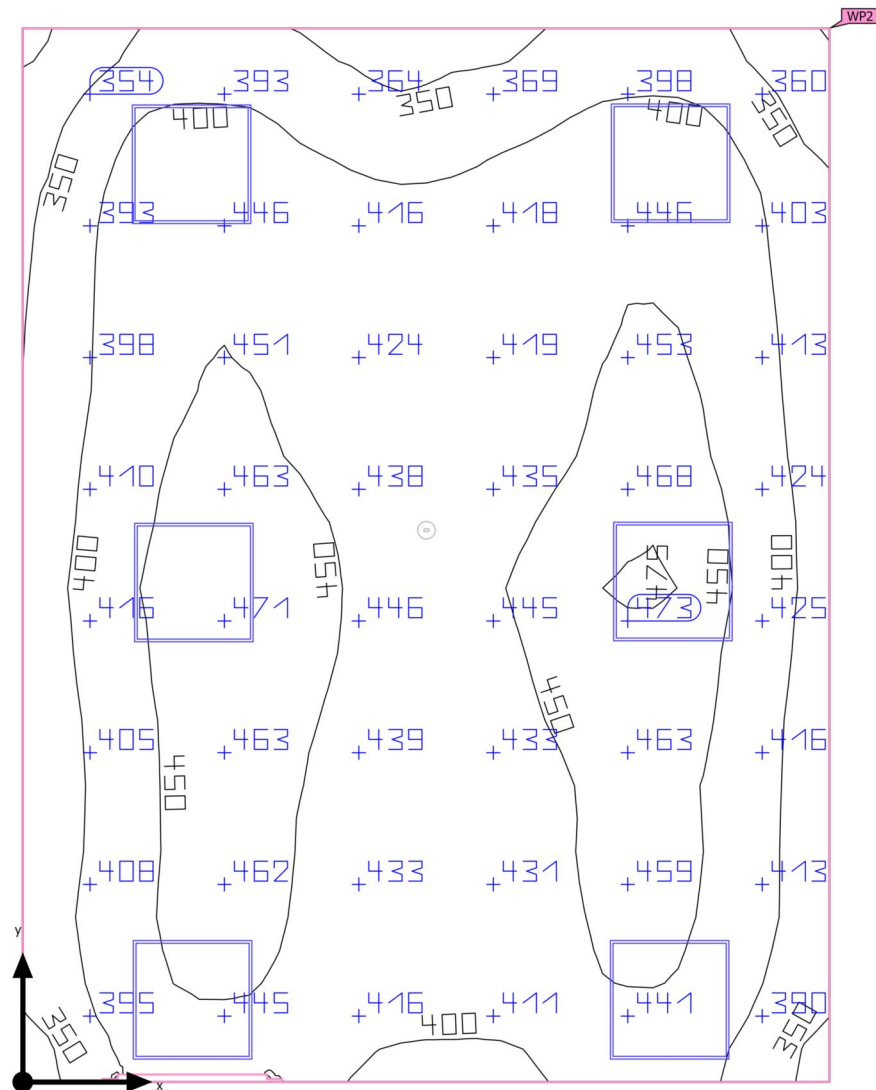

Ground area	21.42 m²	Clearance height	2.700 m
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Mounting height	2.776 m
Maintenance factor	0.76 (fixed)	Height _{Working plane}	0.700 m
		Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	422 lx	$\geq 500 \text{ lx}$	✗	WP2
	$U_o (g_1)$	0.69	≥ 0.60	✓	WP2
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[154 - 245] kWh/a	max. 800 kWh/a	✓	
Space	Lighting power density	4.62 W/m ²	–		
		1.09 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.050 m x 5.290 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 110 OFFICE

Luminaire layout plan

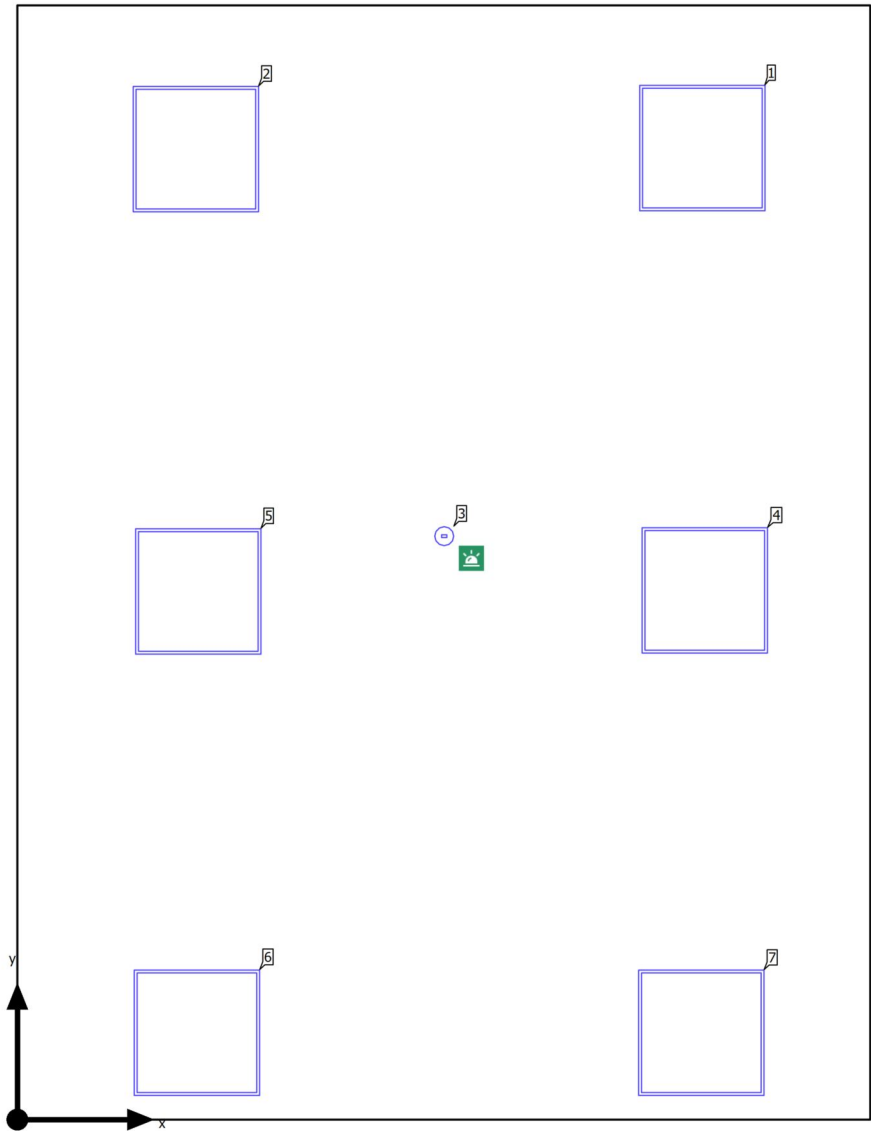

Building A · GROUND FLOOR · 110 OFFICE


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.027 m	2.770 m	2.768 m	3

Building A · GROUND FLOOR · 110 OFFICE

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
3.253 m	4.612 m	2.776 m	1
0.848 m	4.608 m	2.776 m	2
3.264 m	2.512 m	2.776 m	4
0.859 m	2.508 m	2.776 m	5
0.853 m	0.412 m	2.776 m	6
3.248 m	0.412 m	2.776 m	7


Building A · GROUND FLOOR · 110 OFFICE

Luminaire list

Φ_{total} 15000 lm		P_{total} 99.0 W		Luminous efficacy 151.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25	(_LTRevAB)		0.9 W	280 lm (100 %)	-	
6	ETAP	-	U2B-M210-MI-840-025D	(_LTRevAD)		16.5 W	2495 lm	151.2 lm/W	

Building A · GROUND FLOOR · 110 OFFICE (Emergency light scene)

Calculation objects

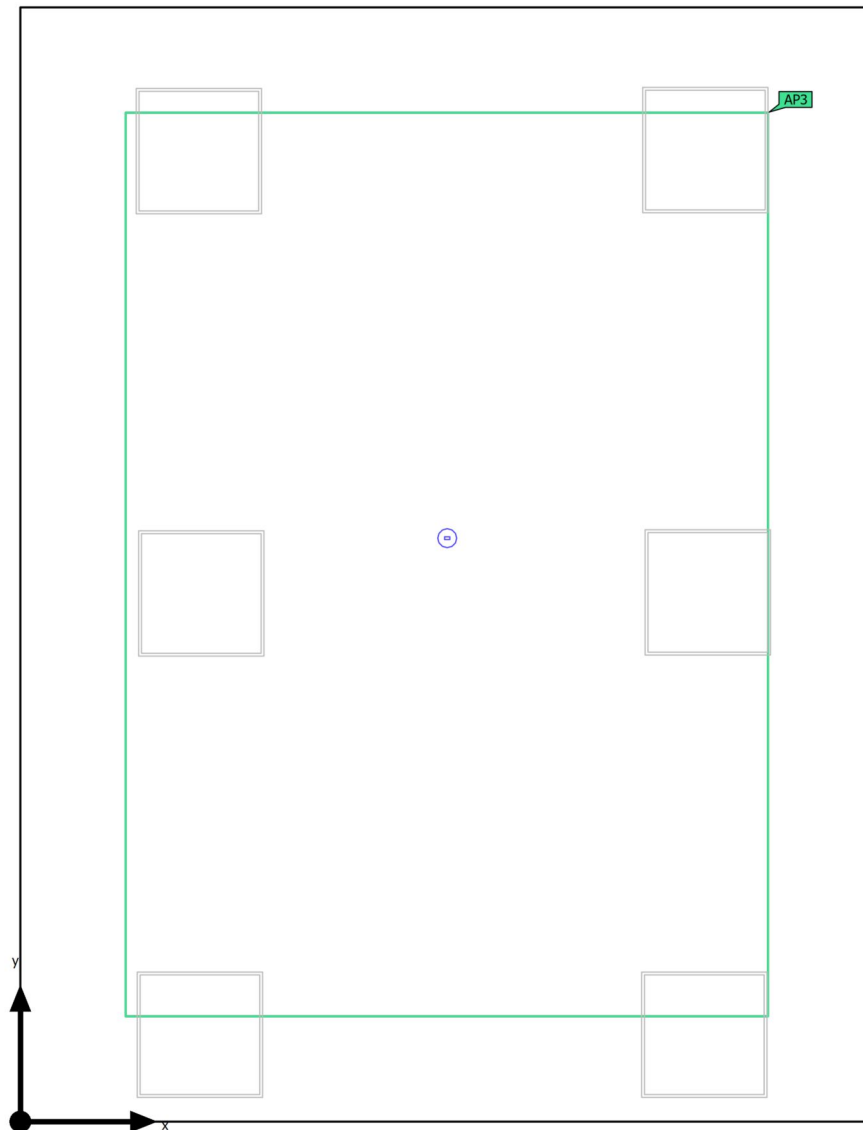

Building A · GROUND FLOOR · 110 OFFICE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.59 lx (≥ 0.50 lx) ✓	9.66 lx	0.37 (≥ 0.025) ✓	AP3

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Calculation objects

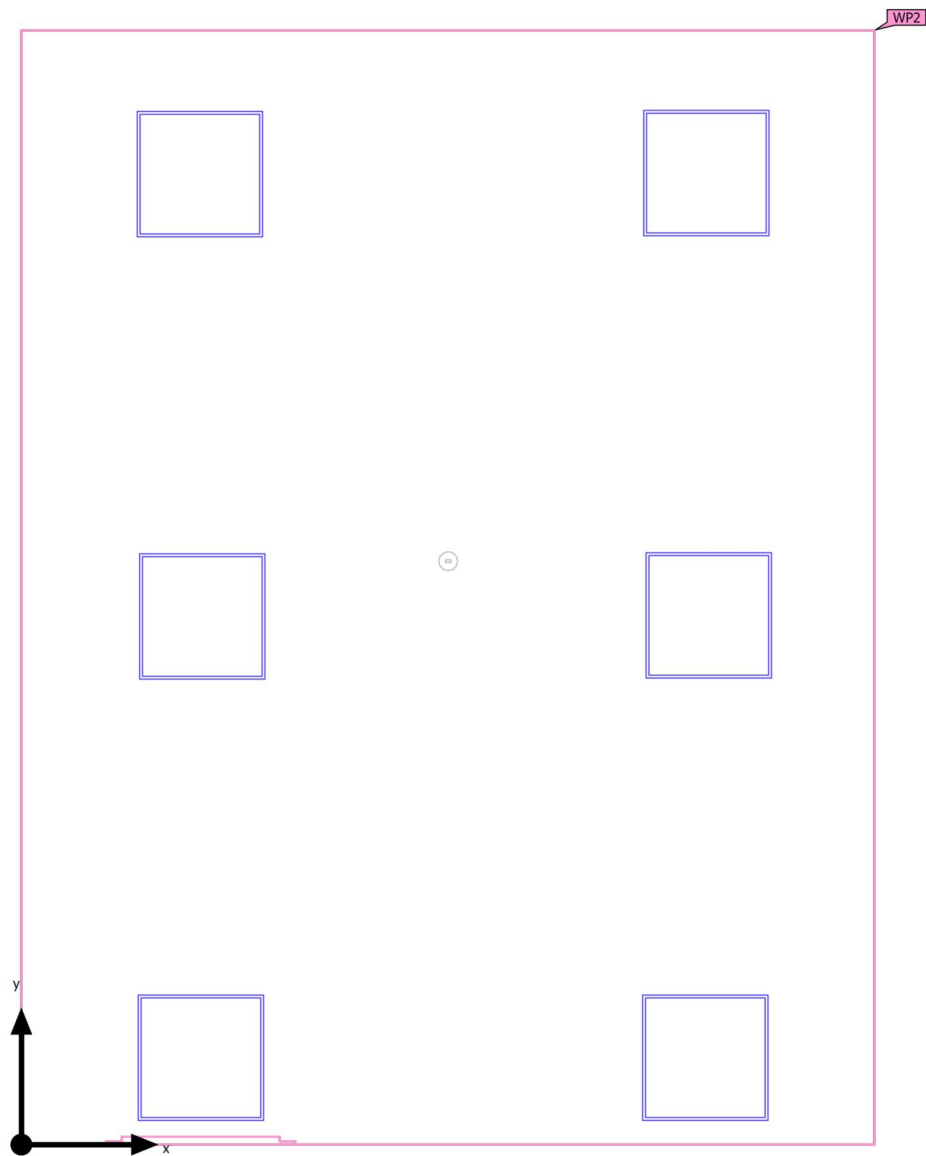

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	422 lx (≥ 500 lx) ✗	290 lx	477 lx	0.69 (≥ 0.60) ✓	0.61	WP2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 110 OFFICE (Emergency light scene)

Anti panic surface (110 OFFICE)

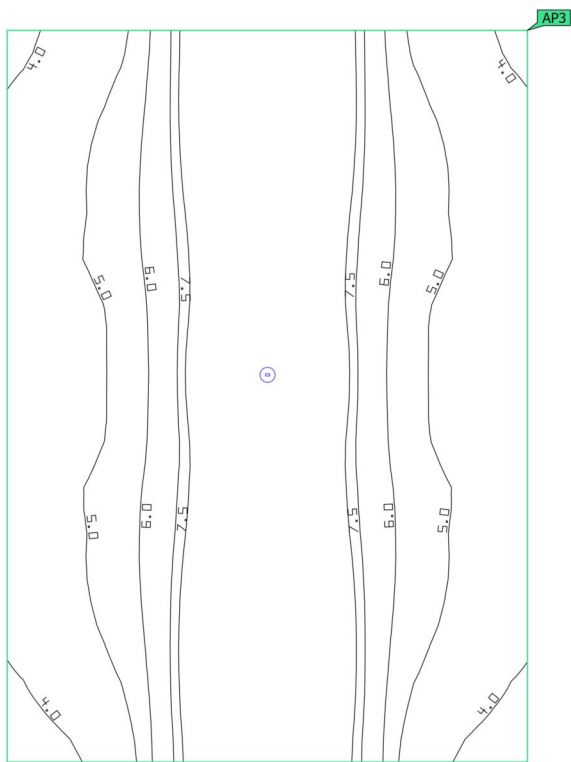


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (110 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.59 lx (≥ 0.50 lx) ✓	9.66 lx	0.37 (≥ 0.025) ✓	AP3

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 110 OFFICE (Light scene 1)

Working plane (110 OFFICE)

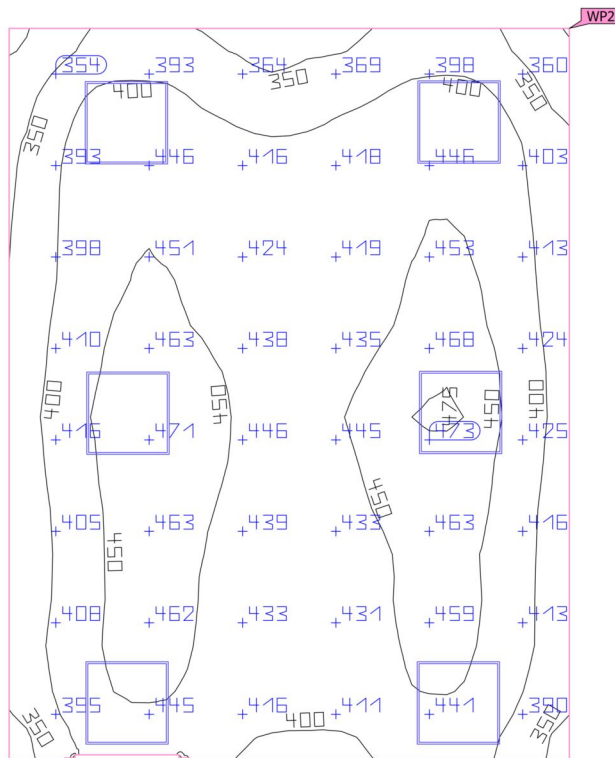


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (110 OFFICE)	422 lx	290 lx	477 lx	0.69	0.61	WP2
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 111 CAD (Emergency light scene)

Summary

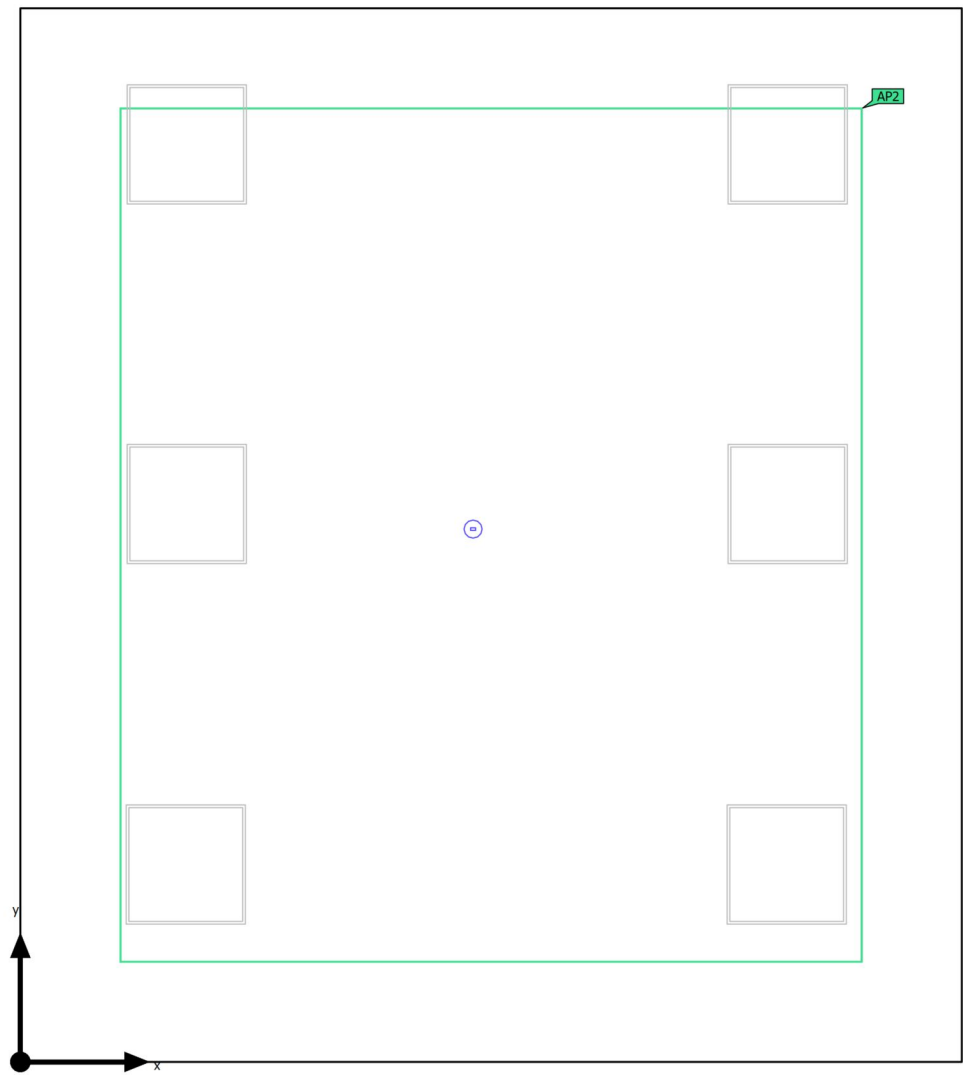

Ground area	24.72 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 111 CAD (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.04 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (111 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.97 lx (≥ 0.50 lx) ✓	9.71 lx	0.20 (≥ 0.025) ✓	AP2

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Summary

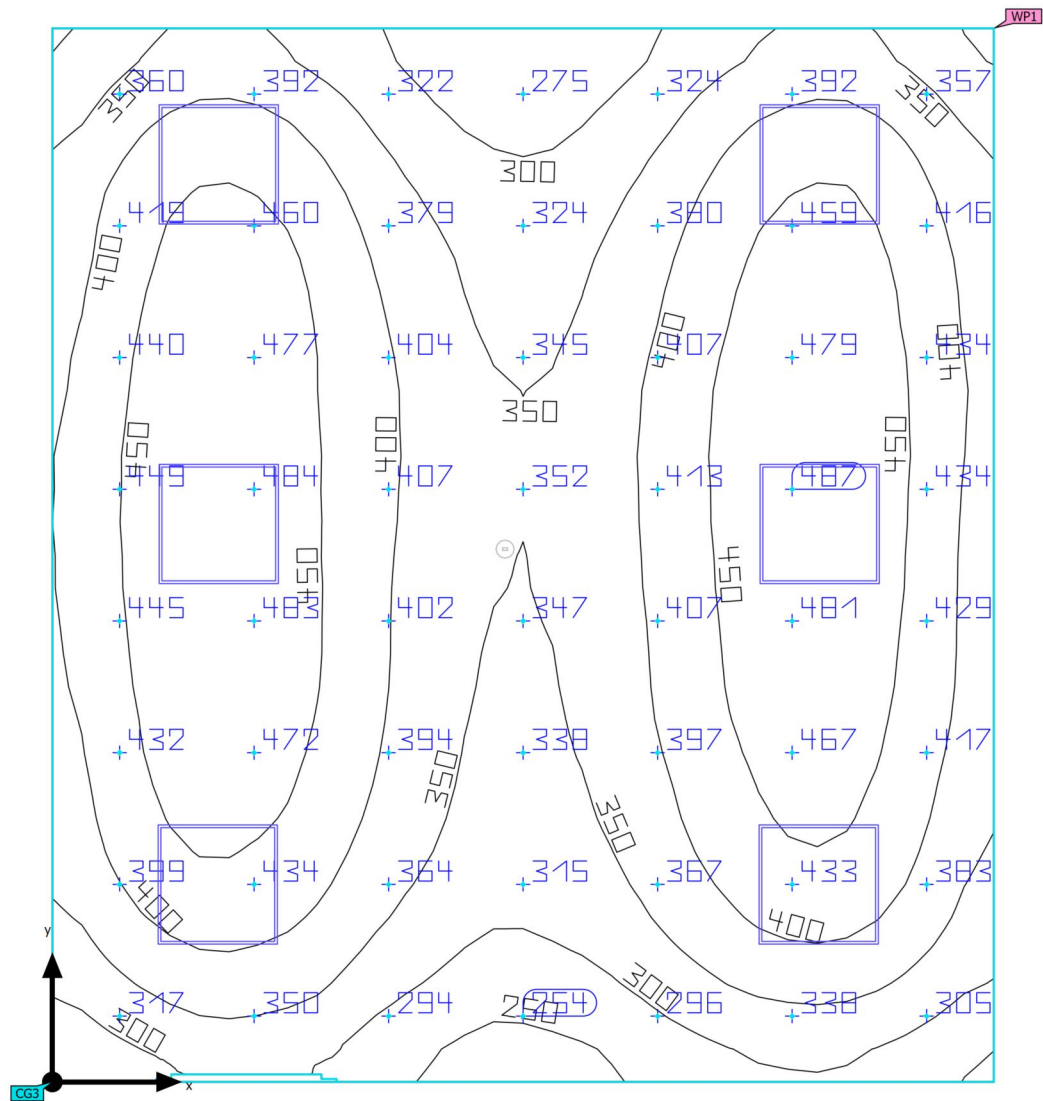

Ground area	24.72 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	392 lx	$\geq 500 \text{ lx}$	✗	WP1
	$U_o (g_1)$	0.57	≥ 0.60	✗	WP1
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[154 - 245] kWh/a	max. 900 kWh/a	✓	
Space	Lighting power density	4.00 W/m ²	–		
		1.02 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.700 m x 5.260 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 111 CAD

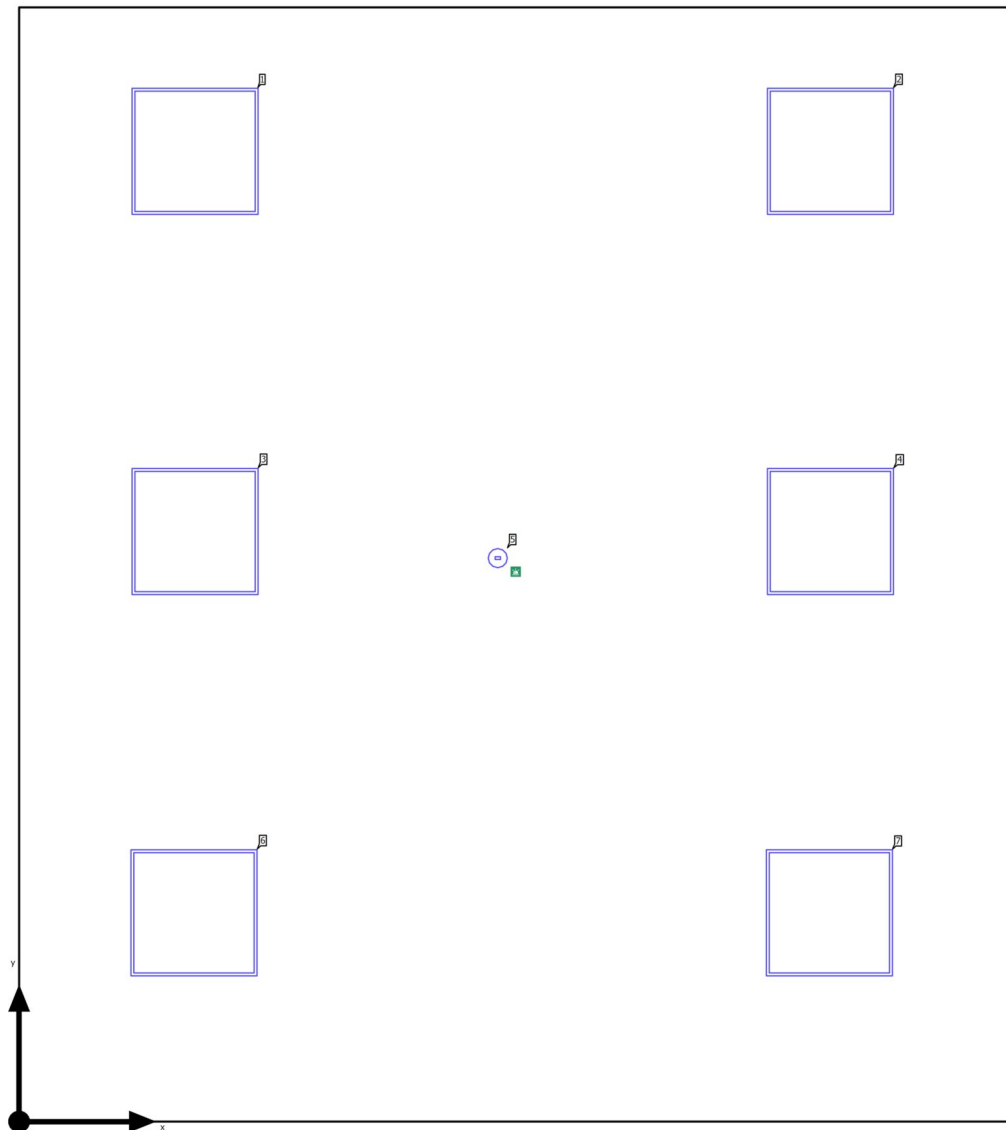Luminaire layout plan

Building A · GROUND FLOOR · 111 CAD


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.260 m	2.660 m	2.768 m	5

Building A · GROUND FLOOR · 111 CAD

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.831 m	4.581 m	2.776 m	1
3.831 m	4.581 m	2.776 m	2
0.831 m	2.786 m	2.776 m	3
3.831 m	2.786 m	2.776 m	4
0.826 m	0.986 m	2.776 m	6
3.826 m	0.986 m	2.776 m	7


Building A · GROUND FLOOR · 111 CAD

Luminaire list

Φ_{total} 15000 lm		P_{total} 99.0 W		Luminous efficacy 151.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25	(_LTRevAB)	 0.9 W	280 lm (100 %)	-		
6	ETAP	-	U2B-M210-MI-840-025D	(_LTRevAD)	16.5 W	2495 lm	151.2 lm/W		

Building A · GROUND FLOOR · 111 CAD (Emergency light scene)

Calculation objects

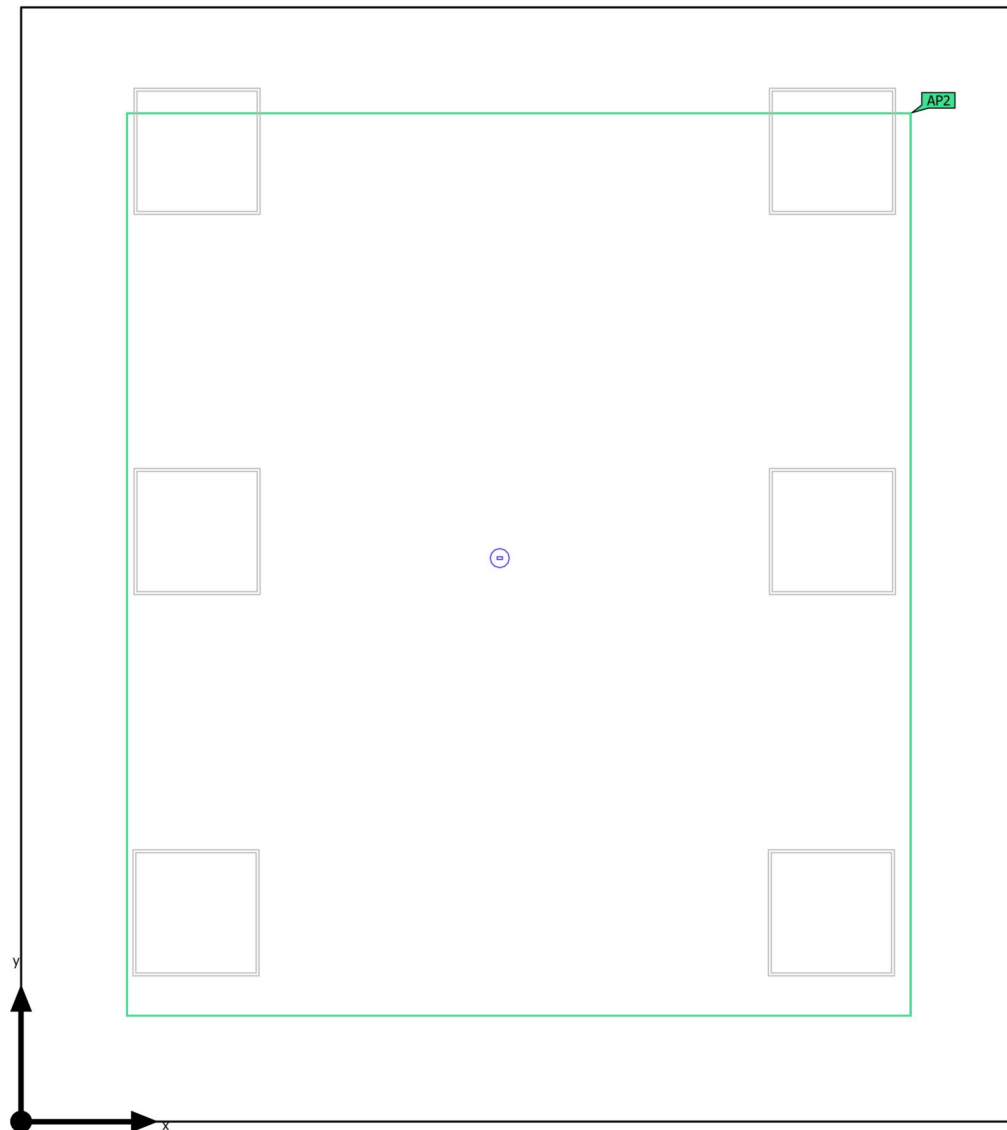

Building A · GROUND FLOOR · 111 CAD (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (111 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.97 lx (≥ 0.50 lx) ✓	9.71 lx	0.20 (≥ 0.025) ✓	AP2

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Calculation objects

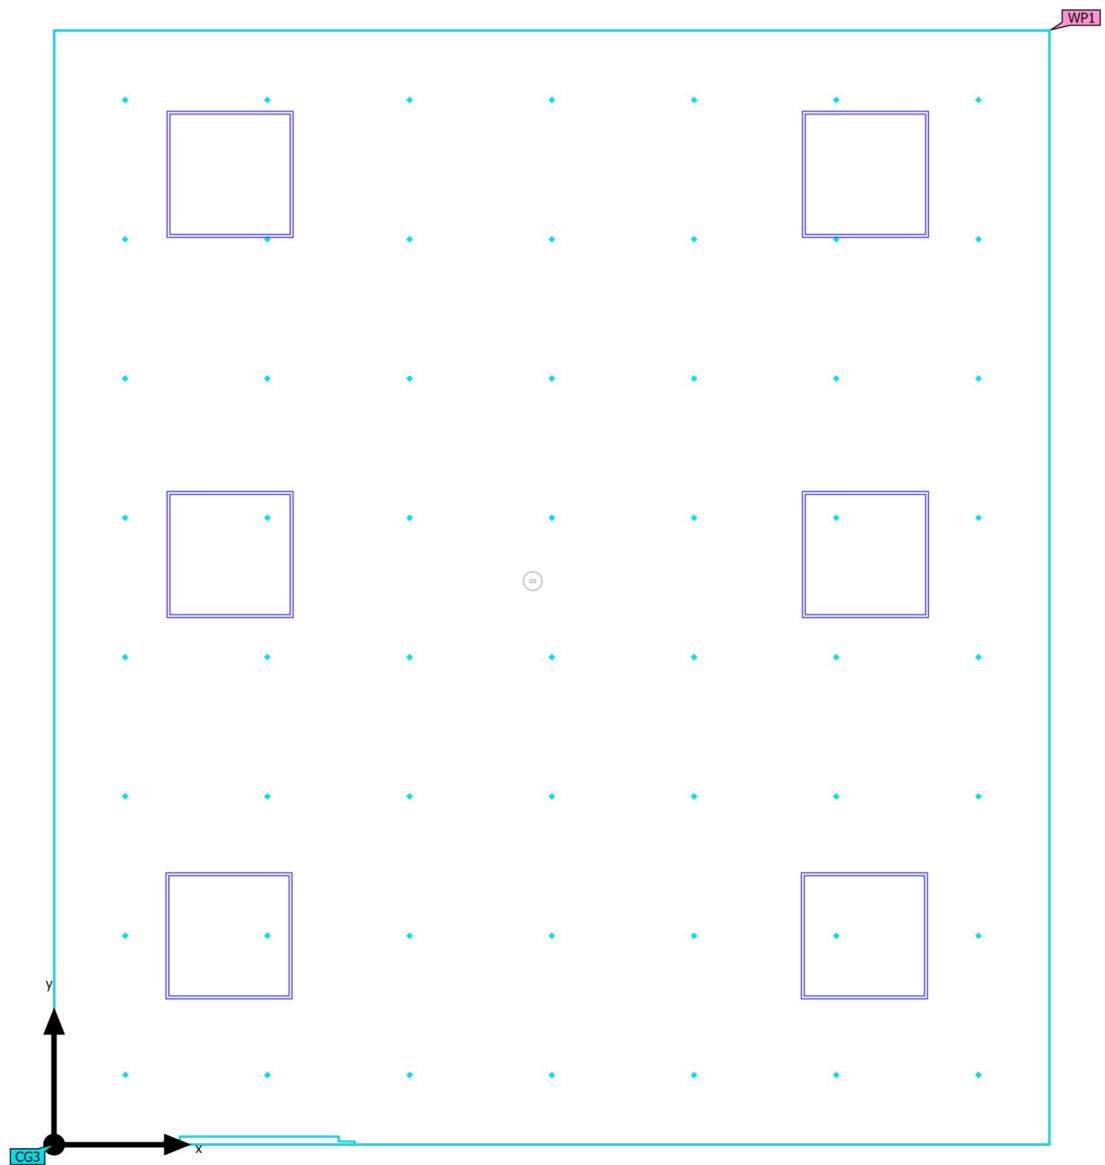

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (111 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	392 lx (≥ 500 lx) ✗	225 lx	491 lx	0.57 (≥ 0.60) ✗	0.46	WP1

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Calculation objects

111 CAD Glare Surface (RUG)

Strongest glare at	135°
max	15.3
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG3

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

Calculation objects



111 CAD Glare Surface (RUG)



Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 111 CAD (Emergency light scene)



Anti panic surface (111 CAD)

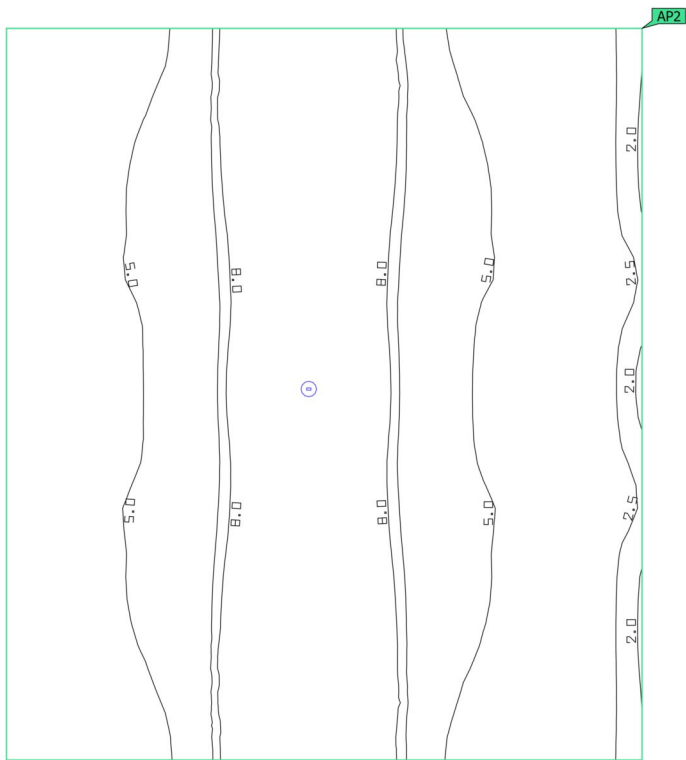

Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (111 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.97 lx (≥ 0.50 lx) ✓	9.71 lx	0.20 (≥ 0.025) ✓	AP2

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 111 CAD (Light scene 1)

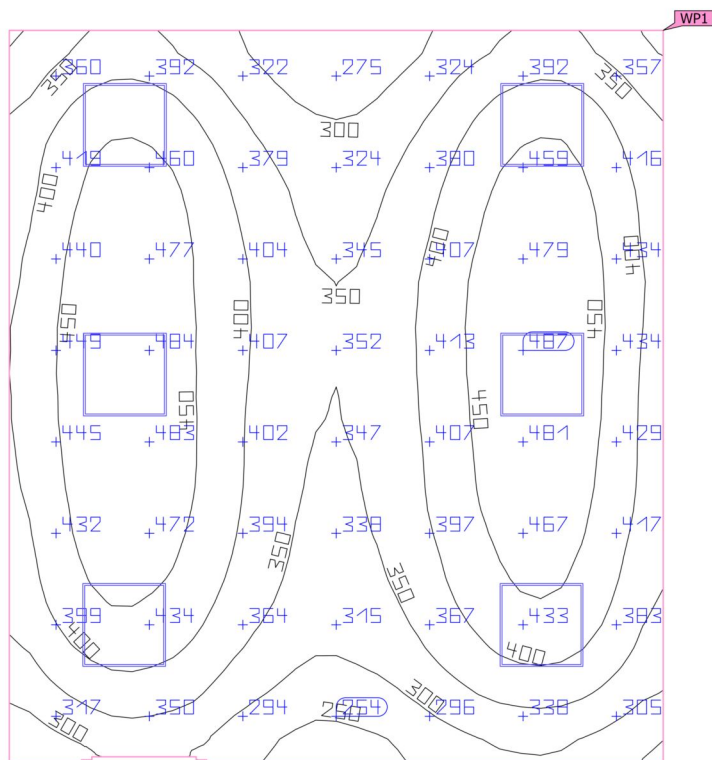
Working plane (111 CAD)

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (111 CAD)	392 lx	225 lx	491 lx	0.57	0.46	WP1
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 112 CAD (Emergency light scene)

Summary

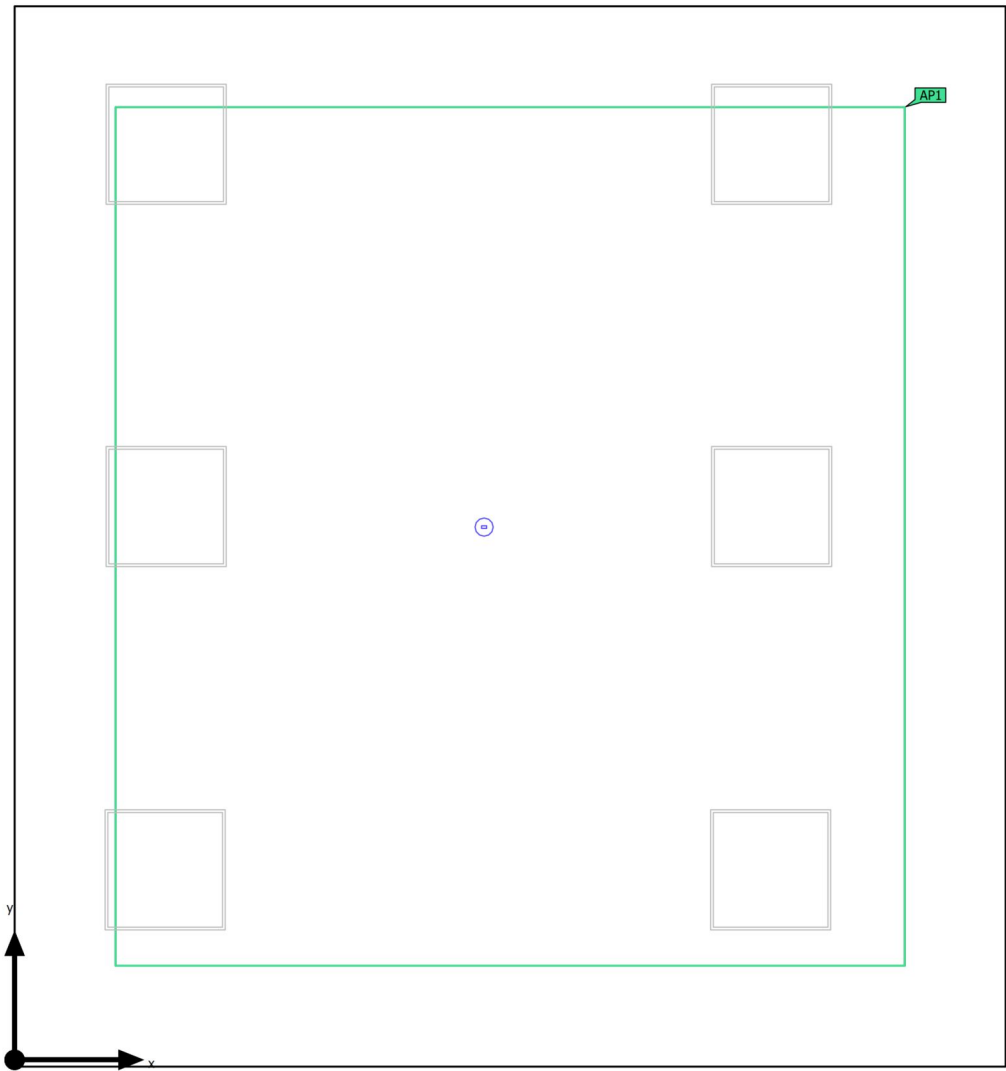

Ground area	25.80 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 112 CAD (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.03 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (112 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.04 lx (≥ 0.50 lx) ✓	9.71 lx	0.11 (≥ 0.025) ✓	AP1

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Summary

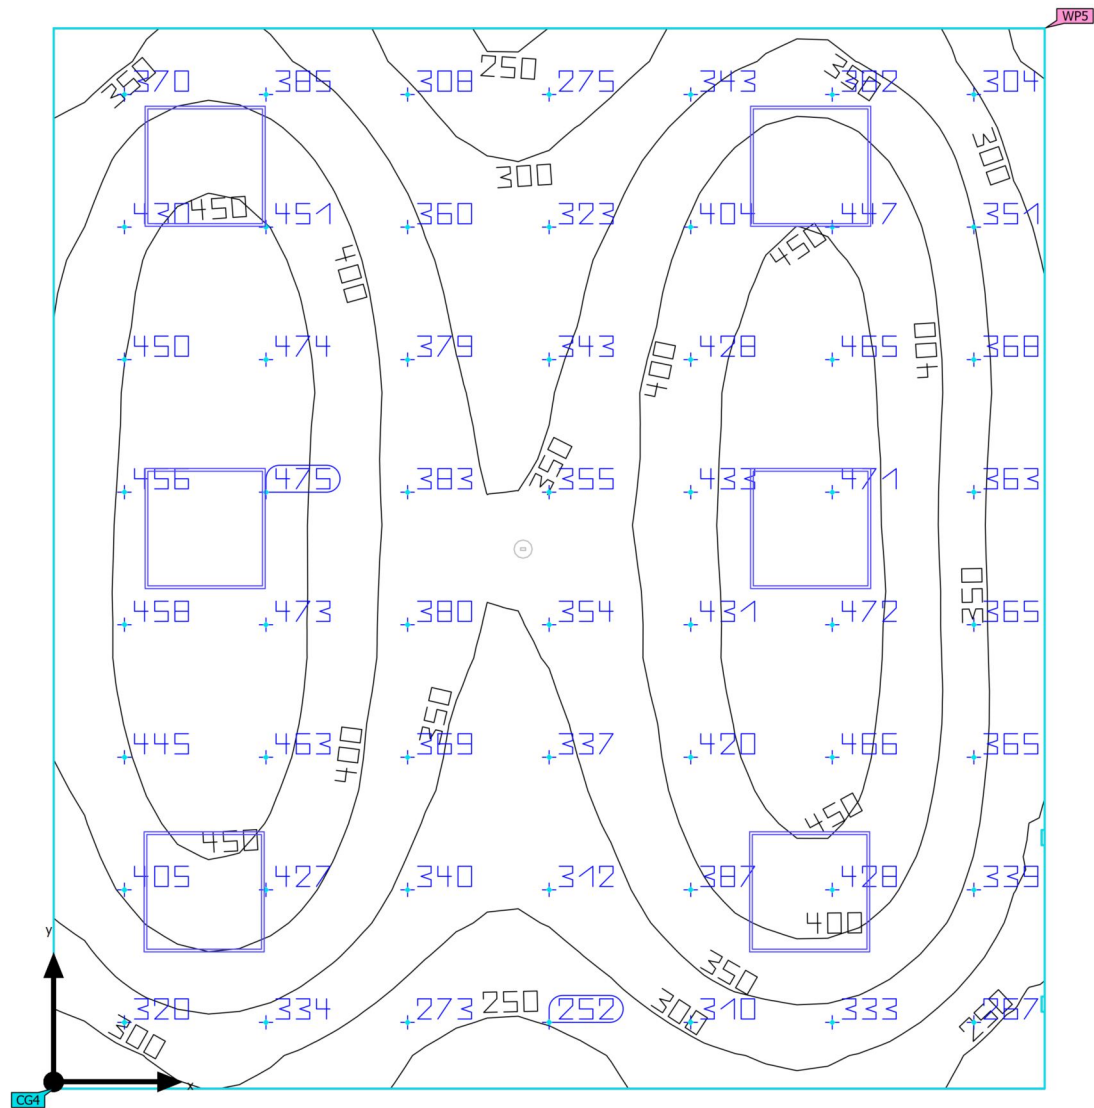

Ground area	25.80 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	382 lx	$\geq 500 \text{ lx}$	✗	WP5
	$U_o (g_1)$	0.54	≥ 0.60	✗	WP5
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[154 - 245] kWh/a	max. 950 kWh/a	✓	
Space	Lighting power density	3.84 W/m ²	–		
		1.00 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.910 m x 5.254 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
6	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 112 CAD

Luminaire layout plan

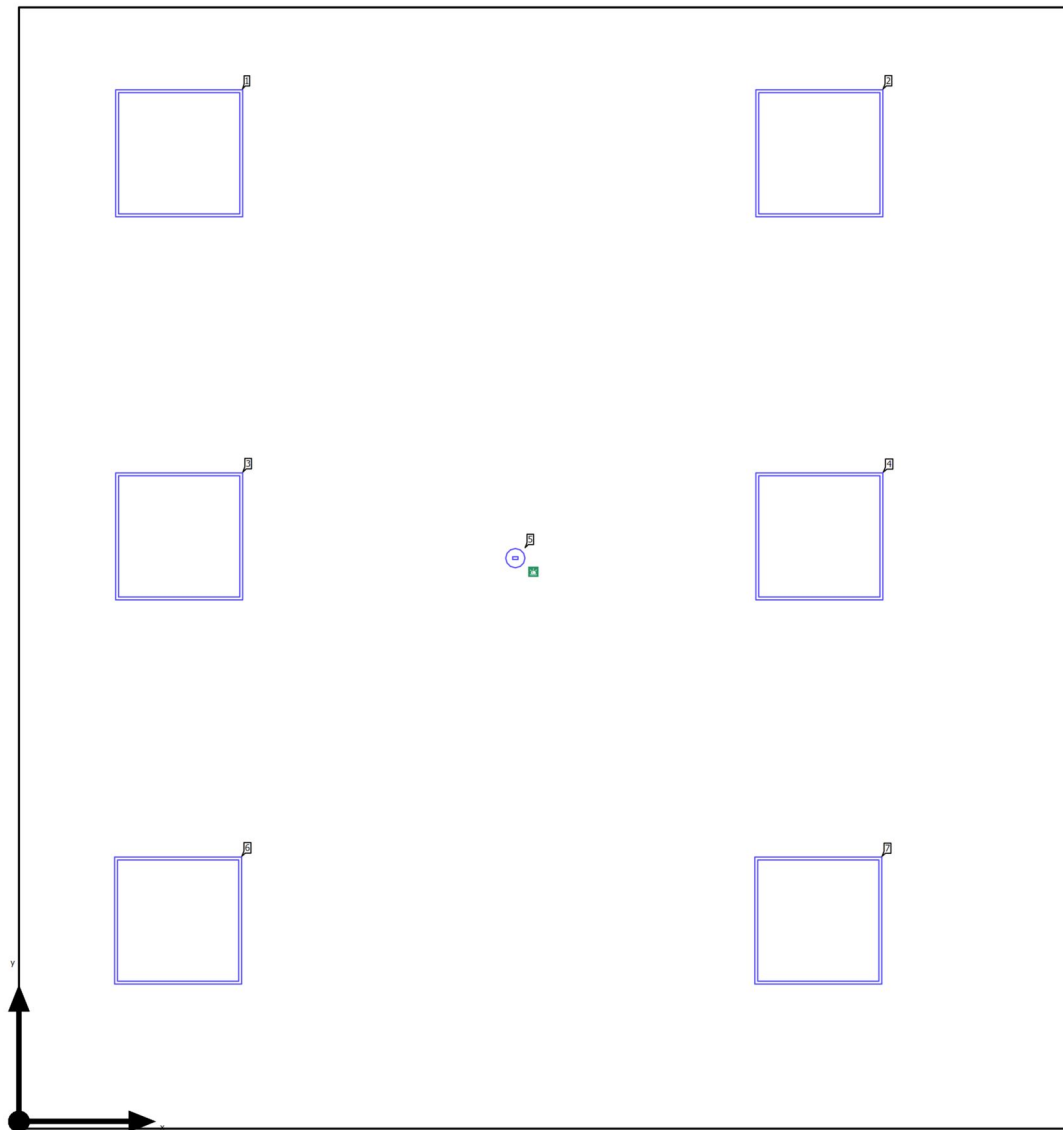

Building A · GROUND FLOOR · 112 CAD


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.326 m	2.640 m	2.768 m	5

Building A · GROUND FLOOR · 112 CAD

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.751 m	4.537 m	2.776 m	1
3.751 m	4.537 m	2.776 m	2
0.751 m	2.742 m	2.776 m	3
3.751 m	2.742 m	2.776 m	4
0.746 m	0.942 m	2.776 m	6
3.746 m	0.942 m	2.776 m	7


Building A · GROUND FLOOR · 112 CAD

Luminaire list

Φ_{total} 15000 lm		P_{total} 99.0 W		Luminous efficacy 151.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25	(_LTRevAB)		0.9 W	280 lm (100 %)	-	
6	ETAP	-	U2B-M210-MI-840-025D	(_LTRevAD)		16.5 W	2495 lm	151.2 lm/W	

Building A · GROUND FLOOR · 112 CAD (Emergency light scene)

Calculation objects

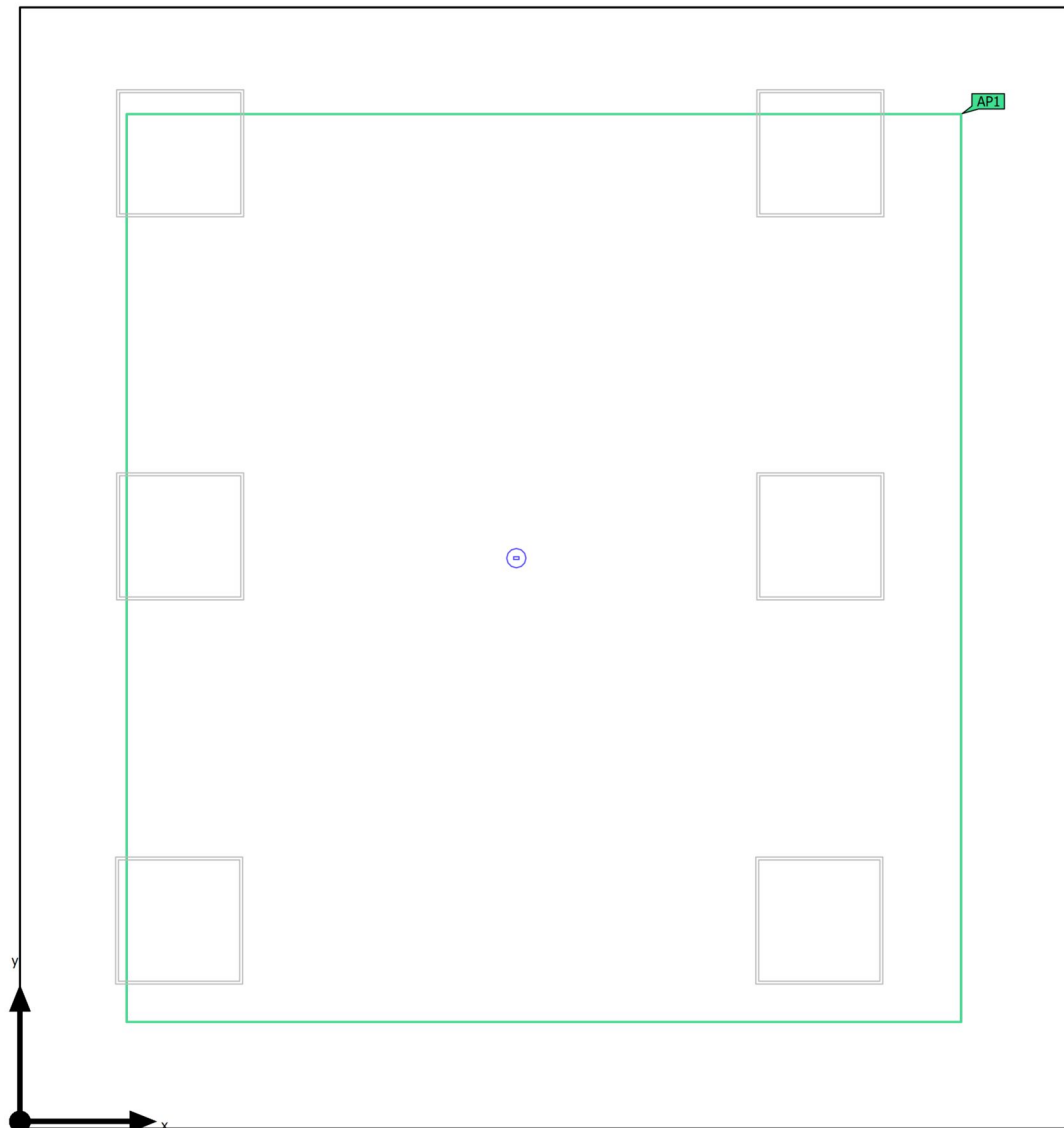

Building A · GROUND FLOOR · 112 CAD (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (112 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.04 lx (≥ 0.50 lx) ✓	9.71 lx	0.11 (≥ 0.025) ✓	AP1

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects

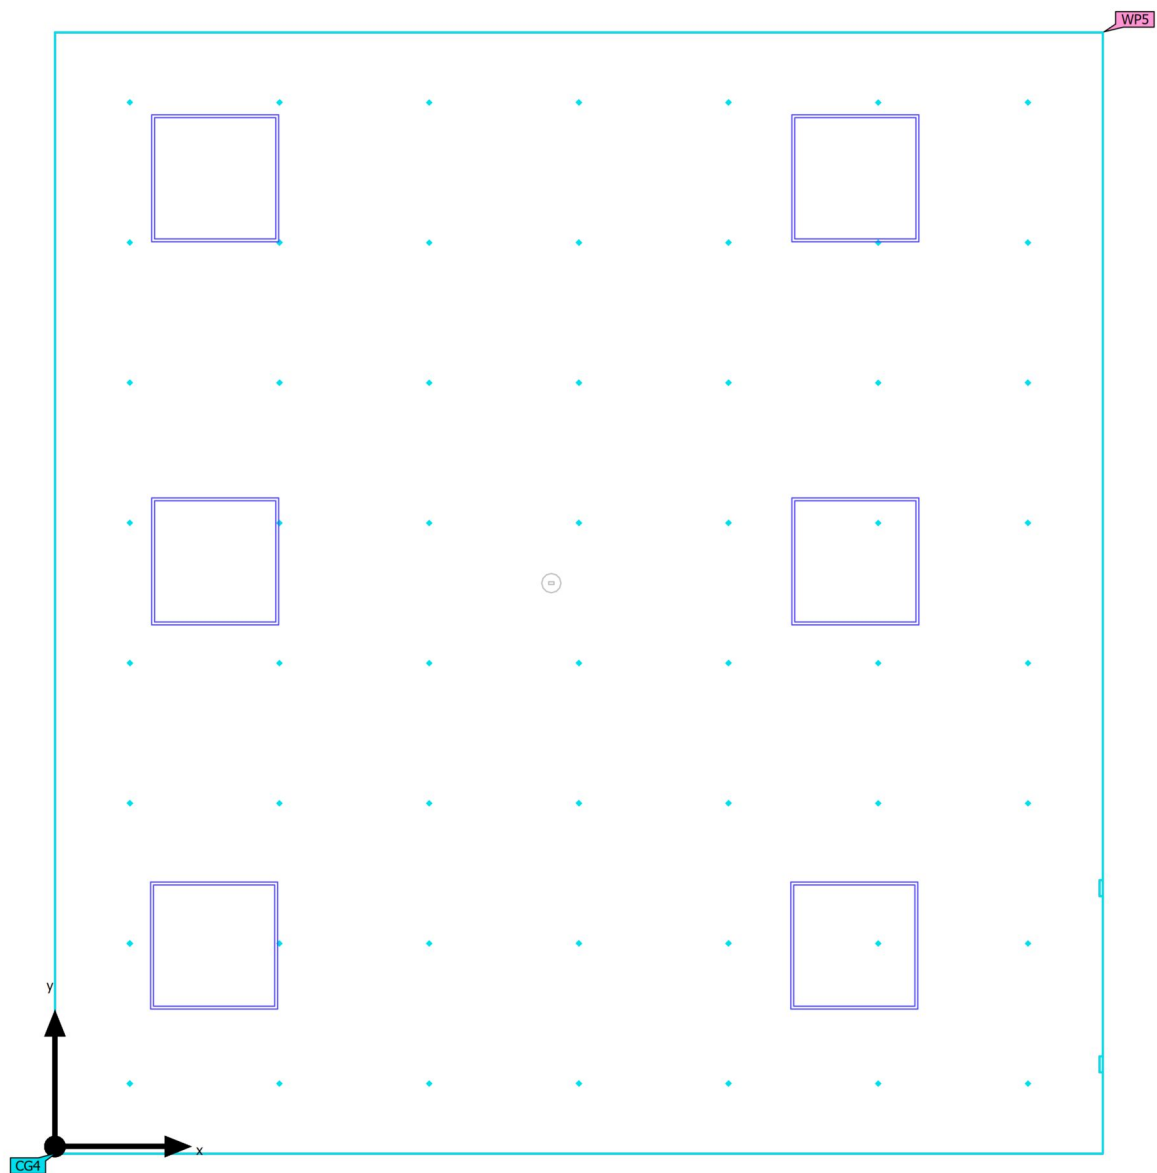

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects

Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (112 CAD) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	382 lx (≥ 500 lx) ✗	208 lx	487 lx	0.54 (≥ 0.60) ✗	0.43	WP5

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects

112 CAD Glare Surface (RUG)

Strongest glare at	120°
max	16.0
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG4

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects

112 CAD Glare Surface (RUG)



Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects


112 CAD Glare Surface (R_G)

Strongest glare at	135°
max	> 90
Target	-
Viewing sector	0° - 360°
Step width	15°
Angle of inclination	-2°
Height	1.200 m
Index	CG4
Method	Simplified calculation according to EN 12464

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Calculation objects



112 CAD Glare Surface (R_G)

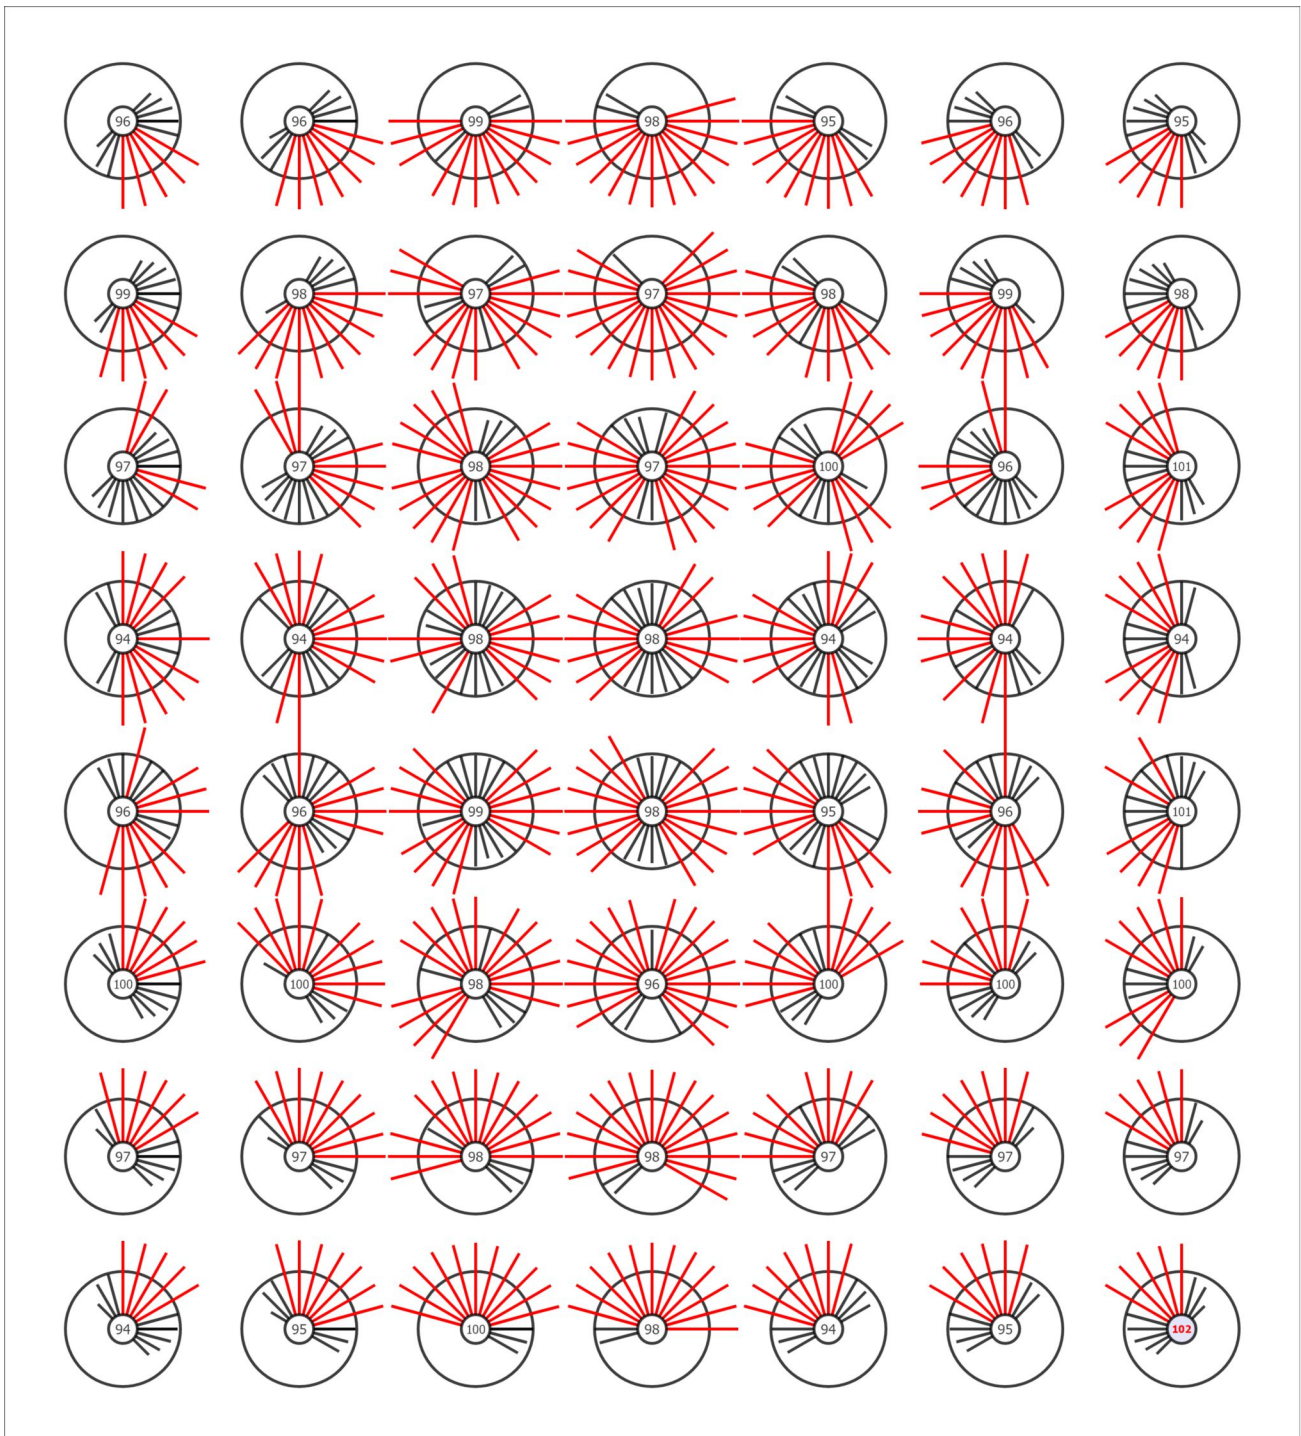

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 112 CAD (Emergency light scene)

Anti panic surface (112 CAD)

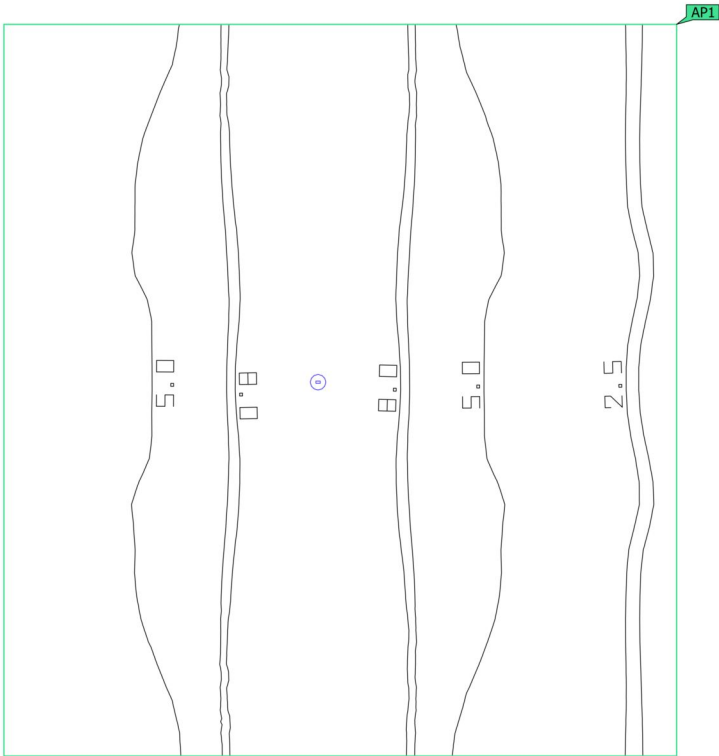



Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (112 CAD) Perpendicular illuminance (adaptive) Height: 0.000 m	1.04 lx (≥ 0.50 lx) ✓	9.71 lx	0.11 (≥ 0.025) ✓	AP1

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 112 CAD (Light scene 1)

Working plane (112 CAD)

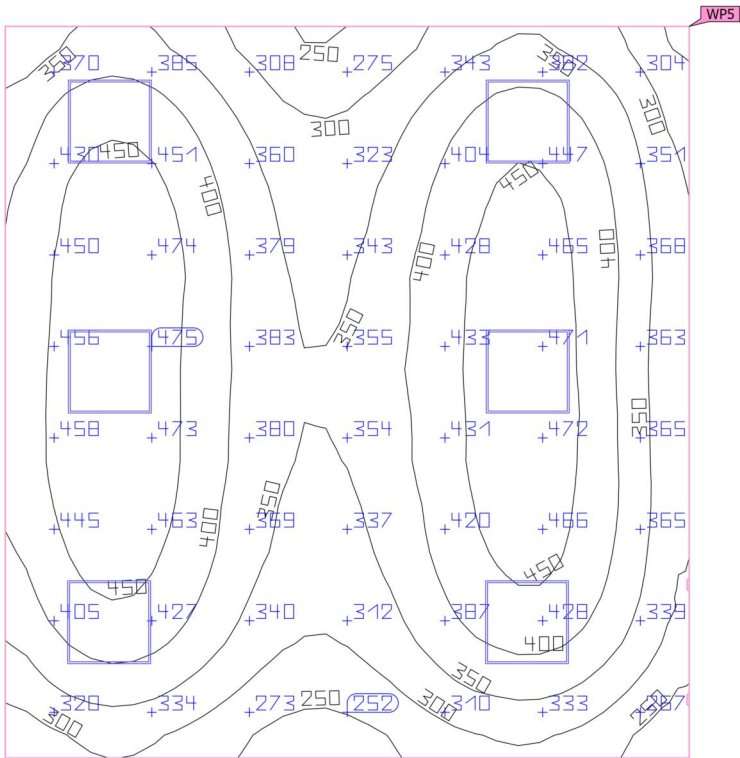


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (112 CAD)	382 lx	208 lx	487 lx	0.54	0.43	WP5
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 113 OFFICE (Emergency light scene)

Summary

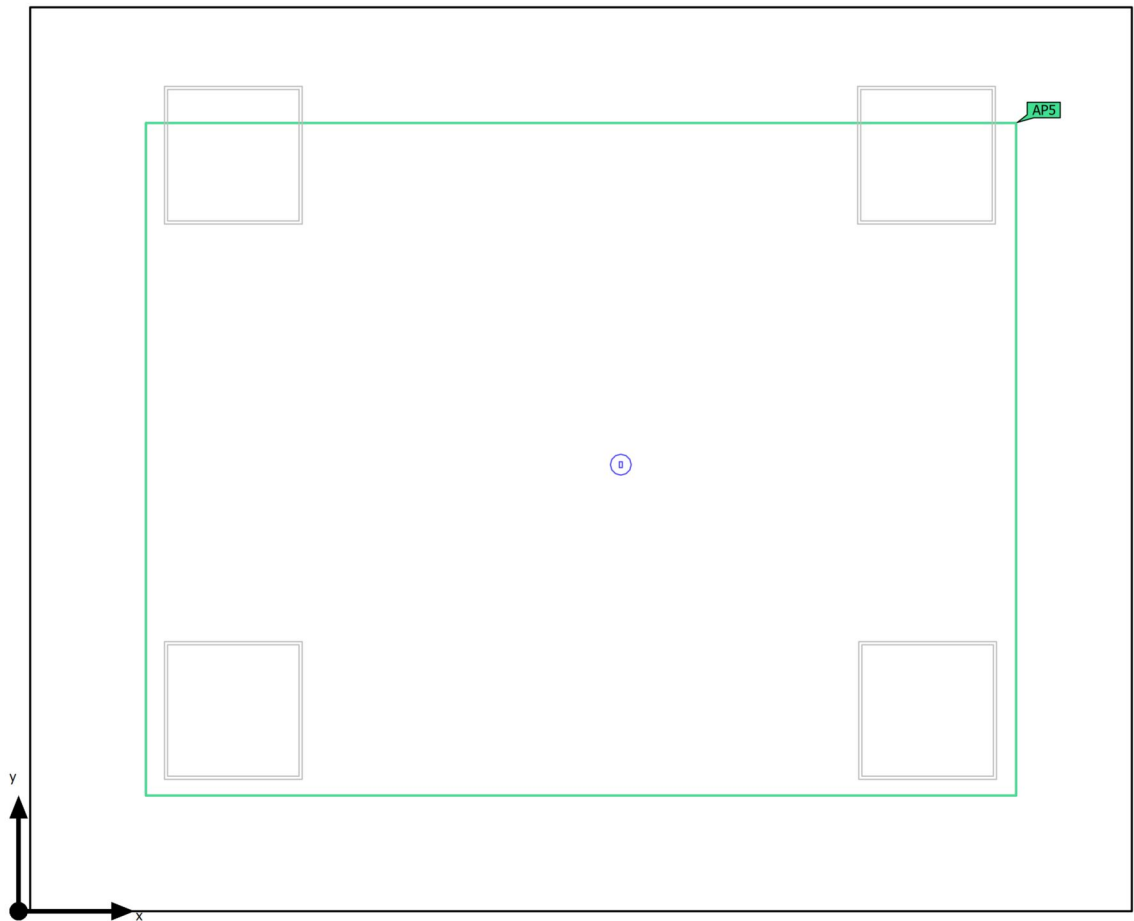

Ground area	18.60 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 113 OFFICE (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.05 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.87 lx (≥ 0.50 lx) ✓	9.67 lx	0.40 (≥ 0.025) ✓	AP5

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Summary

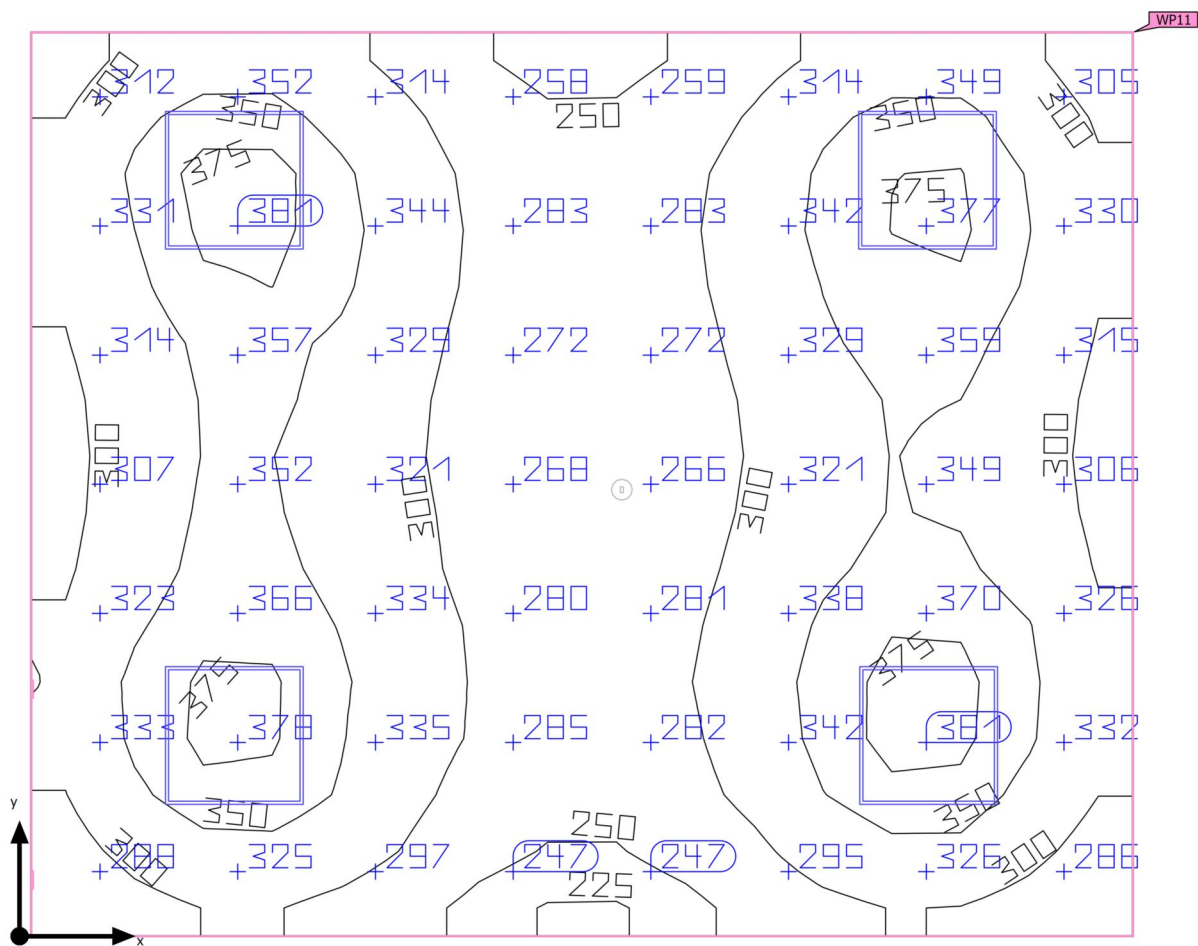

Ground area	18.60 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	317 lx	$\geq 500 \text{ lx}$	✗	WP11
	$U_o (g_1)$	0.70	≥ 0.60	✓	WP11
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	15	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	[103 - 163] kWh/a	max. 700 kWh/a	✓	
Space	Lighting power density	3.55 W/m ²	–		
		1.12 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.760 m x 3.907 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
4	ETAP	-	U2B-M210-MI-840-025D (_LTRevAD)	15	16.5 W	2495 lm	151.2 lm/W

Building A · GROUND FLOOR · 113 OFFICE

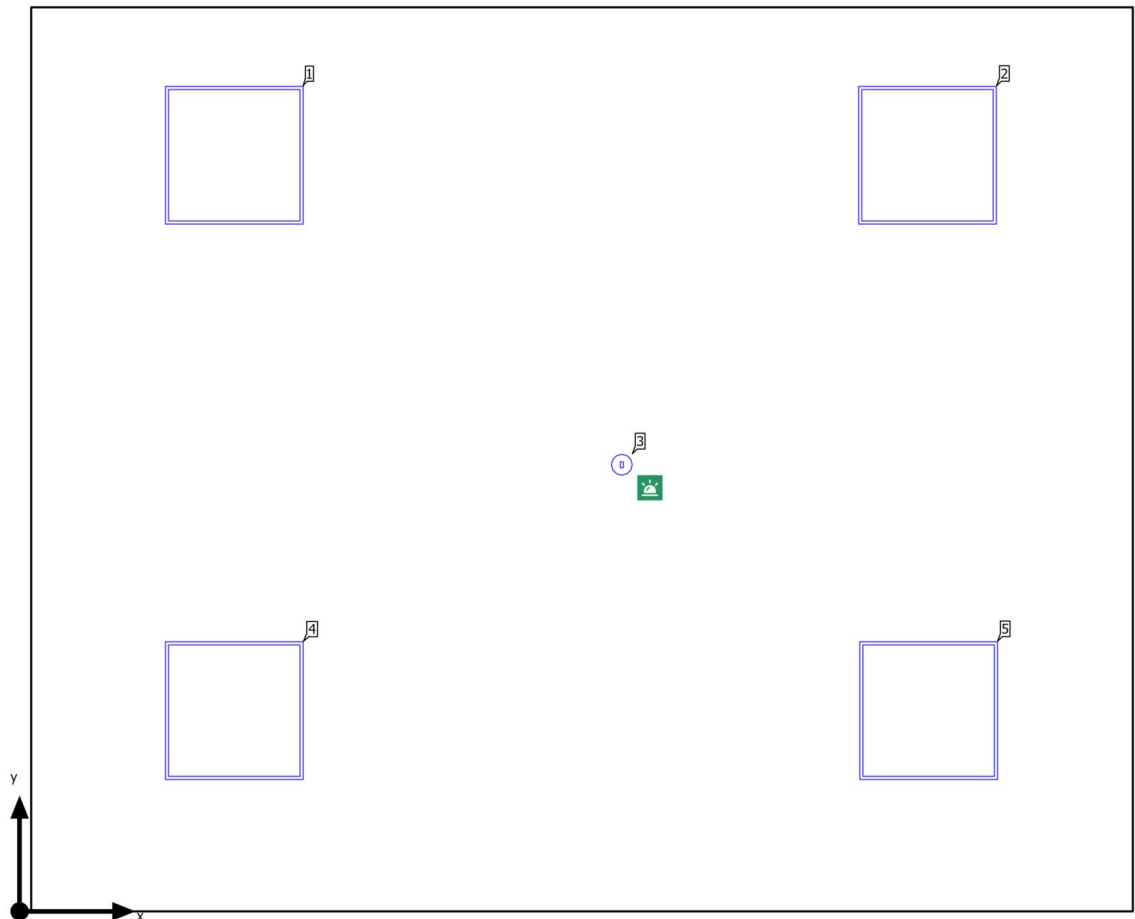Luminaire layout plan

Building A · GROUND FLOOR · 113 OFFICE


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.602 m	1.930 m	2.768 m	3

Building A · GROUND FLOOR · 113 OFFICE

Luminaire layout plan

Manufacturer	ETAP	P	16.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	2495 lm
Article name	U2B-M210-MI-840-025D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.928 m	3.268 m	2.776 m	1
3.923 m	3.268 m	2.776 m	2
0.928 m	0.868 m	2.776 m	4
3.928 m	0.868 m	2.776 m	5


Building A · GROUND FLOOR · 113 OFFICE

Luminaire list

Φ_{total} 10000 lm		P_{total} 66.0 W		Luminous efficacy 151.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25	(_LTRevAB)		0.9 W	280 lm (100 %)	-	
4	ETAP	-	U2B-M210-MI-840-025D	(_LTRevAD)		16.5 W	2495 lm	151.2 lm/W	

Building A · GROUND FLOOR · 113 OFFICE (Emergency light scene)

Calculation objects

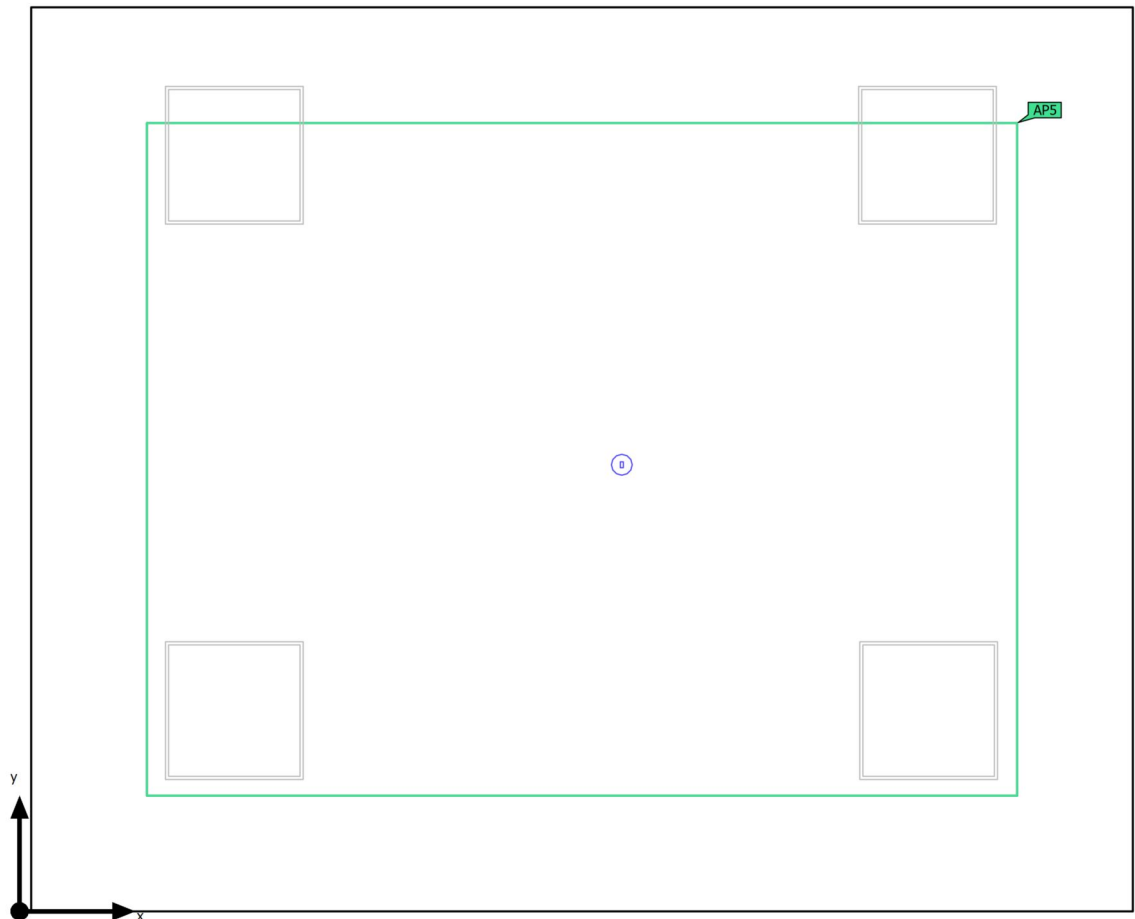

Building A · GROUND FLOOR · 113 OFFICE (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.87 lx (≥ 0.50 lx) ✓	9.67 lx	0.40 (≥ 0.025) ✓	AP5

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Calculation objects

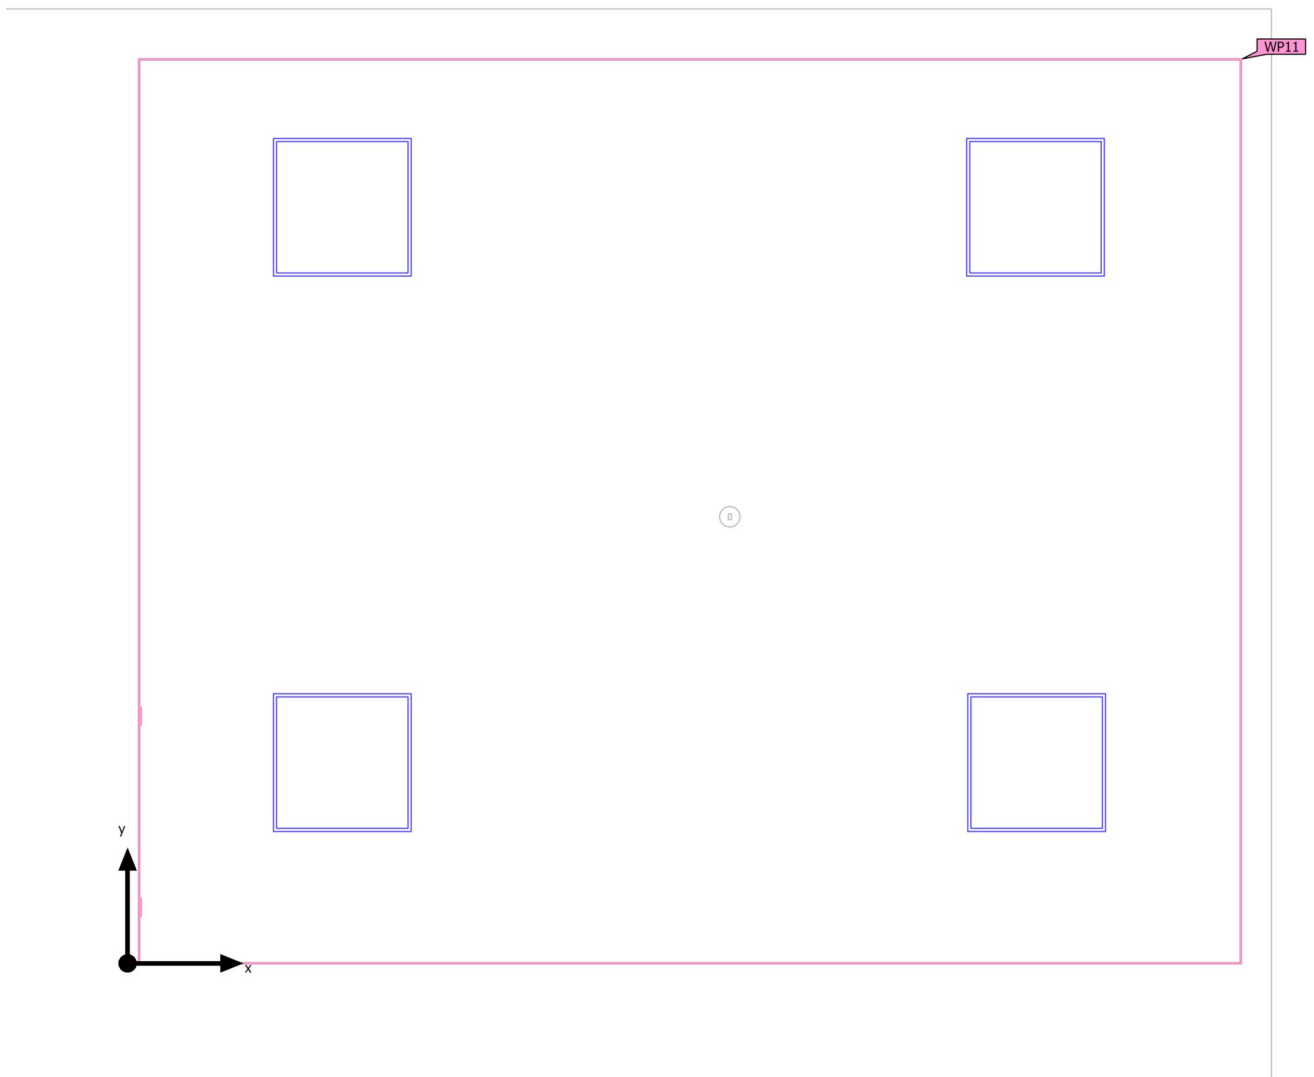

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Calculation objects



Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.700 m, Wall zone: 0.000 m	317 lx (≥ 500 lx) ✗	222 lx	382 lx	0.70 (≥ 0.60) ✓	0.58	WP11

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 113 OFFICE (Emergency light scene)

Anti panic surface (113 OFFICE)

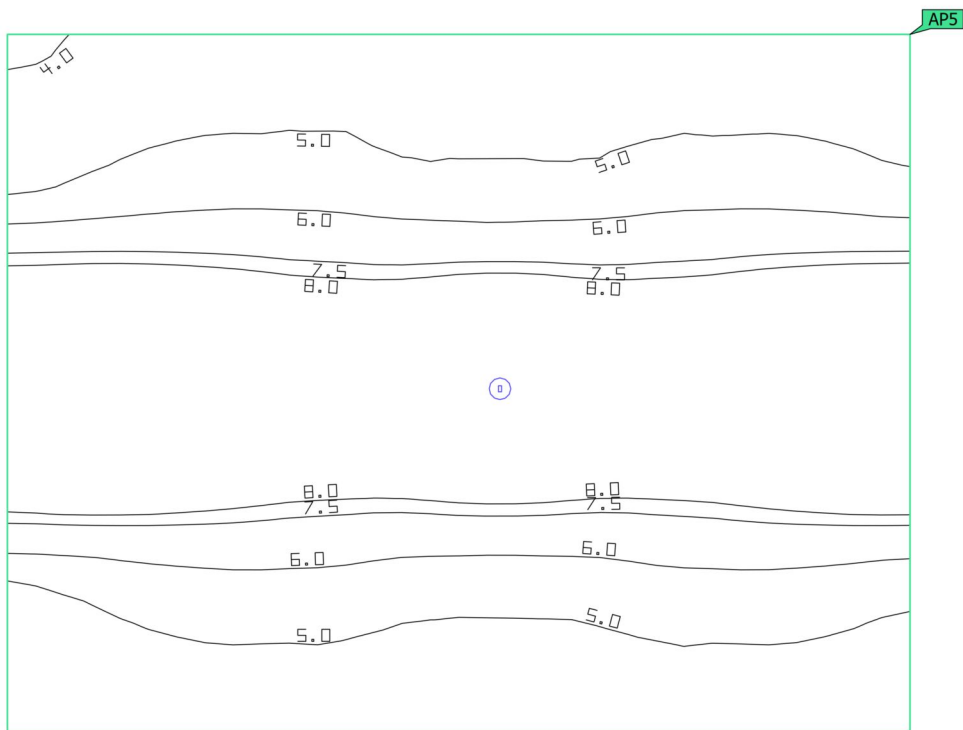



Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (113 OFFICE) Perpendicular illuminance (adaptive) Height: 0.000 m	3.87 lx (≥ 0.50 lx) ✓	9.67 lx	0.40 (≥ 0.025) ✓	AP5

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 113 OFFICE (Light scene 1)

Working plane (113 OFFICE)

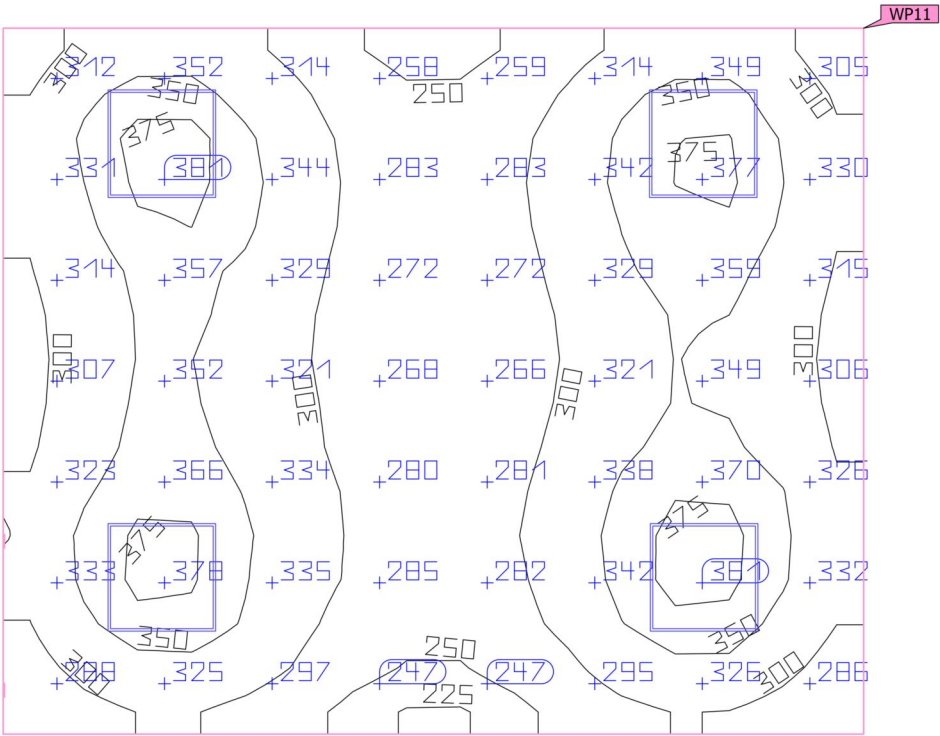


Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (113 OFFICE)	317 lx	222 lx	382 lx	0.70	0.58	WP11
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✓		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 114 VISITORS (Emergency light scene)

Summary

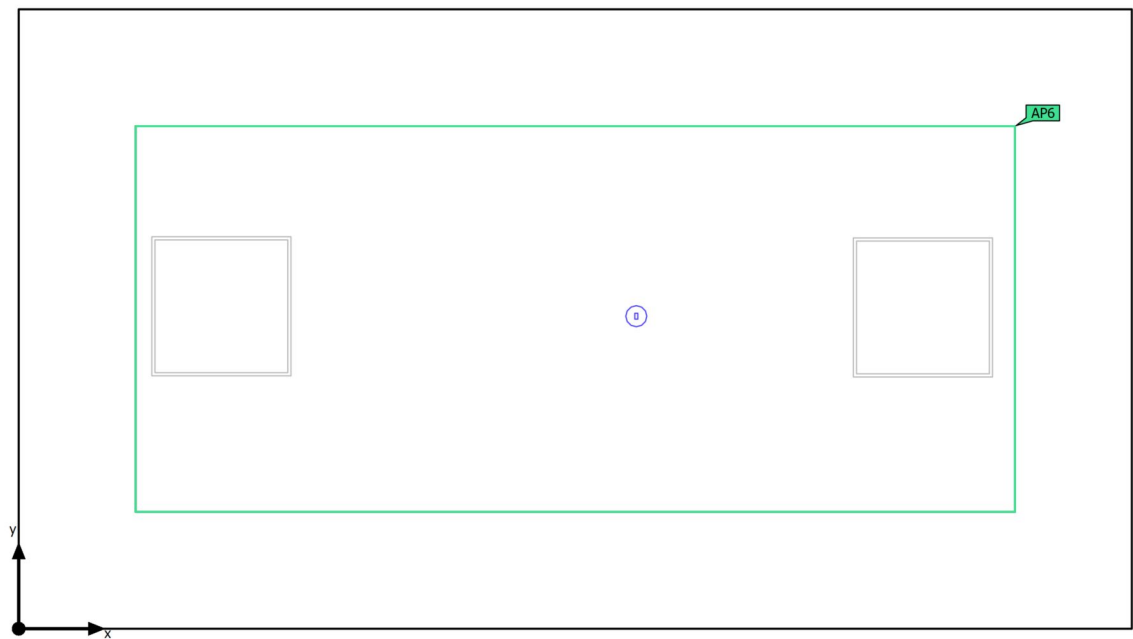

Ground area	12.61 m ²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.768 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 114 VISITORS (Emergency light scene)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Space	Lighting power density	0.07 W/m ²	–		

Anti panic surface

Properties	E _{min} (Target)	E _{max}	U _d (Target)	Index
Anti panic surface (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.000 m	5.14 lx (≥ 0.50 lx) ✓	9.68 lx	0.53 (≥ 0.025) ✓	AP6

Notes on planning:


The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Luminaire list

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	ETAP	-	K9R212/3-AX1-D800A25 (_LTRevAB)	 0.9 W	280 lm (100 %)	–

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Summary

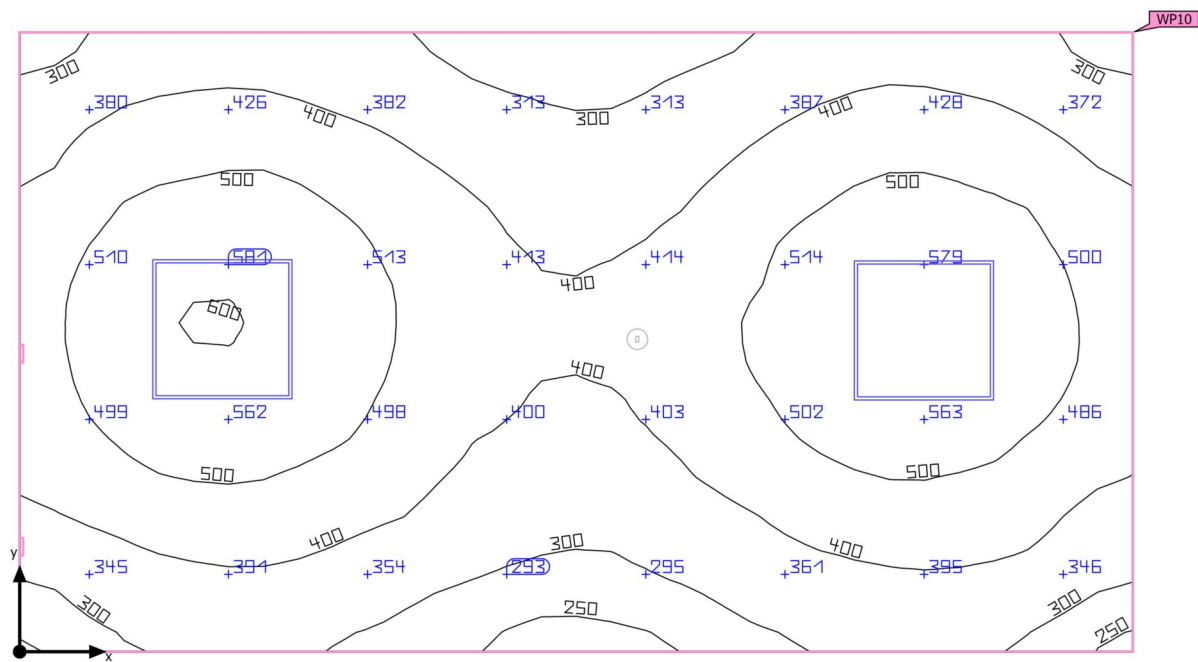

Ground area	12.61 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	2.700 m
Mounting height	2.776 m
Height _{Working plane}	0.700 m
Wall zone _{Working plane}	0.000 m

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Working plane	$\bar{E}_{\text{perpendicular}}$	425 lx	$\geq 500 \text{ lx}$	✗	WP10
	$U_o (g_1)$	0.55	≥ 0.60	✗	WP10
Glare valuation ⁽¹⁾	$R_{UG, \text{max}}$	17	≤ 19	✓	
Energy estimation ⁽²⁾	Consumption	151 kWh/a	max. 450 kWh/a	✓	
Space	Lighting power density	4.84 W/m ²	–		
		1.14 W/m ² /100 lx	–		

(1) Based on a rectangular space of 4.760 m x 2.650 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R_{UG}	P	Φ	Luminous efficacy
2	ETAP	-	U2B-M210-MI-830-045D (_LTRevAD)	17	30.5 W	4490 lm	147.2 lm/W

Building A · GROUND FLOOR · 114 VISITORS

Luminaire layout plan

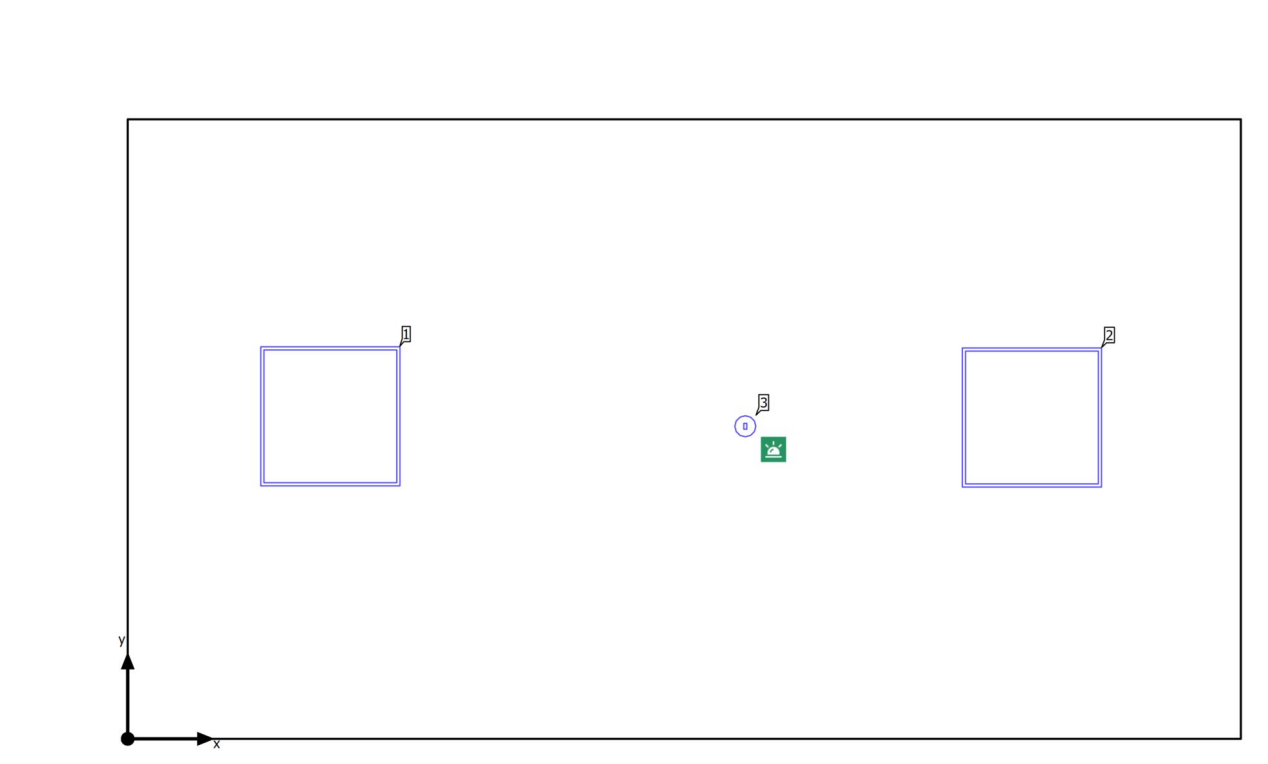

Building A · GROUND FLOOR · 114 VISITORS


Luminaire layout plan

Manufacturer	ETAP	P	0.0 W
Article No.	-	P _{Emergency lighting}	0.9 W
Article name	K9R212/3-AX1-D800A25 (_LTRevAB)	Φ _{Luminaire}	0 lm
		Φ _{Emergency lighting}	280 lm
Fitting	1x light	ELF	100 %

Individual luminaires

X	Y	Mounting height	Luminaire
2.641 m	1.337 m	2.768 m	3

Building A · GROUND FLOOR · 114 VISITORS

Luminaire layout plan

Manufacturer	ETAP	P	30.5 W
Article No.	-	$\Phi_{\text{Luminaire}}$	4490 lm
Article name	U2B-M210-MI-830-045D (_LTRevAD)		
Fitting	1x LED		

Individual luminaires

X	Y	Mounting height	Luminaire
0.867 m	1.379 m	2.776 m	1
3.867 m	1.375 m	2.776 m	2


Building A · GROUND FLOOR · 114 VISITORS

Luminaire list

Φ_{total} 9000 lm		P_{total} 61.0 W		Luminous efficacy 147.5 lm/W		$\Phi_{\text{Emergency lighting}}$ 280 lm		$P_{\text{Emergency lighting}}$ 0.9 W	
pcs.	Manufacturer	Article No.	Article name			P	Φ	Luminous efficacy	
1	ETAP	-	K9R212/3-AX1-D800A25	(_LTRevAB)		0.9 W	280 lm (100 %)	-	
2	ETAP	-	U2B-M210-MI-830-045D	(_LTRevAD)		30.5 W	4490 lm	147.2 lm/W	

Building A · GROUND FLOOR · 114 VISITORS (Emergency light scene)

Calculation objects

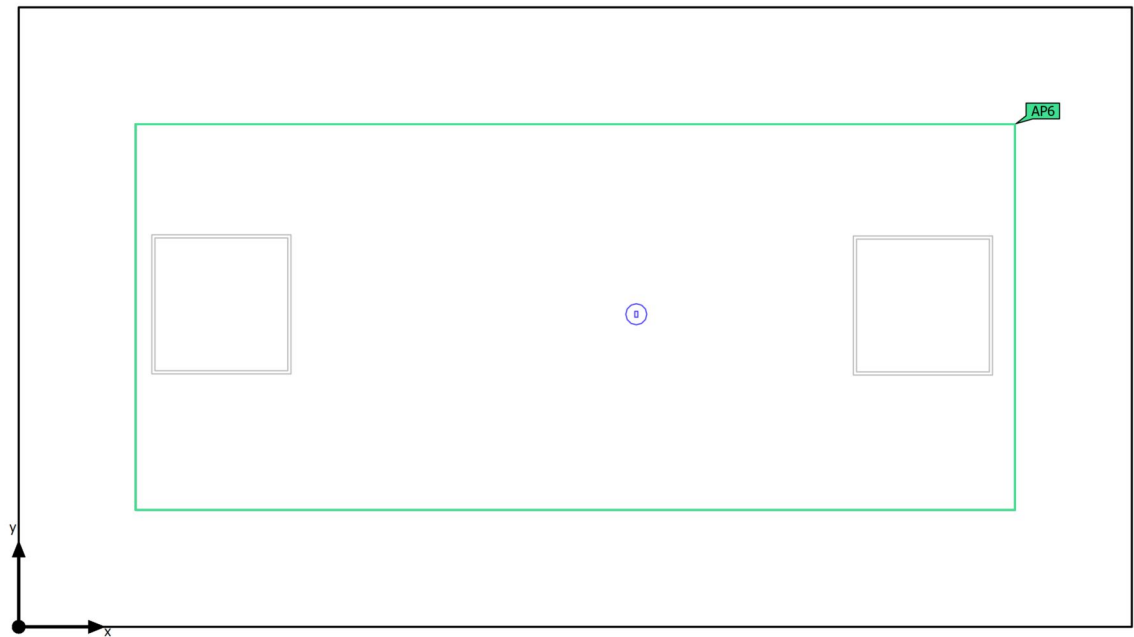

Building A · GROUND FLOOR · 114 VISITORS (Emergency light scene)

Calculation objects

Anti panic surfaces


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.000 m	5.14 lx (≥ 0.50 lx) ✓	9.68 lx	0.53 (≥ 0.025) ✓	AP6

Notes on planning:

The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Calculation objects

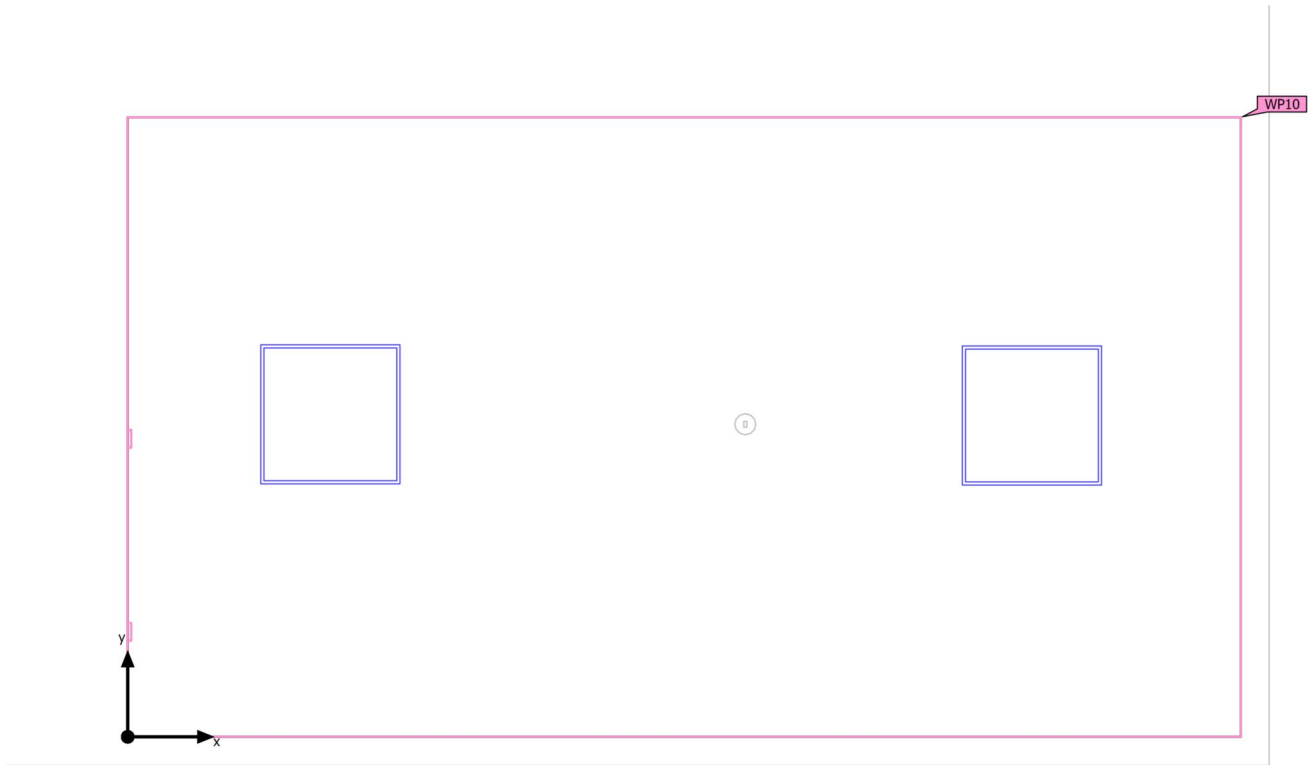

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Calculation objects


Working planes

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (114 VISITORS)	425 lx	235 lx	600 lx	0.55	0.39	WP10
Perpendicular illuminance (adaptive)	(≥ 500 lx)			(≥ 0.60)		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building A · GROUND FLOOR · 114 VISITORS (Emergency light scene)

Anti panic surface (114 VISITORS)


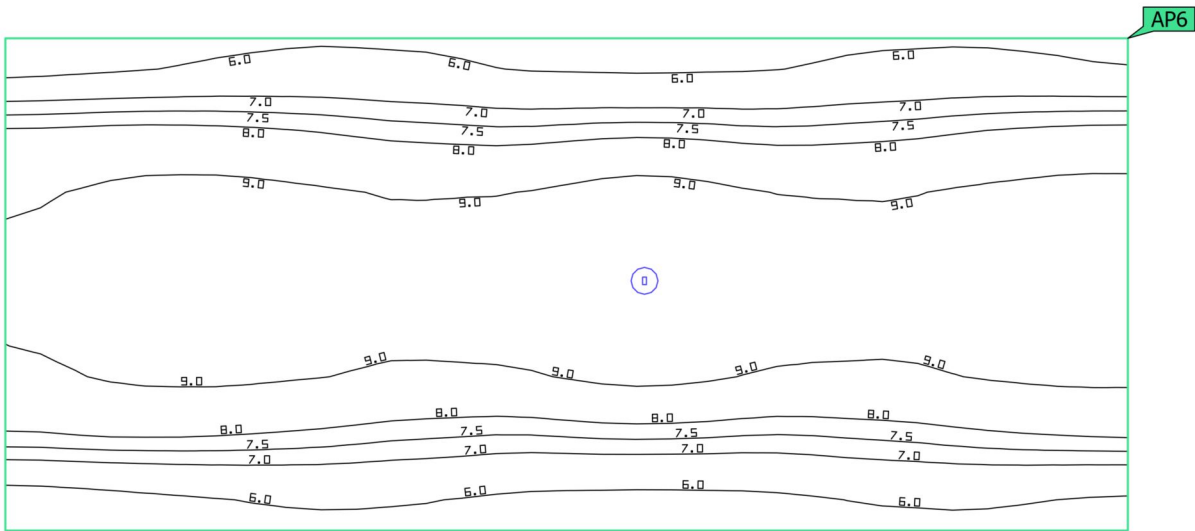


Properties	E_{min} (Target)	E_{max}	U_d (Target)	Index
Anti panic surface (114 VISITORS) Perpendicular illuminance (adaptive) Height: 0.000 m	5.14 lx (≥ 0.50 lx) ✓	9.68 lx	0.53 (≥ 0.025) ✓	AP6

Notes on planning:
The emergency lighting scene was calculated without reflection and taking into account the placed furniture.

Building A · GROUND FLOOR · 114 VISITORS (Light scene 1)

Working plane (114 VISITORS)

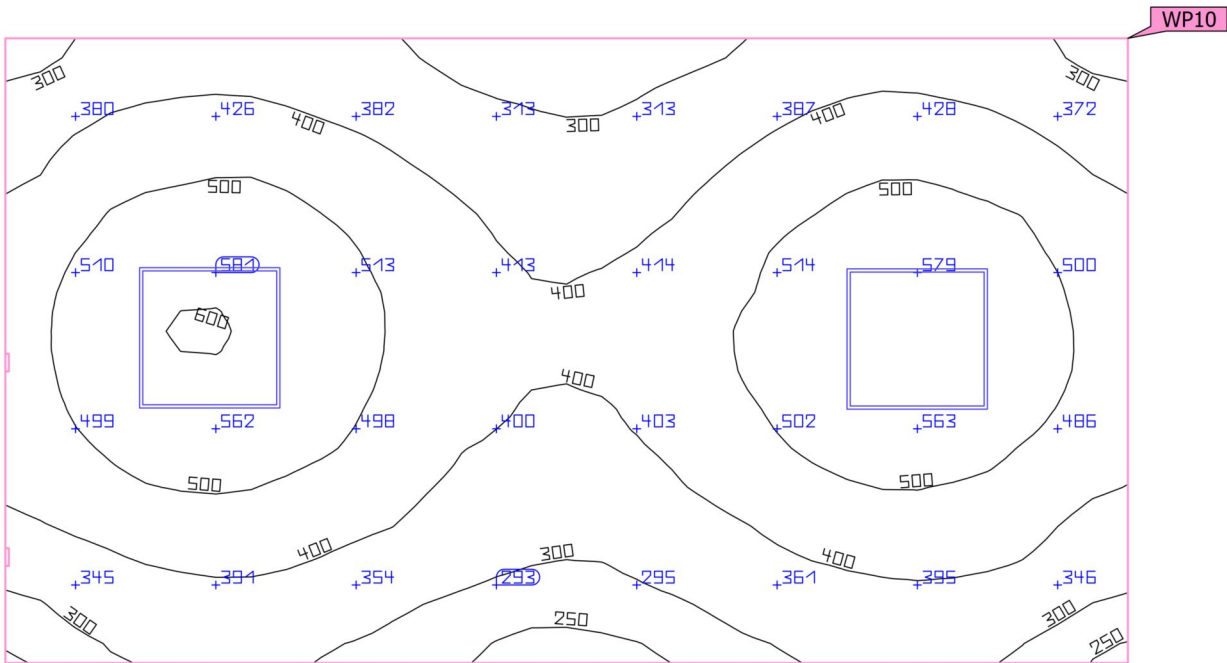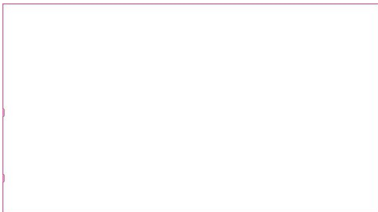

Properties	$\bar{E}$ (Target)	E_{min}	E_{max}	$U_o (g_1)$ (Target)	g_2	Index
Working plane (114 VISITORS)	425 lx	235 lx	600 lx	0.55	0.39	WP10
Perpendicular illuminance (adaptive)	≥ 500 lx			≥ 0.60		
Height: 0.700 m, Wall zone: 0.000 m	✗			✗		

Utilisation profile: DIALux presetting (5.26.2 Standard (office))