


Building B · FIRST FOOR (Light scene 1)

Room list

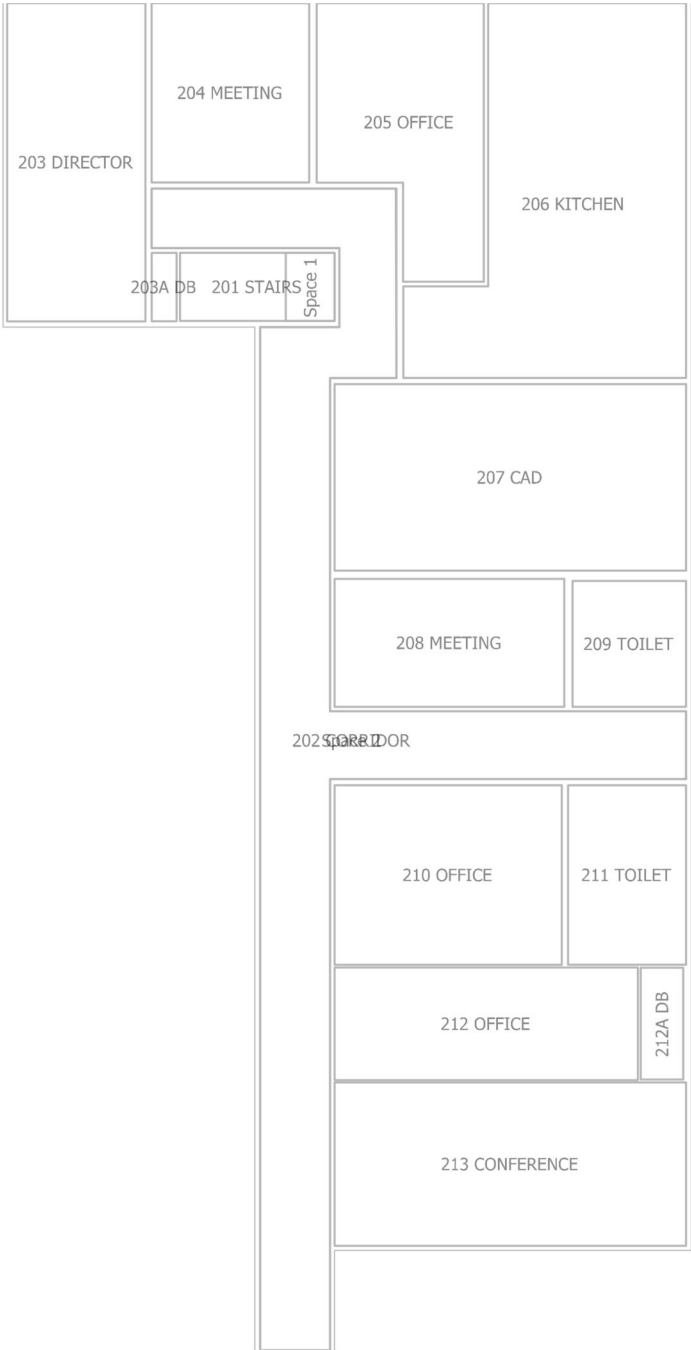

Building B · FIRST FOOR (Light scene 1)

Room list

201 STAIRS

P_{total}
76.0 W**A_{Room}**
6.18 m²**Lighting power density**
12.30 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
1	Philips		2x36W	76.0 W	4663 lm

202 CORRIDOR

P_{total}
684.0 W**A_{Room}**
69.35 m²**Lighting power density**
9.86 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
9	Philips		2x36W	76.0 W	4663 lm

203 DIRECTOR

P_{total}
304.0 W**A_{Room}**
25.83 m²**Lighting power density**
11.77 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
4	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

204 MEETING

P_{total}
304.0 W

A_{Room}
16.60 m²

Lighting power density
18.32 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
4	Philips		2x36W	76.0 W	4663 lm

205 OFFICE

P_{total}
380.0 W

A_{Room}
22.32 m²

Lighting power density
17.03 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
5	Philips		2x36W	76.0 W	4663 lm

206 KITCHEN

P_{total}
532.0 W

A_{Room}
48.10 m²

Lighting power density
11.06 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
7	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

207 CAD

P_{total}
684.0 W**A_{Room}**
38.48 m²**Lighting power density**
17.77 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
9	Philips		2x36W	76.0 W	4663 lm

208 MEETING

P_{total}
456.0 W**A_{Room}**
17.26 m²**Lighting power density**
26.43 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
6	Philips		2x36W	76.0 W	4663 lm

209 TOILET

P_{total}
152.0 W**A_{Room}**
8.39 m²**Lighting power density**
18.12 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	Φ _{Luminaire}
2	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

210 OFFICE

P_{total}
684.0 W

A_{Room}
23.95 m²

Lighting power density
28.56 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
9	Philips		2x36W	76.0 W	4663 lm

211 TOILET

P_{total}
228.0 W

A_{Room}
12.43 m²

Lighting power density
18.35 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
3	Philips		2x36W	76.0 W	4663 lm

212 OFFICE

P_{total}
608.0 W

A_{Room}
20.07 m²

Lighting power density
30.30 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR (Light scene 1)

Room list

212A DB

P_{total}
76.0 W

A_{Room}
2.79 m²

Lighting power density
27.23 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

213 CONFERENCE

P_{total}
608.0 W

A_{Room}
33.71 m²

Lighting power density
18.04 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
8	Philips		2x36W	76.0 W	4663 lm

Space 1

P_{total}
76.0 W

A_{Room}
1.95 m²

Lighting power density
38.94 W/m² (Space)

pcs.	Manufacturer	Article No.	Article name	P	$\Phi_{\text{Luminaire}}$
1	Philips		2x36W	76.0 W	4663 lm

Building B · FIRST FOOR

Luminaire list Φ_{total}

359051 lm

 P_{total}

5852.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
77	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR (Light scene 1)

Calculation objects

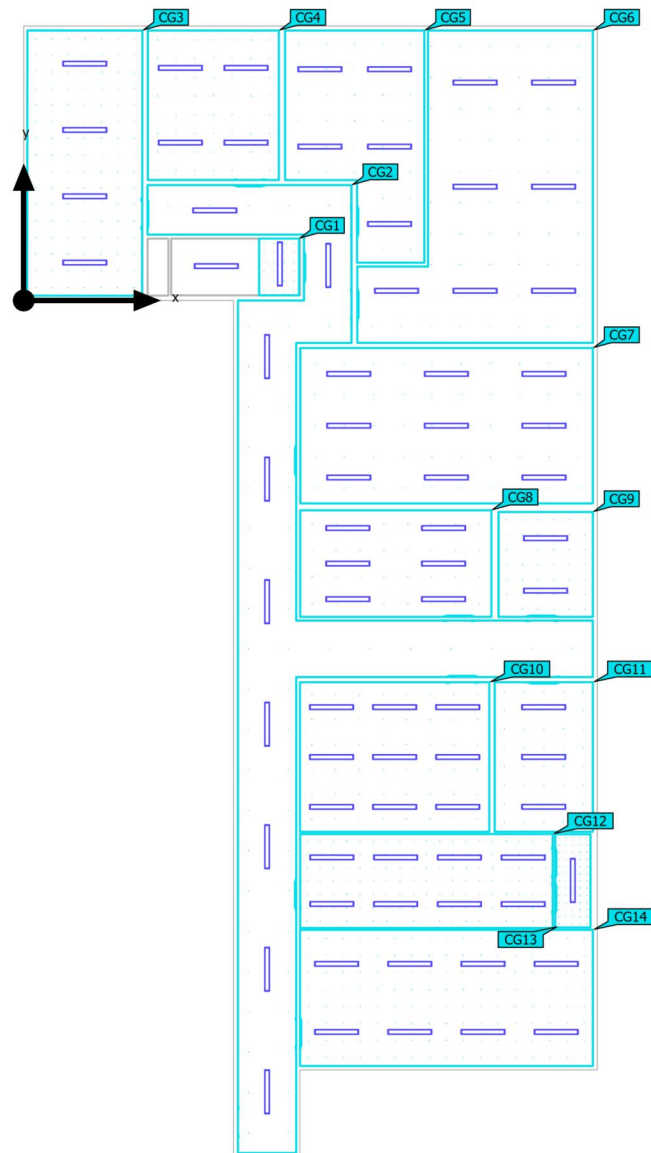

Building B · FIRST FOOR (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	359 lx	301 lx	402 lx	0.84	0.75	CG1
202 Corridor Perpendicular illuminance Height: 0.000 m	244 lx	148 lx	407 lx	0.61	0.36	CG2
203 Director Perpendicular illuminance Height: 0.700 m	344 lx	182 lx	485 lx	0.53	0.38	CG3
204 Meeting Perpendicular illuminance Height: 0.700 m	477 lx	320 lx	585 lx	0.67	0.55	CG4
205 Office Perpendicular illuminance Height: 0.700 m	458 lx	307 lx	579 lx	0.67	0.53	CG5
206 Kitchen Perpendicular illuminance Height: 0.850 m	337 lx	171 lx	443 lx	0.51	0.39	CG6
207 CAD Perpendicular illuminance Height: 0.700 m	548 lx	366 lx	691 lx	0.67	0.53	CG7
208 Meeting Perpendicular illuminance Height: 0.700 m	686 lx	489 lx	853 lx	0.71	0.57	CG8
209 Toilet Perpendicular illuminance Height: 0.000 m	310 lx	238 lx	376 lx	0.77	0.63	CG9
210 Office Perpendicular illuminance Height: 0.700 m	827 lx	544 lx	1017 lx	0.66	0.53	CG10
211 Toilet Perpendicular illuminance Height: 0.000 m	361 lx	266 lx	451 lx	0.74	0.59	CG11

Building B · FIRST FOOR (Light scene 1)

Calculation objects

212 Office Perpendicular illuminance Height: 0.700 m	768 lx	488 lx	932 lx	0.64	0.52	CG12
212A DB Perpendicular illuminance Height: 0.000 m	227 lx	176 lx	263 lx	0.78	0.67	CG13
213 Conference Perpendicular illuminance Height: 0.700 m	535 lx	320 lx	662 lx	0.60	0.48	CG14

Building B · FIRST FOOR (Light scene 1)

Calculation objects


205 Office (RUG)

Strongest glare at	90°
max	17.8
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG5

Building B · FIRST FOOR (Light scene 1)

Calculation objects

205 Office (RUG)

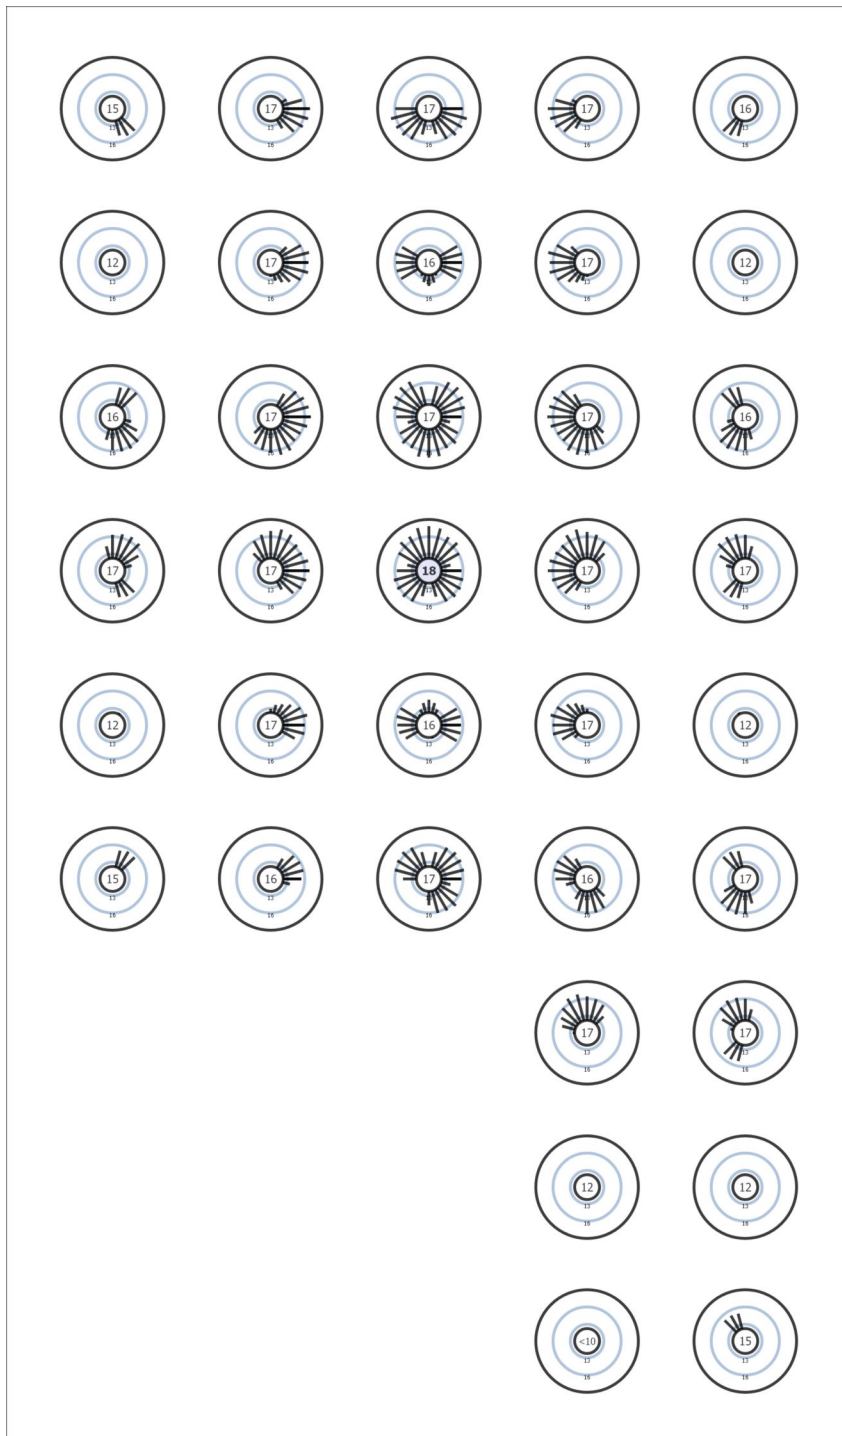

Building B · FIRST FOOR (Light scene 1)

Calculation objects


207 CAD (RUG)

Strongest glare at	15°
max	18.5
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG7

Building B · FIRST FOOR (Light scene 1)

Calculation objects

207 CAD (RUG)

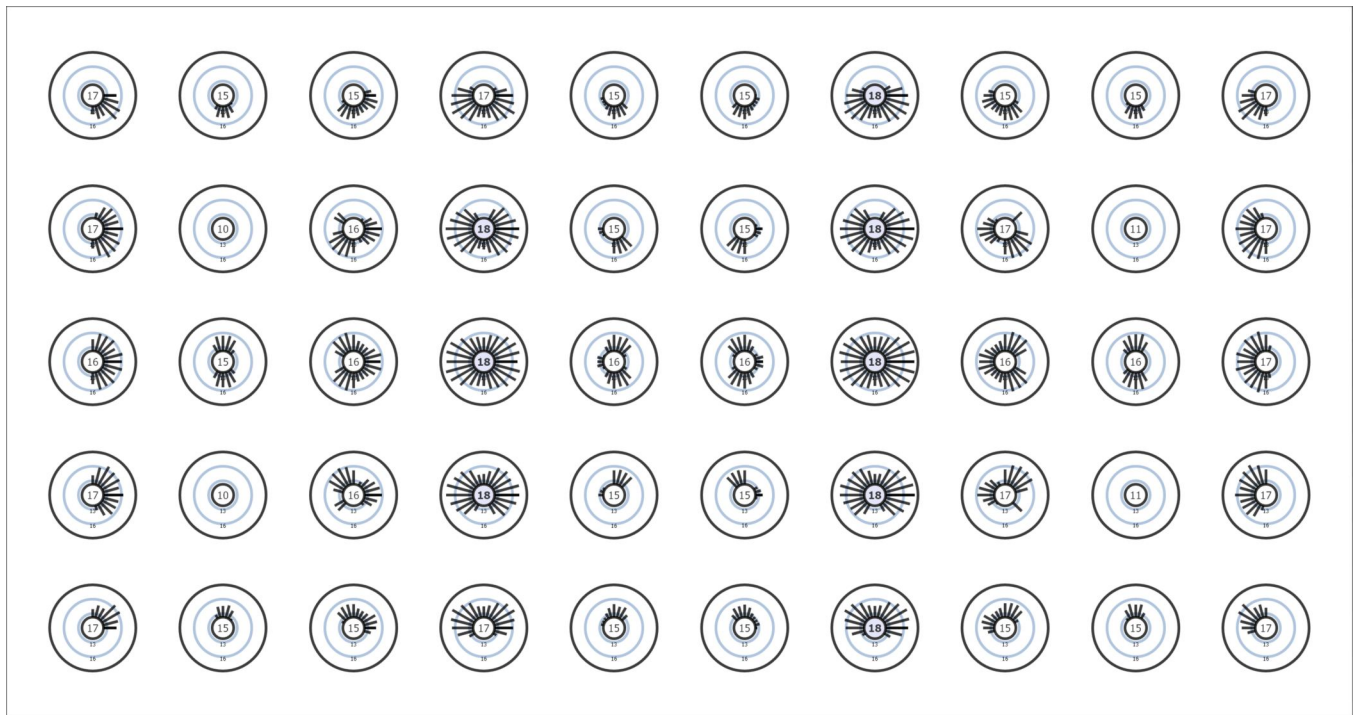

Building B · FIRST FOOR (Light scene 1)

Calculation objects


210 Office (RUG)

Strongest glare at	165°
max	17.3
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG10

Building B · FIRST FOOR (Light scene 1)

Calculation objects

210 Office (RUG)

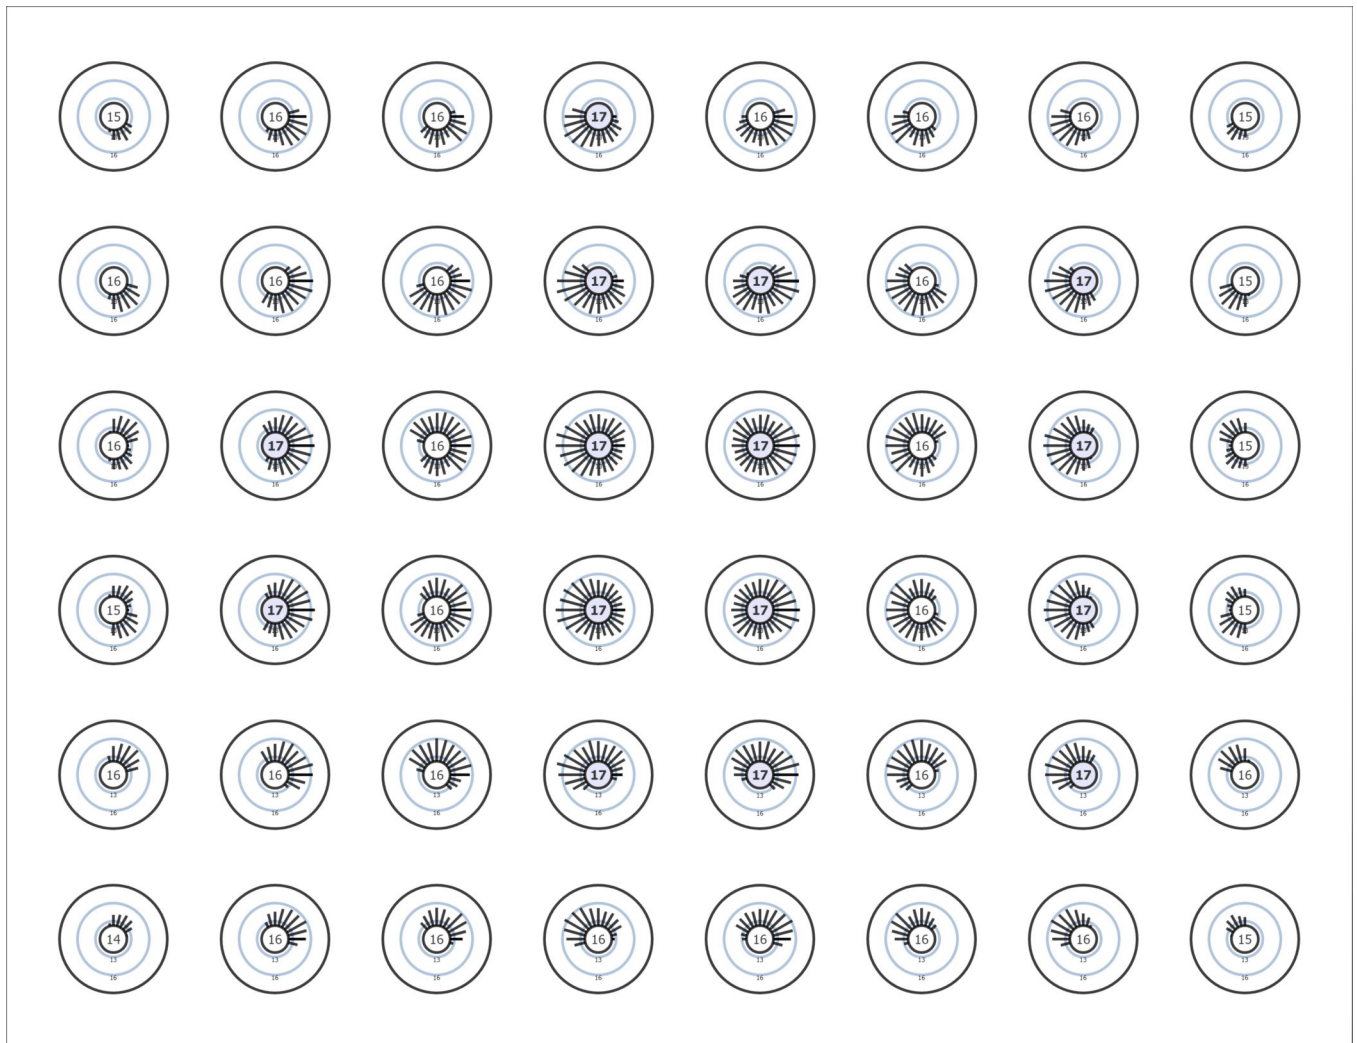

Building B · FIRST FOOR (Light scene 1)

Calculation objects


212 Office (RUG)

Strongest glare at	195°
max	16.8
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG12

Building B · FIRST FOOR (Light scene 1)


Calculation objects

212 Office (RUG)

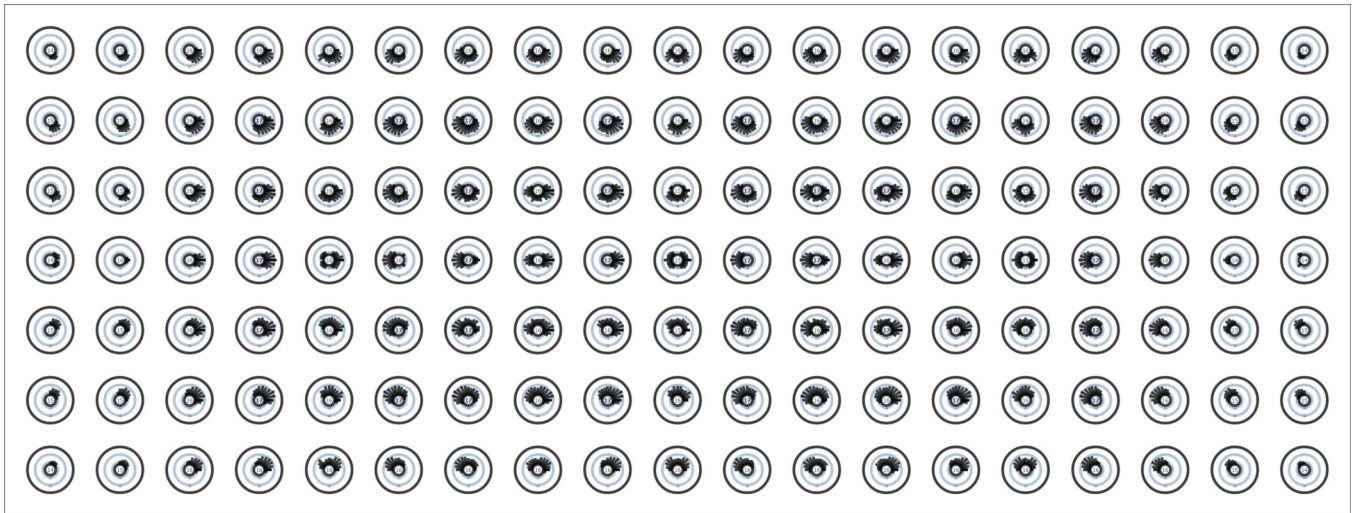


Building B · FIRST FOOR · 201 STAIRS

Luminaire layout plan

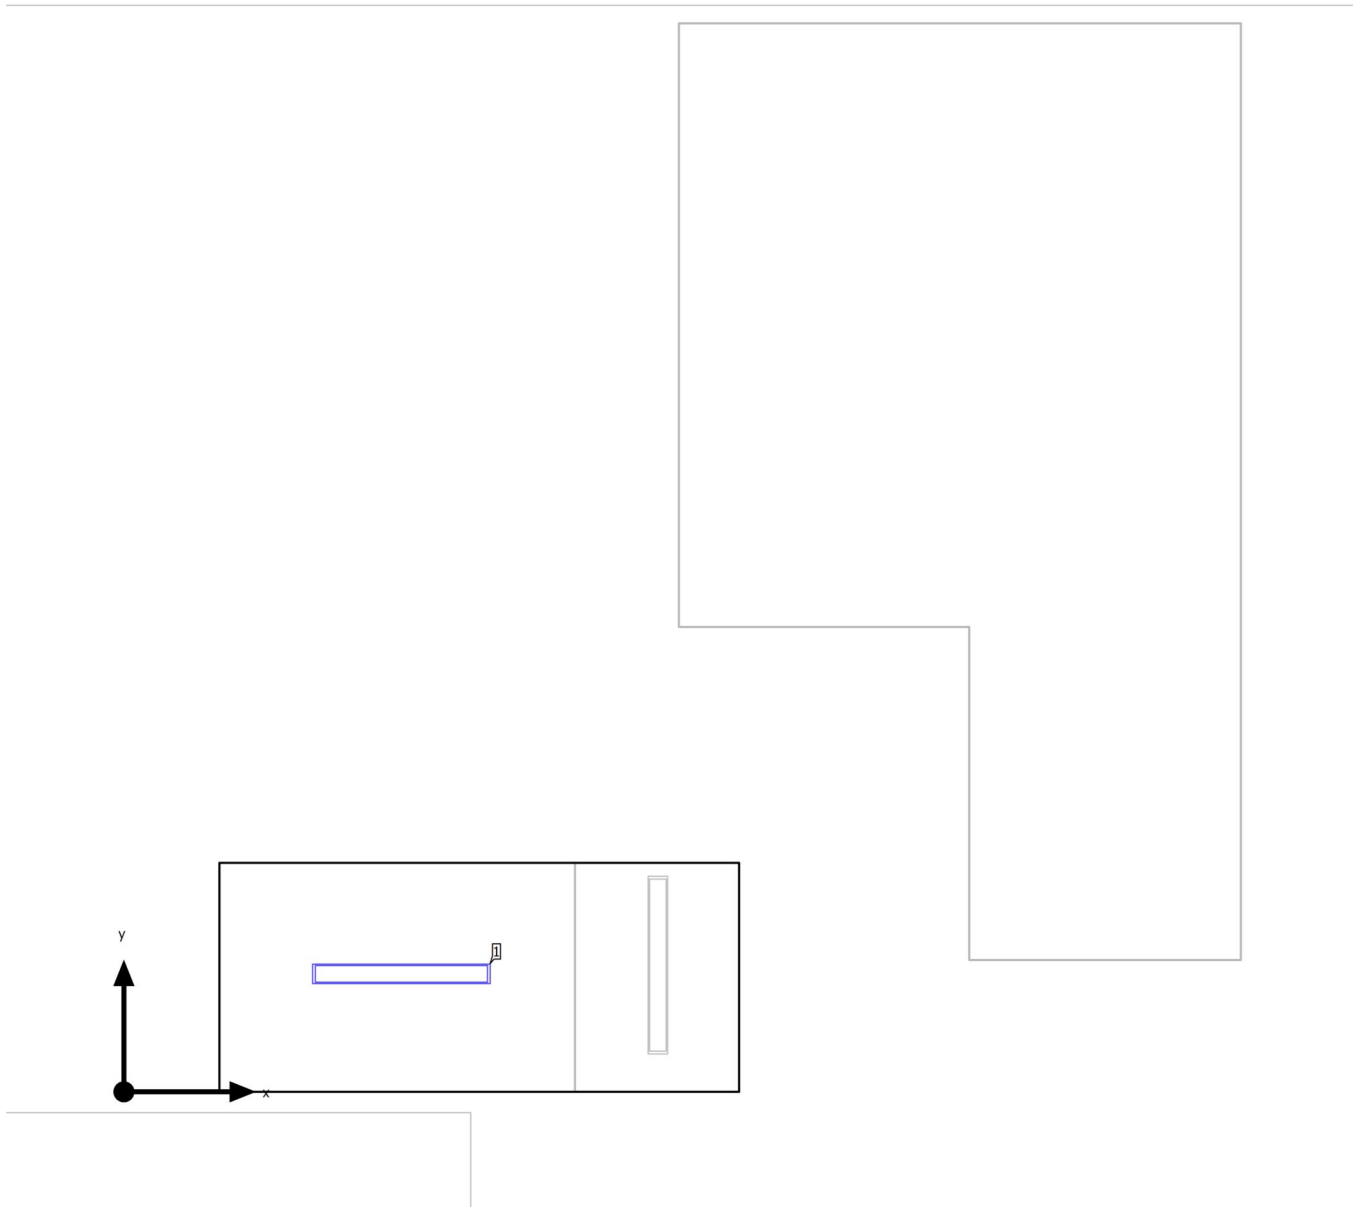

Building B · FIRST FOOR · 201 STAIRS

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
2.000 m	0.850 m	3.300 m	1

Building B · FIRST FOOR · 201 STAIRS


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

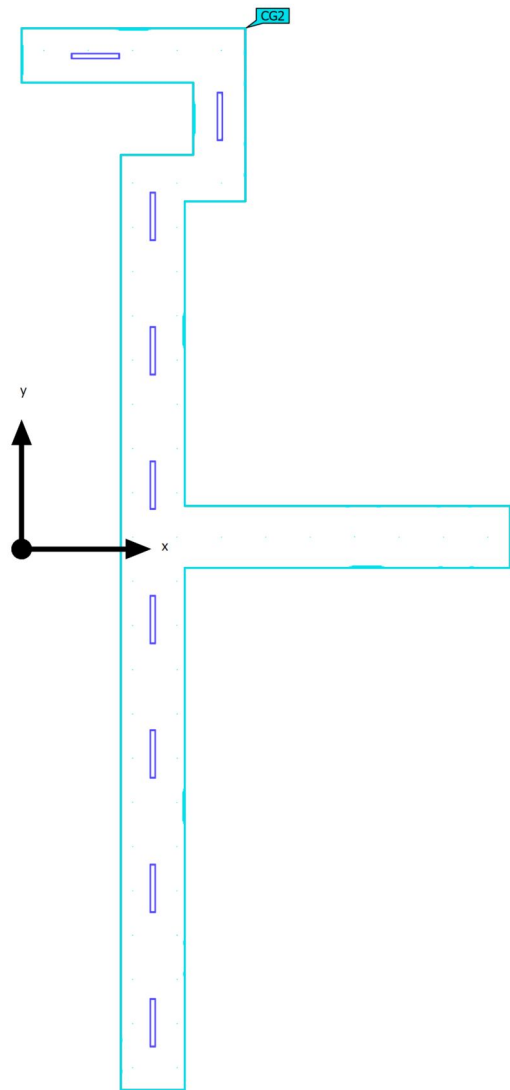

Ground area	69.35 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.76 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	31	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[1275 - 1693] kWh/a	max. 2450 kWh/a	✓	
Space	Lighting power density	9.86 W/m ²	–		

(1) Based on a rectangular space of 28.146 m x 12.950 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
9	Philips		2x36W	31	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire layout plan

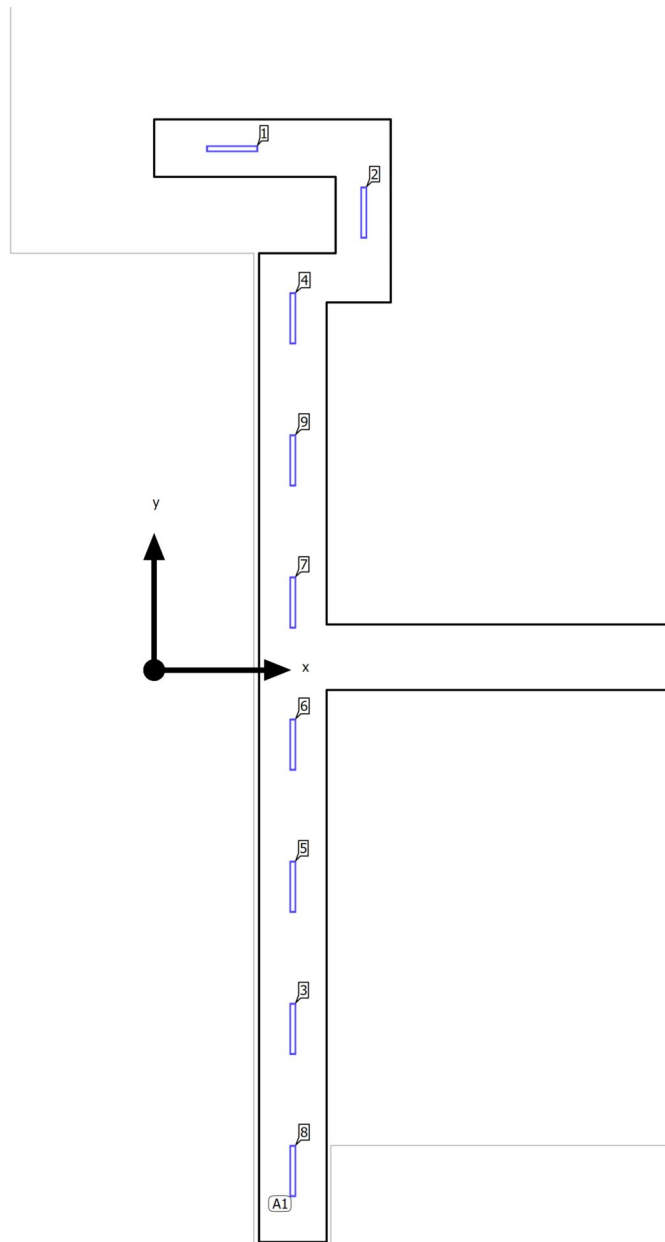

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

7 x Philips 2x36W

Type	Line arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.477 m / 8.819 m / 3.300 m	3.477 m	-8.996 m	3.300 m	3
X-direction	7 pcs., Centre - centre, 3.563 m	3.477 m	8.819 m	3.300 m	4
Arrangement	A1	3.477 m	-5.433 m	3.300 m	5
		3.477 m	-1.870 m	3.300 m	6
		3.477 m	1.693 m	3.300 m	7
		3.477 m	-12.559 m	3.300 m	8
		3.477 m	5.256 m	3.300 m	9

Individual luminaires

X	Y	Mounting height	Luminaire
1.956 m	13.069 m	3.300 m	1
5.256 m	11.469 m	3.300 m	2

Building B · FIRST FOOR · 202 CORRIDOR

Luminaire list Φ_{total}

41967 lm

 P_{total}

684.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Calculation objects

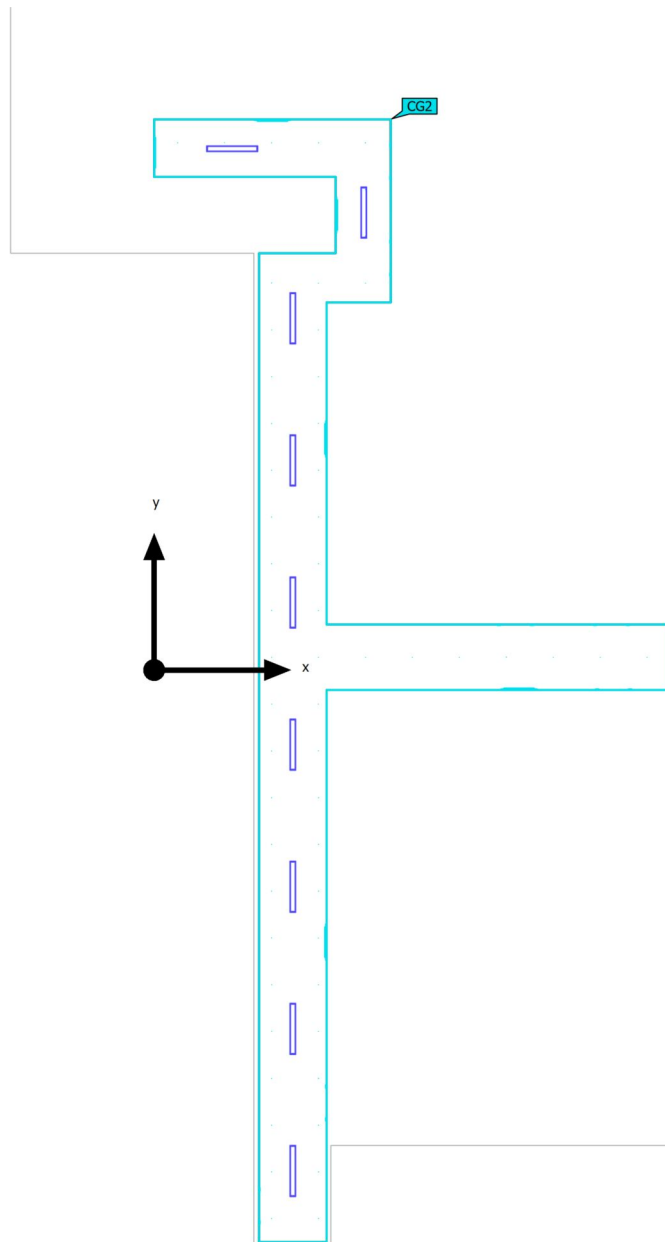

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Perpendicular illuminance Height: 0.000 m	244 lx	148 lx	407 lx	0.61	0.36	CG2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 202 CORRIDOR (Light scene 1)

202 Corridor

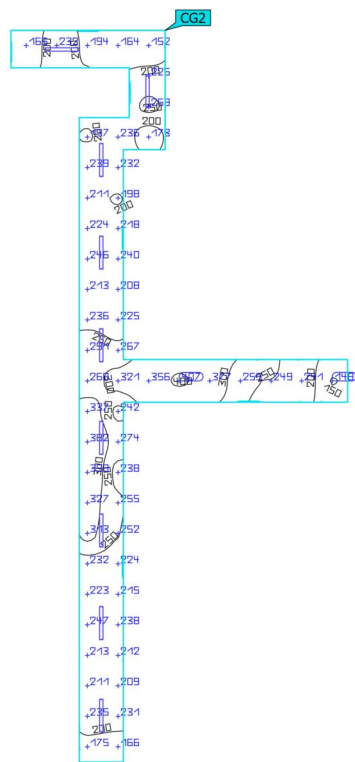


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
202 Corridor Perpendicular illuminance Height: 0.000 m	244 lx	148 lx	407 lx	0.61	0.36	CG2

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

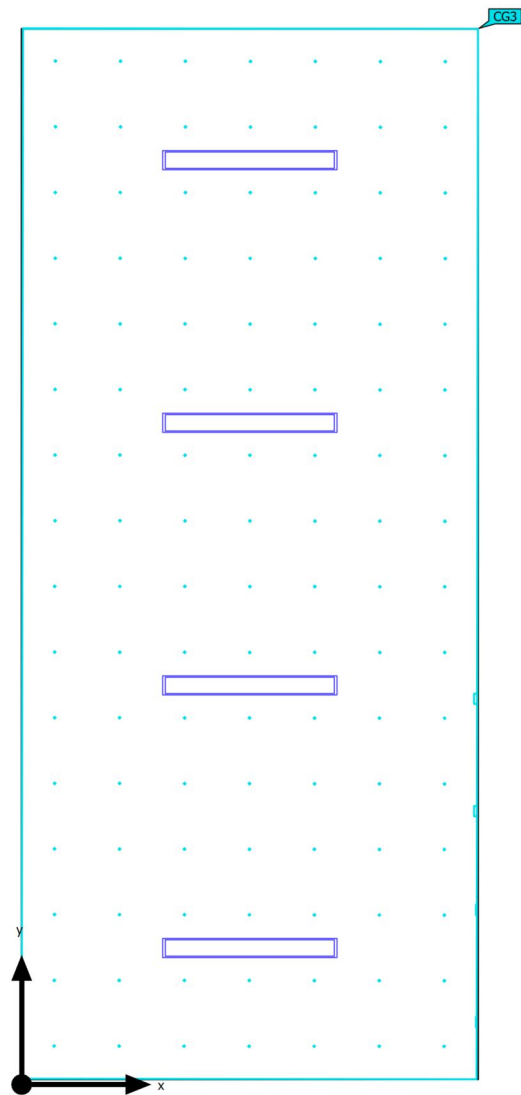

Ground area	25.83 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.76 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 950 kWh/a	✓	
Space	Lighting power density	11.77 W/m ²	–		

(1) Based on a rectangular space of 3.350 m x 7.712 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 203 DIRECTOR

Luminaire layout plan

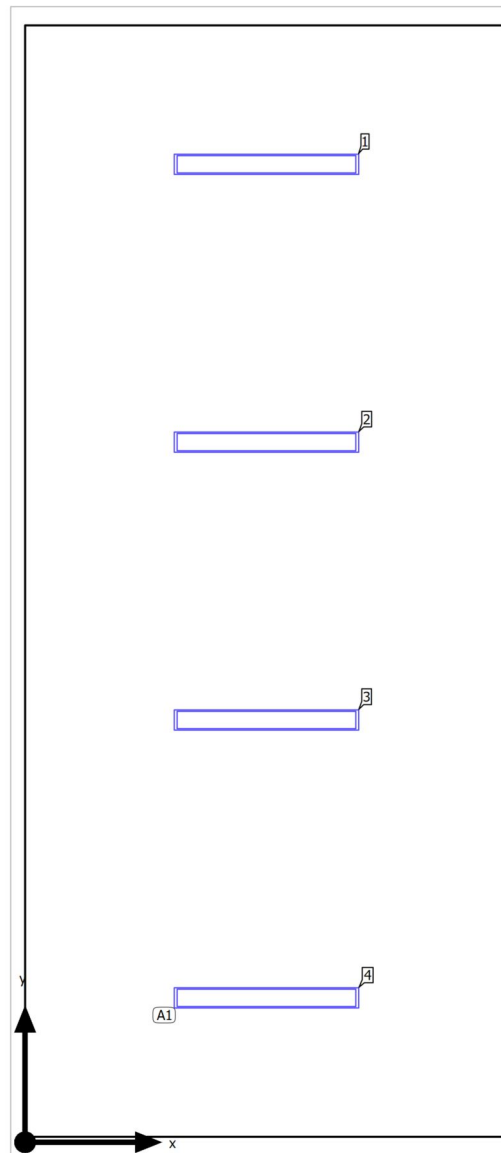

Building B · FIRST FOOR · 203 DIRECTOR

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

4 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.675 m / 1.002 m / 3.300 m	1.675 m	6.786 m	3.300 m	1
X-direction	1 pcs., Centre - centre, 3.350 m	1.675 m	4.858 m	3.300 m	2
Y-direction	4 pcs., Centre - centre, 1.928 m	1.675 m	2.930 m	3.300 m	3
		1.675 m	1.002 m	3.300 m	4
Arrangement	A1				

Building B · FIRST FOOR · 203 DIRECTOR


Luminaire list

Φ_{total} 18652 lm	P_{total} 304.0 W	Luminous efficacy 61.4 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

Calculation objects

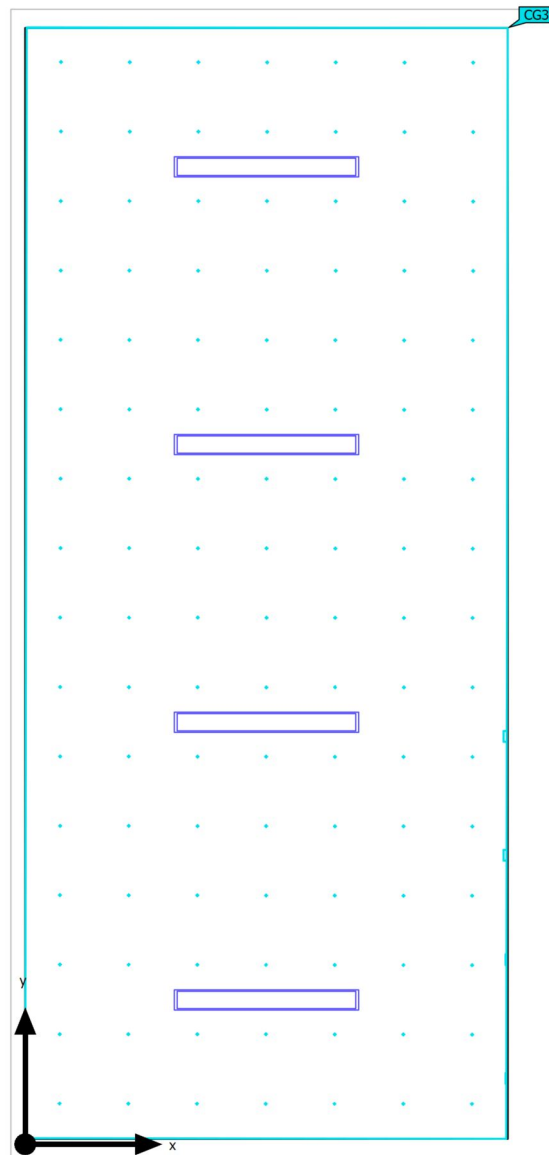

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)


Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203 Director Perpendicular illuminance Height: 0.700 m	344 lx	182 lx	485 lx	0.53	0.38	CG3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 203 DIRECTOR (Light scene 1)

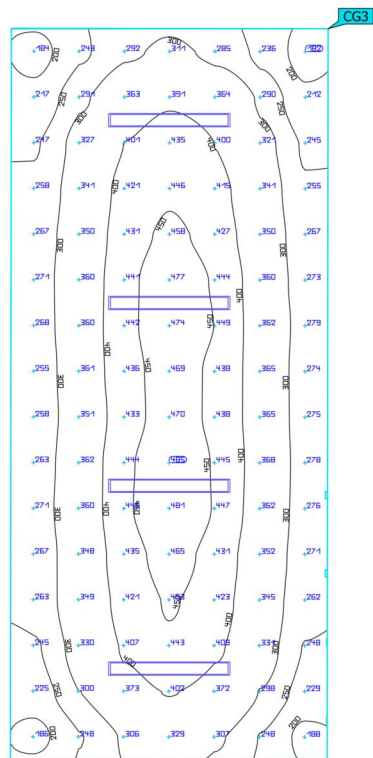
203 Director

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
203 Director Perpendicular illuminance Height: 0.700 m	344 lx	182 lx	485 lx	0.53	0.38	CG3

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

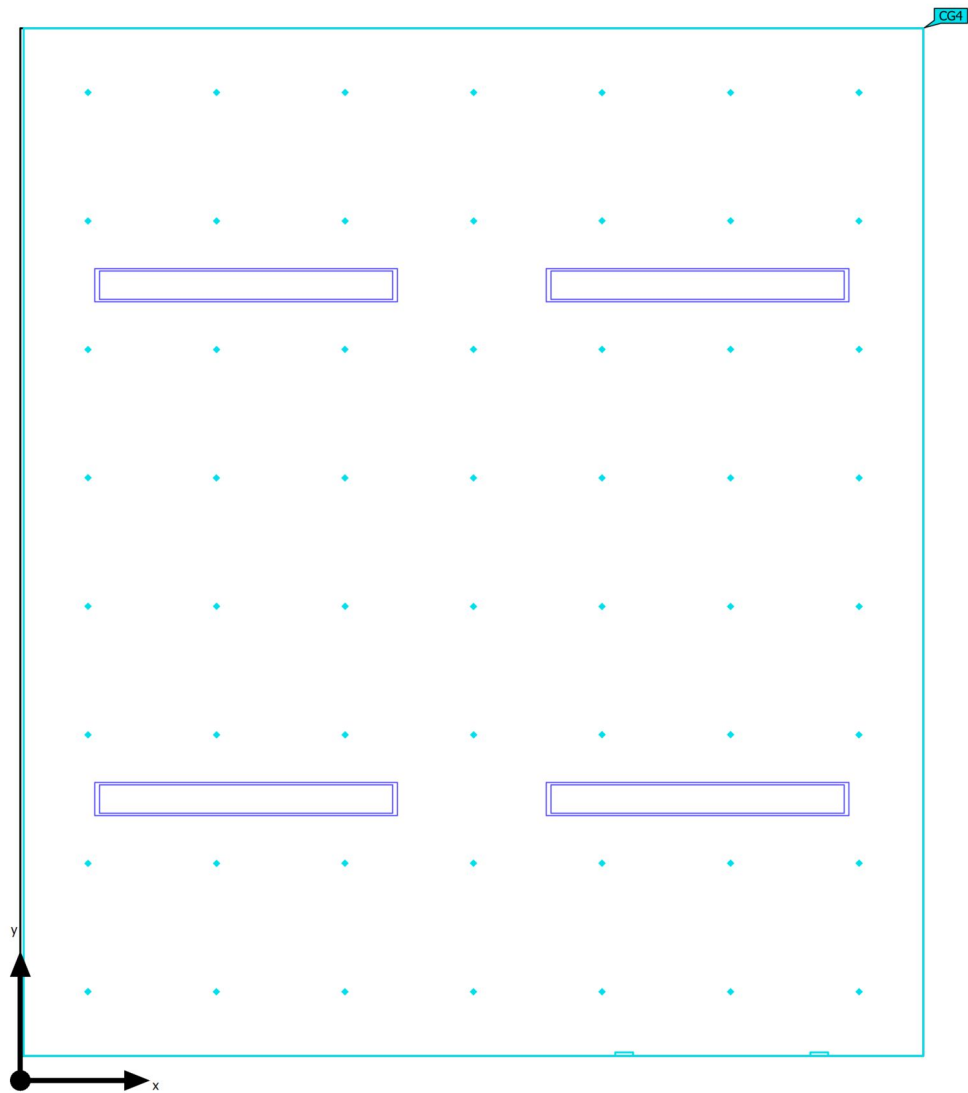

Ground area	16.60 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.76 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[474 - 752] kWh/a	max. 600 kWh/a	✗	
Space	Lighting power density	18.32 W/m ²	–		

(1) Based on a rectangular space of 3.819 m x 4.346 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
4	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 204 MEETING

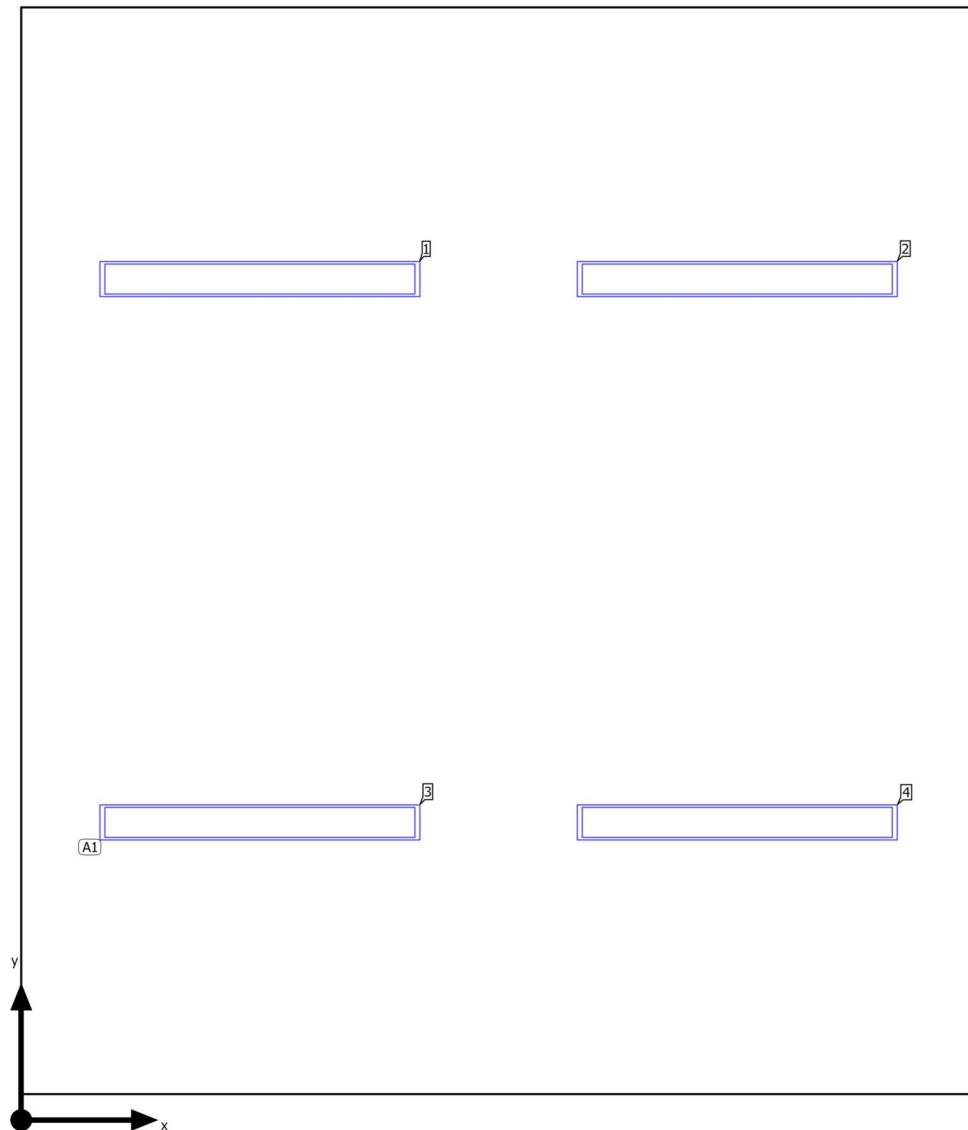Luminaire layout plan

Building B · FIRST FOOR · 204 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

4 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.955 m / 1.190 m / 3.300 m	0.955 m	3.363 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 1.909 m	2.864 m	3.363 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 2.173 m	0.955 m	1.190 m	3.300 m	3
		2.864 m	1.190 m	3.300 m	4
Arrangement	A1				

Building B · FIRST FOOR · 204 MEETING

Luminaire list Φ_{total}

18652 lm

 P_{total}

304.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
4	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Calculation objects

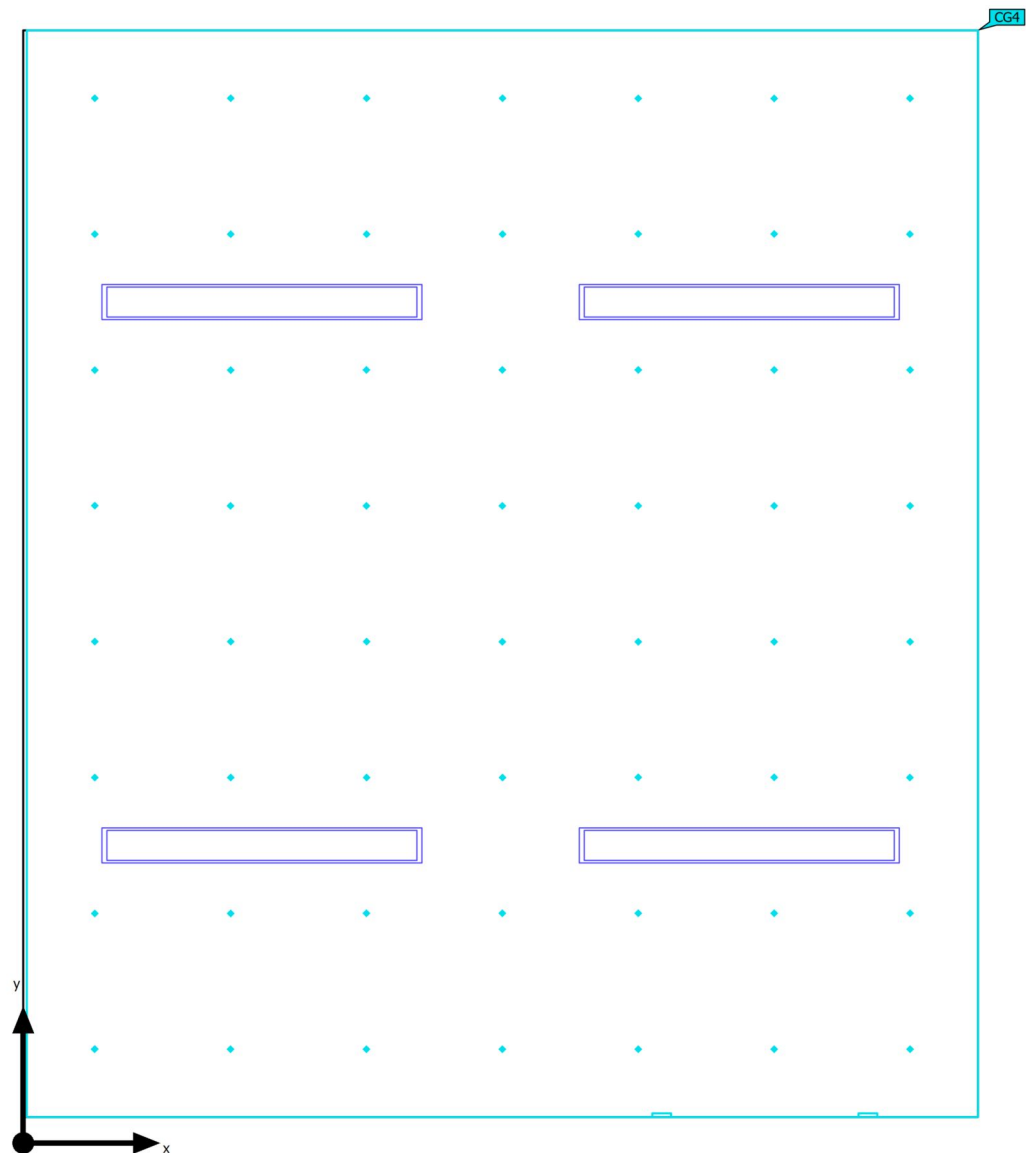

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
204 Meeting Perpendicular illuminance Height: 0.700 m	477 lx	320 lx	585 lx	0.67	0.55	CG4

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 204 MEETING (Light scene 1)

204 Meeting

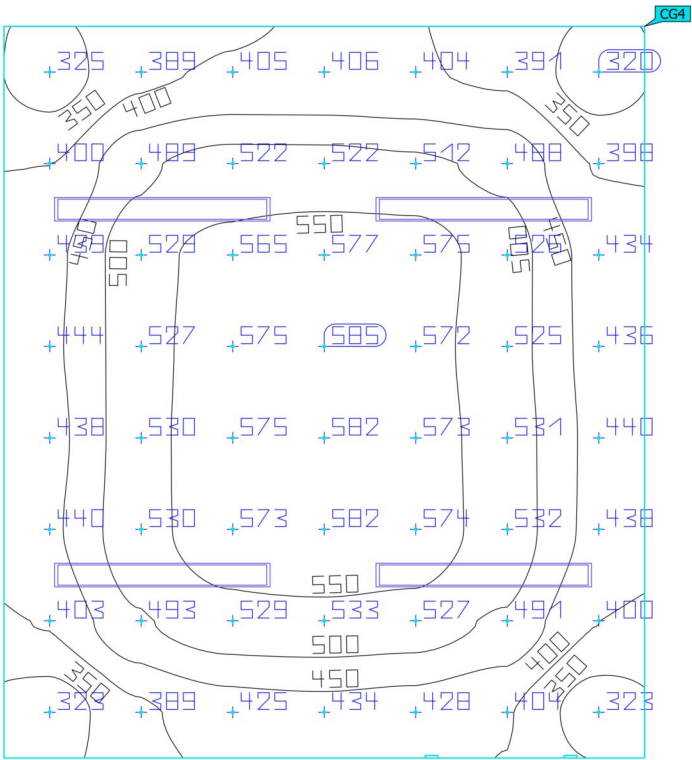


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
204 Meeting Perpendicular illuminance Height: 0.700 m	477 lx	320 lx	585 lx	0.67	0.55	CG4

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

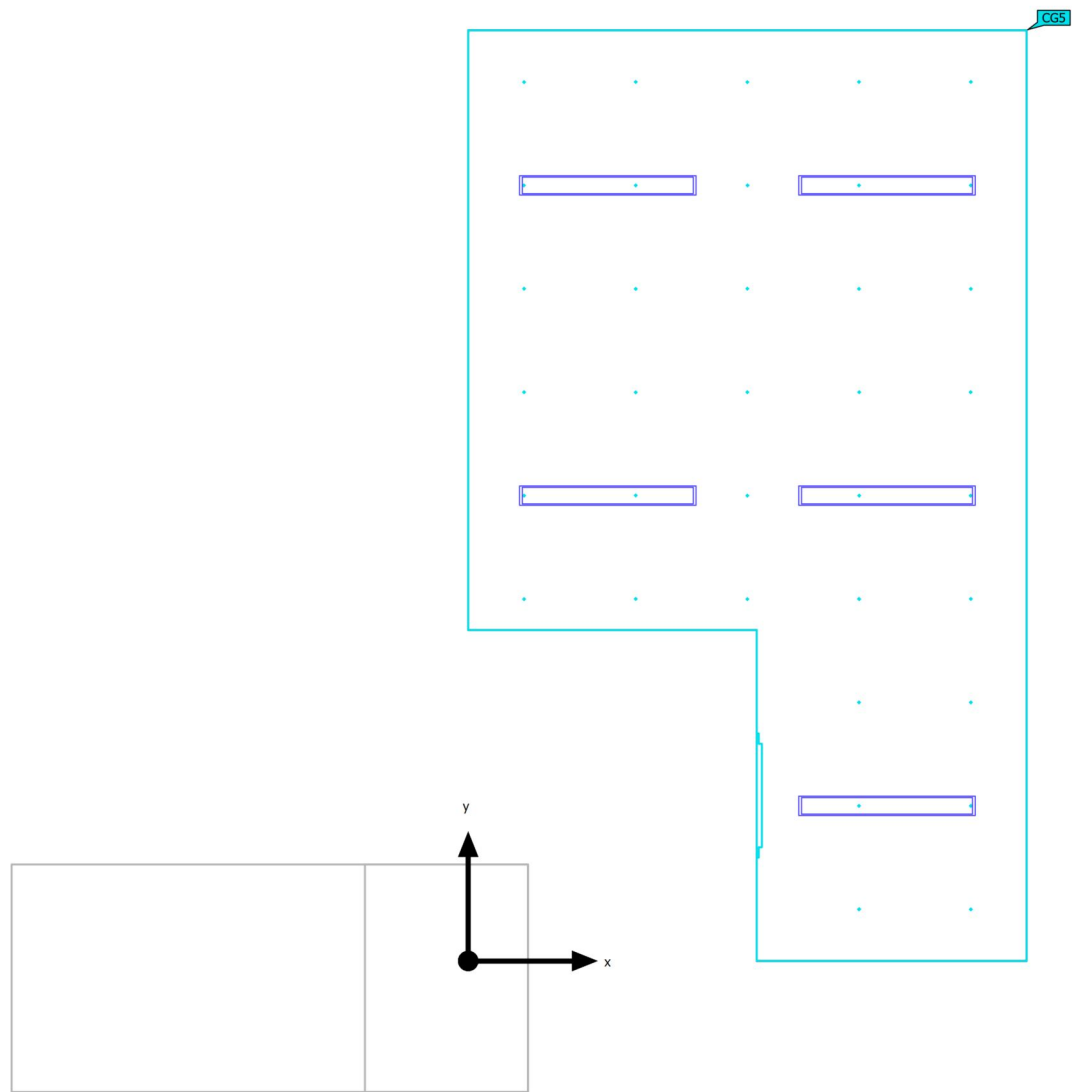

Ground area	22.32 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[593 - 941] kWh/a	max. 800 kWh/a	✗	
Space	Lighting power density	17.03 W/m ²	–		

(1) Based on a rectangular space of 6.750 m x 4.050 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
5	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 205 OFFICE

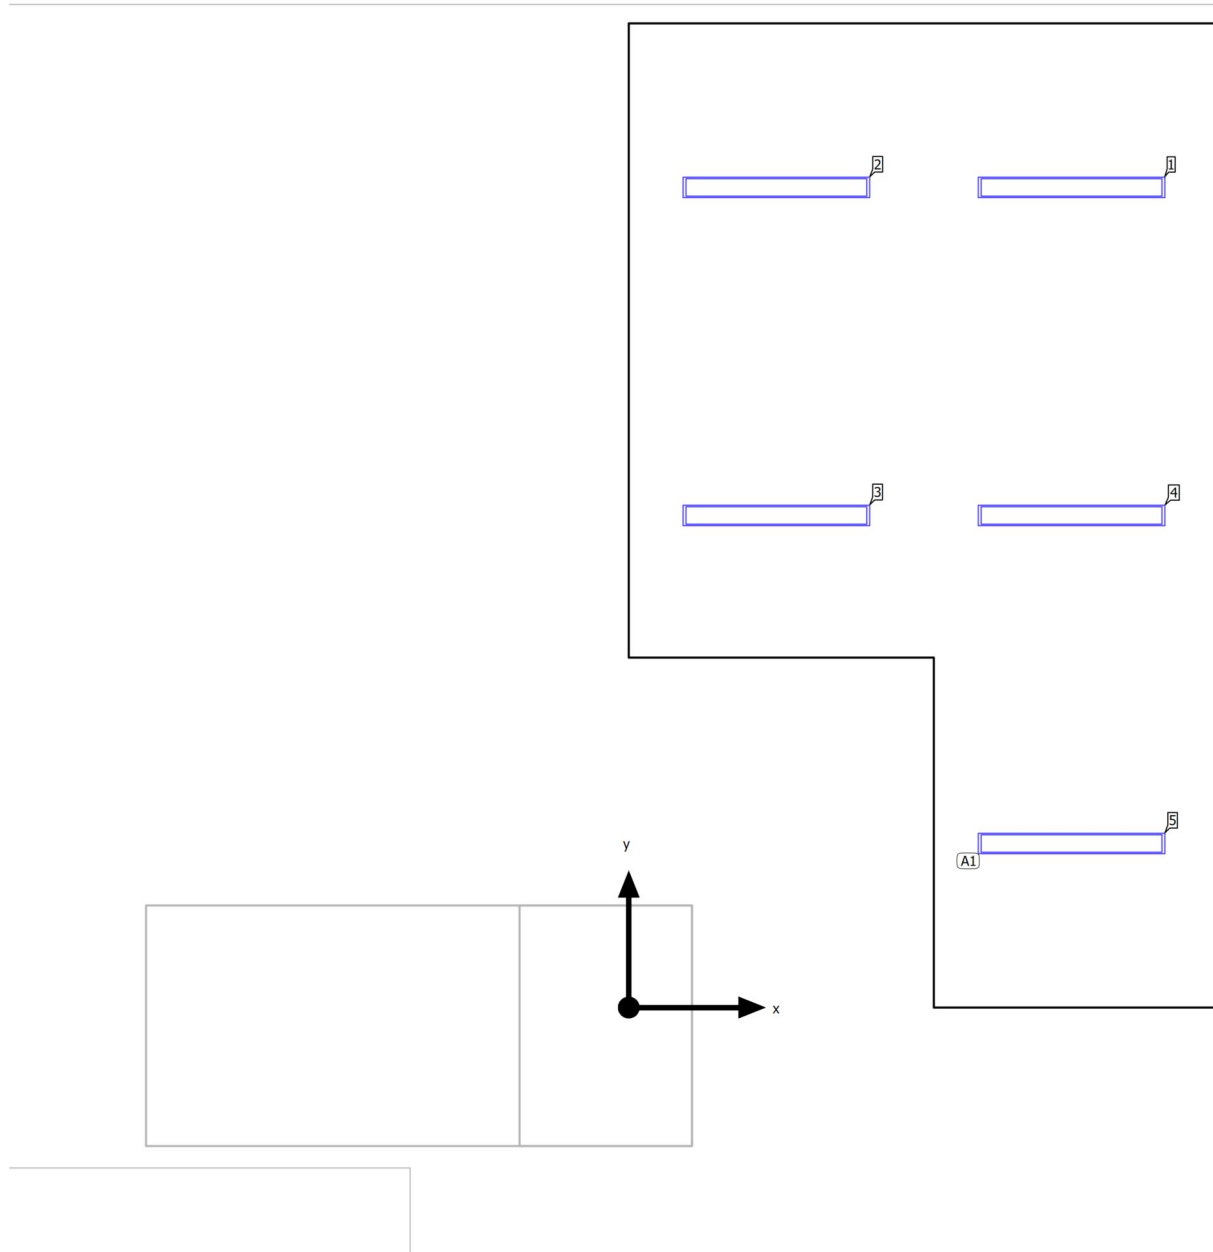Luminaire layout plan

Building B · FIRST FOOR · 205 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

5 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.037 m / 1.125 m / 3.300 m	3.037 m	5.625 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.025 m	1.012 m	5.625 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 2.250 m	1.012 m	3.375 m	3.300 m	3
		3.037 m	3.375 m	3.300 m	4
Arrangement	A1	3.037 m	1.125 m	3.300 m	5

Building B · FIRST FOOR · 205 OFFICE

Luminaire list Φ_{total}

23315 lm

 P_{total}

380.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
5	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects

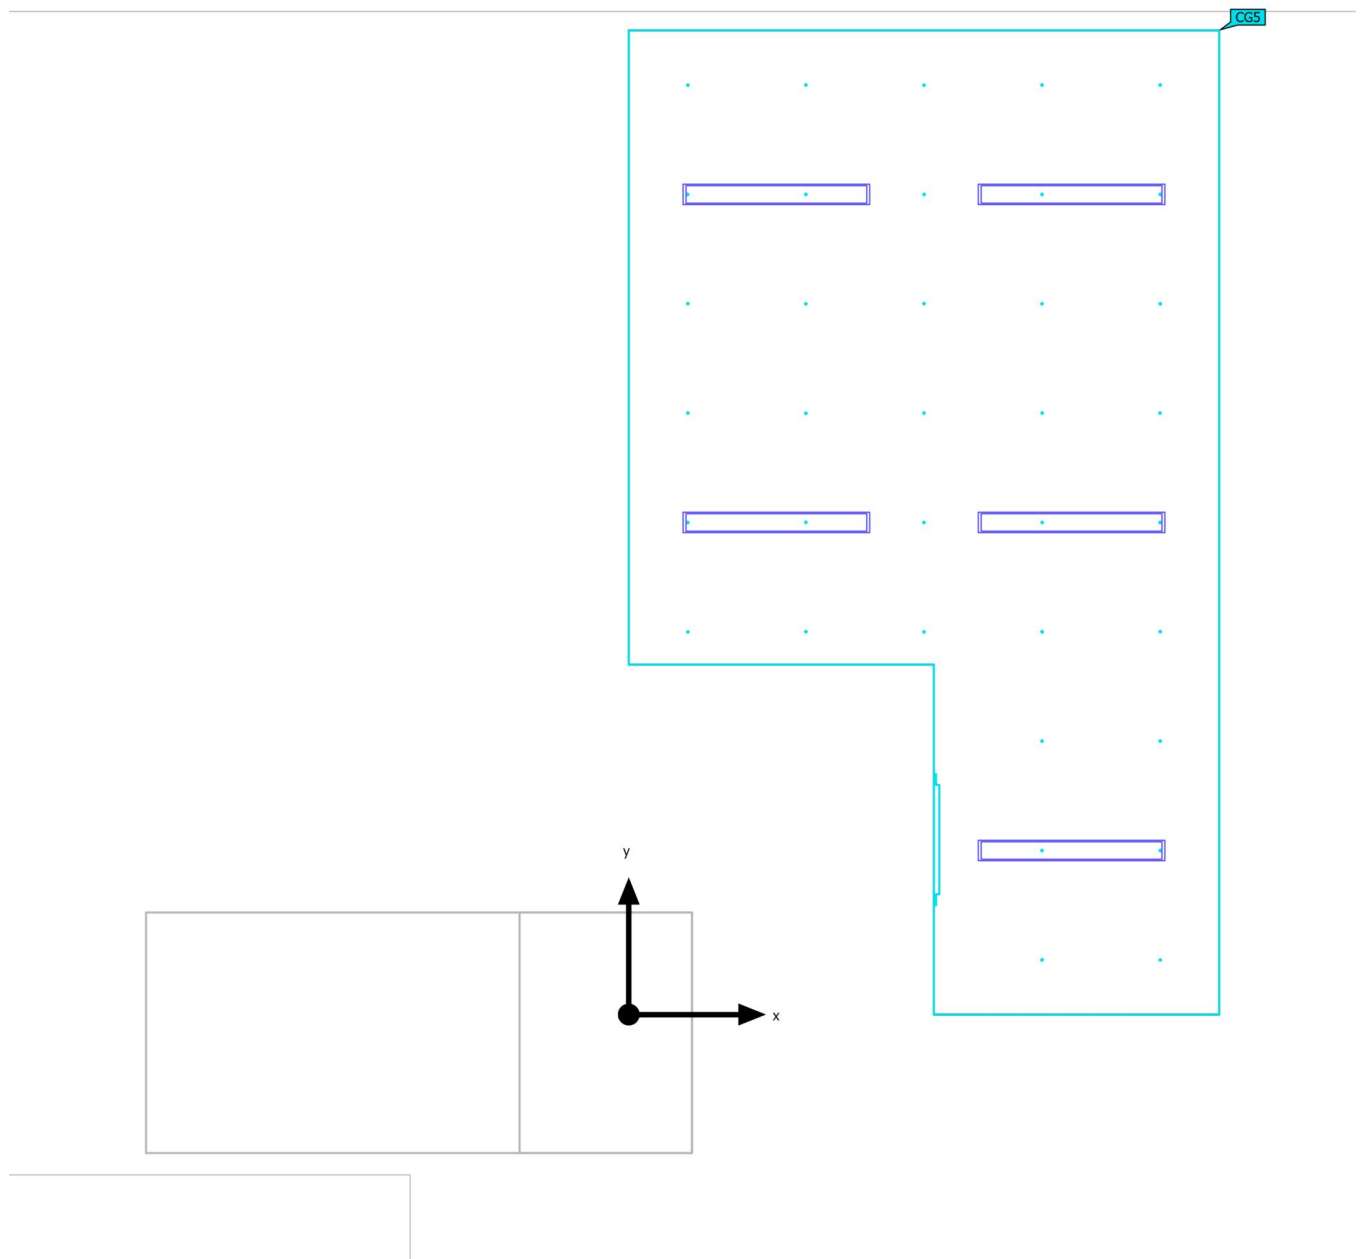

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
205 Office Perpendicular illuminance Height: 0.700 m	458 lx	307 lx	579 lx	0.67	0.53	CG5

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects


205 Office (RUG)

Strongest glare at	90°
max	17.8
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG5

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

Calculation objects



205 Office (RUG)

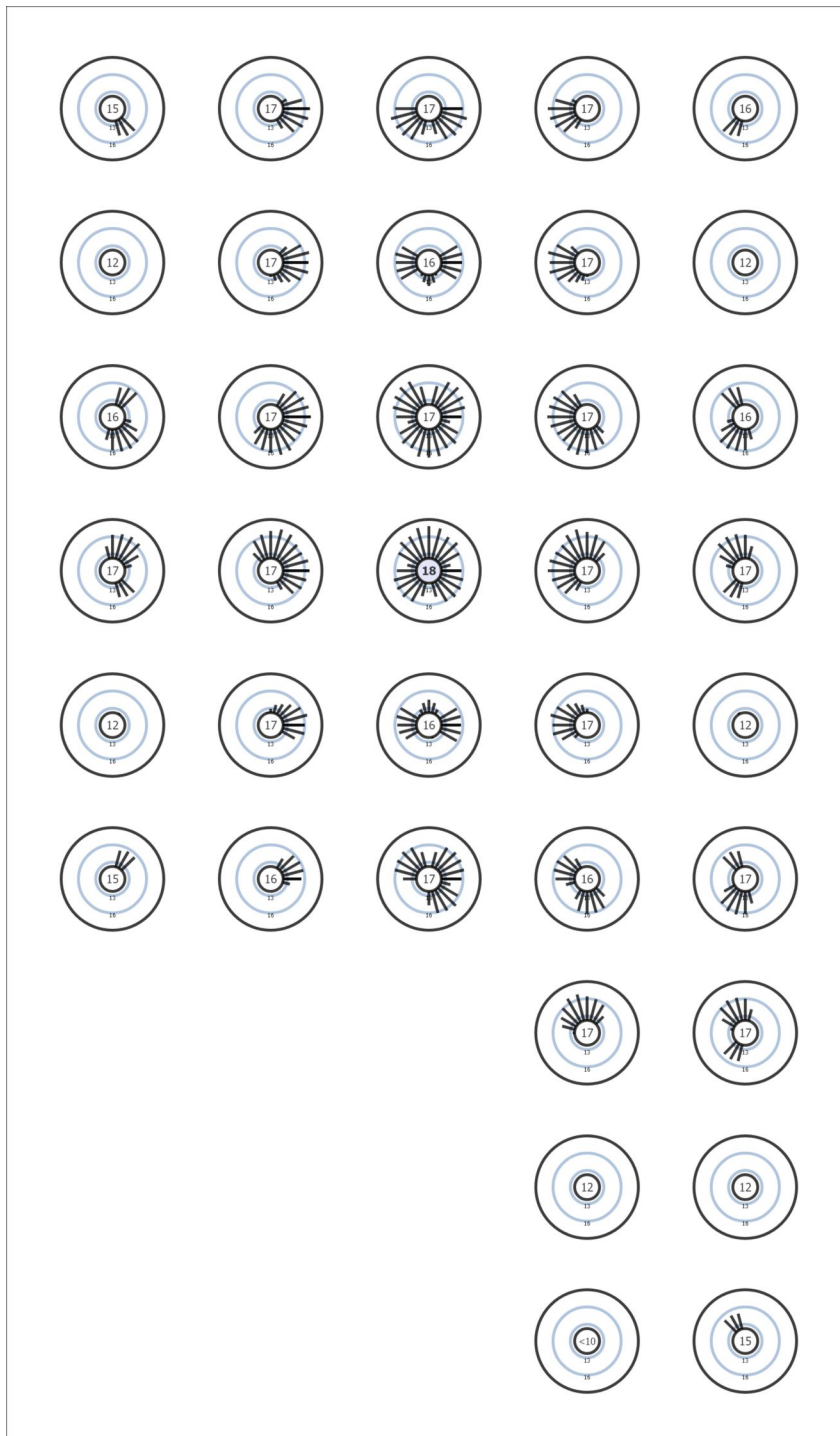

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 205 OFFICE (Light scene 1)

205 Office

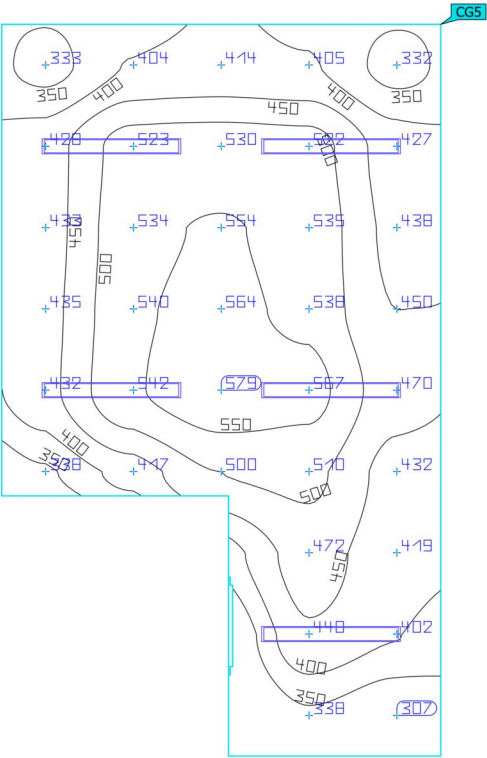


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
205 Office Perpendicular illuminance Height: 0.700 m	458 lx	307 lx	579 lx	0.67	0.53	CG5

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

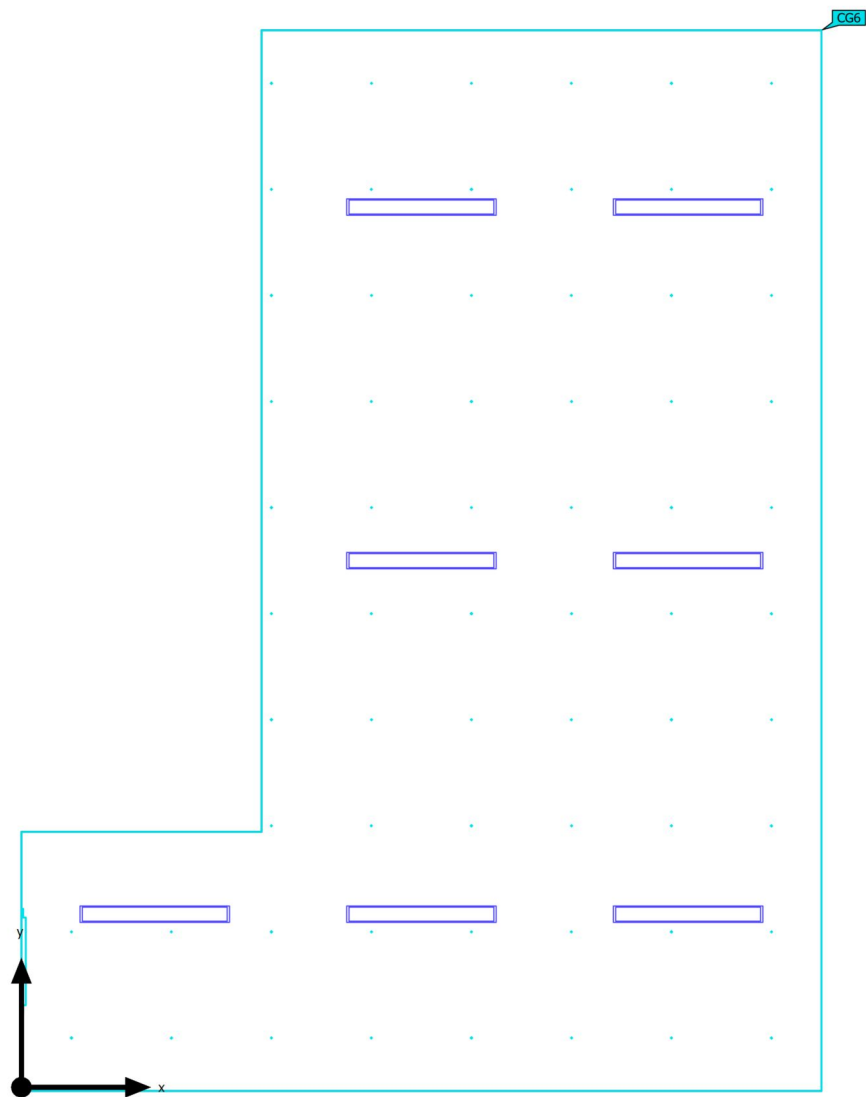

Ground area	48.10 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	26	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[830 - 1317] kWh/a	max. 1700 kWh/a	✓	
Space	Lighting power density	11.06 W/m ²	–		

(1) Based on a rectangular space of 6.850 m x 9.082 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
7	Philips		2x36W	26	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 206 KITCHEN

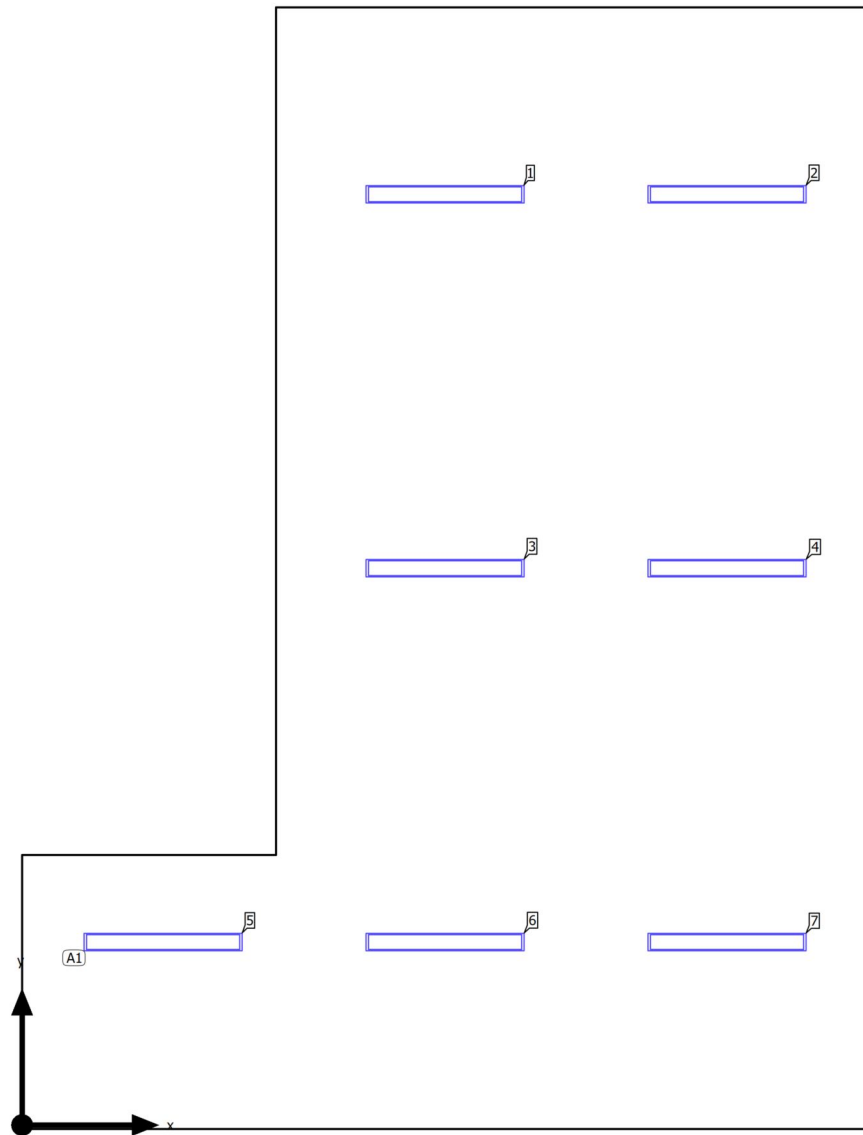Luminaire layout plan

Building B · FIRST FOOR · 206 KITCHEN

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

7 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.142 m / 1.482 m / 3.300 m	3.425 m	7.536 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 2.283 m	5.708 m	7.536 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 3.027 m	3.425 m	4.509 m	3.300 m	3
		5.708 m	4.509 m	3.300 m	4
Arrangement	A1	1.142 m	1.482 m	3.300 m	5
		3.425 m	1.482 m	3.300 m	6
		5.708 m	1.482 m	3.300 m	7

Building B · FIRST FOOR · 206 KITCHEN

Luminaire list Φ_{total}

32641 lm

 P_{total}

532.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
7	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Calculation objects

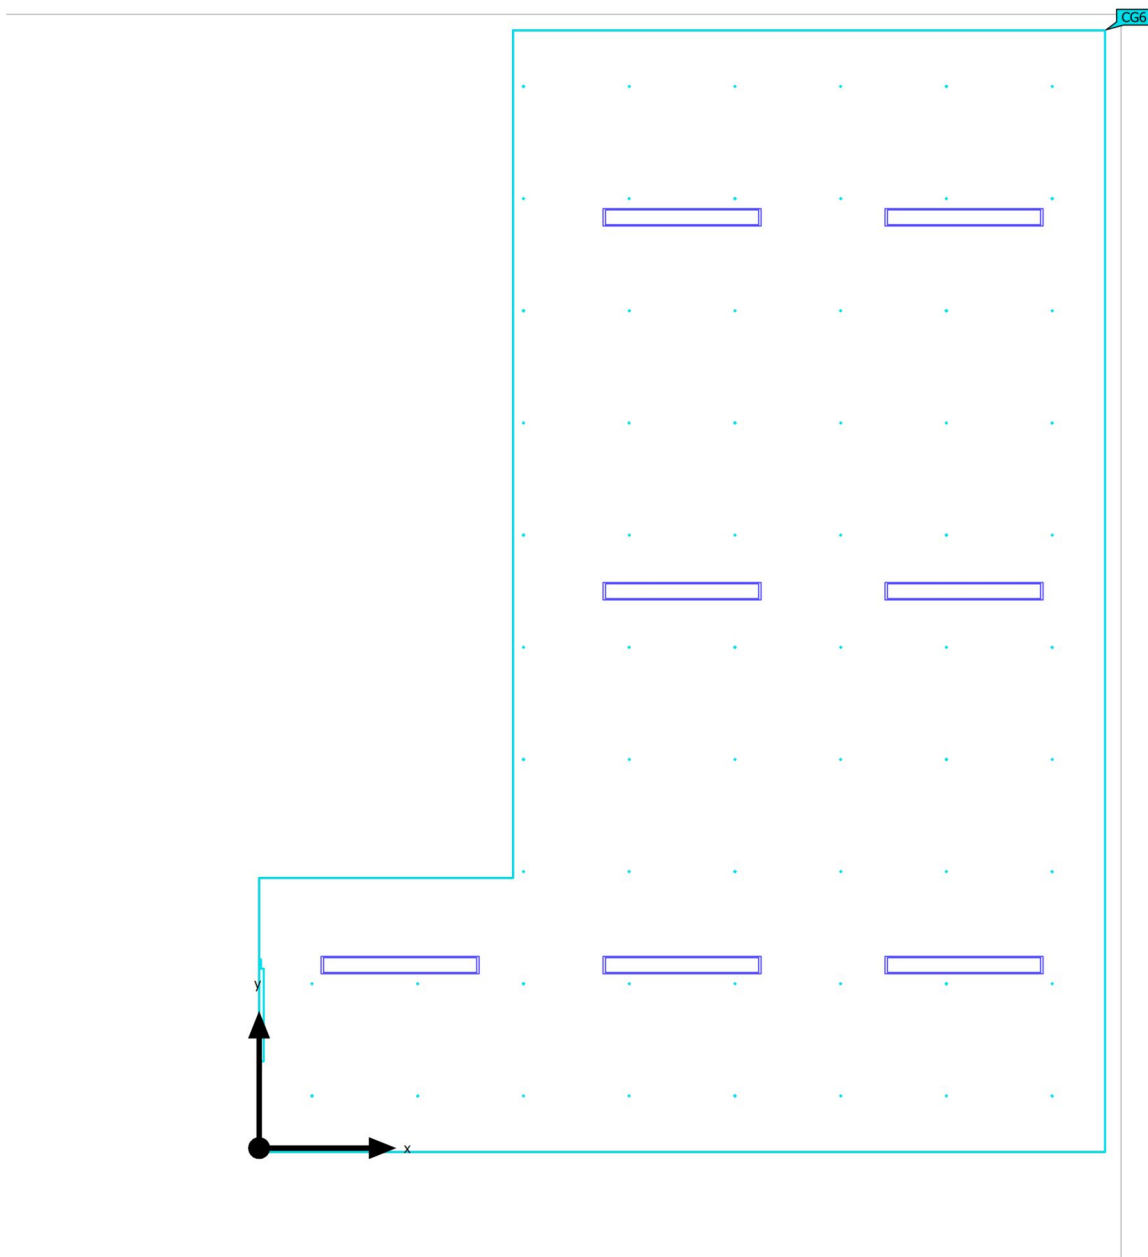

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
206 Kitchen Perpendicular illuminance Height: 0.850 m	337 lx	171 lx	443 lx	0.51	0.39	CG6

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 206 KITCHEN (Light scene 1)

206 Kitchen

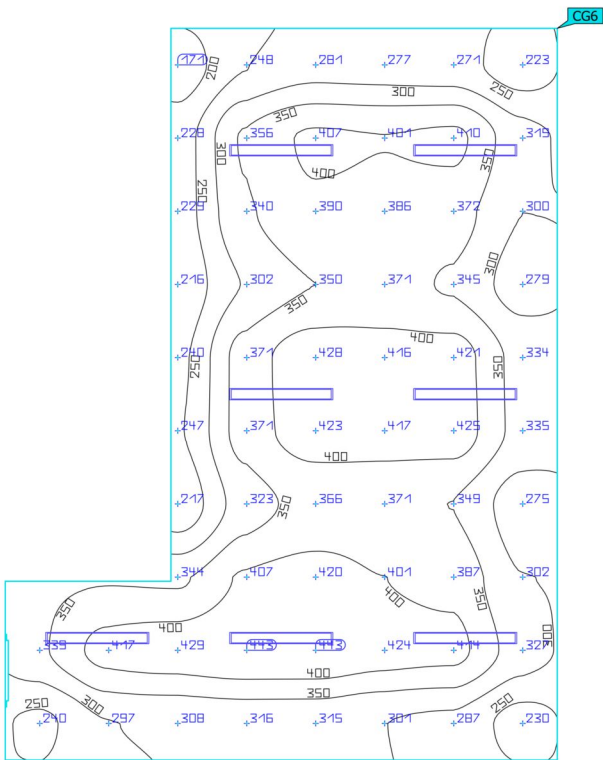


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
206 Kitchen Perpendicular illuminance Height: 0.850 m	337 lx	171 lx	443 lx	0.51	0.39	CG6

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

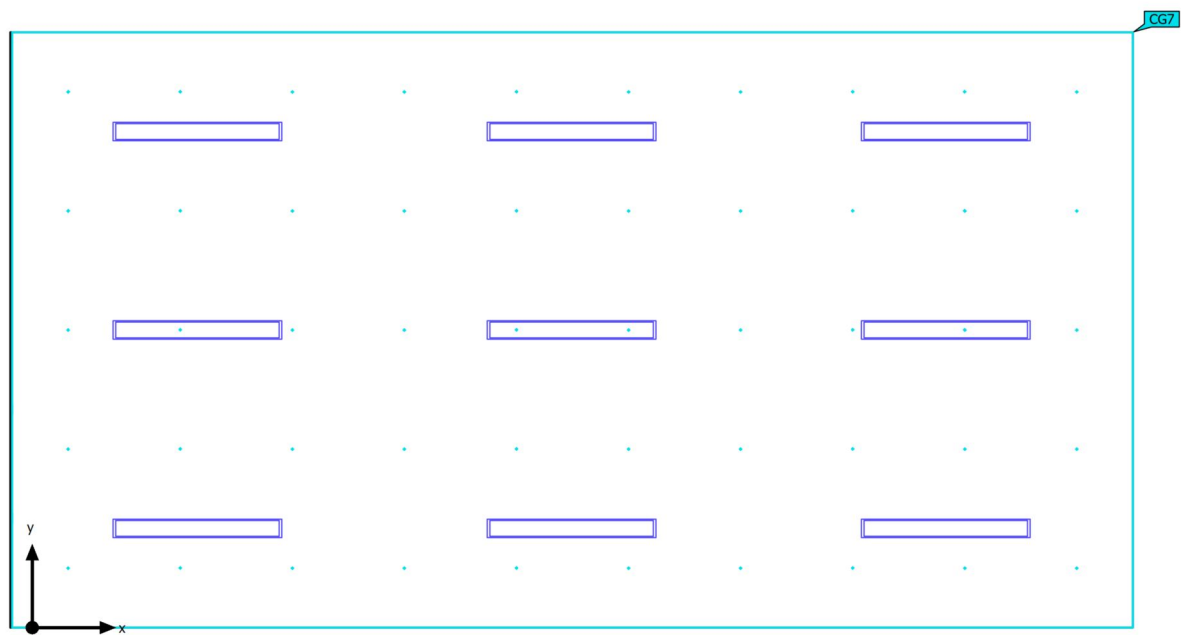

Ground area	38.48 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[1067 - 1693] kWh/a	max. 1350 kWh/a	✗	
Space	Lighting power density	17.77 W/m ²	–		

(1) Based on a rectangular space of 8.516 m x 4.519 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
9	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 207 CAD

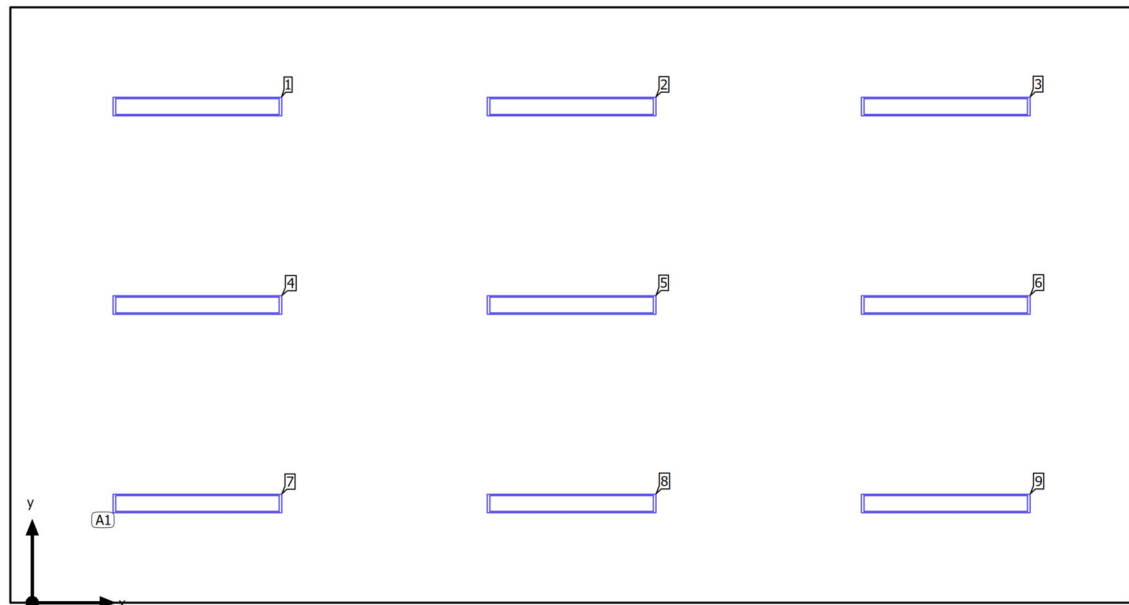Luminaire layout plan

Building B · FIRST FOOR · 207 CAD

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

9 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.253 m / 0.753 m / 3.300 m	1.253 m	3.766 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 2.839 m	4.092 m	3.766 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 1.506 m	6.931 m	3.766 m	3.300 m	3
Arrangement	A1	1.253 m	2.259 m	3.300 m	4
		4.092 m	2.259 m	3.300 m	5
		6.931 m	2.259 m	3.300 m	6
		1.253 m	0.753 m	3.300 m	7
		4.092 m	0.753 m	3.300 m	8
		6.931 m	0.753 m	3.300 m	9

Building B · FIRST FOOR · 207 CAD

Luminaire list Φ_{total}

41967 lm

 P_{total}

684.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects

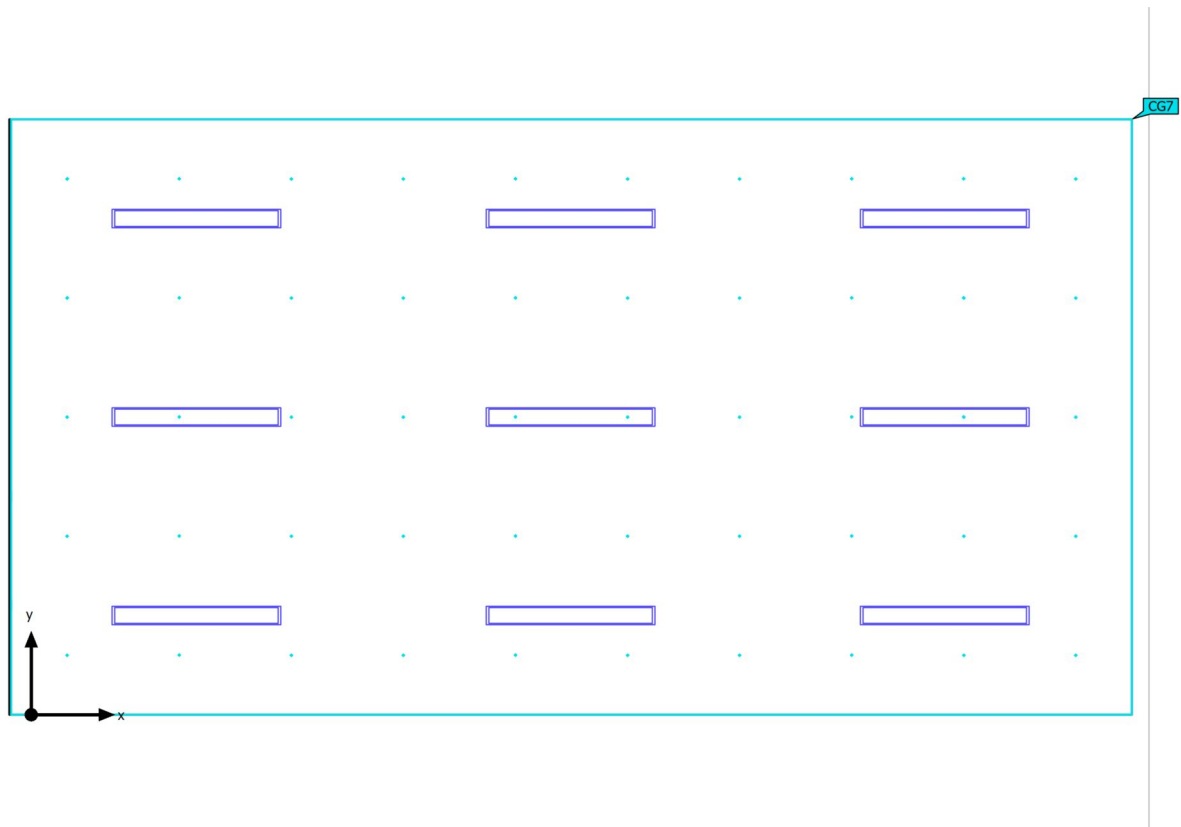

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
207 CAD Perpendicular illuminance Height: 0.700 m	548 lx	366 lx	691 lx	0.67	0.53	CG7

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects


207 CAD (RUG)

Strongest glare at	15°
max	18.5
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG7

Building B · FIRST FOOR · 207 CAD (Light scene 1)

Calculation objects


207 CAD (RUG)

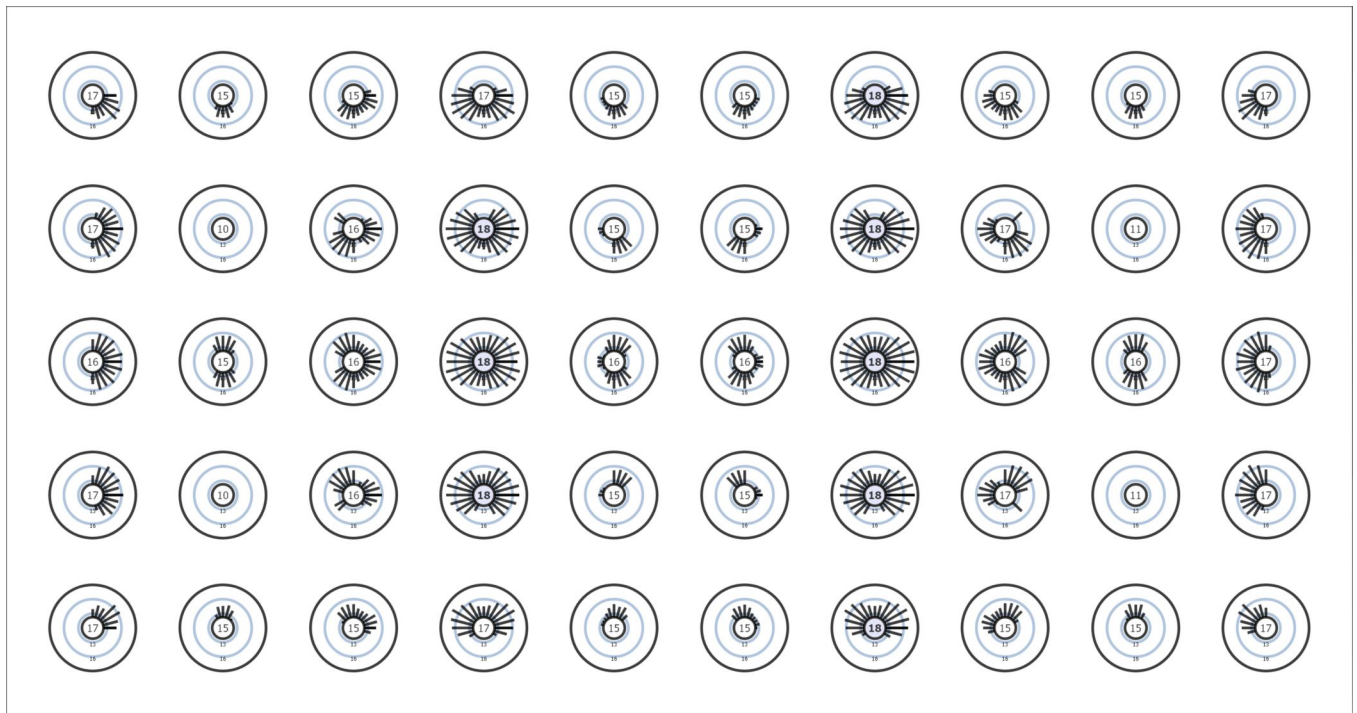

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 207 CAD (Light scene 1)

207 CAD

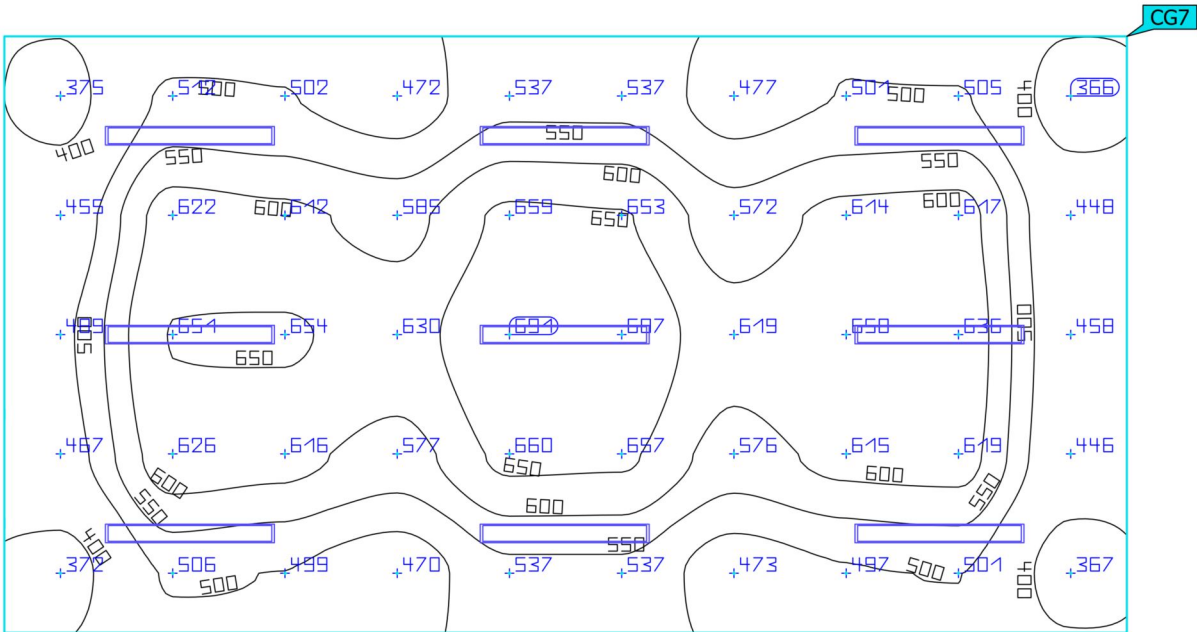


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
207 CAD Perpendicular illuminance Height: 0.700 m	548 lx	366 lx	691 lx	0.67	0.53	CG7

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

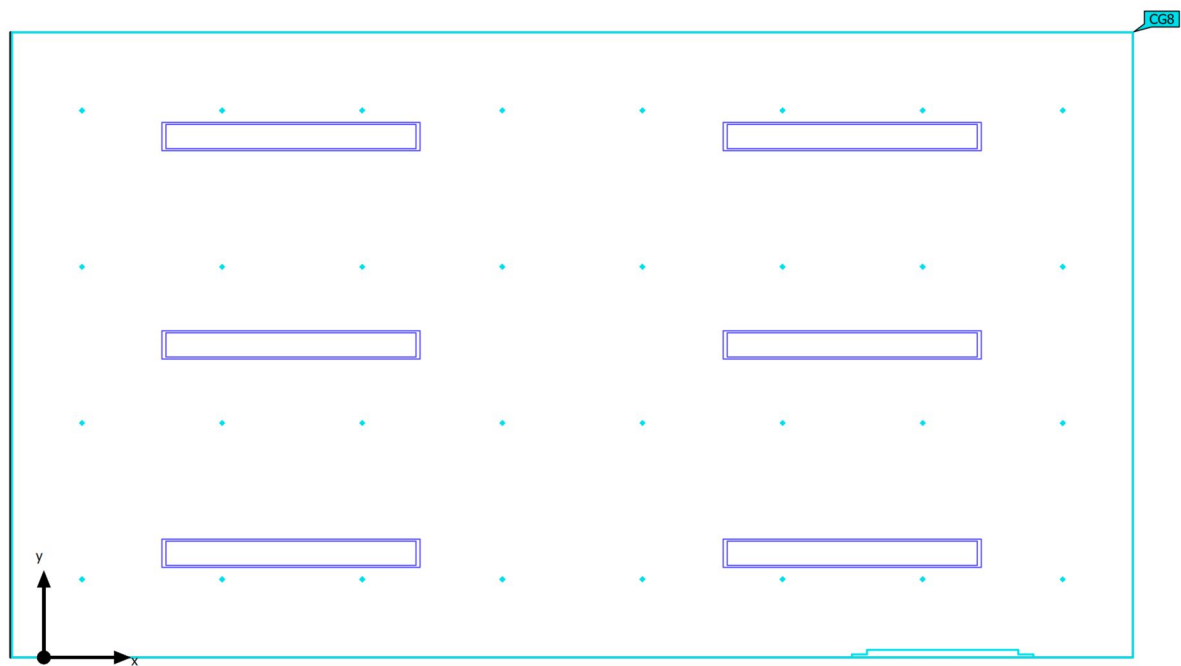

Ground area	17.26 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	1129 kWh/a	max. 650 kWh/a	✗	
Space	Lighting power density	26.43 W/m ²	–		

(1) Based on a rectangular space of 5.566 m x 3.100 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
6	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 208 MEETING

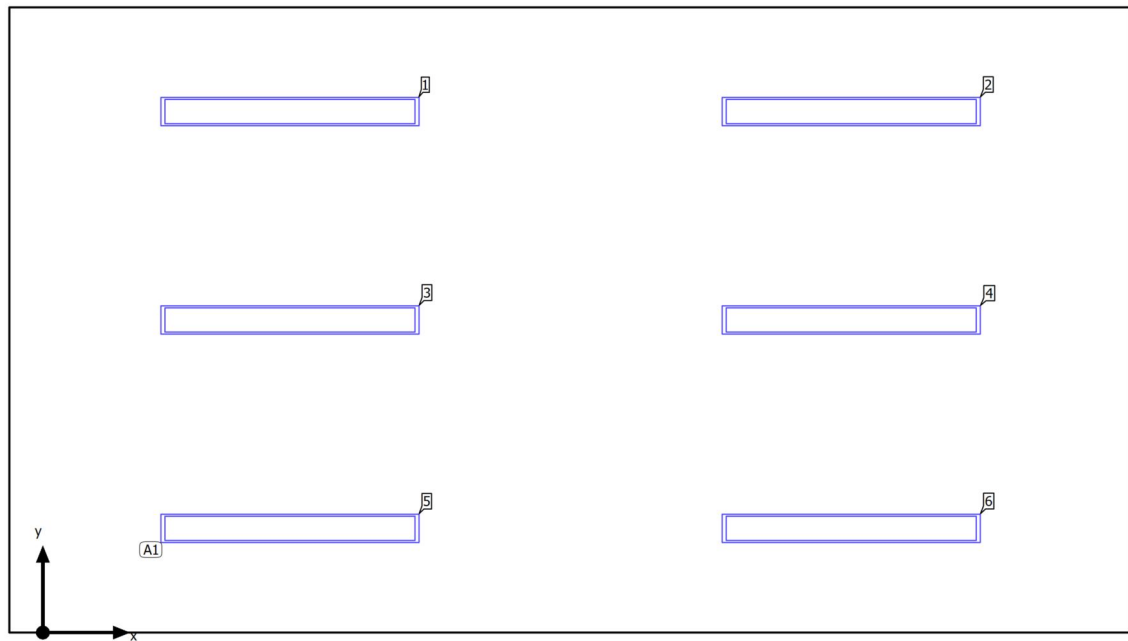Luminaire layout plan

Building B · FIRST FOOR · 208 MEETING

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

6 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.225 m / 0.517 m / 3.300 m	1.225 m	2.583 m	3.300 m	1
X-direction	2 pcs., Centre - centre, 2.783 m	4.008 m	2.583 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 1.033 m	1.225 m	1.550 m	3.300 m	3
		4.008 m	1.550 m	3.300 m	4
Arrangement	A1	1.225 m	0.517 m	3.300 m	5
		4.008 m	0.517 m	3.300 m	6

Building B · FIRST FOOR · 208 MEETING

Luminaire list Φ_{total}

27978 lm

 P_{total}

456.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
6	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Calculation objects

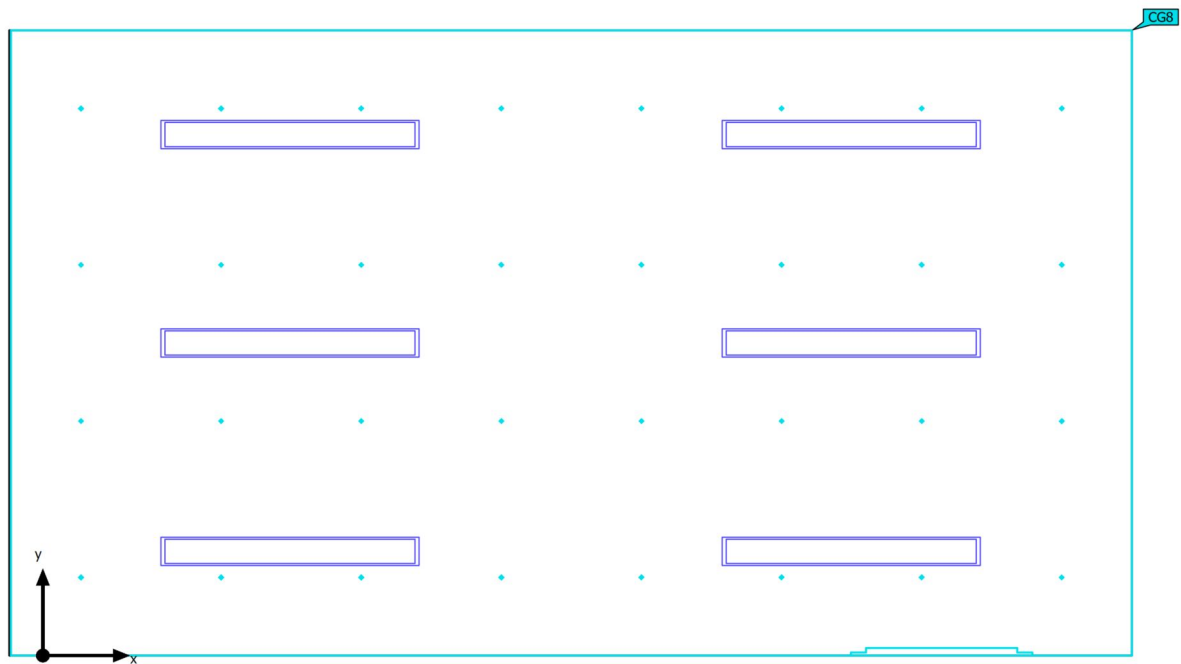

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
208 Meeting Perpendicular illuminance Height: 0.700 m	686 lx	489 lx	853 lx	0.71	0.57	CG8

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 208 MEETING (Light scene 1)

208 Meeting

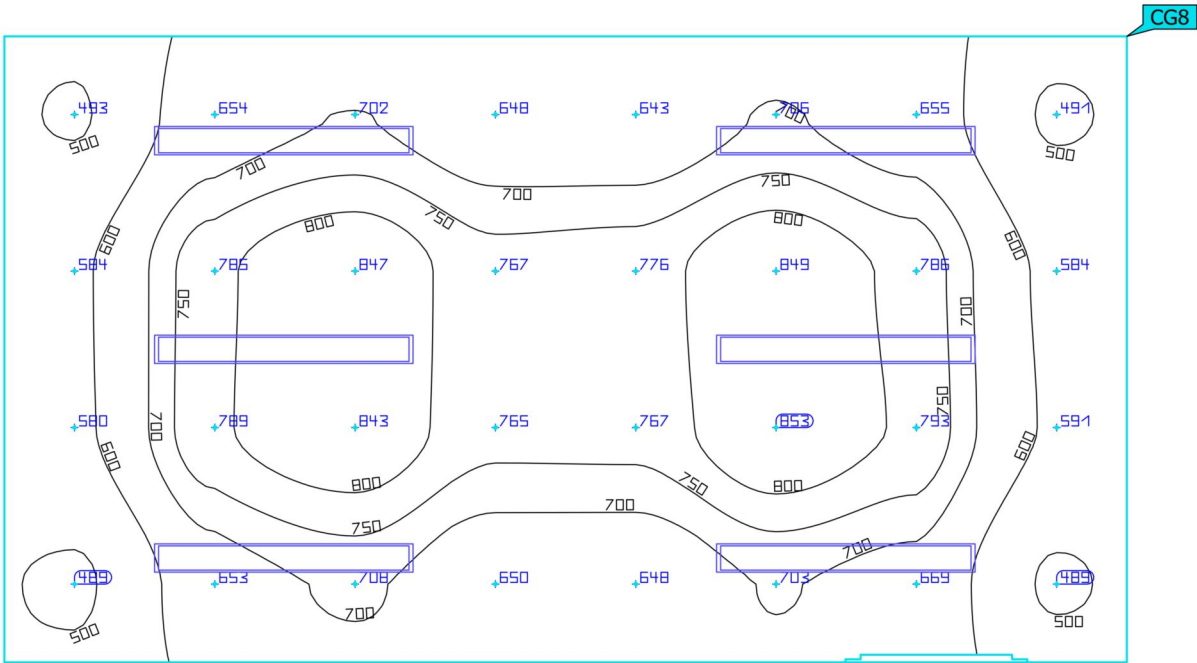


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
208 Meeting Perpendicular illuminance Height: 0.700 m	686 lx	489 lx	853 lx	0.71	0.57	CG8

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

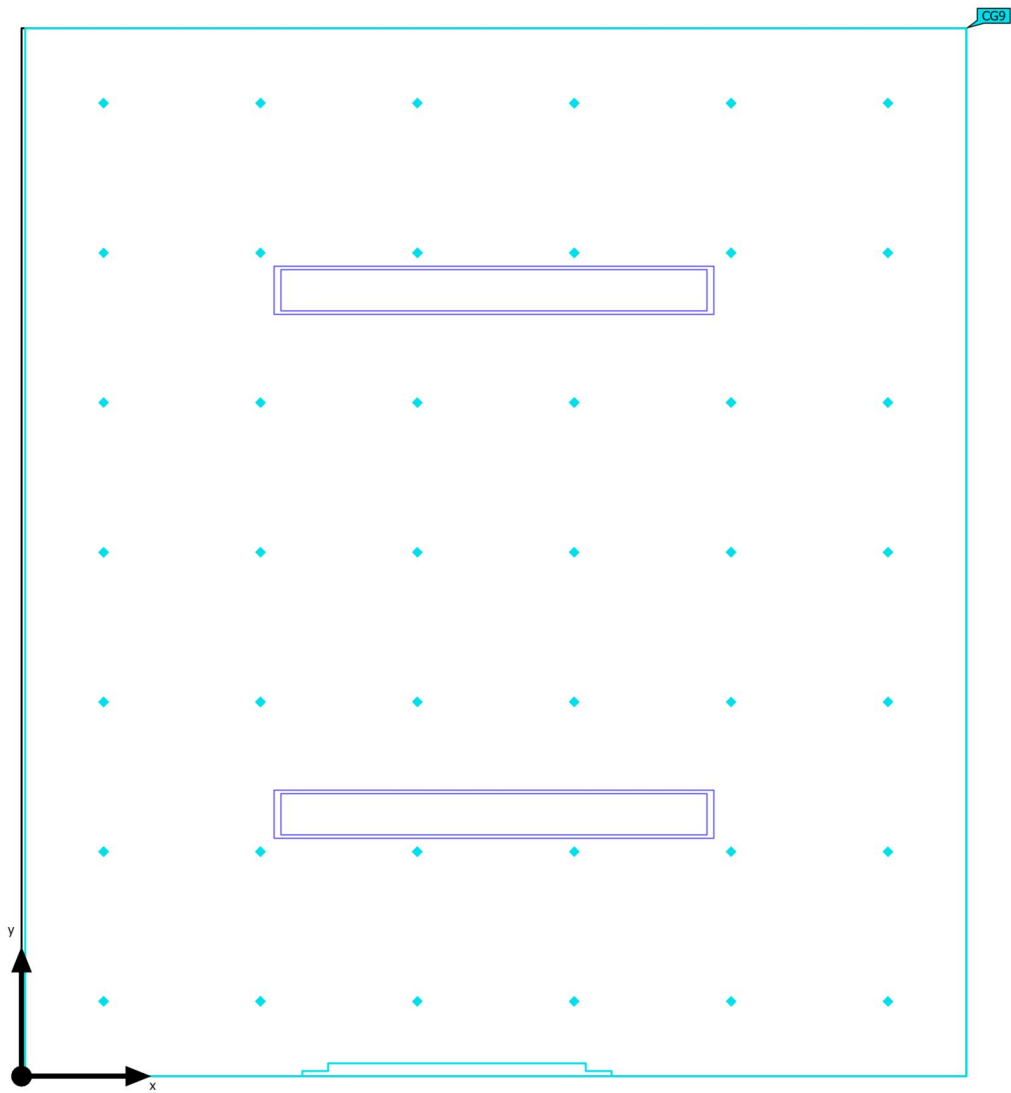

Ground area	8.39 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.76 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[237 - 376] kWh/a	max. 300 kWh/a	✗	
Space	Lighting power density	18.12 W/m ²	–		

(1) Based on a rectangular space of 3.050 m x 2.750 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
2	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 209 TOILET

Luminaire layout plan

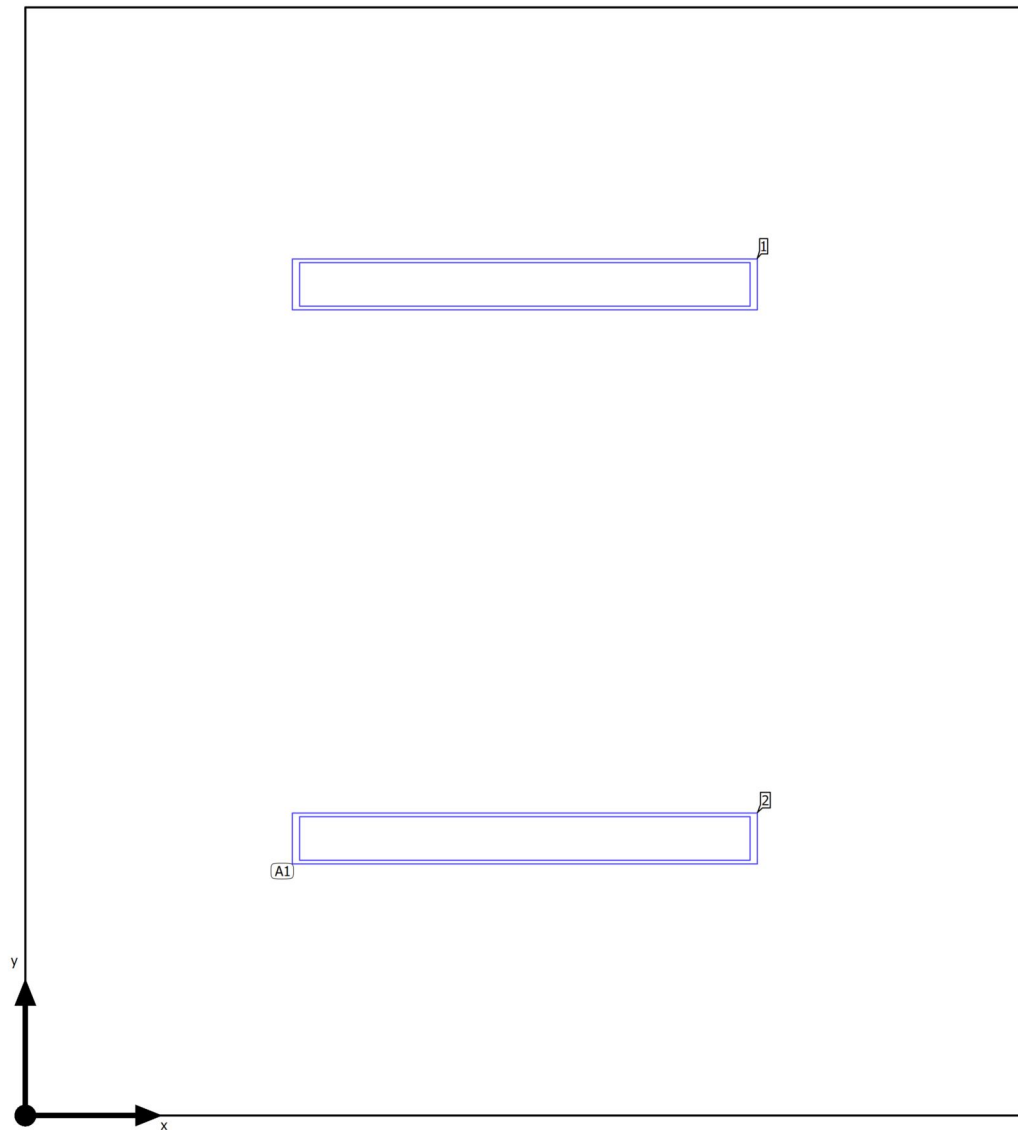

Building B · FIRST FOOR · 209 TOILET

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

2 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.375 m / 0.763 m / 3.300 m	1.375 m	2.287 m	3.300 m	1
X-direction	1 pcs., Centre - centre, 2.750 m	1.375 m	0.763 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 1.525 m				
Arrangement	A1				

Building B · FIRST FOOR · 209 TOILET


Luminaire list

Φ_{total} 9326 lm	P_{total} 152.0 W	Luminous efficacy 61.4 lm/W
----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
2	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Calculation objects

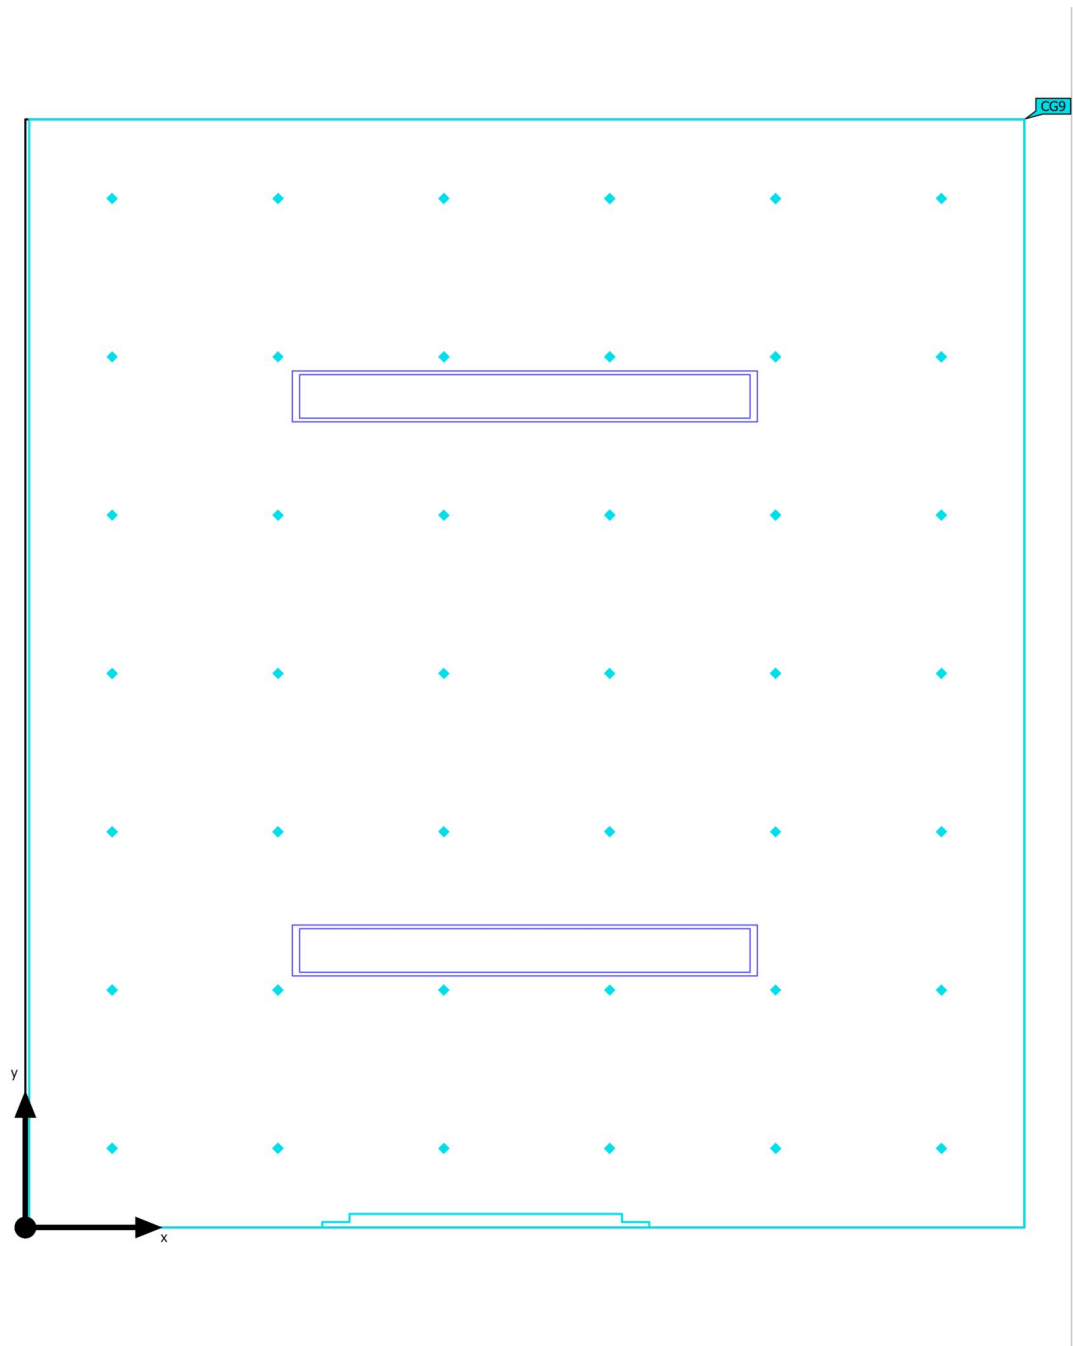

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
209 Toilet Perpendicular illuminance Height: 0.000 m	310 lx	238 lx	376 lx	0.77	0.63	CG9

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 209 TOILET (Light scene 1)

209 Toilet

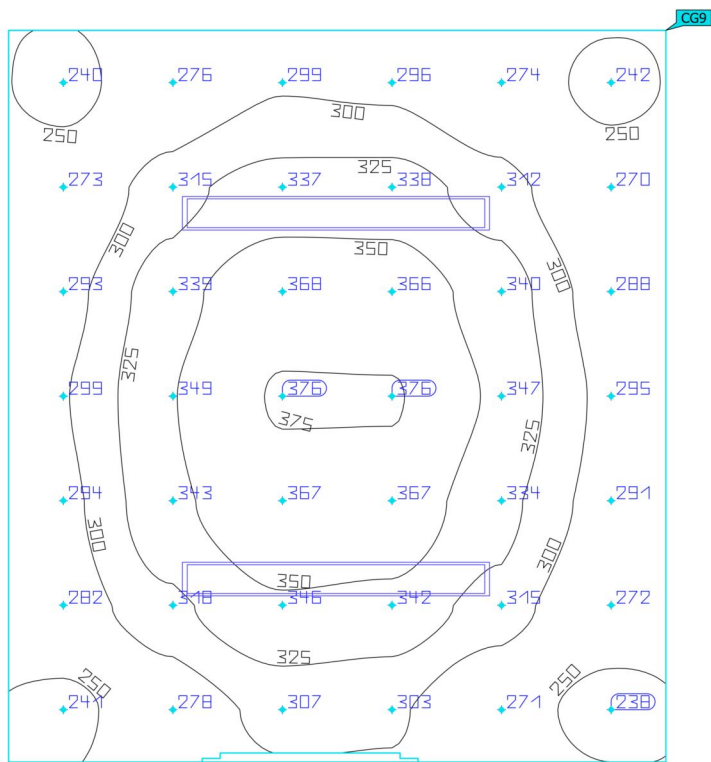


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
209 Toilet Perpendicular illuminance Height: 0.000 m	310 lx	238 lx	376 lx	0.77	0.63	CG9

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

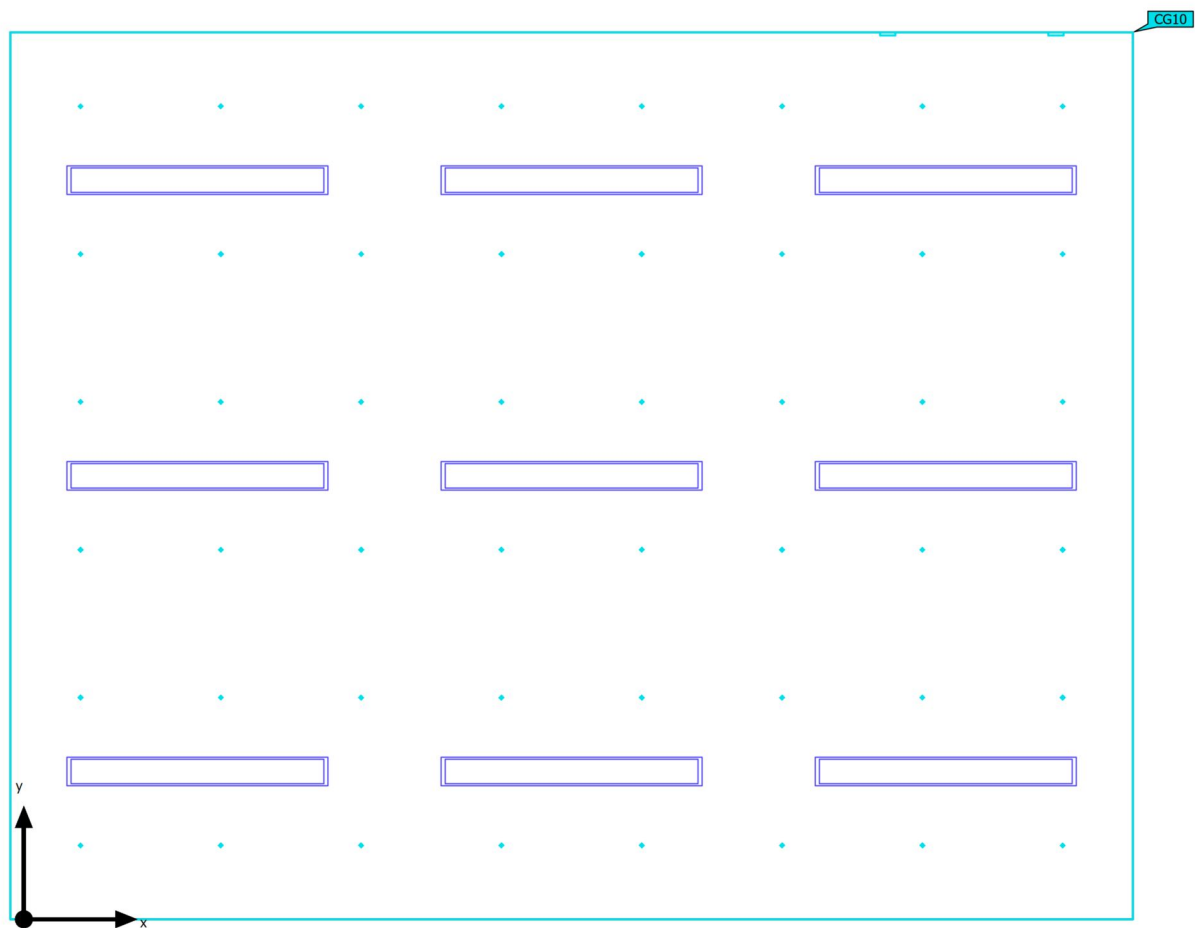

Ground area	23.95 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	23	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	1693 kWh/a	max. 850 kWh/a	✗	
Space	Lighting power density	28.56 W/m ²	–		

(1) Based on a rectangular space of 5.505 m x 4.350 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
9	Philips		2x36W	23	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 210 OFFICE

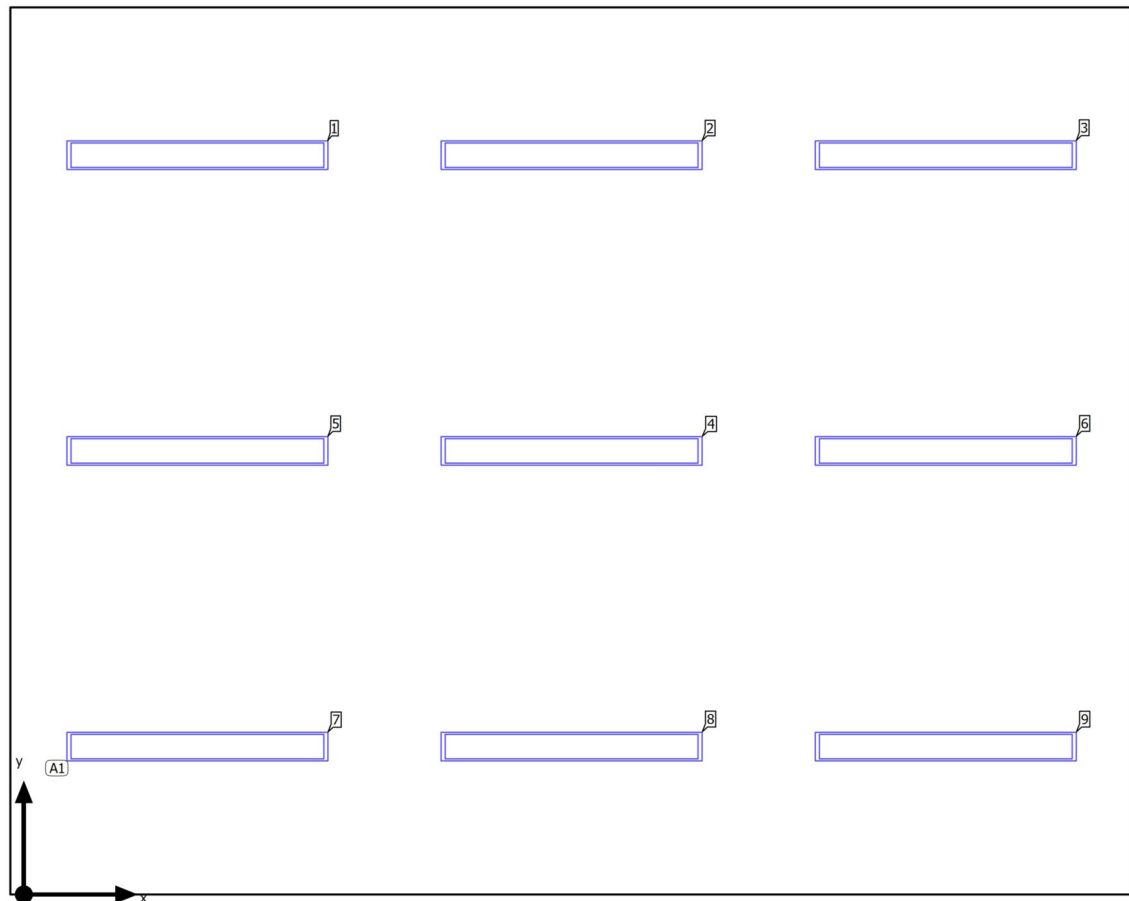Luminaire layout plan

Building B · FIRST FOOR · 210 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

9 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.851 m / 0.725 m / 3.300 m	0.851 m	3.625 m	3.300 m	1
X-direction	3 pcs., Centre - centre, 1.835 m	2.686 m	3.625 m	3.300 m	2
		4.521 m	3.625 m	3.300 m	3
Y-direction	3 pcs., Centre - centre, 1.450 m	2.686 m	2.175 m	3.300 m	4
		0.851 m	2.175 m	3.300 m	5
Arrangement	A1	4.521 m	2.175 m	3.300 m	6
		0.851 m	0.725 m	3.300 m	7
		2.686 m	0.725 m	3.300 m	8
		4.521 m	0.725 m	3.300 m	9

Building B · FIRST FOOR · 210 OFFICE

Luminaire list Φ_{total}

41967 lm

 P_{total}

684.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
9	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects

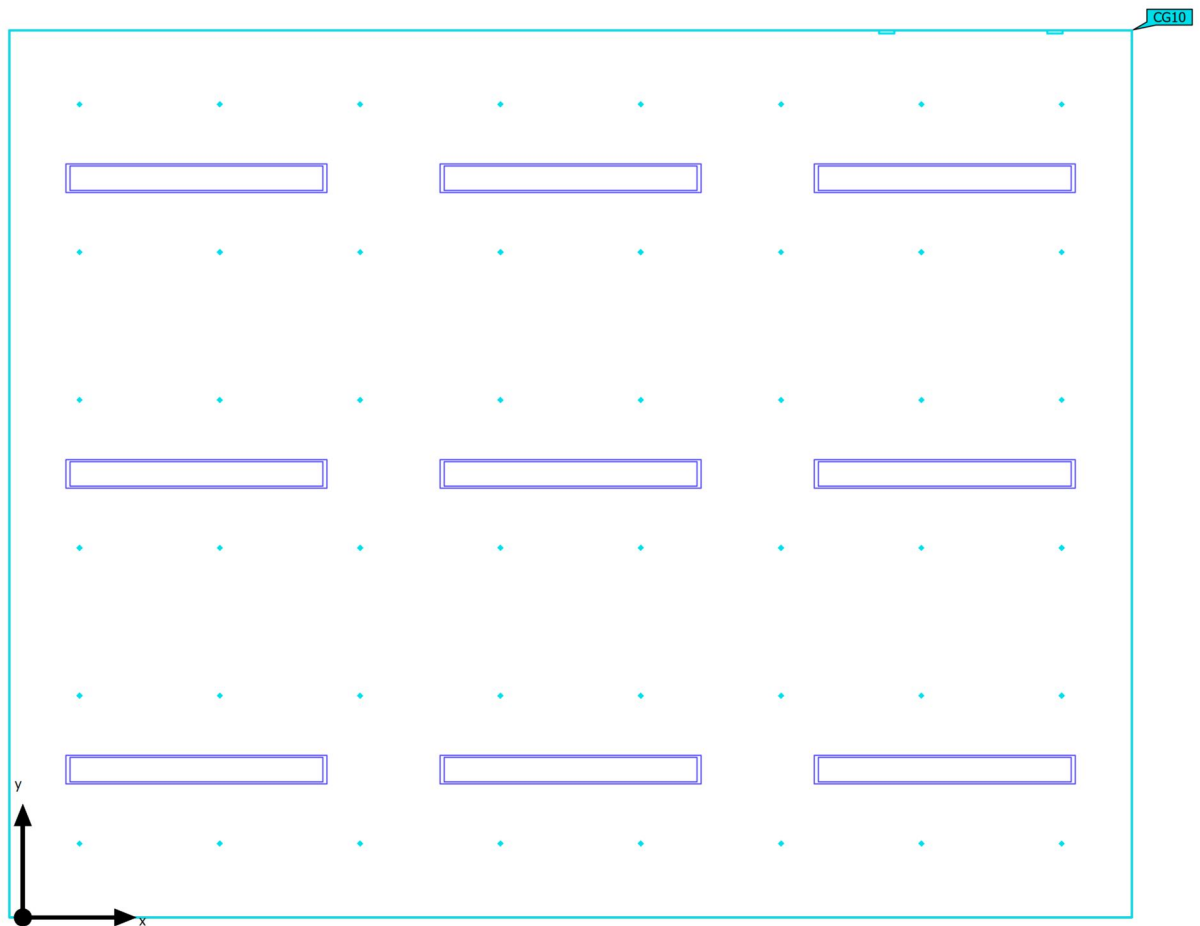

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
210 Office Perpendicular illuminance Height: 0.700 m	827 lx	544 lx	1017 lx	0.66	0.53	CG10

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects


210 Office (RUG)

Strongest glare at	165°
max	17.3
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG10

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

Calculation objects


210 Office (RUG)

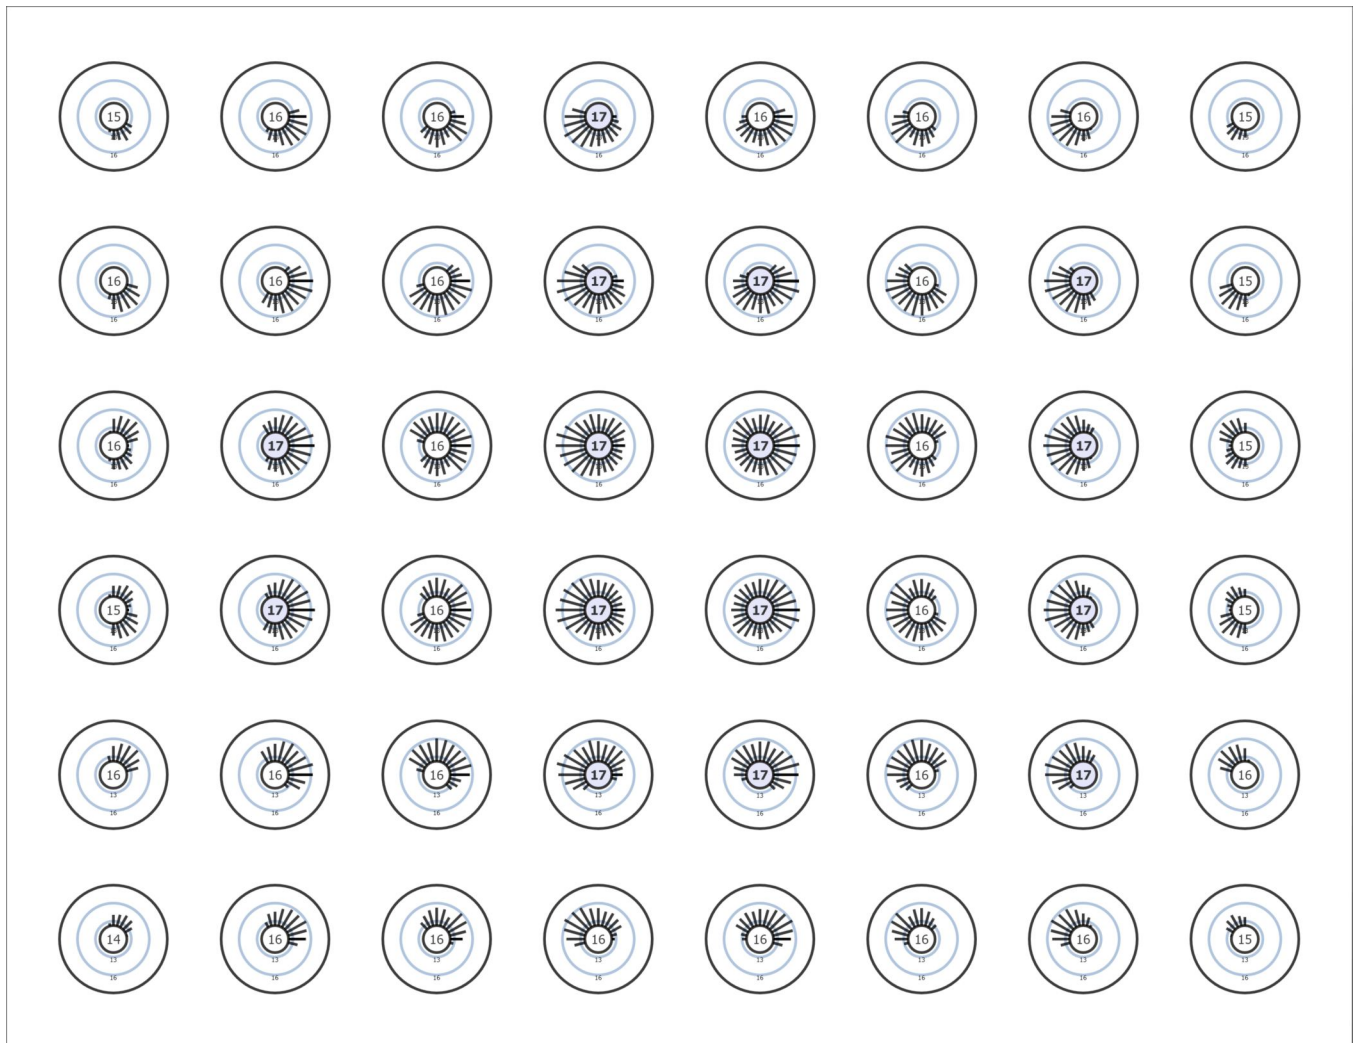

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 210 OFFICE (Light scene 1)

210 Office

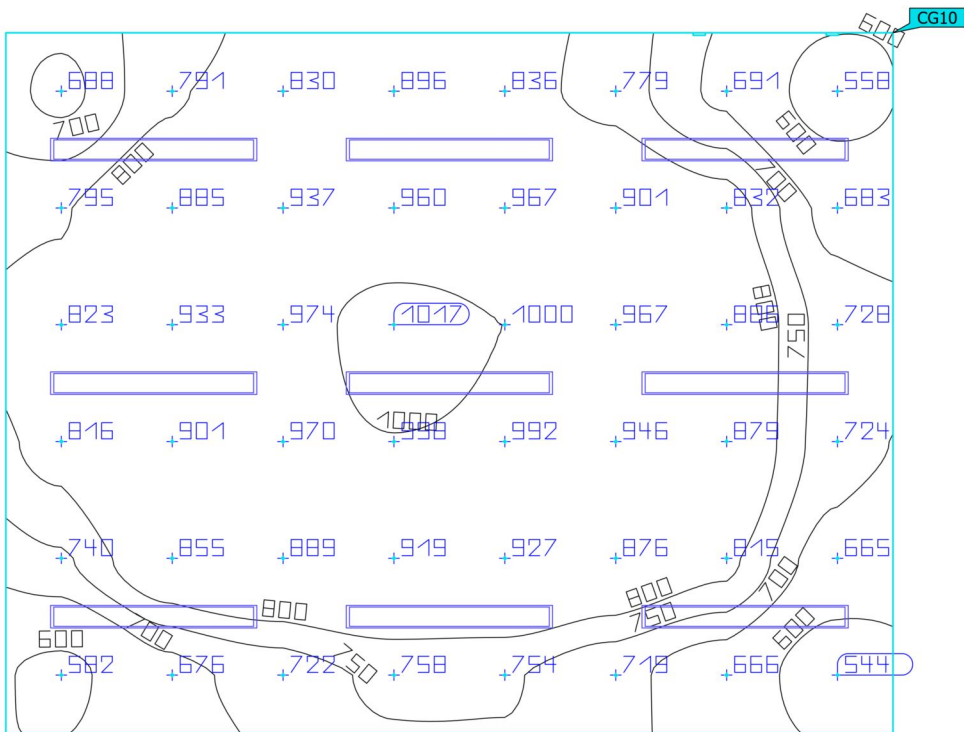


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
210 Office Perpendicular illuminance Height: 0.700 m	827 lx	544 lx	1017 lx	0.66	0.53	CG10

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

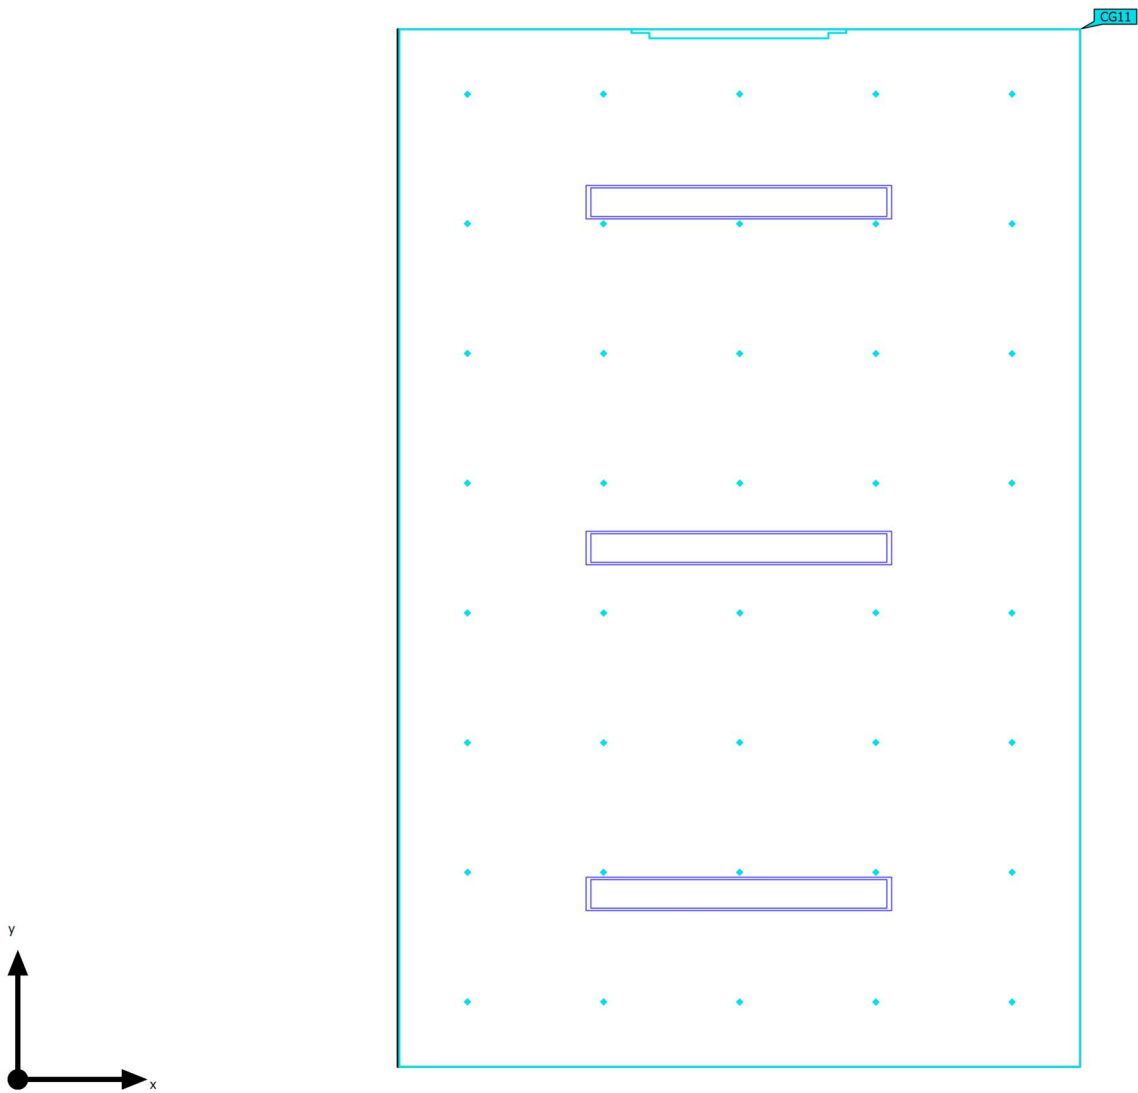

Ground area	12.43 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[356 - 564] kWh/a	max. 450 kWh/a	✗	
Space	Lighting power density	18.35 W/m ²	–		

(1) Based on a rectangular space of 4.347 m x 2.859 m and SHR of 0.25.



(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
3	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 211 TOILET

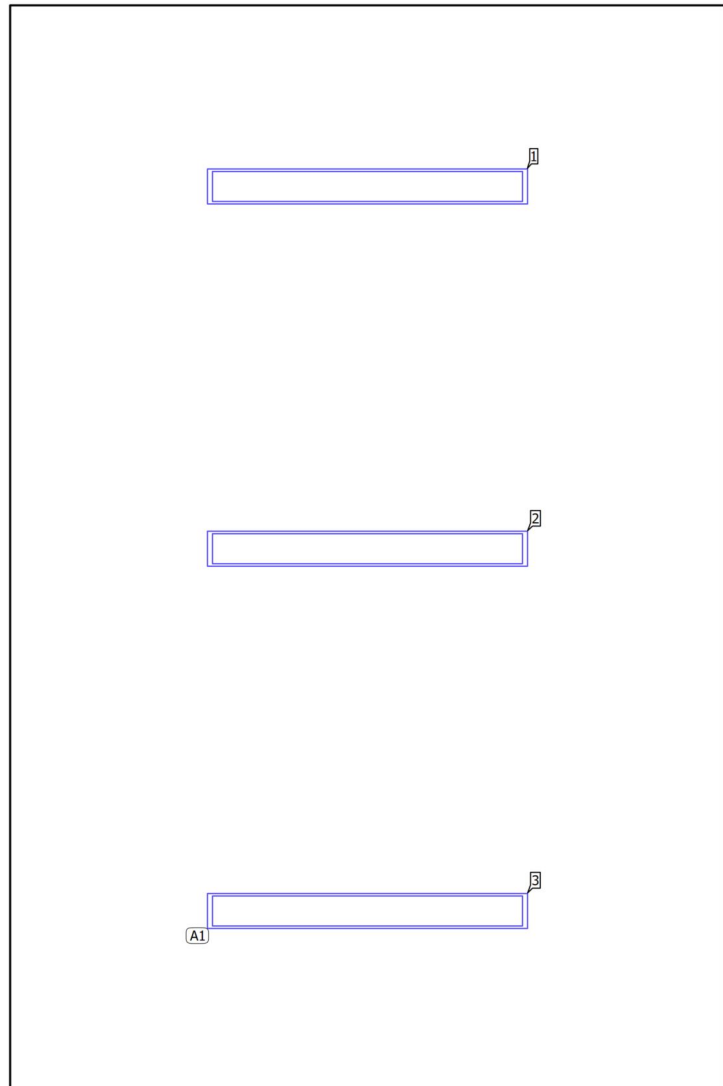Luminaire layout plan

Building B · FIRST FOOR · 211 TOILET

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

3 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	3.021 m / 0.777 m / 3.300 m	3.021 m	3.675 m	3.300 m	1
X-direction	1 pcs., Centre - centre, 2.859 m	3.021 m	2.226 m	3.300 m	2
Y-direction	3 pcs., Centre - centre, 1.449 m	3.021 m	0.777 m	3.300 m	3
Arrangement	A1				

Building B · FIRST FOOR · 211 TOILET



Luminaire list

Φ_{total} 13989 lm	P_{total} 228.0 W	Luminous efficacy 61.4 lm/W
-----------------------------------	-------------------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
3	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

Calculation objects

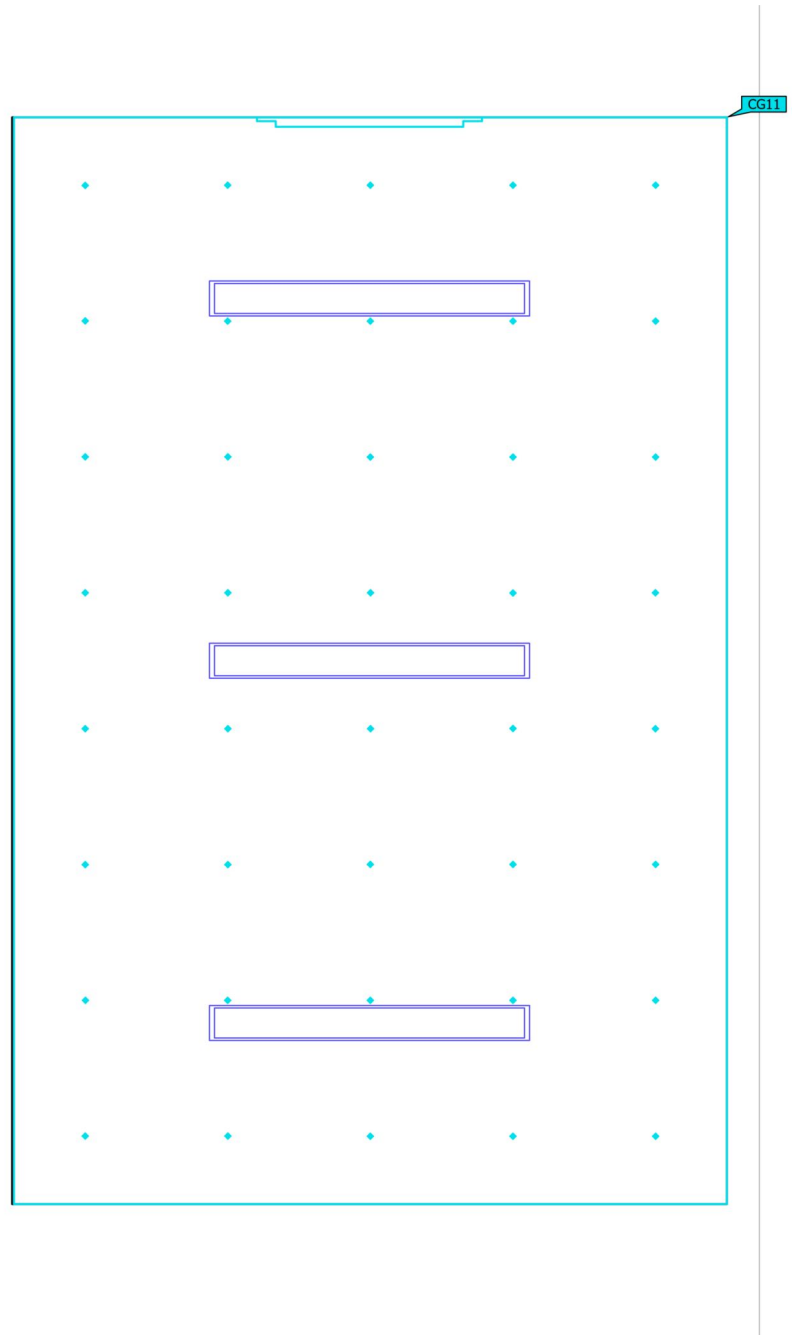

Building B · FIRST FOOR · 211 TOILET (Light scene 1)


Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
211 Toilet Perpendicular illuminance Height: 0.000 m	361 lx	266 lx	451 lx	0.74	0.59	CG11

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 211 TOILET (Light scene 1)

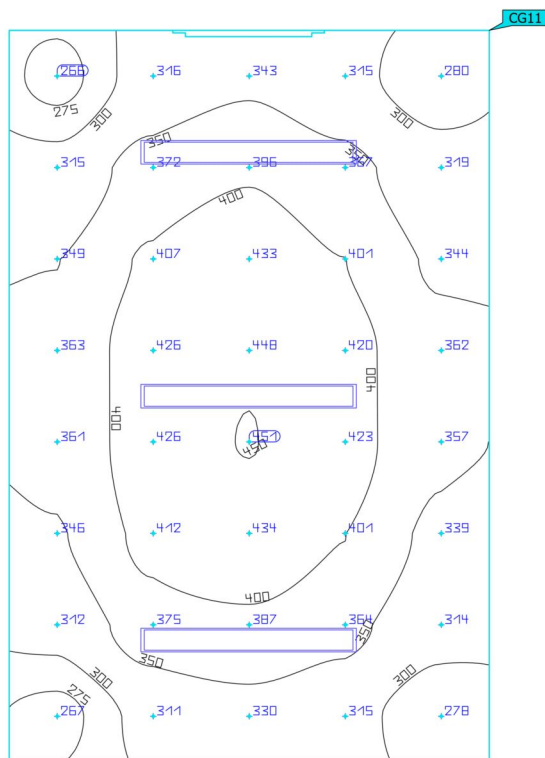
211 Toilet

Properties	$\bar{E}$	$E_{\min}$	$E_{\max}$	$U_o (g_1)$	g_2	Index
211 Toilet	361 lx	266 lx	451 lx	0.74	0.59	CG11
Perpendicular illuminance						
Height: 0.000 m						

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

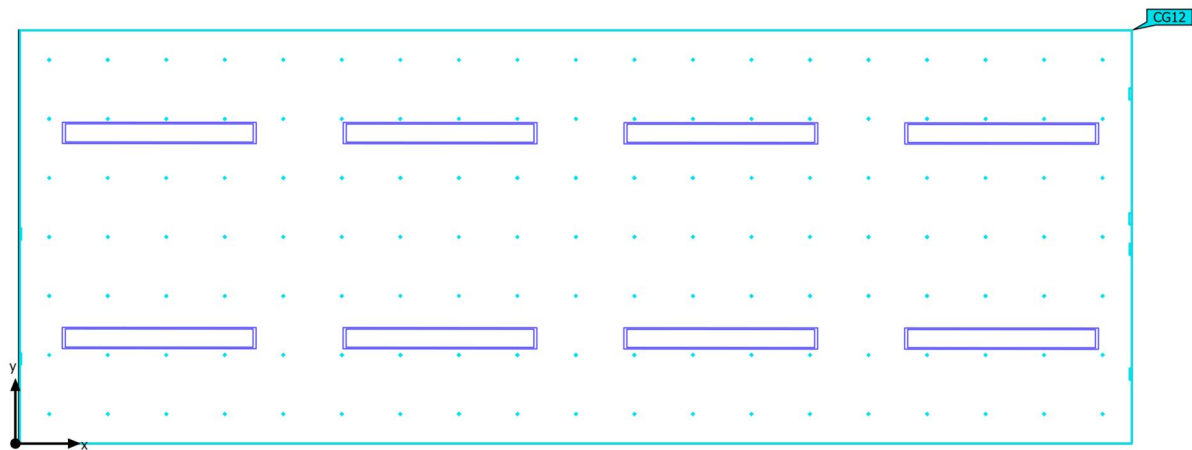

Ground area	20.07 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.76 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	1505 kWh/a	max. 750 kWh/a	✗	
Space	Lighting power density	30.30 W/m ²	–		

(1) Based on a rectangular space of 7.350 m x 2.730 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212 OFFICE

Luminaire layout plan

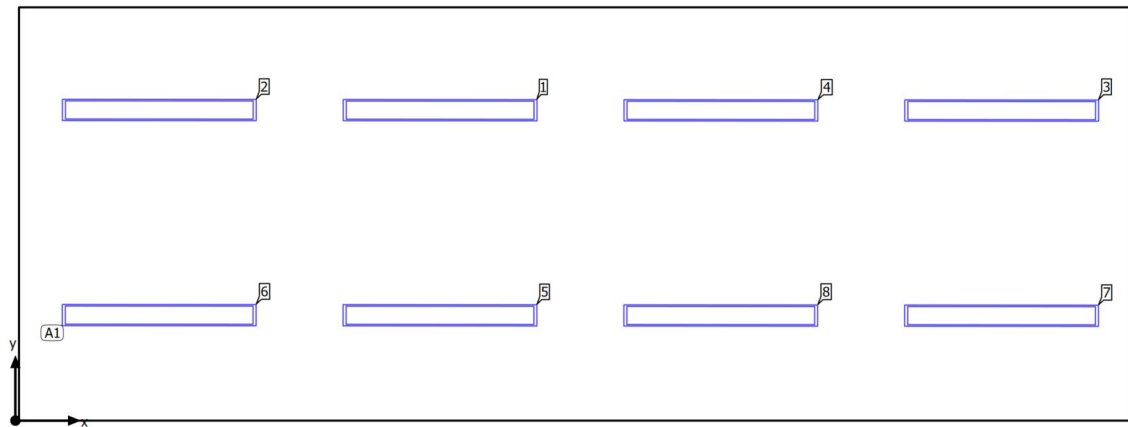

Building B · FIRST FOOR · 212 OFFICE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	0.950 m / 0.697 m / 3.300 m	2.805 m	2.051 m	3.300 m	1
X-direction	4 pcs., Centre - centre, 1.855 m	0.951 m	2.052 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 1.355 m	6.514 m	2.048 m	3.300 m	3
Arrangement	A1	4.660 m	2.049 m	3.300 m	4
		2.804 m	0.696 m	3.300 m	5
		0.950 m	0.697 m	3.300 m	6
		6.513 m	0.693 m	3.300 m	7
		4.659 m	0.694 m	3.300 m	8

Building B · FIRST FOOR · 212 OFFICE

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Calculation objects

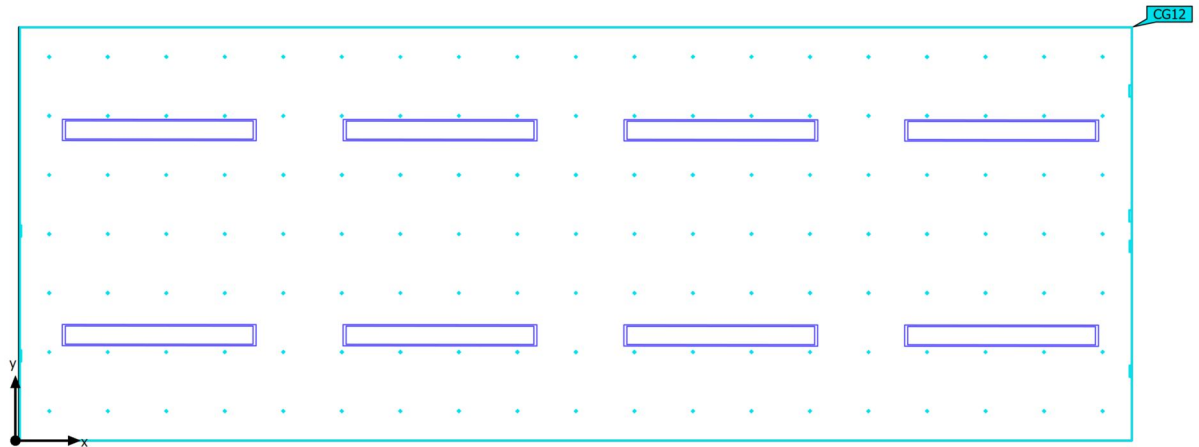

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212 Office Perpendicular illuminance Height: 0.700 m	768 lx	488 lx	932 lx	0.64	0.52	CG12

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

Calculation objects


212 Office (RUG)

Strongest glare at	195°
max	16.8
Target	≤ 19.0
Viewing sector	0° - 360°
Step width	15°
Height	1.200 m
Index	CG12

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)


Calculation objects

212 Office (RUG)

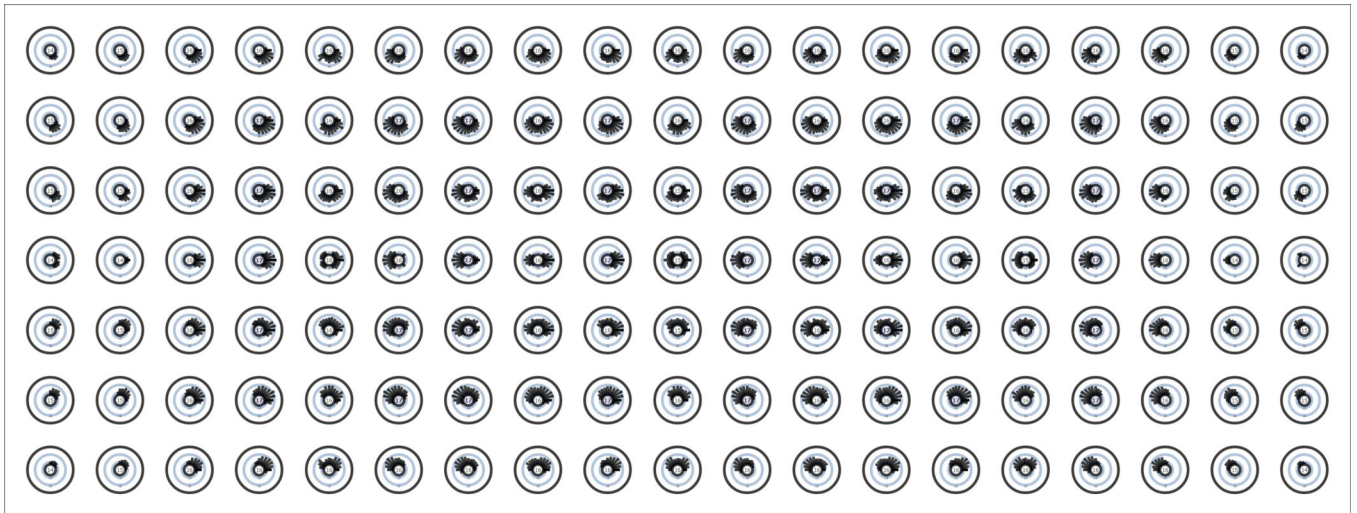

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212 OFFICE (Light scene 1)

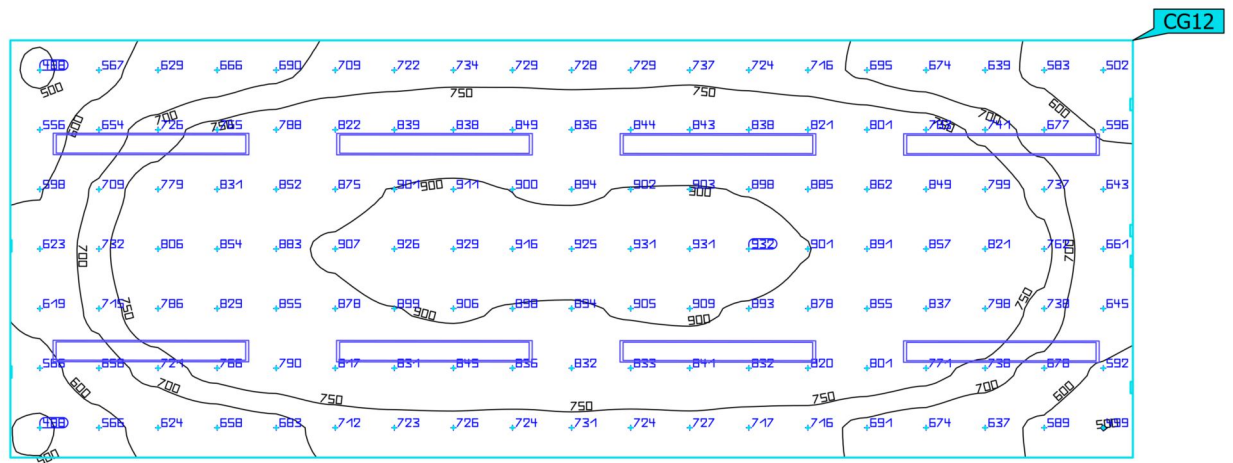
212 Office

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212 Office Perpendicular illuminance Height: 0.700 m	768 lx	488 lx	932 lx	0.64	0.52	CG12

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

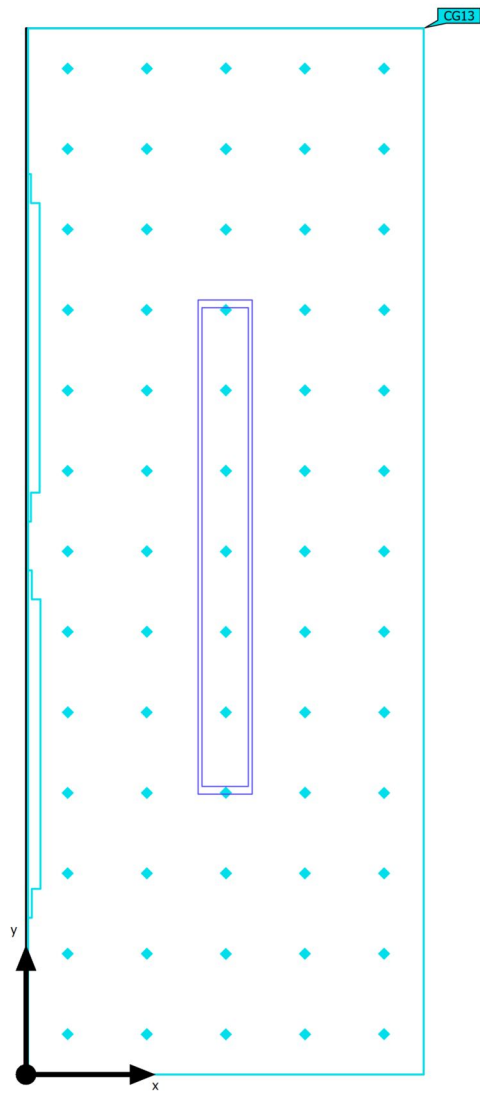

Ground area	2.79 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %	Clearance height	3.300 m
Maintenance factor	0.76 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · 212A DB (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 100 kWh/a	✗	
Space	Lighting power density	27.23 W/m ²	–		

(1) Based on a rectangular space of 1.030 m x 2.710 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building B · FIRST FOOR · 212A DB

Luminaire layout plan

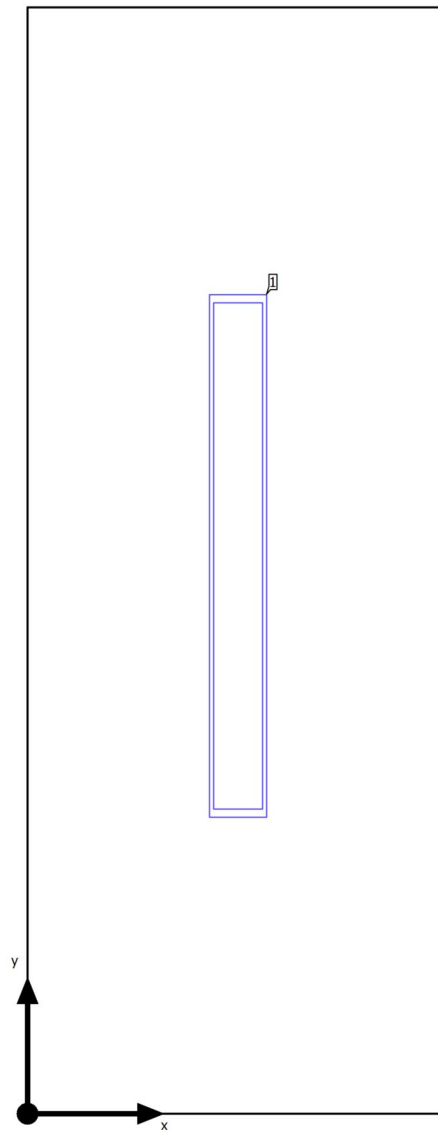

Building B · FIRST FOOR · 212A DB

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.516 m	1.366 m	3.300 m	1

Building B · FIRST FOOR · 212A DB


Luminaire list

Φ_{total} 4663 lm	P_{total} 76.0 W	Luminous efficacy 61.4 lm/W
---------------------------	-----------------------	--------------------------------

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 212A DB (Light scene 1)

Calculation objects

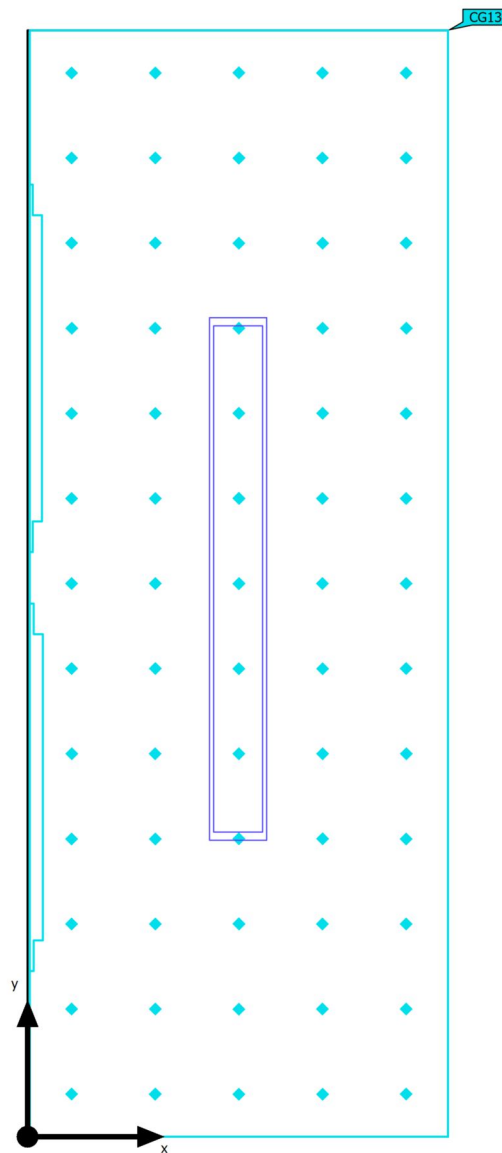

Building B · FIRST FOOR · 212A DB (Light scene 1)

Calculation objects


Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212A DB Perpendicular illuminance Height: 0.000 m	227 lx	176 lx	263 lx	0.78	0.67	CG13

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 212A DB (Light scene 1)

212A DB

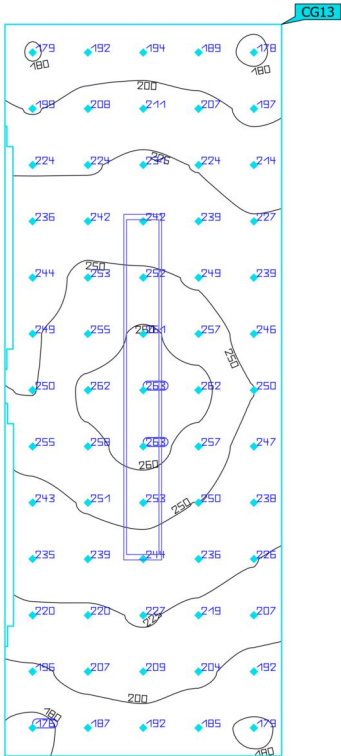


Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
212A DB Perpendicular illuminance Height: 0.000 m	227 lx	176 lx	263 lx	0.78	0.67	CG13

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

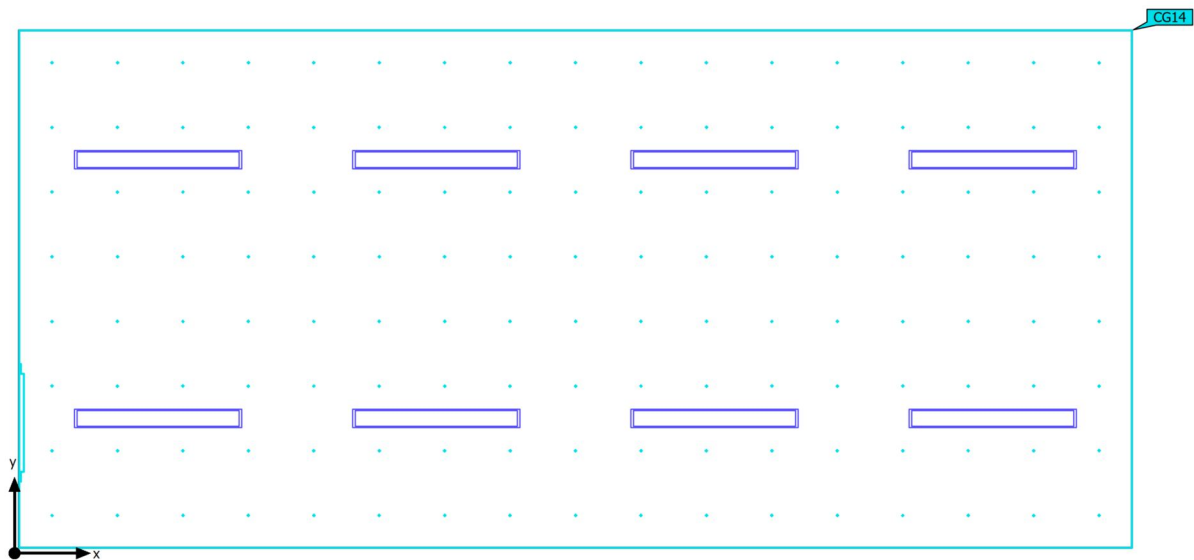

Ground area	33.71 m²
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 %
Maintenance factor	0.76 (fixed)

Clearance height	3.300 m
Mounting height	3.300 m

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	25	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	[948 - 1505] kWh/a	max. 1200 kWh/a	✗	
Space	Lighting power density	18.04 W/m ²	–		

(1) Based on a rectangular space of 8.516 m x 3.958 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Luminaire list


pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
8	Philips		2x36W	25	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire layout plan

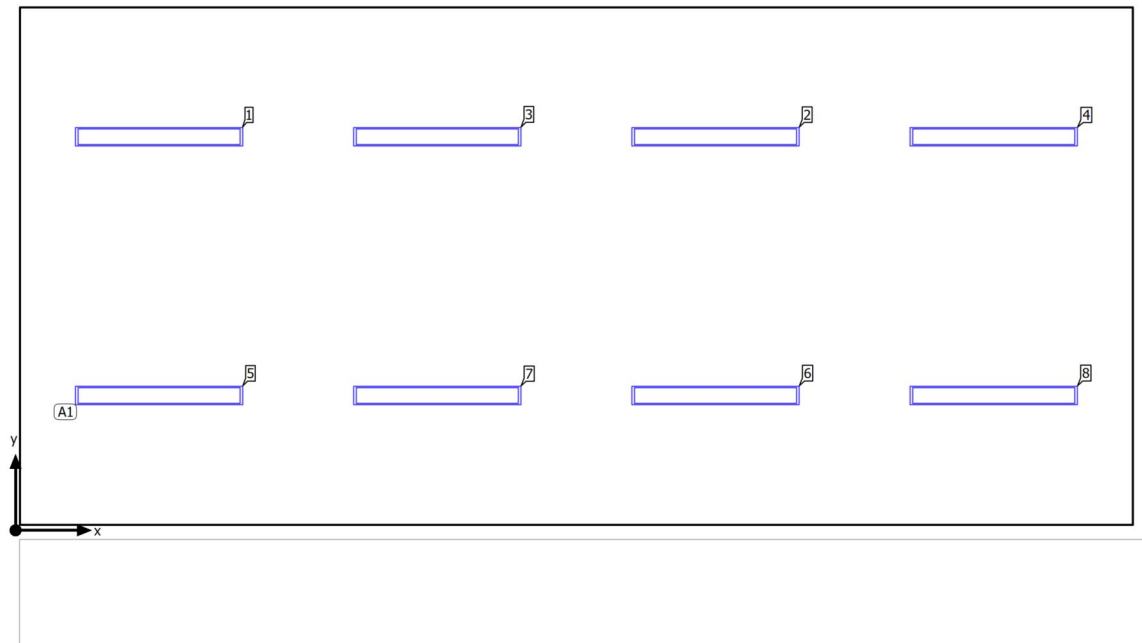

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire layout plan

Manufacturer	Philips	P	76.0 W
Article name	2x36W	$\Phi_{\text{Luminaire}}$	4663 lm
Fitting	2x T8 36W/827		

8 x Philips 2x36W

Type	Field Arrangement	X	Y	Mounting height	Luminaire
1st luminaire (X/Y/Z)	1.098 m / 1.031 m / 3.300 m	1.098 m	3.010 m	3.300 m	1
X-direction	4 pcs., Centre - centre, 2.129 m	5.356 m	3.010 m	3.300 m	2
Y-direction	2 pcs., Centre - centre, 1.979 m	3.227 m	3.010 m	3.300 m	3
		7.485 m	3.010 m	3.300 m	4
Arrangement	A1	1.098 m	1.031 m	3.300 m	5
		5.356 m	1.031 m	3.300 m	6
		3.227 m	1.031 m	3.300 m	7
		7.485 m	1.031 m	3.300 m	8

Building B · FIRST FOOR · 213 CONFERENCE

Luminaire list Φ_{total}

37304 lm

 P_{total}

608.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
8	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

Calculation objects

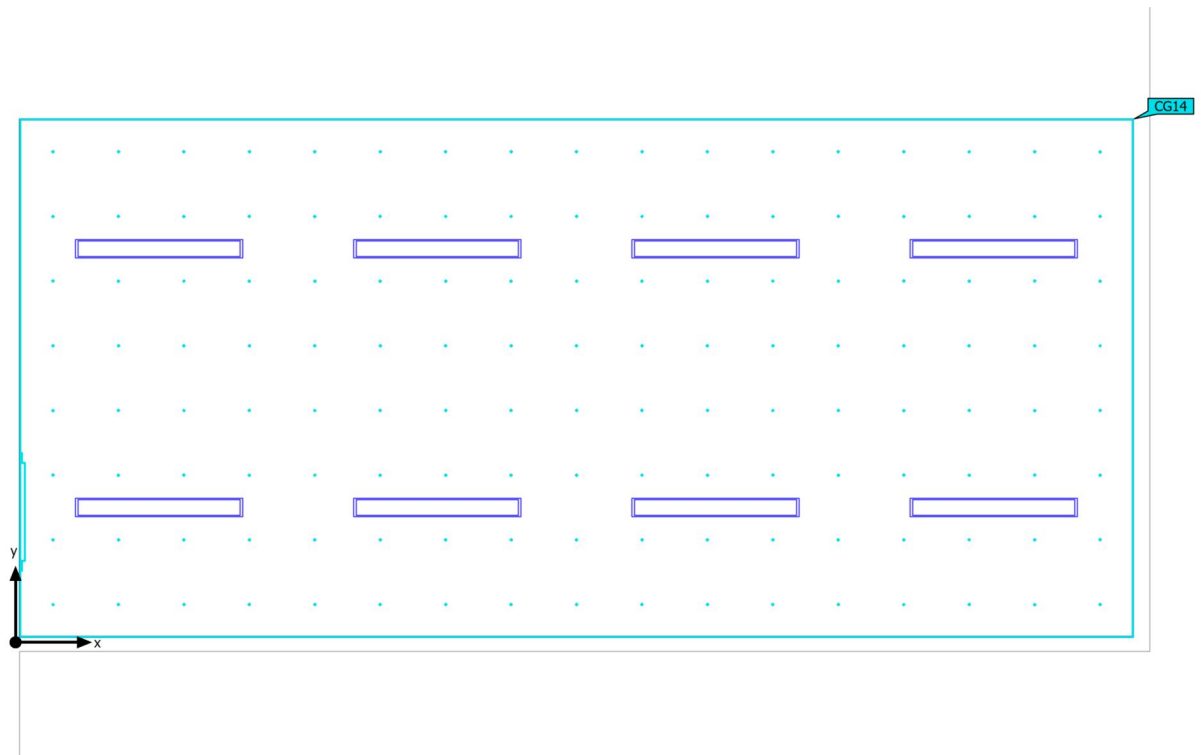

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)


Calculation objects

Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
213 Conference Perpendicular illuminance Height: 0.700 m	535 lx	320 lx	662 lx	0.60	0.48	CG14

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · 213 CONFERENCE (Light scene 1)

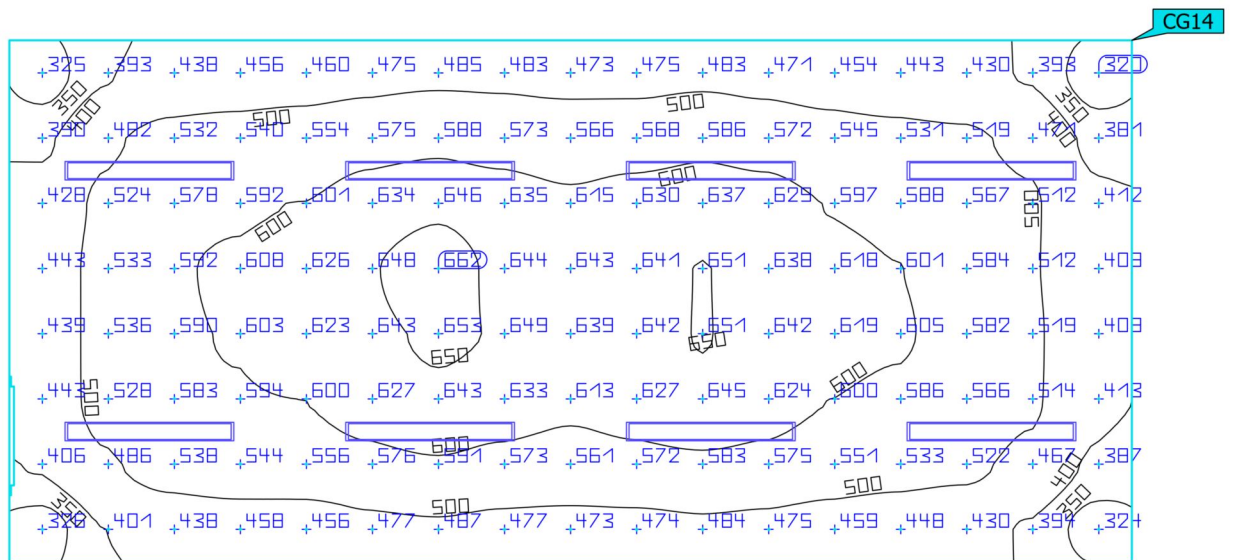
213 Conference

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
213 Conference	535 lx	320 lx	662 lx	0.60	0.48	CG14
Perpendicular illuminance						
Height: 0.700 m						

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · FIRST FOOR · Space 1 (Light scene 1)

Summary

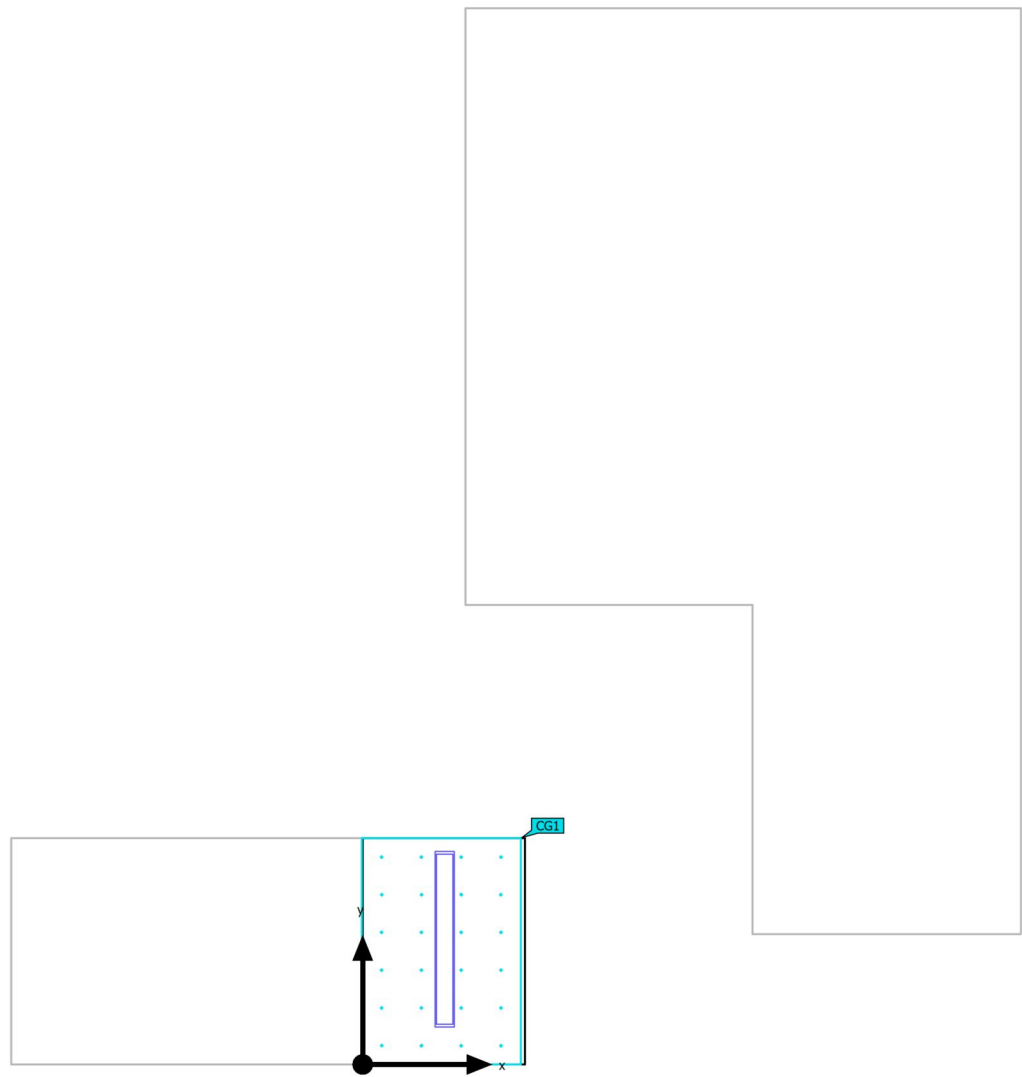

Ground area	1.95 m²		
Reflection factors	Ceiling: 70.0 %, Walls: 50.0 %, Floor: 0.0 %		
Maintenance factor	0.80 (fixed)	Mounting height	3.300 m

Building B · FIRST FOOR · Space 1 (Light scene 1)

Summary

Results

	Symbol	Calculated	Target	Check	Index
Glare valuation ⁽¹⁾	R _{UG, max}	21	≤ 19	✗	
Energy estimation ⁽²⁾	Consumption	188 kWh/a	max. 100 kWh/a	✗	
Space	Lighting power density	38.94 W/m ²	–		

(1) Based on a rectangular space of 1.650 m x 1.183 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (34.2 Standard (office))

Luminaire list

pcs.	Manufacturer	Article No.	Article name	R _{UG}	P	Φ	Luminous efficacy
1	Philips		2x36W	21	76.0 W	4663 lm	61.4 lm/W


Building B · FIRST FOOR · Space 1

Luminaire layout plan

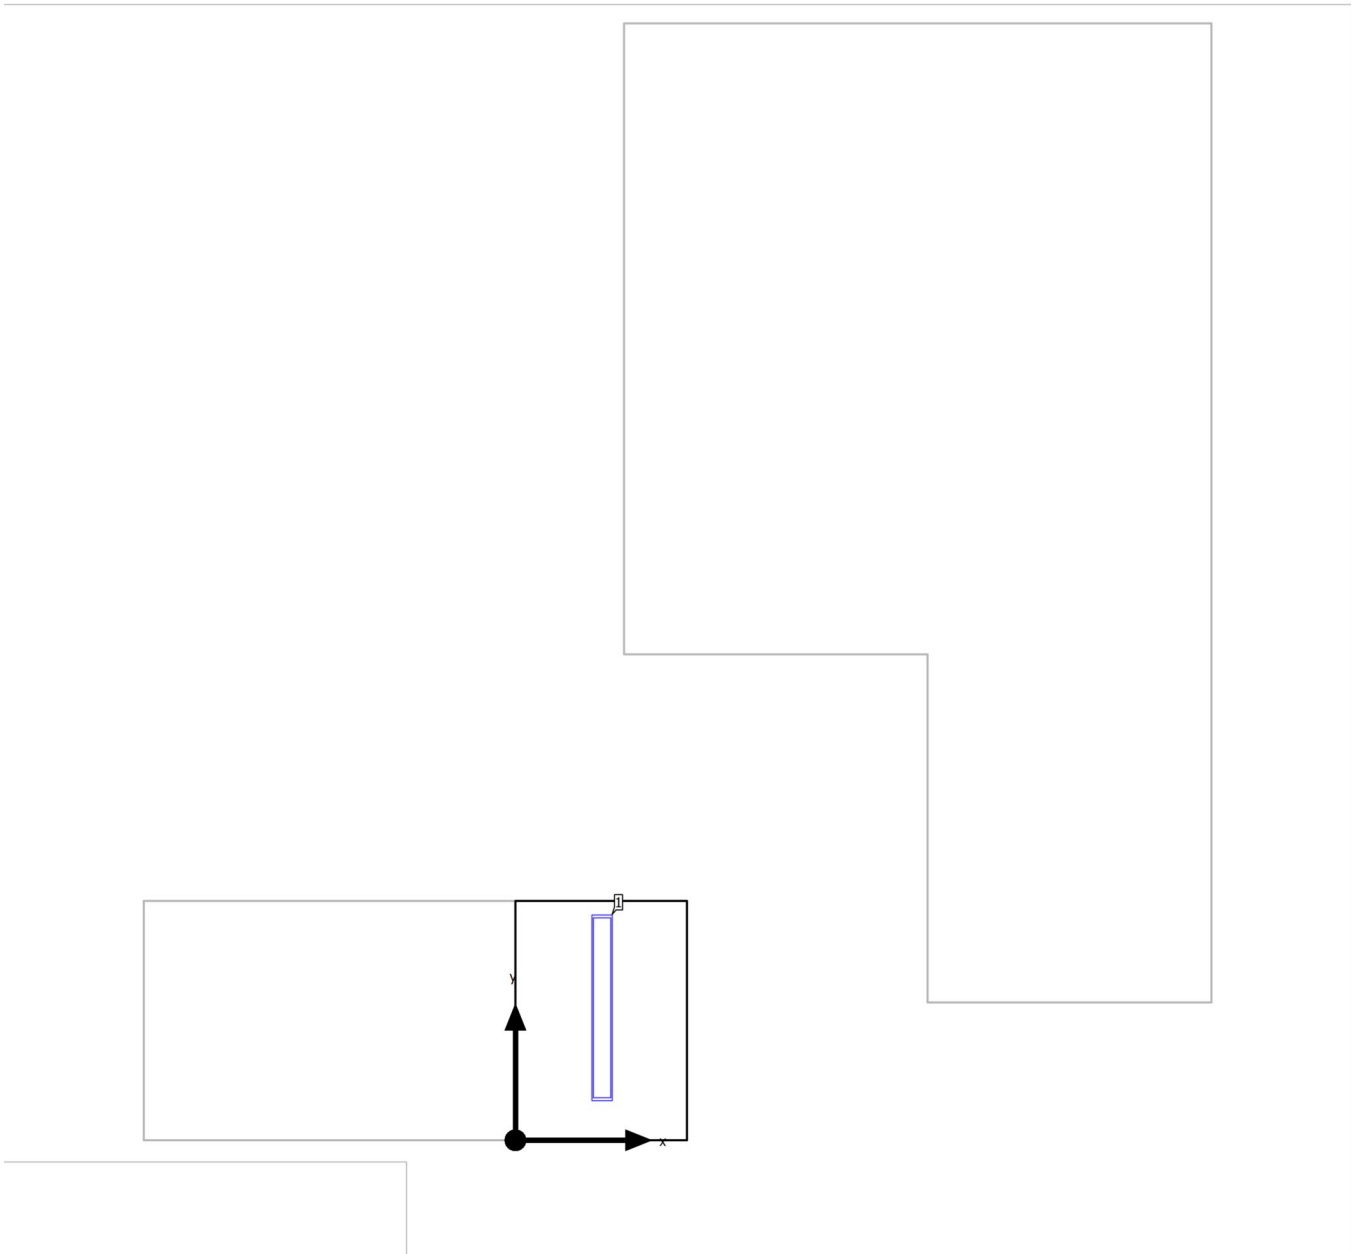

Building B · FIRST FOOR · Space 1

Luminaire layout plan



Manufacturer	Philips	P	76.0 W
Article name	2x36W	Φ _{Luminaire}	4663 lm
Fitting	2x T8 36W/827		

Individual luminaires

X	Y	Mounting height	Luminaire
0.598 m	0.913 m	3.300 m	1

Building B · FIRST FOOR · Space 1

Luminaire list Φ_{total}

4663 lm

 P_{total}

76.0 W


Luminous efficacy

61.4 lm/W

pcs.	Manufacturer	Article No.	Article name	P	Φ	Luminous efficacy
1	Philips		2x36W	76.0 W	4663 lm	61.4 lm/W

Building B · FIRST FOOR · Space 1 (Light scene 1)

Calculation objects

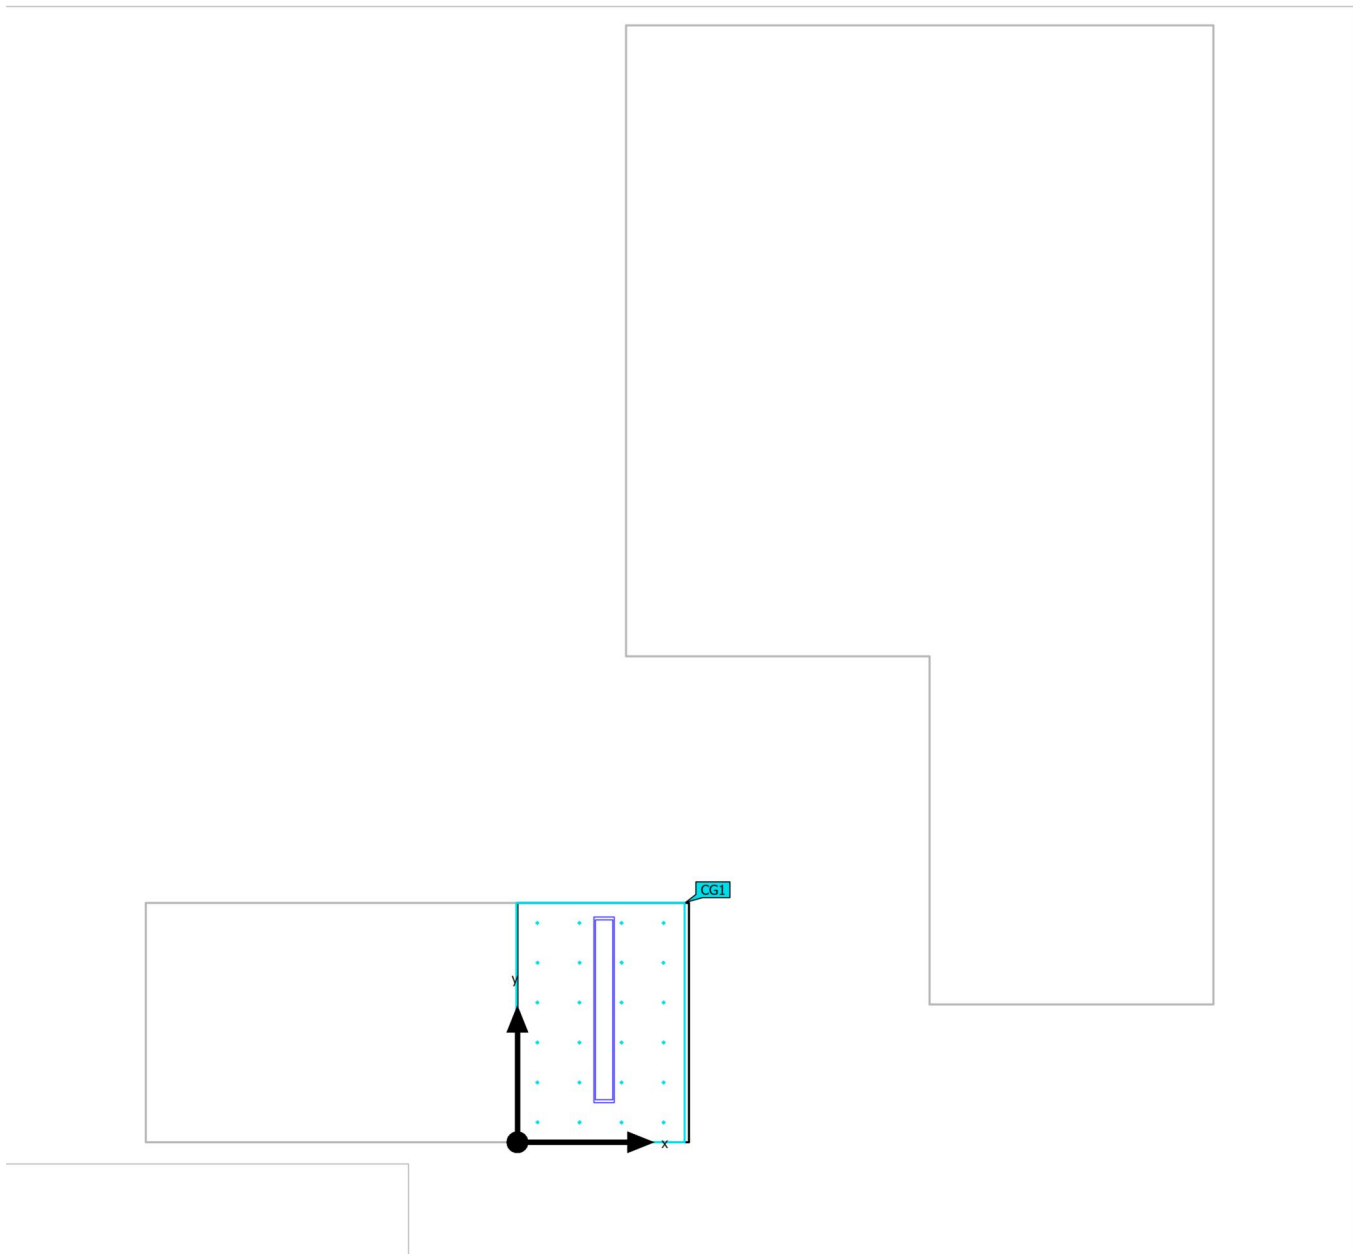

Building B · FIRST FOOR · Space 1 (Light scene 1)

Calculation objects



Calculation surfaces

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	359 lx	301 lx	402 lx	0.84	0.75	CG1

Utilisation profile: DIALux presetting (34.2 Standard (office))

Building B · FIRST FOOR · Space 1 (Light scene 1)

201 Stairs

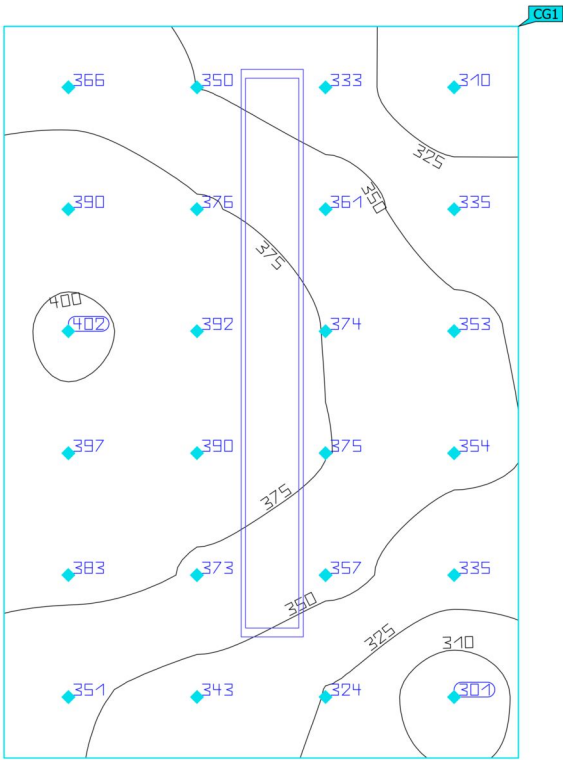

Properties	$\bar{E}$	E_{min}	E_{max}	$U_o (g_1)$	g_2	Index
201 Stairs Perpendicular illuminance Height: 0.000 m	359 lx	301 lx	402 lx	0.84	0.75	CG1

Utilisation profile: DIALux presetting (34.2 Standard (office))