


Building B · GROUND FOOR (Light scene 1)

Room list

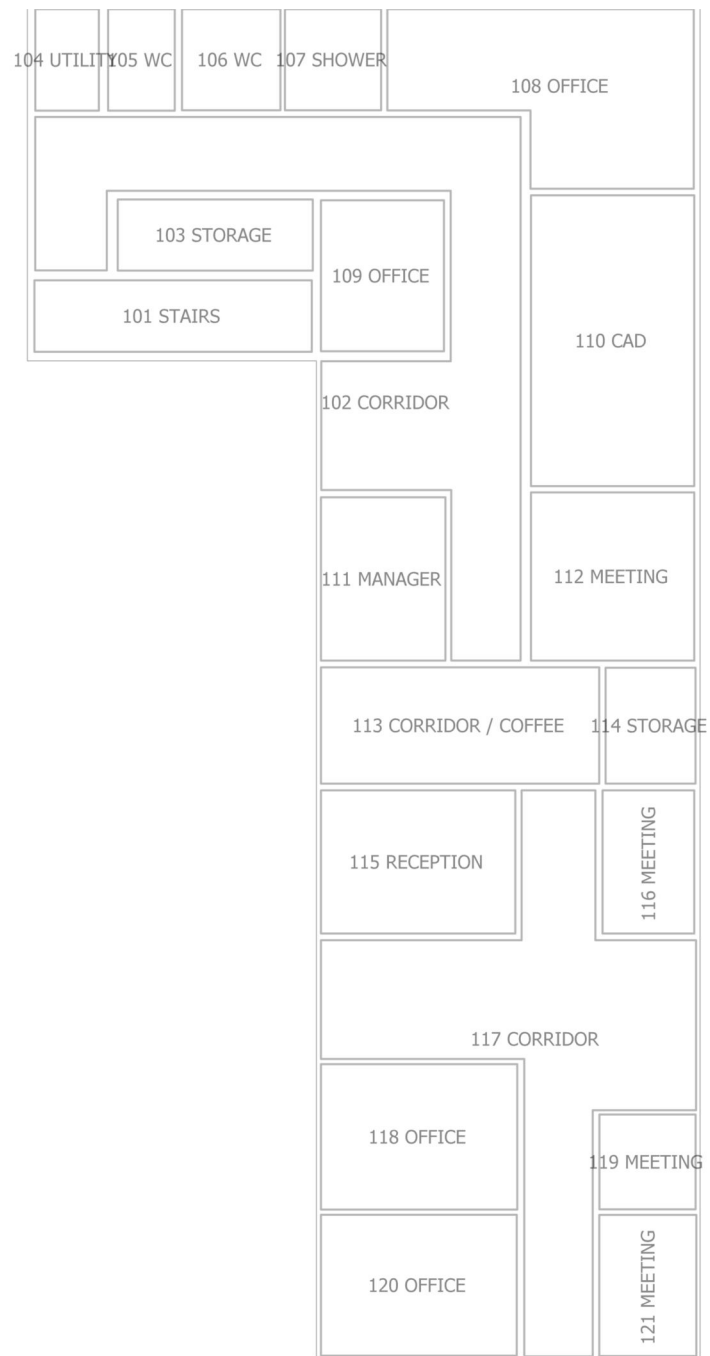

Building B · GROUND FOOR (Light scene 1)

**Room list**

## 101 STAIRS

$P_{\text{total}}$   
76.0 W

$A_{\text{Room}}$   
9.91 m<sup>2</sup>

Lighting power density  
7.67 W/m<sup>2</sup> (Space)

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 102 CORRIDOR

$P_{\text{total}}$   
892.0 W

$A_{\text{Room}}$   
45.44 m<sup>2</sup>

Lighting power density  
19.63 W/m<sup>2</sup> = 5.16 W/m<sup>2</sup>/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$  (Working plane)  
380 lx

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|---------|---------------------------|
| 2    | Philips      |             | 2x36W        | 76.0 W  | 4663 lm                   |
| 5    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                   |

## 103 STORAGE

$P_{\text{total}}$   
148.0 W

$A_{\text{Room}}$   
6.93 m<sup>2</sup>

Lighting power density  
21.35 W/m<sup>2</sup> = 6.57 W/m<sup>2</sup>/100 lx (Space)

$\bar{E}_{\text{perpendicular}}$  (Working plane)  
325 lx

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|---------|---------------------------|
| 1    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                   |

Building B · GROUND FOOR (Light scene 1)

**Room list**

## 104 UTILITY

$P_{\text{total}}$   
76.0 W

$A_{\text{Room}}$   
3.22 m<sup>2</sup>

Lighting power density  
23.58 W/m<sup>2</sup> = 11.51 W/m<sup>2</sup>/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$   
205 lx

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 105 WC

$P_{\text{total}}$   
76.0 W

$A_{\text{Room}}$   
3.38 m<sup>2</sup>

Lighting power density  
22.47 W/m<sup>2</sup> = 11.16 W/m<sup>2</sup>/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$   
201 lx

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

## 106 WC

$P_{\text{total}}$   
76.0 W

$A_{\text{Room}}$   
4.98 m<sup>2</sup>

Lighting power density  
15.27 W/m<sup>2</sup> = 8.23 W/m<sup>2</sup>/100 lx (Space)

$\bar{E}_{\text{perpendicular (Working plane)}}$   
186 lx

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi_{\text{Luminaire}}$ |
|------|--------------|-------------|--------------|--------|---------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                   |

Building B · GROUND FOOR (Light scene 1)

**Room list**

## 107 SHOWER

|                                    |                                                |                                                                                                 |                                                            |
|------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>76.0 W | <b>A<sub>Room</sub></b><br>4.86 m <sup>2</sup> | <b>Lighting power density</b><br>15.63 W/m <sup>2</sup> = 8.35 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>187 lx |
|------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|--------|------------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm                |

## 108 OFFICE

|                                     |                                                 |                                                                                                 |                                                            |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>592.0 W | <b>A<sub>Room</sub></b><br>21.90 m <sup>2</sup> | <b>Lighting power density</b><br>27.03 W/m <sup>2</sup> = 3.59 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>753 lx |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 109 OFFICE

|                                     |                                                |                                                                                                 |                                                            |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>296.0 W | <b>A<sub>Room</sub></b><br>9.28 m <sup>2</sup> | <b>Lighting power density</b><br>31.90 W/m <sup>2</sup> = 3.98 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>801 lx |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |



Building B · GROUND FOOR (Light scene 1)

**Room list**

110 CAD

**P<sub>total</sub>**  
888.0 W**A<sub>Room</sub>**  
23.72 m<sup>2</sup>**Lighting power density**  
 $37.43 \text{ W/m}^2 = 3.38 \text{ W/m}^2/100 \text{ lx (Space)}$ **E<sub>perpendicular</sub> (Working plane)**  
1107 lx

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 6    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

111 MANAGER

**P<sub>total</sub>**  
296.0 W**A<sub>Room</sub>**  
10.16 m<sup>2</sup>**Lighting power density**  
 $29.14 \text{ W/m}^2 = 3.94 \text{ W/m}^2/100 \text{ lx (Space)}$ **E<sub>perpendicular</sub> (Working plane)**  
740 lx

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

112 MEETING

**P<sub>total</sub>**  
444.0 W**A<sub>Room</sub>**  
13.72 m<sup>2</sup>**Lighting power density**  
 $32.35 \text{ W/m}^2 = 3.74 \text{ W/m}^2/100 \text{ lx (Space)}$ **E<sub>perpendicular</sub> (Working plane)**  
865 lx

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 3    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

Building B · GROUND FOOR (Light scene 1)

**Room list**

## 113 CORRIDOR / COFFEE

|                                     |                                                 |                                                                                                 |                                                            |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>296.0 W | <b>A<sub>Room</sub></b><br>16.18 m <sup>2</sup> | <b>Lighting power density</b><br>18.30 W/m <sup>2</sup> = 4.54 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>403 lx |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 114 STORAGE

|                                     |                                                |                                                                                                 |                                                            |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>148.0 W | <b>A<sub>Room</sub></b><br>5.21 m <sup>2</sup> | <b>Lighting power density</b><br>28.43 W/m <sup>2</sup> = 7.05 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>403 lx |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 1    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 115 RECEPTION

|                                     |                                                 |                                                                                                 |                                                             |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|-------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>592.0 W | <b>A<sub>Room</sub></b><br>13.90 m <sup>2</sup> | <b>Lighting power density</b><br>42.58 W/m <sup>2</sup> = 3.98 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>1069 lx |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|-------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

Building B · GROUND FOOR (Light scene 1)

**Room list**

## 116 MEETING

|                                     |                                                |                                                                                                 |                                                            |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>296.0 W | <b>A<sub>Room</sub></b><br>6.56 m <sup>2</sup> | <b>Lighting power density</b><br>45.12 W/m <sup>2</sup> = 5.28 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>854 lx |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 117 CORRIDOR

|                                     |                                                 |                                                                                                 |                                                            |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>888.0 W | <b>A<sub>Room</sub></b><br>40.60 m <sup>2</sup> | <b>Lighting power density</b><br>21.87 W/m <sup>2</sup> = 4.06 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>538 lx |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 6    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 118 OFFICE

|                                     |                                                 |                                                                                                 |                                                             |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|-------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>592.0 W | <b>A<sub>Room</sub></b><br>14.27 m <sup>2</sup> | <b>Lighting power density</b><br>41.50 W/m <sup>2</sup> = 3.90 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>1064 lx |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|-------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

Building B · GROUND FOOR (Light scene 1)

**Room list**

## 119 MEETING

|                                     |                                                |                                                                                                 |                                                            |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>148.0 W | <b>A<sub>Room</sub></b><br>4.56 m <sup>2</sup> | <b>Lighting power density</b><br>32.47 W/m <sup>2</sup> = 6.04 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>538 lx |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 1    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 120 OFFICE

|                                     |                                                 |                                                                                                 |                                                             |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|-------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>592.0 W | <b>A<sub>Room</sub></b><br>13.79 m <sup>2</sup> | <b>Lighting power density</b><br>42.93 W/m <sup>2</sup> = 3.79 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>1133 lx |
|-------------------------------------|-------------------------------------------------|-------------------------------------------------------------------------------------------------|-------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

## 121 MEETING

|                                     |                                                |                                                                                                 |                                                            |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|
| <b>P<sub>total</sub></b><br>296.0 W | <b>A<sub>Room</sub></b><br>6.84 m <sup>2</sup> | <b>Lighting power density</b><br>43.25 W/m <sup>2</sup> = 4.80 W/m <sup>2</sup> /100 lx (Space) | <b>E<sub>perpendicular</sub> (Working plane)</b><br>900 lx |
|-------------------------------------|------------------------------------------------|-------------------------------------------------------------------------------------------------|------------------------------------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | Φ <sub>Luminaire</sub> |
|------|--------------|-------------|--------------|---------|------------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm                |

Building B · GROUND FOOR

**Luminaire list** $\Phi_{\text{total}}$ 

437773 lm

 $P_{\text{total}}$ 

7784.0 W


Luminous efficacy

56.2 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 7    | Philips      |             | 2x36W        | 76.0 W  | 4663 lm | 61.4 lm/W         |
| 49   | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR (Light scene 1)

## Calculation objects

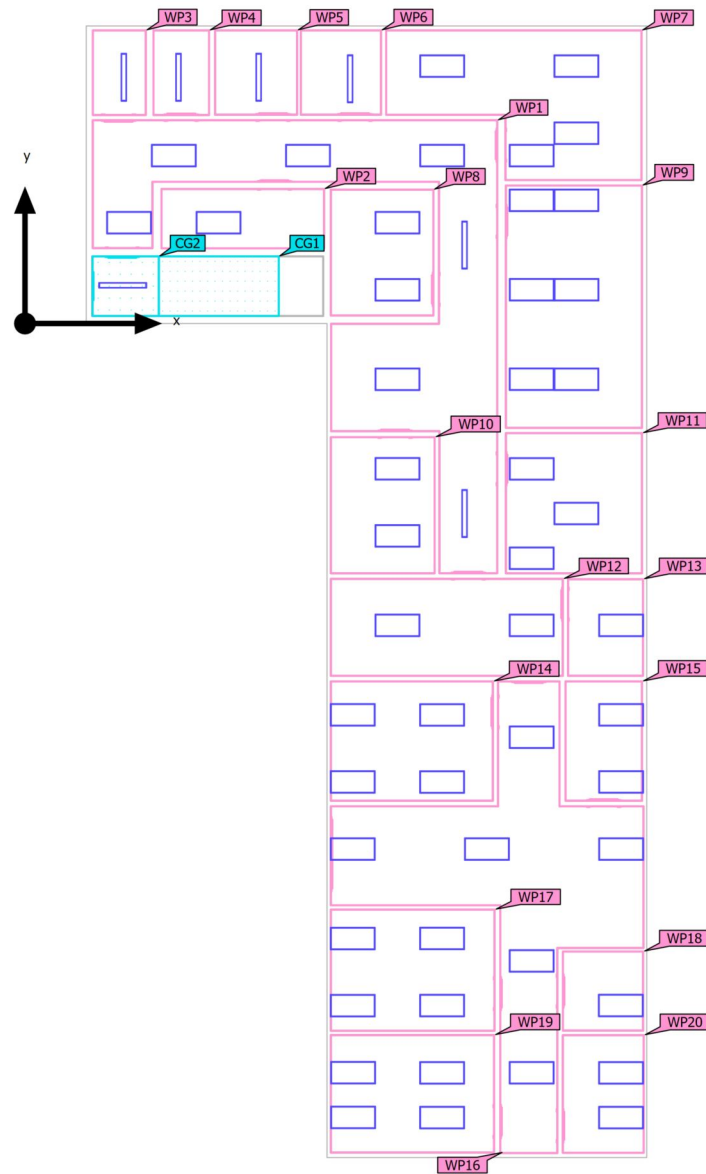

Building B · GROUND FOOR (Light scene 1)

**Calculation objects**

## Working planes

| Properties                                                                                                  | $\bar{E}$<br>(Target)      | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|-------------------------------------------------------------------------------------------------------------|----------------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (102 CORRIDOR)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 380 lx<br>(≥ 500 lx)<br>✗  | 96.2 lx   | 659 lx    | 0.25<br>(≥ 0.60)<br>✗   | 0.15  | WP1   |
| Working plane (103 STORAGE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m  | 325 lx<br>(≥ 500 lx)<br>✗  | 160 lx    | 454 lx    | 0.49<br>(≥ 0.60)<br>✗   | 0.35  | WP2   |
| Working plane (104 UTILITY)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m  | 205 lx<br>(≥ 500 lx)<br>✗  | 185 lx    | 222 lx    | 0.90<br>(≥ 0.60)<br>✓   | 0.83  | WP3   |
| Working plane (105 WC)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m       | 201 lx<br>(≥ 500 lx)<br>✗  | 132 lx    | 217 lx    | 0.66<br>(≥ 0.60)<br>✓   | 0.61  | WP4   |
| Working plane (106 WC)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m       | 186 lx<br>(≥ 500 lx)<br>✗  | 153 lx    | 206 lx    | 0.82<br>(≥ 0.60)<br>✓   | 0.74  | WP5   |
| Working plane (107 SHOWER)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m   | 187 lx<br>(≥ 500 lx)<br>✗  | 155 lx    | 211 lx    | 0.83<br>(≥ 0.60)<br>✓   | 0.73  | WP6   |
| Working plane (108 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m   | 753 lx<br>(≥ 500 lx)<br>✓  | 326 lx    | 1288 lx   | 0.43<br>(≥ 0.60)<br>✗   | 0.25  | WP7   |
| Working plane (109 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m   | 801 lx<br>(≥ 500 lx)<br>✓  | 425 lx    | 1096 lx   | 0.53<br>(≥ 0.60)<br>✗   | 0.39  | WP8   |
| Working plane (110 CAD)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m      | 1107 lx<br>(≥ 500 lx)<br>✓ | 377 lx    | 1587 lx   | 0.34<br>(≥ 0.60)<br>✗   | 0.24  | WP9   |
| Working plane (111 MANAGER)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m  | 740 lx<br>(≥ 500 lx)<br>✓  | 369 lx    | 1036 lx   | 0.50<br>(≥ 0.60)<br>✗   | 0.36  | WP10  |
| Working plane (112 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m  | 865 lx<br>(≥ 500 lx)<br>✓  | 303 lx    | 1311 lx   | 0.35<br>(≥ 0.60)<br>✗   | 0.23  | WP11  |

## Building B · GROUND FOOR (Light scene 1)

## Calculation objects

|                                                                                                                      |                            |        |         |                       |      |      |
|----------------------------------------------------------------------------------------------------------------------|----------------------------|--------|---------|-----------------------|------|------|
| Working plane (113 CORRIDOR / COFFEE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 403 lx<br>(≥ 500 lx)<br>✗  | 246 lx | 506 lx  | 0.61<br>(≥ 0.60)<br>✓ | 0.49 | WP12 |
| Working plane (114 STORAGE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m           | 403 lx<br>(≥ 500 lx)<br>✗  | 298 lx | 472 lx  | 0.74<br>(≥ 0.60)<br>✓ | 0.63 | WP13 |
| Working plane (115 RECEPTION)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m         | 1069 lx<br>(≥ 500 lx)<br>✓ | 561 lx | 1335 lx | 0.52<br>(≥ 0.60)<br>✗ | 0.42 | WP14 |
| Working plane (116 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m           | 854 lx<br>(≥ 500 lx)<br>✓  | 500 lx | 1088 lx | 0.59<br>(≥ 0.60)<br>✗ | 0.46 | WP15 |
| Working plane (117 CORRIDOR)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m          | 538 lx<br>(≥ 500 lx)<br>✓  | 220 lx | 778 lx  | 0.41<br>(≥ 0.60)<br>✗ | 0.28 | WP16 |
| Working plane (118 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m            | 1064 lx<br>(≥ 500 lx)<br>✓ | 610 lx | 1291 lx | 0.57<br>(≥ 0.60)<br>✗ | 0.47 | WP17 |
| Working plane (119 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m           | 538 lx<br>(≥ 500 lx)<br>✓  | 264 lx | 724 lx  | 0.49<br>(≥ 0.60)<br>✗ | 0.36 | WP18 |
| Working plane (120 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m            | 1133 lx<br>(≥ 500 lx)<br>✓ | 636 lx | 1410 lx | 0.56<br>(≥ 0.60)<br>✗ | 0.45 | WP19 |
| Working plane (121 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m           | 900 lx<br>(≥ 500 lx)<br>✓  | 487 lx | 1231 lx | 0.54<br>(≥ 0.60)<br>✗ | 0.40 | WP20 |

## Calculation surfaces

| Properties                                                            | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-----------------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| Calculation surface 4<br>Perpendicular illuminance<br>Height: 1.600 m | 181 lx    | 0.00 lx   | 258 lx    | 0.00        | 0.00  | CG1   |



Building B · GROUND FOOR (Light scene 1)


Calculation objects

|                           |        |        |        |      |      |     |
|---------------------------|--------|--------|--------|------|------|-----|
| Calculation surface 5     | 237 lx | 206 lx | 259 lx | 0.87 | 0.80 | CG2 |
| Perpendicular illuminance |        |        |        |      |      |     |
| Height: 0.000 m           |        |        |        |      |      |     |

---

Building B · GROUND FOOR · 101 STAIRS (Light scene 1)

Summary

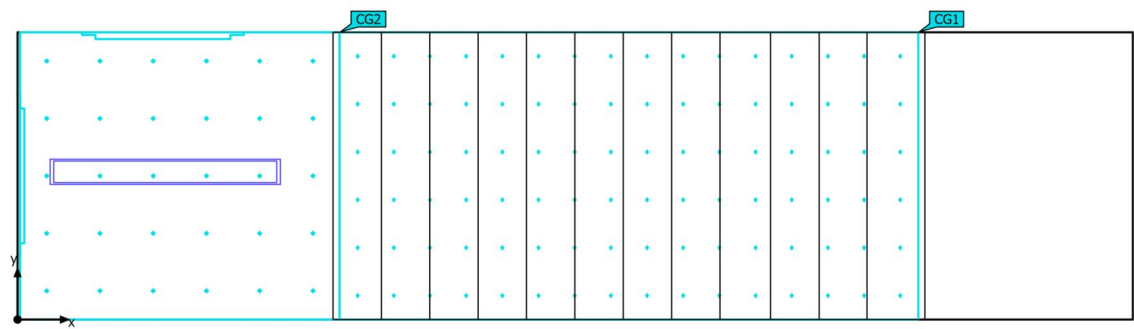

|                    |                                                     |                  |         |
|--------------------|-----------------------------------------------------|------------------|---------|
| Ground area        | 9.91 m²                                             |                  |         |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Clearance height | 2.700 m |
| Maintenance factor | 0.76 (fixed)                                        | Mounting height  | 2.700 m |

Building B · GROUND FOOR · 101 STAIRS (Light scene 1)

## Summary

### Results

|                                  | Symbol                 | Calculated            | Target         | Check | Index |
|----------------------------------|------------------------|-----------------------|----------------|-------|-------|
| Glare valuation <sup>(1)</sup>   | R <sub>UG, max</sub>   | 25                    | ≤ 19           | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption            | 188 kWh/a             | max. 350 kWh/a | ✓     |       |
| Space                            | Lighting power density | 7.67 W/m <sup>2</sup> | –              |       |       |

(1) Based on a rectangular space of 6.200 m x 1.598 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | R <sub>UG</sub> | P      | Φ       | Luminous efficacy |
|------|--------------|-------------|--------------|-----------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 25              | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · GROUND FOOR · 101 STAIRS

## Luminaire layout plan

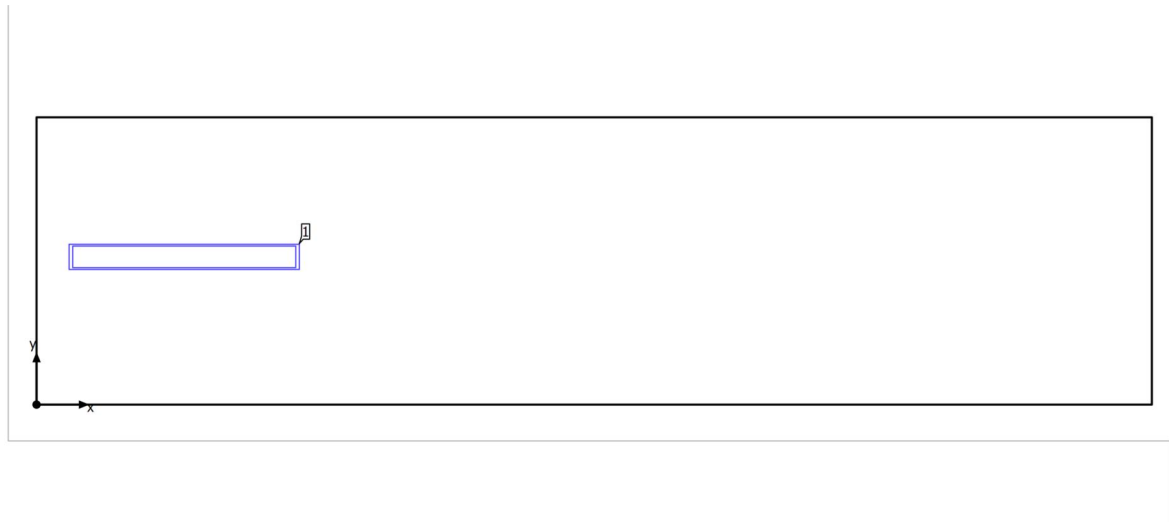

Building B · GROUND FOOR · 101 STAIRS

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.821 m | 0.822 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 101 STAIRS


**Luminaire list**

|                                  |                              |                                |
|----------------------------------|------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>4663 lm | $P_{\text{total}}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · GROUND FOOR · 101 STAIRS (Light scene 1)

## Calculation objects

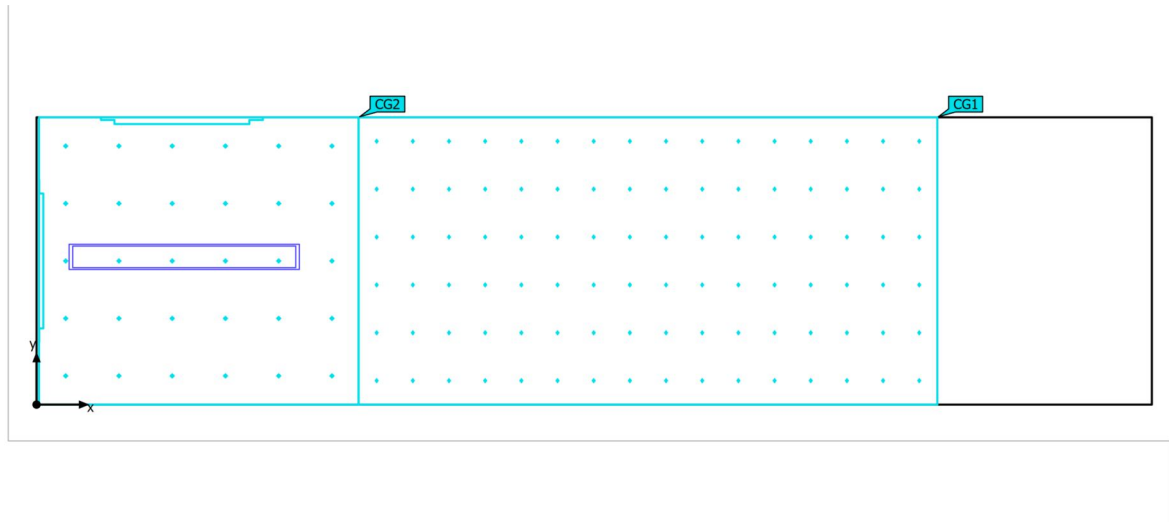

Building B · GROUND FOOR · 101 STAIRS (Light scene 1)

## Calculation objects

### Calculation surfaces


| Properties                                                            | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-----------------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| Calculation surface 4<br>Perpendicular illuminance<br>Height: 1.600 m | 181 lx    | 0.00 lx   | 258 lx    | 0.00        | 0.00  | CG1   |
| Calculation surface 5<br>Perpendicular illuminance<br>Height: 0.000 m | 237 lx    | 206 lx    | 259 lx    | 0.87        | 0.80  | CG2   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))



Building B · GROUND FOOR · 101 STAIRS (Light scene 1)

## Calculation surface 4

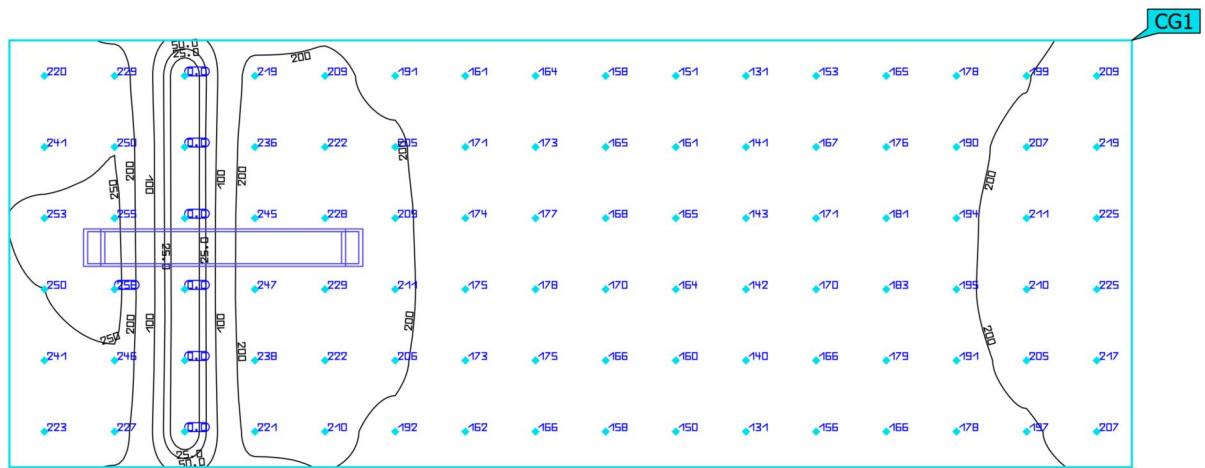


| Properties                                                            | $\bar{E}$ | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-----------------------------------------------------------------------|-----------|-----------|-----------|-------------|-------|-------|
| Calculation surface 4<br>Perpendicular illuminance<br>Height: 1.600 m | 181 lx    | 0.00 lx   | 258 lx    | 0.00        | 0.00  | CG1   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 101 STAIRS (Light scene 1)

### Calculation surface 5

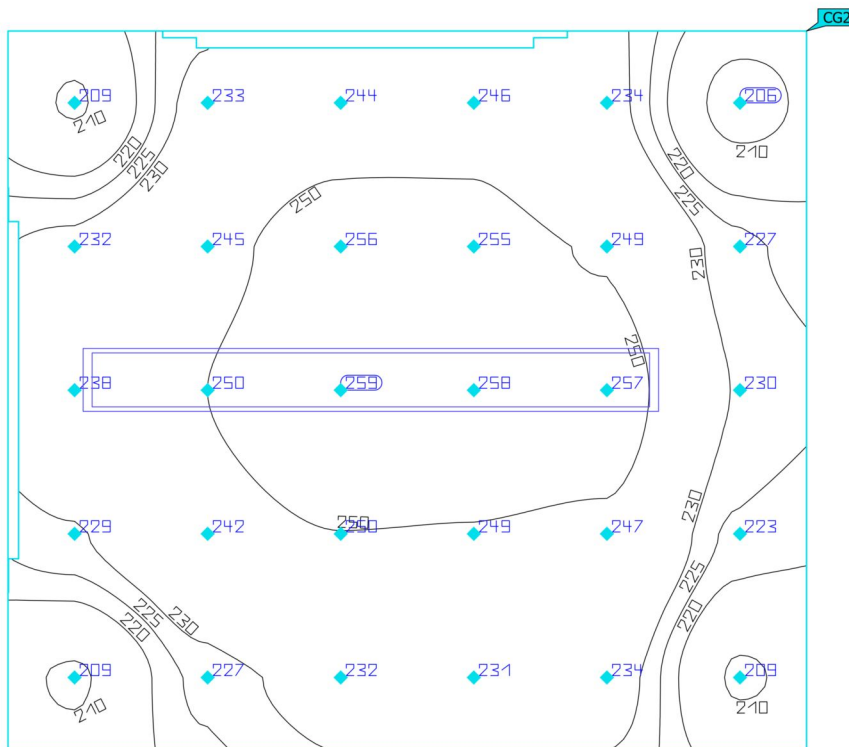


| Properties                                                            | $E$    | $E_{min}$ | $E_{max}$ | $U_o (g_1)$ | $g_2$ | Index |
|-----------------------------------------------------------------------|--------|-----------|-----------|-------------|-------|-------|
| Calculation surface 5<br>Perpendicular illuminance<br>Height: 0.000 m | 237 lx | 206 lx    | 259 lx    | 0.87        | 0.80  | CG2   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 102 CORRIDOR (Light scene 1)

Summary

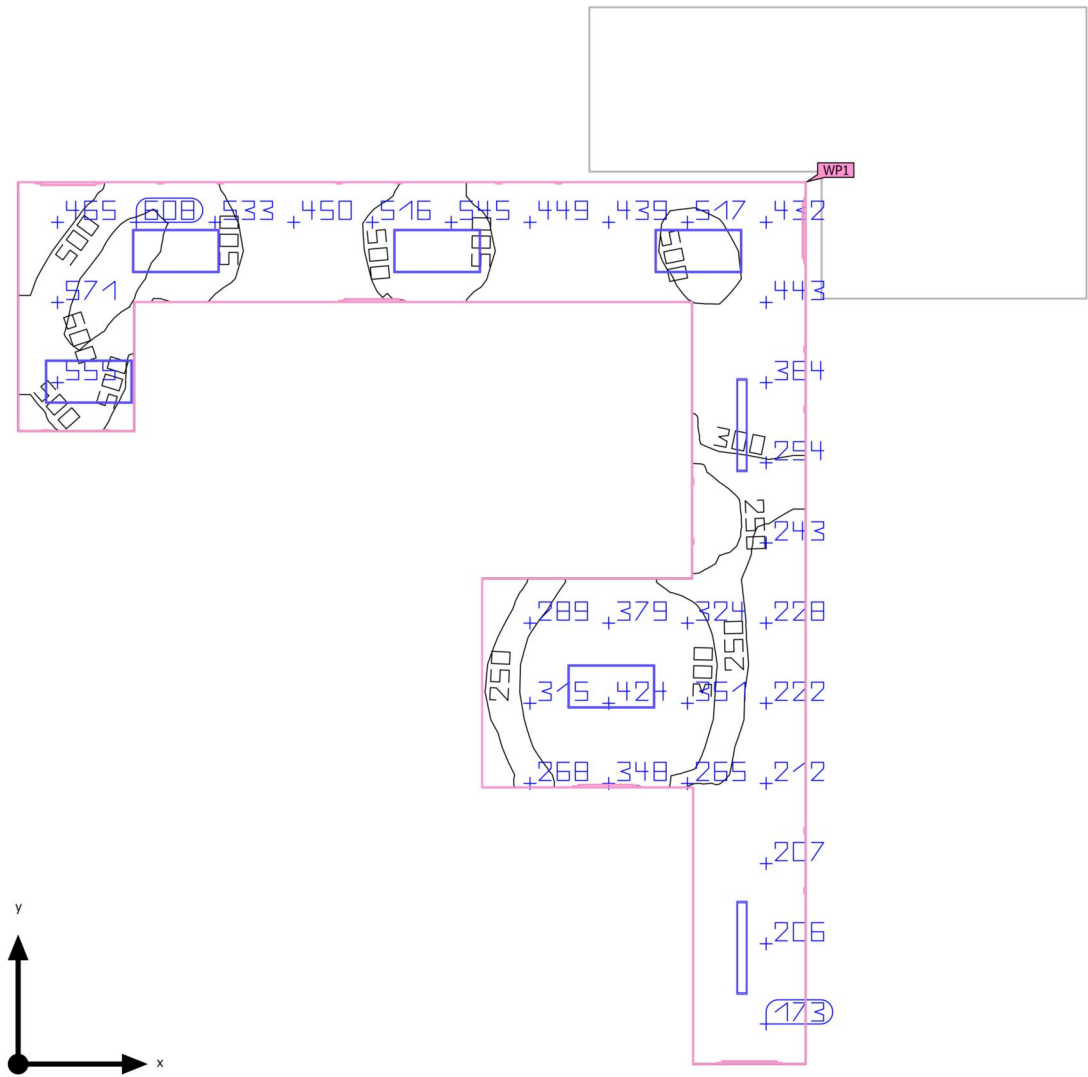

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 45.44 m <sup>2</sup>                                |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 102 CORRIDOR (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 380 lx                        | $\geq 500 \text{ lx}$ | ✗     | WP1   |
|                                  | $U_o (g_1)$                      | 0.25                          | $\geq 0.60$           | ✗     | WP1   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 29                            | $\leq 19$             | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [1596 - 2208] kWh/a           | max. 1600 kWh/a       | ✗     |       |
| Space                            | Lighting power density           | 19.63 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 5.16 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 10.850 m x 12.150 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 2    | Philips      |             | 2x36W        | 29       | 76.0 W  | 4663 lm | 61.4 lm/W         |
| 5    | Philips      |             | 4x36W SLB    | 20       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 102 CORRIDOR

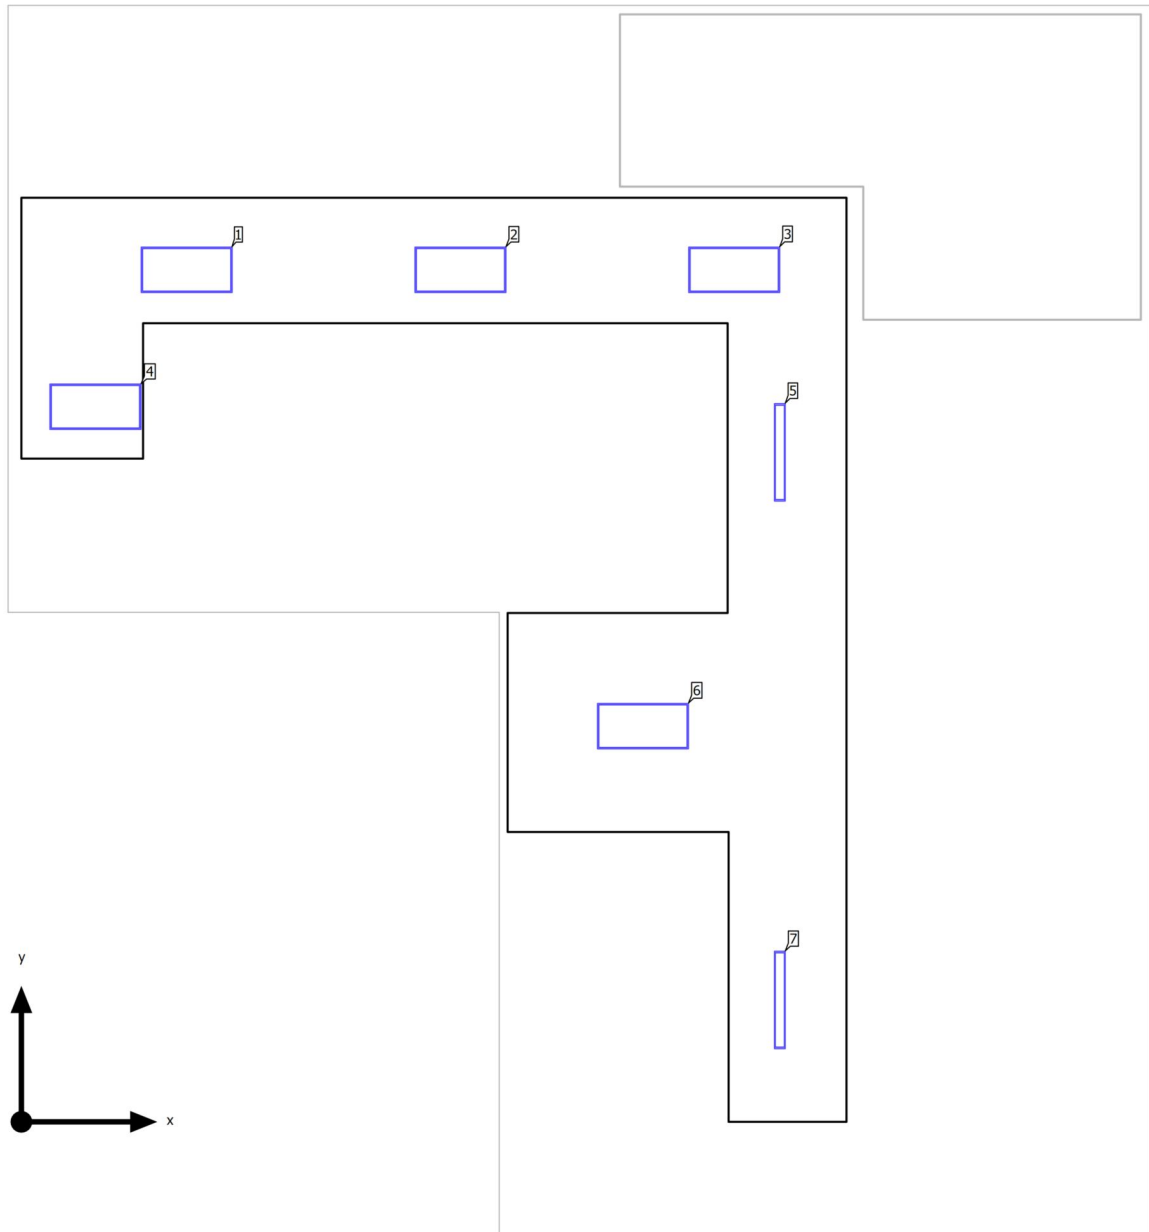**Luminaire layout plan**

Building B · GROUND FOOR · 102 CORRIDOR


**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 9.974 m | 8.802 m | 2.700 m         | 5         |
| 9.974 m | 1.602 m | 2.700 m         | 7         |

Building B · GROUND FOOR · 102 CORRIDOR

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y        | Mounting height | Luminaire |
|---------|----------|-----------------|-----------|
| 2.174 m | 11.202 m | 2.700 m         | 1         |
| 5.774 m | 11.202 m | 2.700 m         | 2         |
| 9.374 m | 11.202 m | 2.700 m         | 3         |
| 0.974 m | 9.402 m  | 2.700 m         | 4         |
| 8.174 m | 5.202 m  | 2.700 m         | 6         |

Building B · GROUND FOOR · 102 CORRIDOR

**Luminaire list** $\Phi_{\text{total}}$ 

50666 lm

 $P_{\text{total}}$ 

892.0 W

Luminous efficacy


56.8 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 2    | Philips      |             | 2x36W        | 76.0 W  | 4663 lm | 61.4 lm/W         |
| 5    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 102 CORRIDOR (Light scene 1)

## Calculation objects

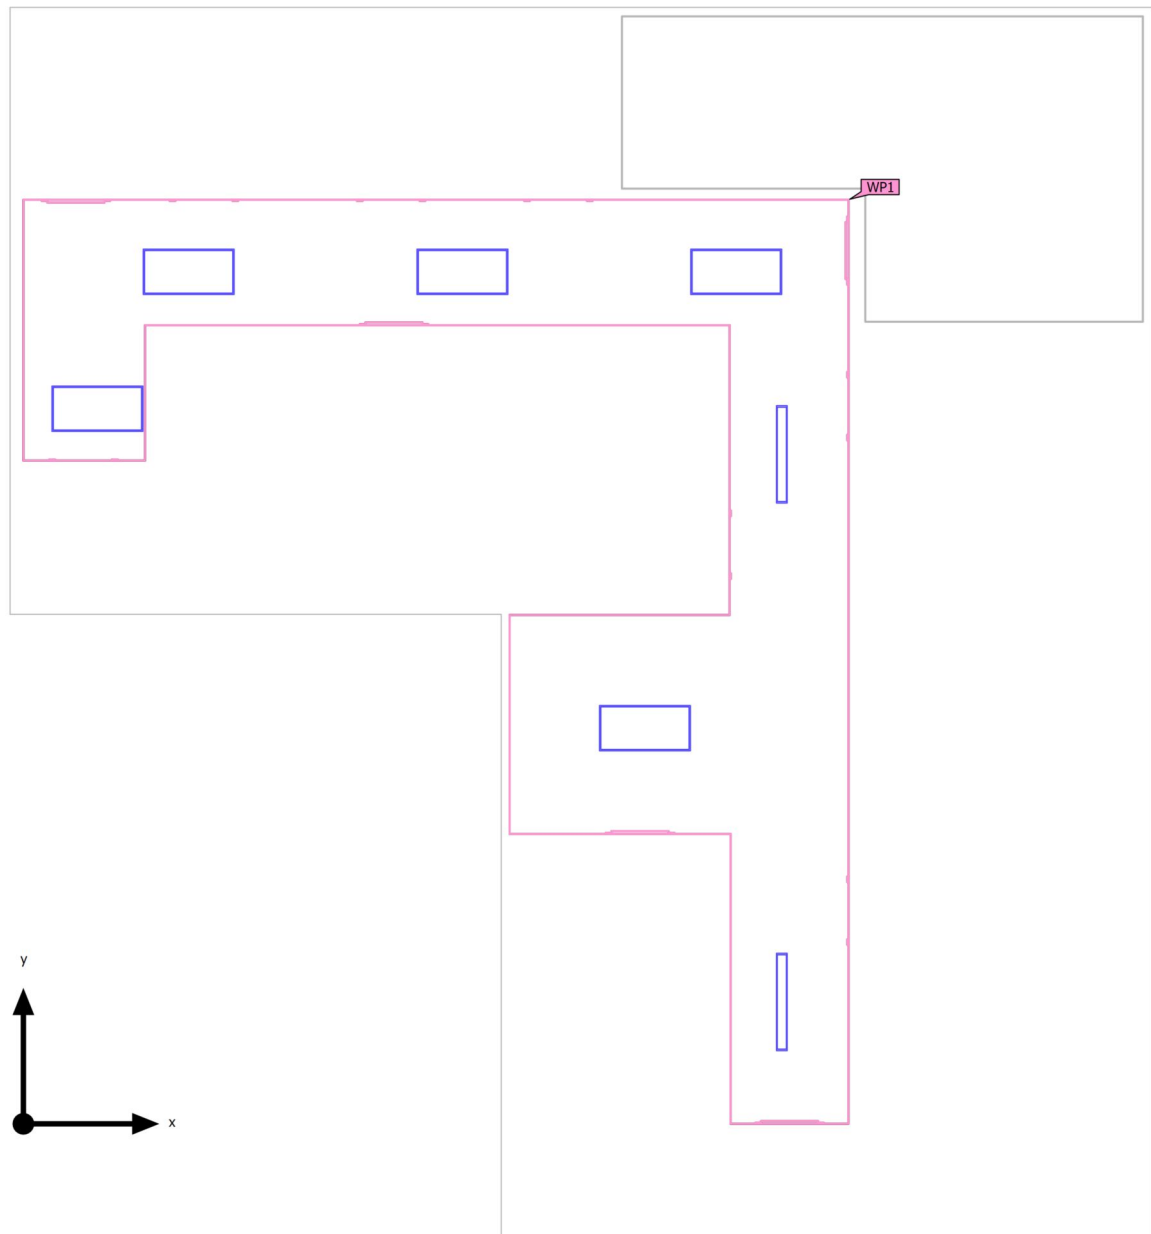

Building B · GROUND FOOR · 102 CORRIDOR (Light scene 1)

**Calculation objects**


## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (102 CORRIDOR)         | 380 lx                | 96.2 lx   | 659 lx    | 0.25                    | 0.15  | WP1   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 102 CORRIDOR (Light scene 1)

## Working plane (102 CORRIDOR)

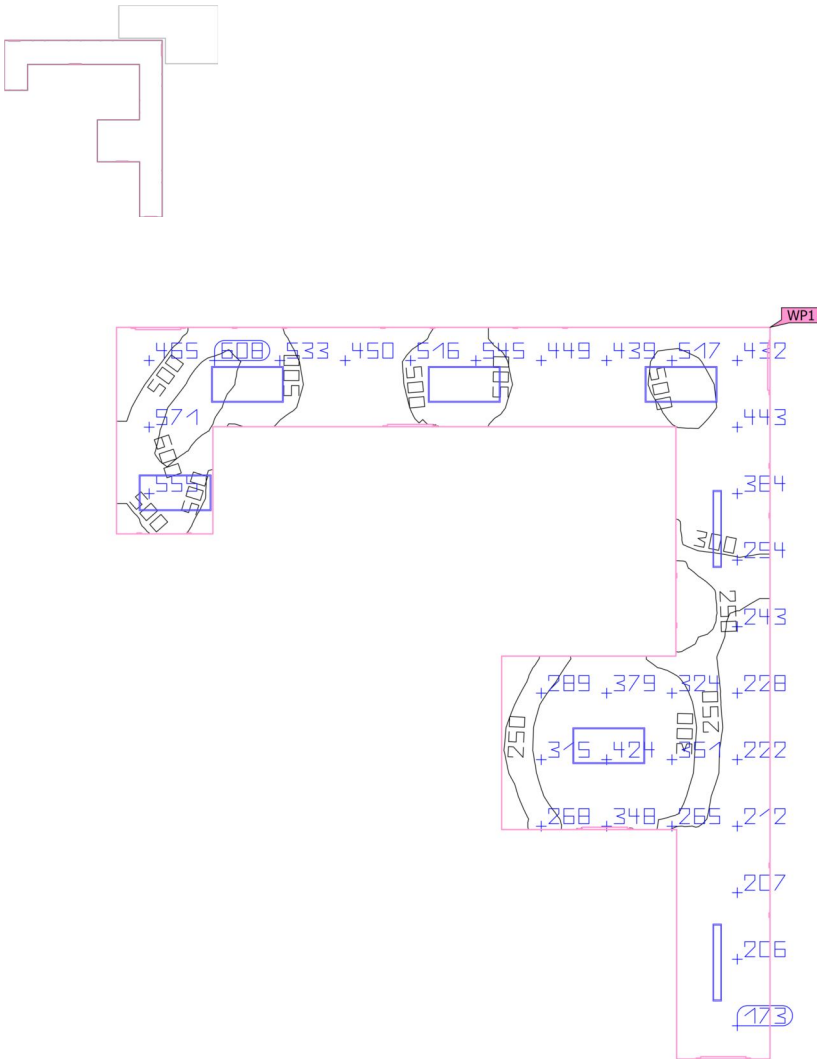


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (102 CORRIDOR)         | 380 lx                | 96.2 lx   | 659 lx    | 0.25                    | 0.15  | WP1   |
| Perpendicular illuminance (adaptive) | $\geq 500$ lx         |           |           | $\geq 0.60$             |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 103 STORAGE (Light scene 1)

Summary

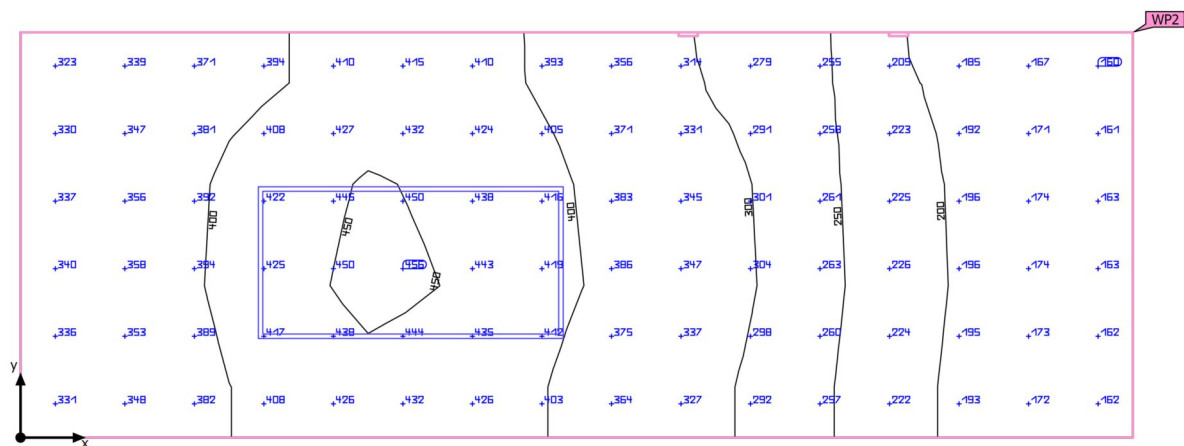

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 6.93 m²                                             |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 103 STORAGE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 325 lx                        | $\geq 500 \text{ lx}$ | ✗     | WP2   |
|                                  | $U_o (g_1)$                      | 0.49                          | $\geq 0.60$           | ✗     | WP2   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | 366 kWh/a                     | max. 250 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 21.35 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 6.57 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 4.360 m x 1.590 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 1    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 103 STORAGE

## Luminaire layout plan

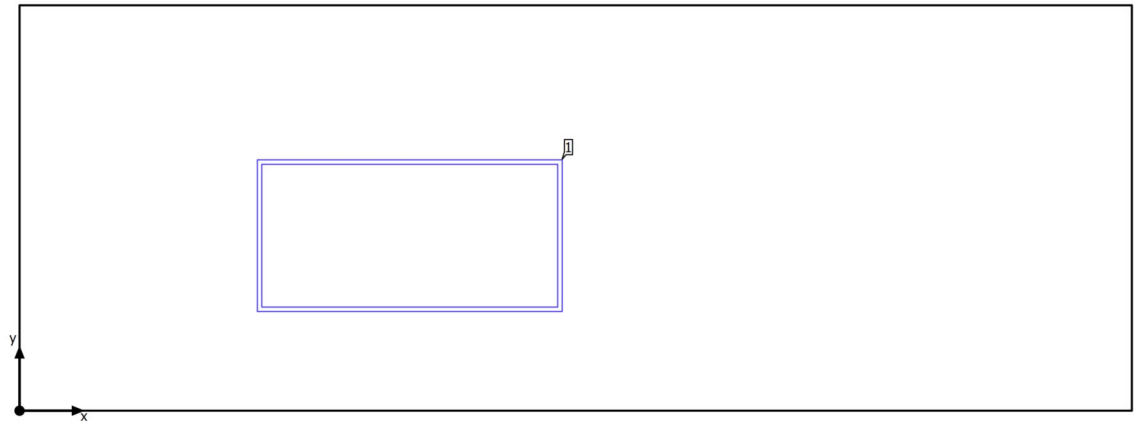

Building B · GROUND FOOR · 103 STORAGE

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.530 m | 0.686 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 103 STORAGE

**Luminaire list**


|                                  |                               |                                |
|----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>8268 lm | $P_{\text{total}}$<br>148.0 W | Luminous efficacy<br>55.9 lm/W |
|----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 1    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 103 STORAGE (Light scene 1)

## Calculation objects

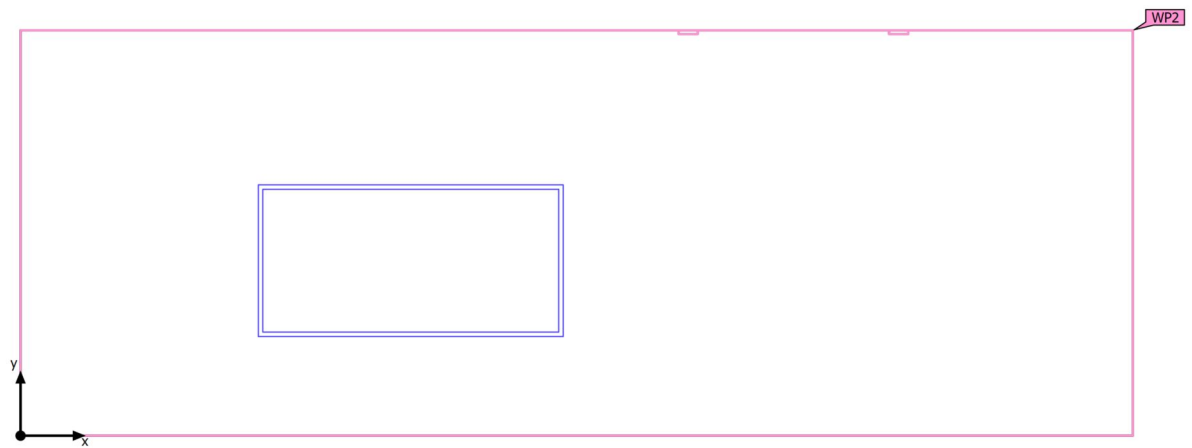

Building B · GROUND FOOR · 103 STORAGE (Light scene 1)

**Calculation objects**


## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (103 STORAGE)          | 325 lx                | 160 lx    | 454 lx    | 0.49                    | 0.35  | WP2   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 103 STORAGE (Light scene 1)

## Working plane (103 STORAGE)

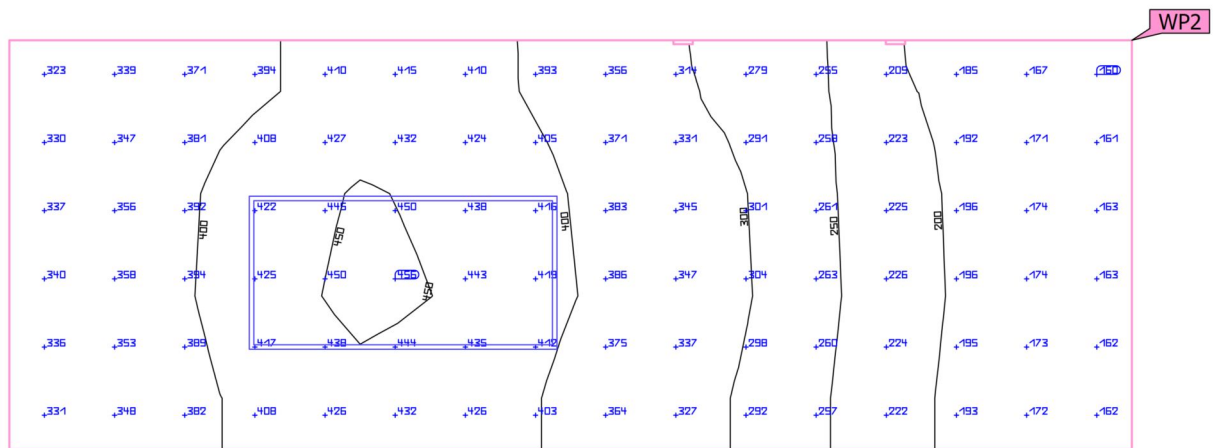


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (103 STORAGE)          | 325 lx                | 160 lx    | 454 lx    | 0.49                    | 0.35  | WP2   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 104 UTILITY (Light scene 1)

Summary

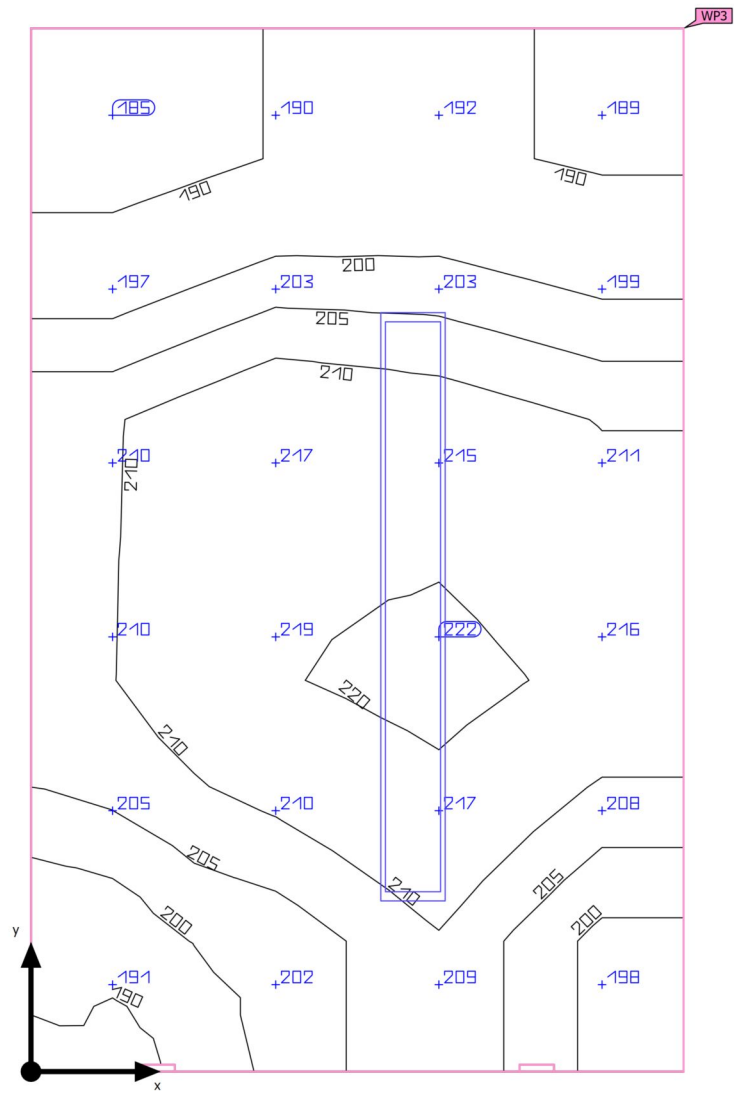

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 3.22 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 104 UTILITY (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                     | Target         | Check | Index |
|----------------------------------|----------------------------------|--------------------------------|----------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 205 lx                         | $\geq 500$ lx  | ✗     | WP3   |
|                                  | $U_o (g_1)$                      | 0.90                           | $\geq 0.60$    | ✓     | WP3   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 21                             | $\leq 19$      | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [119 - 188] kWh/a              | max. 150 kWh/a | ✗     |       |
| Space                            | Lighting power density           | 23.58 W/m <sup>2</sup>         | –              |       |       |
|                                  |                                  | 11.51 W/m <sup>2</sup> /100 lx | –              |       |       |

(1) Based on a rectangular space of 1.420 m x 2.270 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 21       | 76.0 W | 4663 lm | 61.4 lm/W         |


Building B · GROUND FOOR · 104 UTILITY

## Luminaire layout plan

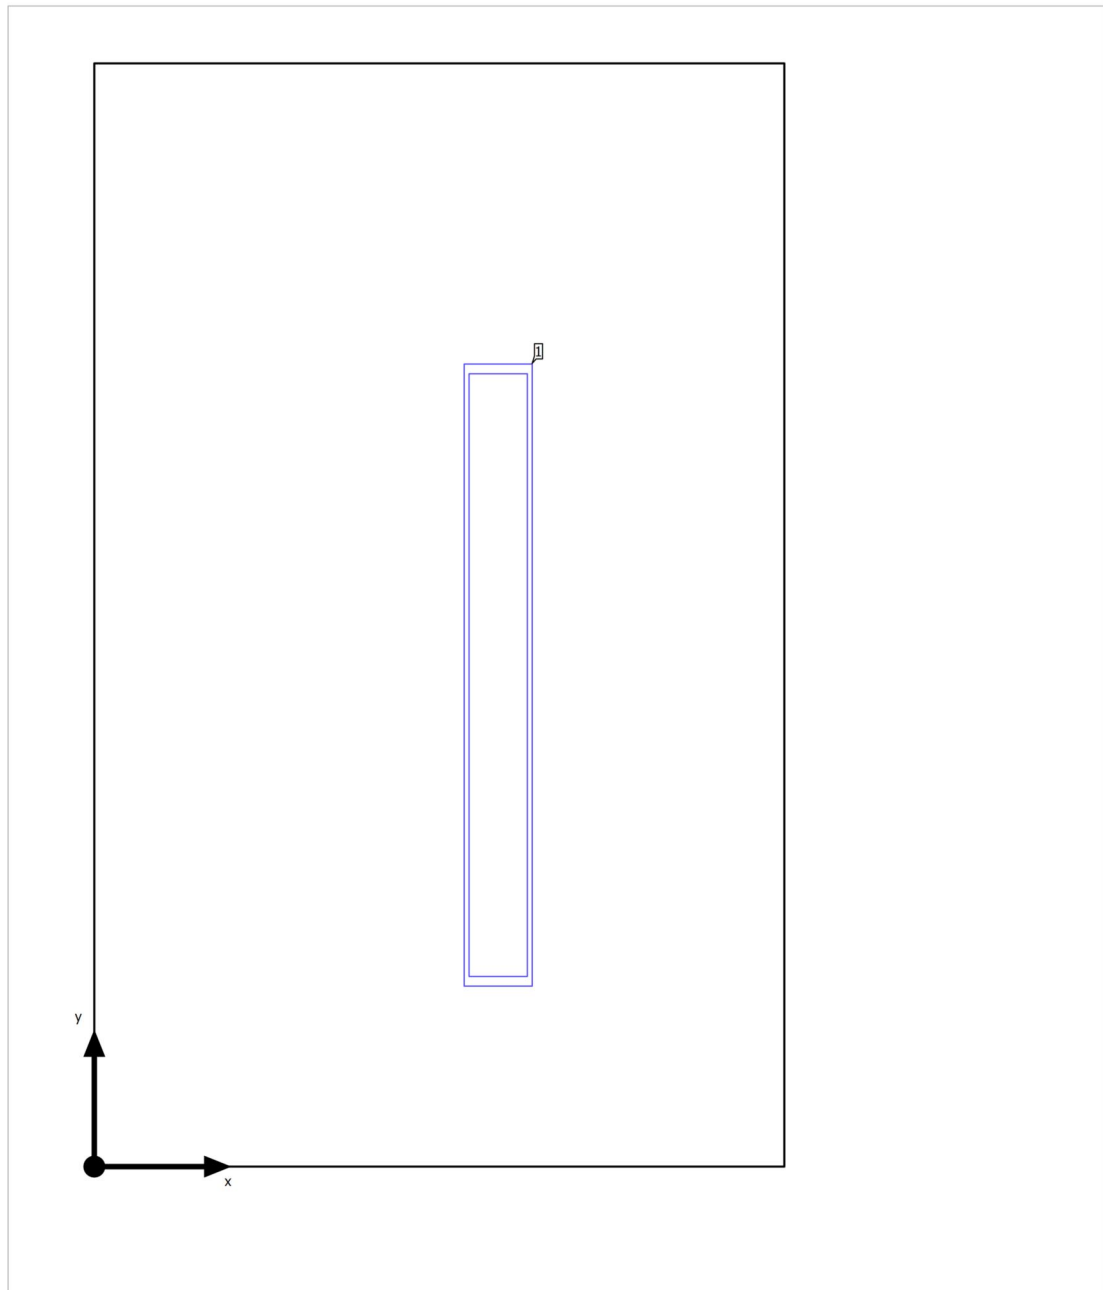

Building B · GROUND FOOR · 104 UTILITY

Luminaire layout plan



|              |               |                        |         |
|--------------|---------------|------------------------|---------|
| Manufacturer | Philips       | P                      | 76.0 W  |
| Article name | 2x36W         | Φ <sub>Luminaire</sub> | 4663 lm |
| Fitting      | 2x T8 36W/827 |                        |         |

Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.831 m | 1.011 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 104 UTILITY

**Luminaire list**


|                                  |                              |                                |
|----------------------------------|------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>4663 lm | $P_{\text{total}}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |



Building B · GROUND FOOR · 104 UTILITY (Light scene 1)

## Calculation objects

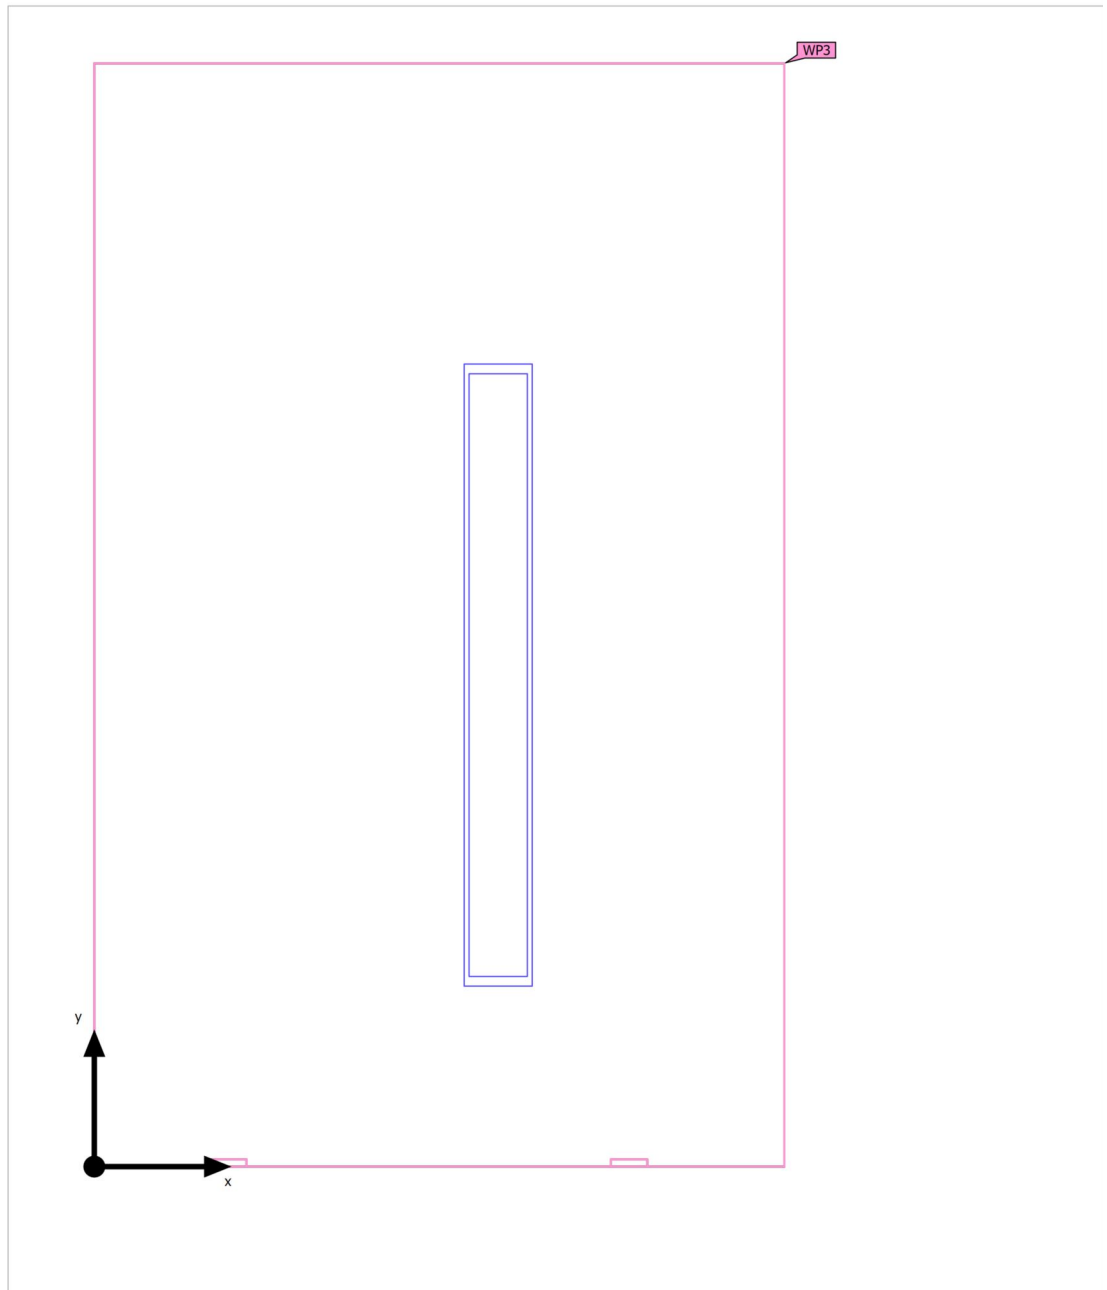

Building B · GROUND FOOR · 104 UTILITY (Light scene 1)

**Calculation objects**


## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (104 UTILITY)          | 205 lx                | 185 lx    | 222 lx    | 0.90                    | 0.83  | WP3   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 104 UTILITY (Light scene 1)

## Working plane (104 UTILITY)

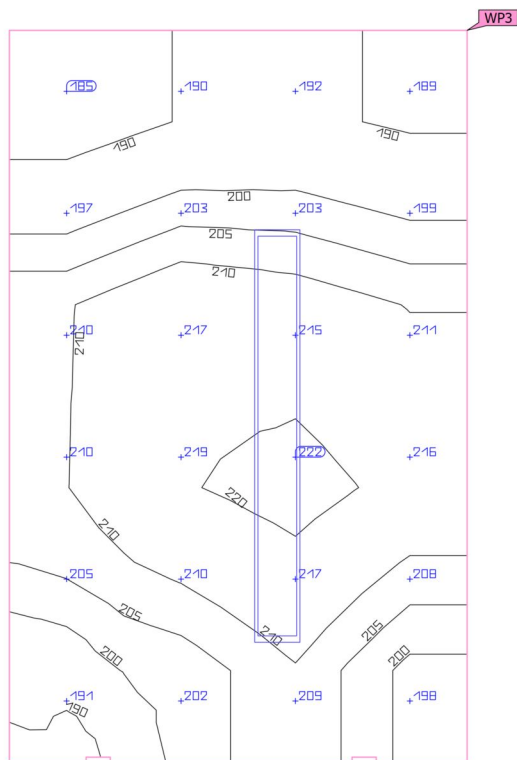


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (104 UTILITY)          | 205 lx                | 185 lx    | 222 lx    | 0.90                    | 0.83  | WP3   |
| Perpendicular illuminance (adaptive) | $\geq 500$ lx         |           |           | $\geq 0.60$             |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 105 WC (Light scene 1)

Summary

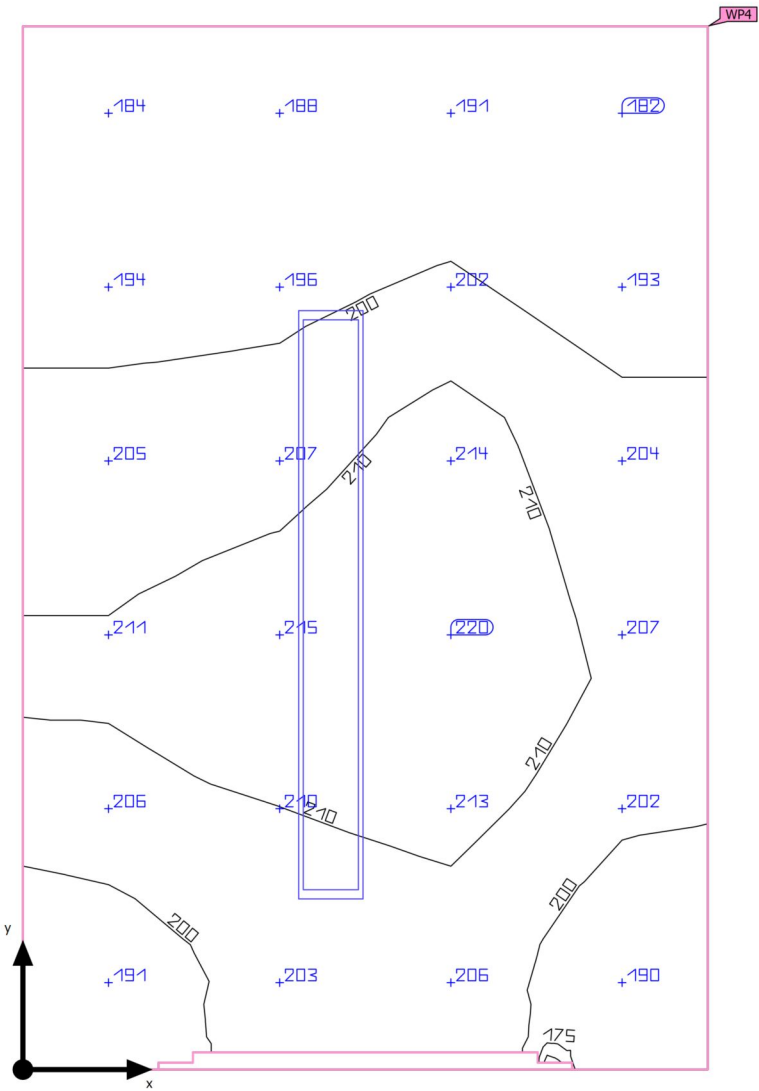

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 3.38 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 105 WC (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                     | Target         | Check | Index |
|----------------------------------|----------------------------------|--------------------------------|----------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 201 lx                         | $\geq 500$ lx  | ✗     | WP4   |
|                                  | $U_o (g_1)$                      | 0.66                           | $\geq 0.60$    | ✓     | WP4   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 21                             | $\leq 19$      | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [119 - 188] kWh/a              | max. 150 kWh/a | ✗     |       |
| Space                            | Lighting power density           | 22.47 W/m <sup>2</sup>         | –              |       |       |
|                                  |                                  | 11.16 W/m <sup>2</sup> /100 lx | –              |       |       |

(1) Based on a rectangular space of 1.490 m x 2.270 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 21       | 76.0 W | 4663 lm | 61.4 lm/W         |


Building B · GROUND FOOR · 105 WC

## Luminaire layout plan

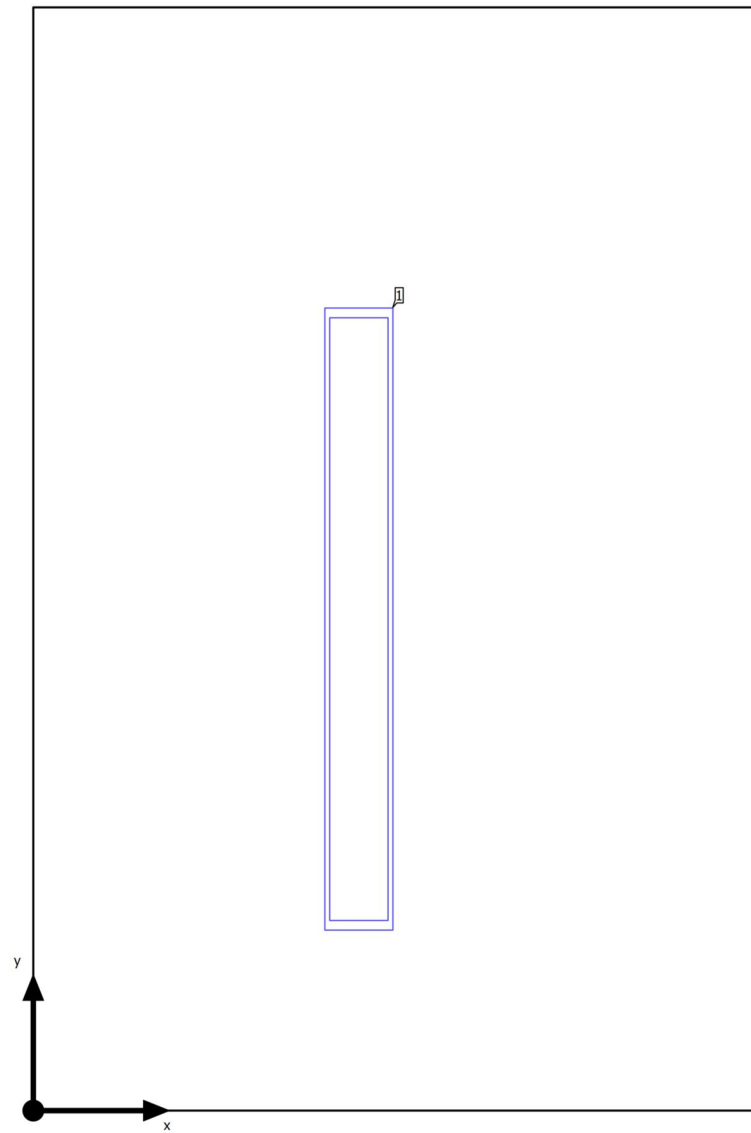

Building B · GROUND FOOR · 105 WC

Luminaire layout plan



|              |               |                        |         |
|--------------|---------------|------------------------|---------|
| Manufacturer | Philips       | P                      | 76.0 W  |
| Article name | 2x36W         | Φ <sub>Luminaire</sub> | 4663 lm |
| Fitting      | 2x T8 36W/827 |                        |         |

Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.670 m | 1.011 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 105 WC

**Luminaire list**


|                                  |                              |                                |
|----------------------------------|------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>4663 lm | $P_{\text{total}}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |



Building B · GROUND FOOR · 105 WC (Light scene 1)

## Calculation objects

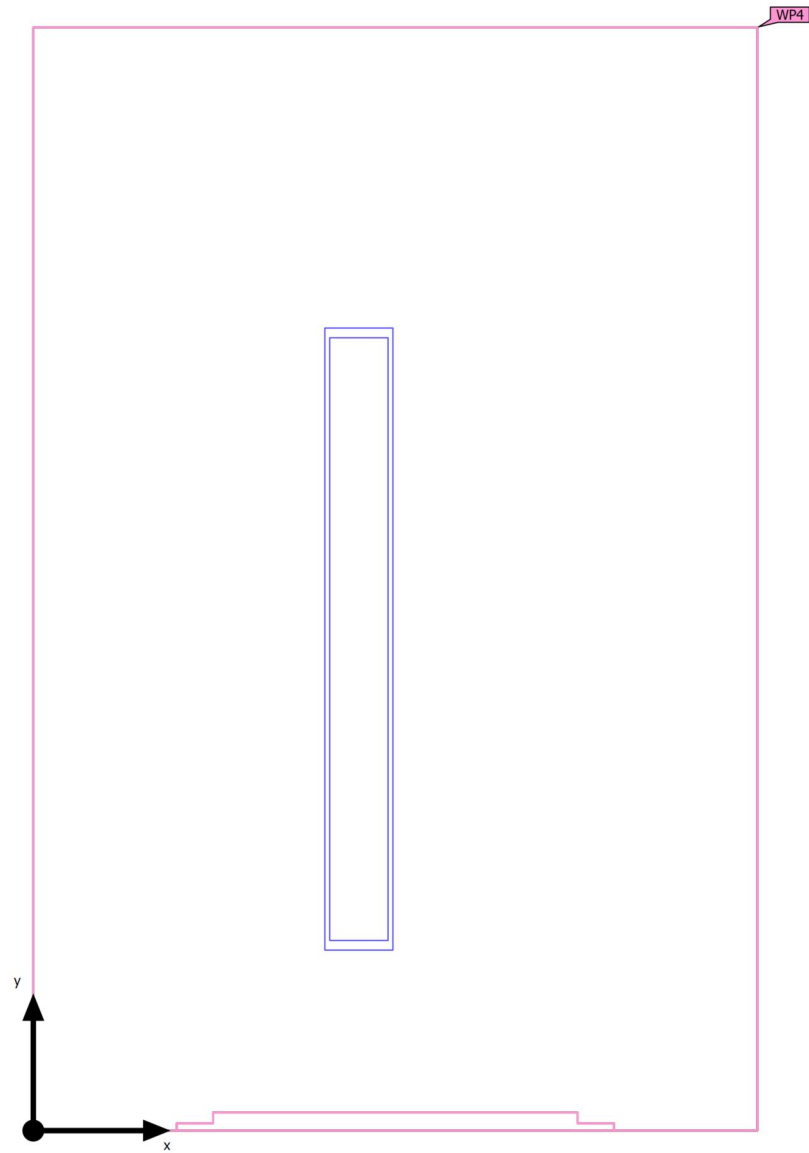

Building B · GROUND FOOR · 105 WC (Light scene 1)

**Calculation objects**



## Working planes

| Properties                                                                                            | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|-------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (105 WC)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 201 lx<br>( $\geq 500$ lx)<br>✗ | 132 lx    | 217 lx    | 0.66<br>( $\geq 0.60$ )<br>✓ | 0.61  | WP4   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 105 WC (Light scene 1)

### Working plane (105 WC)

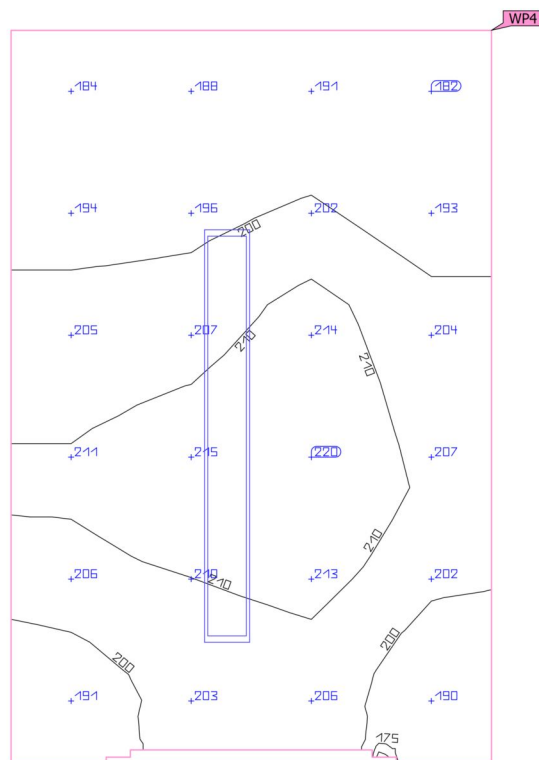


| Properties                                                                                            | E<br>(Target)                                              | E <sub>min</sub> | E <sub>max</sub> | U <sub>o</sub> (g <sub>1</sub> )<br>(Target)             | g <sub>2</sub> | Index                                                         |
|-------------------------------------------------------------------------------------------------------|------------------------------------------------------------|------------------|------------------|----------------------------------------------------------|----------------|---------------------------------------------------------------|
| Working plane (105 WC)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 201 lx<br>(≥ 500 lx)<br><span style="color: red;">✗</span> | 132 lx           | 217 lx           | 0.66<br>(≥ 0.60)<br><span style="color: green;">✓</span> | 0.61           | <div style="border: 1px solid black; padding: 2px;">WP4</div> |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 106 WC (Light scene 1)

Summary

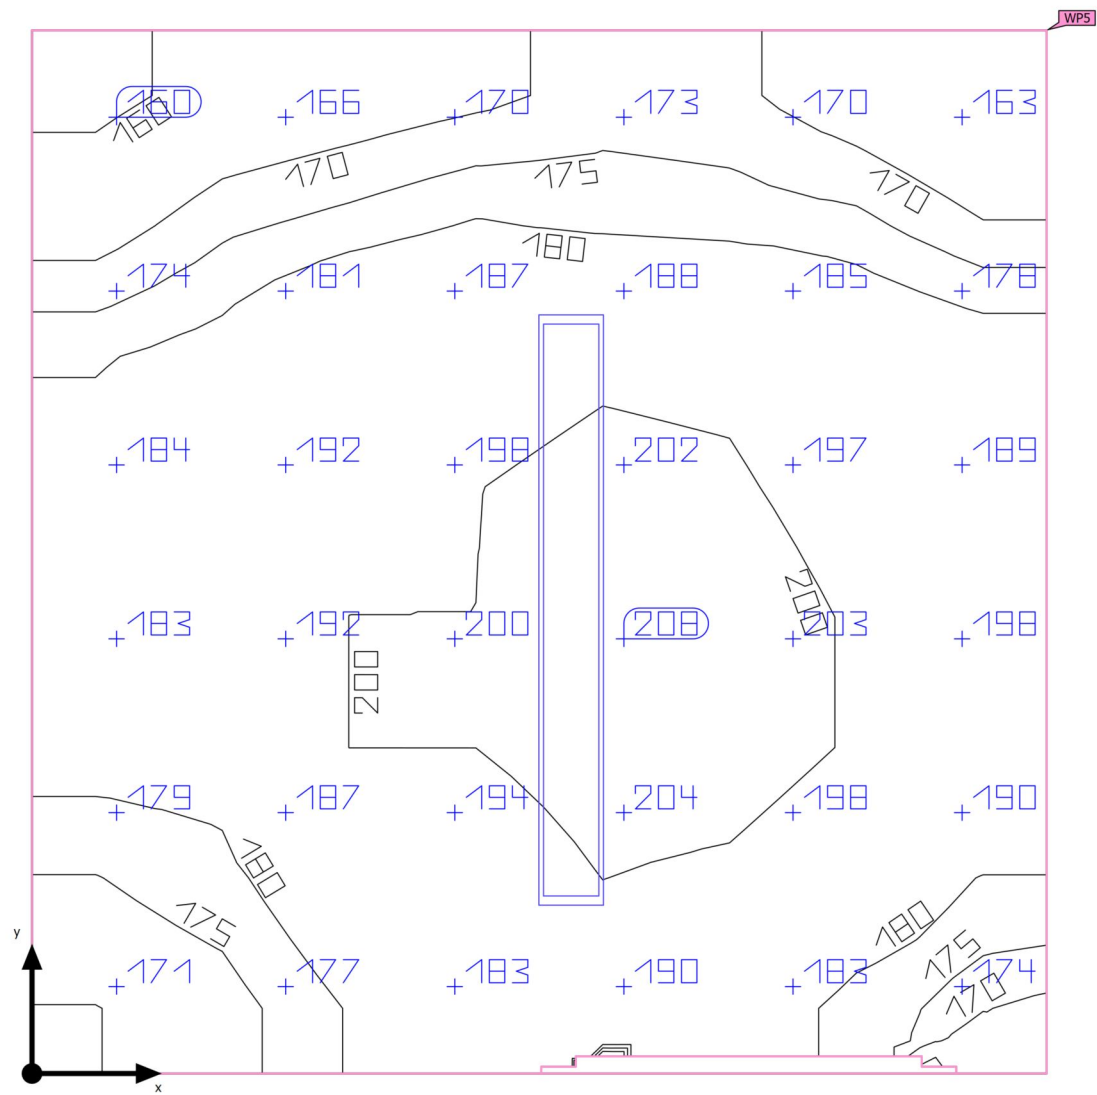

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 4.98 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 106 WC (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target         | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|----------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 186 lx                        | $\geq 500$ lx  | ✗     | WP5   |
|                                  | $U_o (g_1)$                      | 0.82                          | $\geq 0.60$    | ✓     | WP5   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 21                            | $\leq 19$      | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [119 - 188] kWh/a             | max. 200 kWh/a | ✓     |       |
| Space                            | Lighting power density           | 15.27 W/m <sup>2</sup>        | –              |       |       |
|                                  |                                  | 8.23 W/m <sup>2</sup> /100 lx | –              |       |       |

(1) Based on a rectangular space of 2.200 m x 2.262 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 21       | 76.0 W | 4663 lm | 61.4 lm/W         |

Building B · GROUND FOOR · 106 WC

## Luminaire layout plan

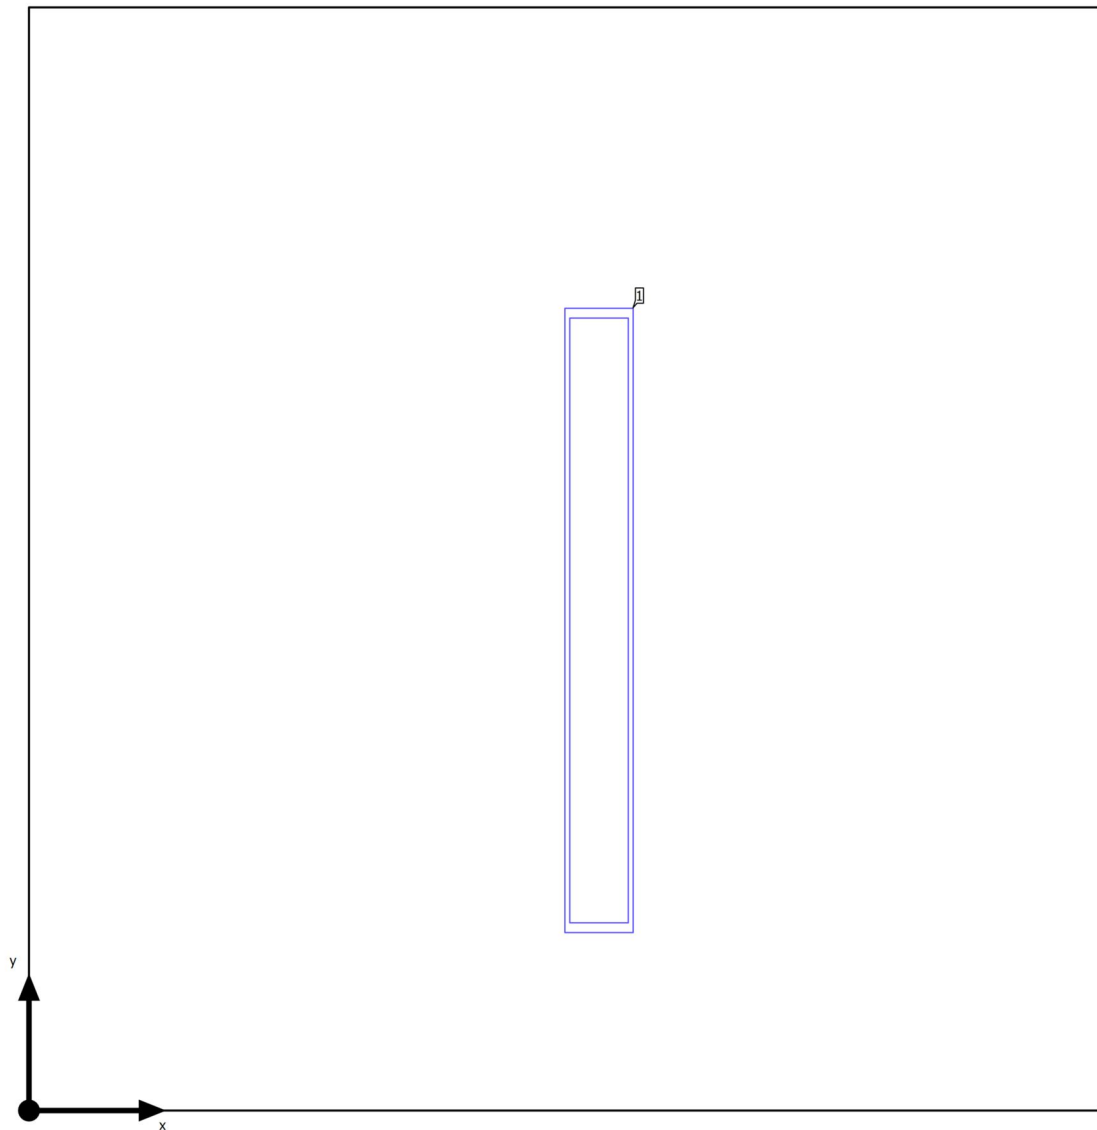

Building B · GROUND FOOR · 106 WC

**Luminaire layout plan**

|              |               |                           |         |
|--------------|---------------|---------------------------|---------|
| Manufacturer | Philips       | P                         | 76.0 W  |
| Article name | 2x36W         | $\Phi_{\text{Luminaire}}$ | 4663 lm |
| Fitting      | 2x T8 36W/827 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.169 m | 1.005 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 106 WC

**Luminaire list**


|                                  |                              |                                |
|----------------------------------|------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>4663 lm | $P_{\text{total}}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |



Building B · GROUND FOOR · 106 WC (Light scene 1)

## Calculation objects

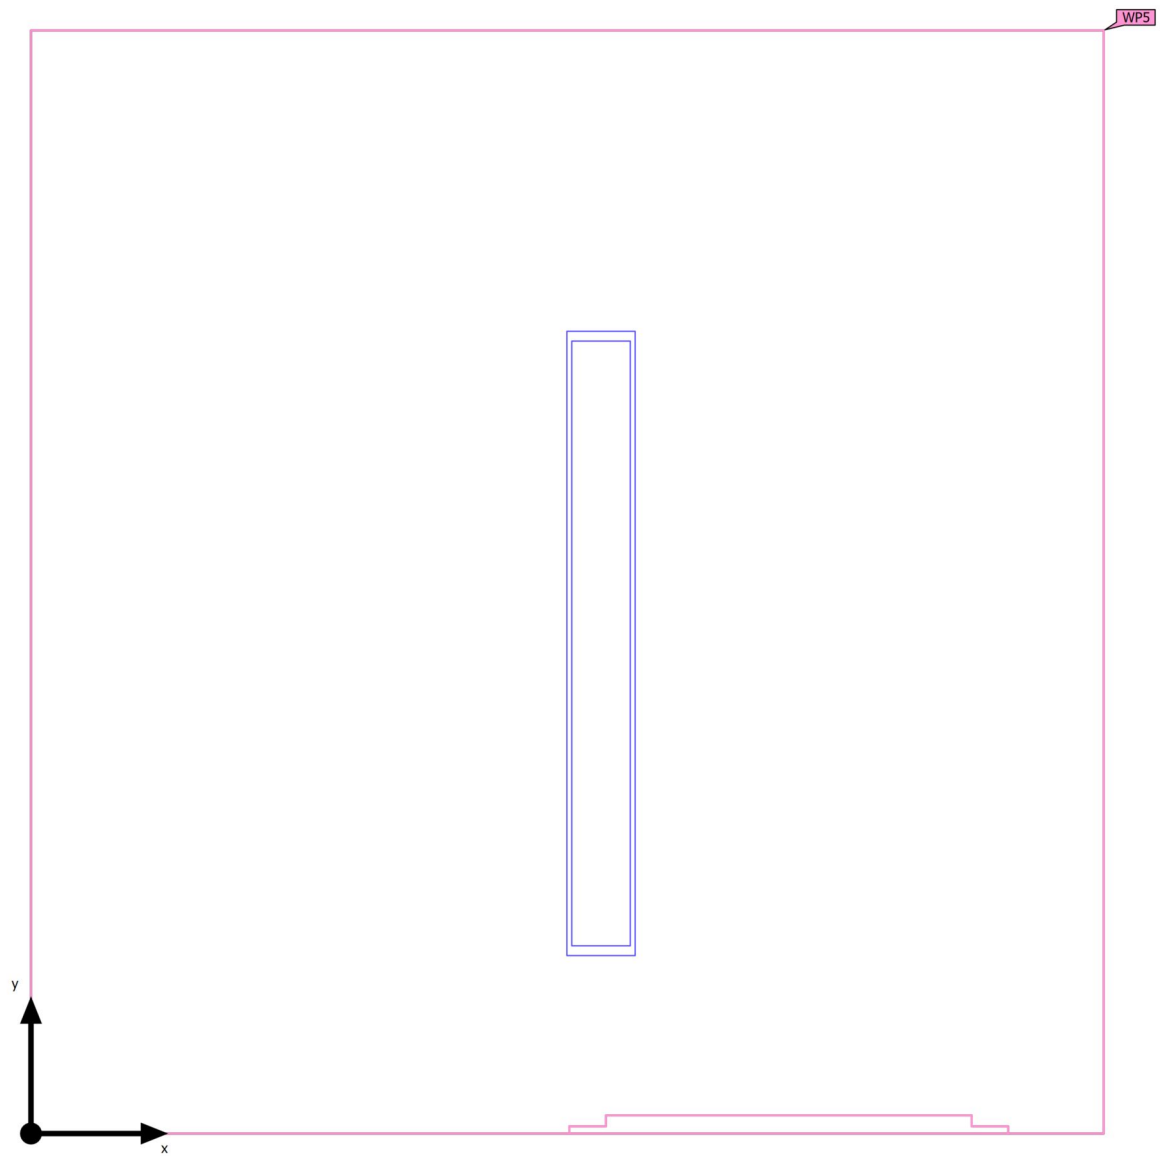

Building B · GROUND FOOR · 106 WC (Light scene 1)

**Calculation objects**



## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (106 WC)               | 186 lx                | 153 lx    | 206 lx    | 0.82                    | 0.74  | WP5   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 106 WC (Light scene 1)

Working plane (106 WC)

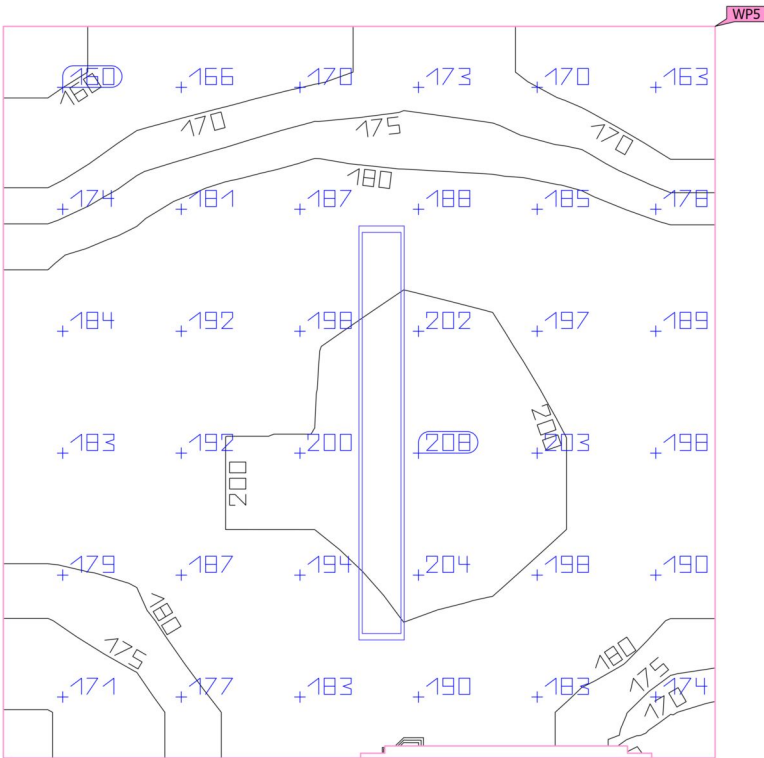


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (106 WC)               | 186 lx                | 153 lx    | 206 lx    | 0.82                    | 0.74  | WP5   |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 107 SHOWER (Light scene 1)

Summary

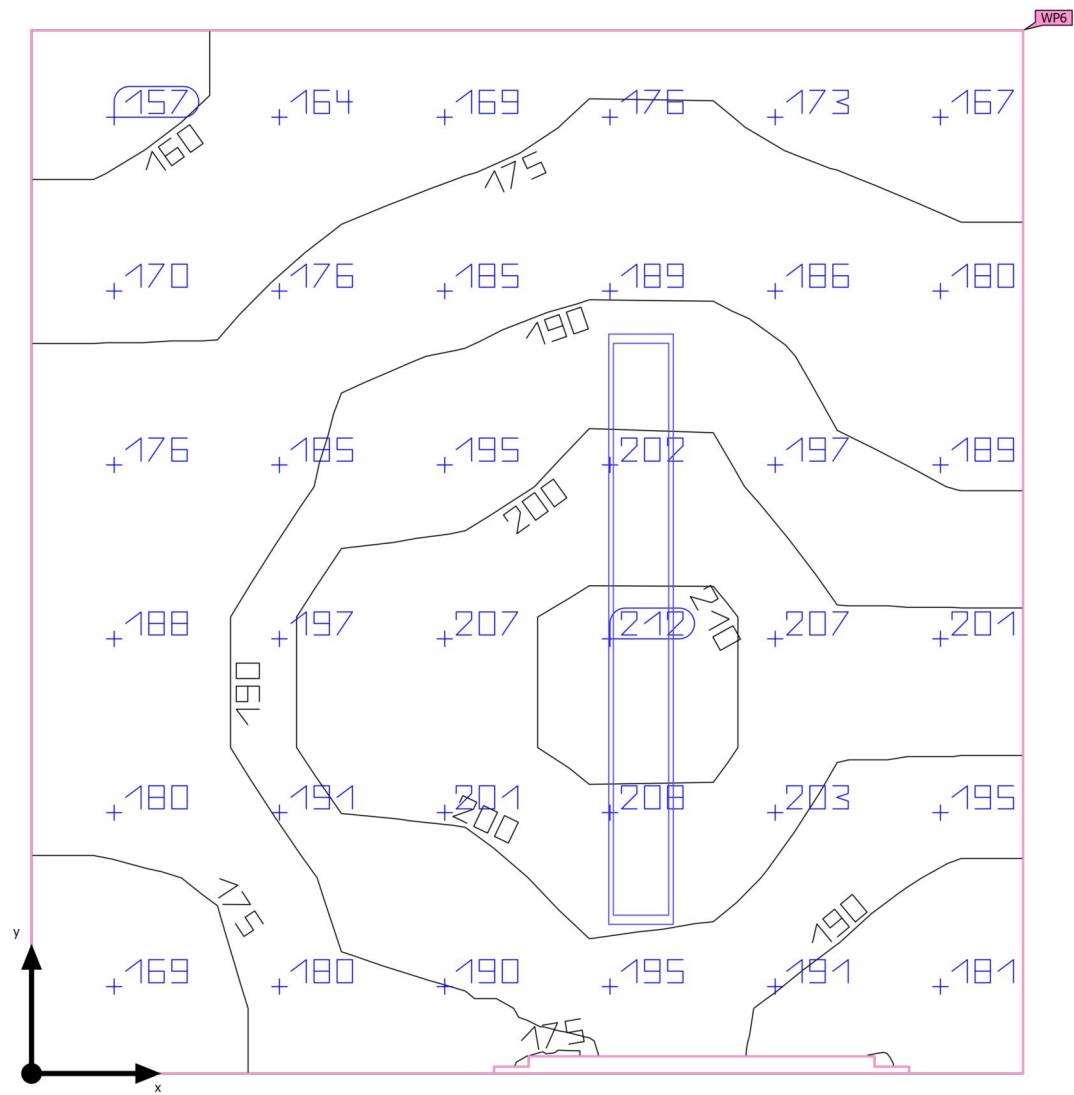

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 4.86 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 107 SHOWER (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 187 lx                        | $\geq 500 \text{ lx}$ | ✗     | WP6   |
|                                  | $U_o (g_1)$                      | 0.83                          | $\geq 0.60$           | ✓     | WP6   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 21                            | $\leq 19$             | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [119 - 188] kWh/a             | max. 200 kWh/a        | ✓     |       |
| Space                            | Lighting power density           | 15.63 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 8.35 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 2.150 m x 2.262 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 21       | 76.0 W | 4663 lm | 61.4 lm/W         |


Building B · GROUND FOOR · 107 SHOWER

## Luminaire layout plan

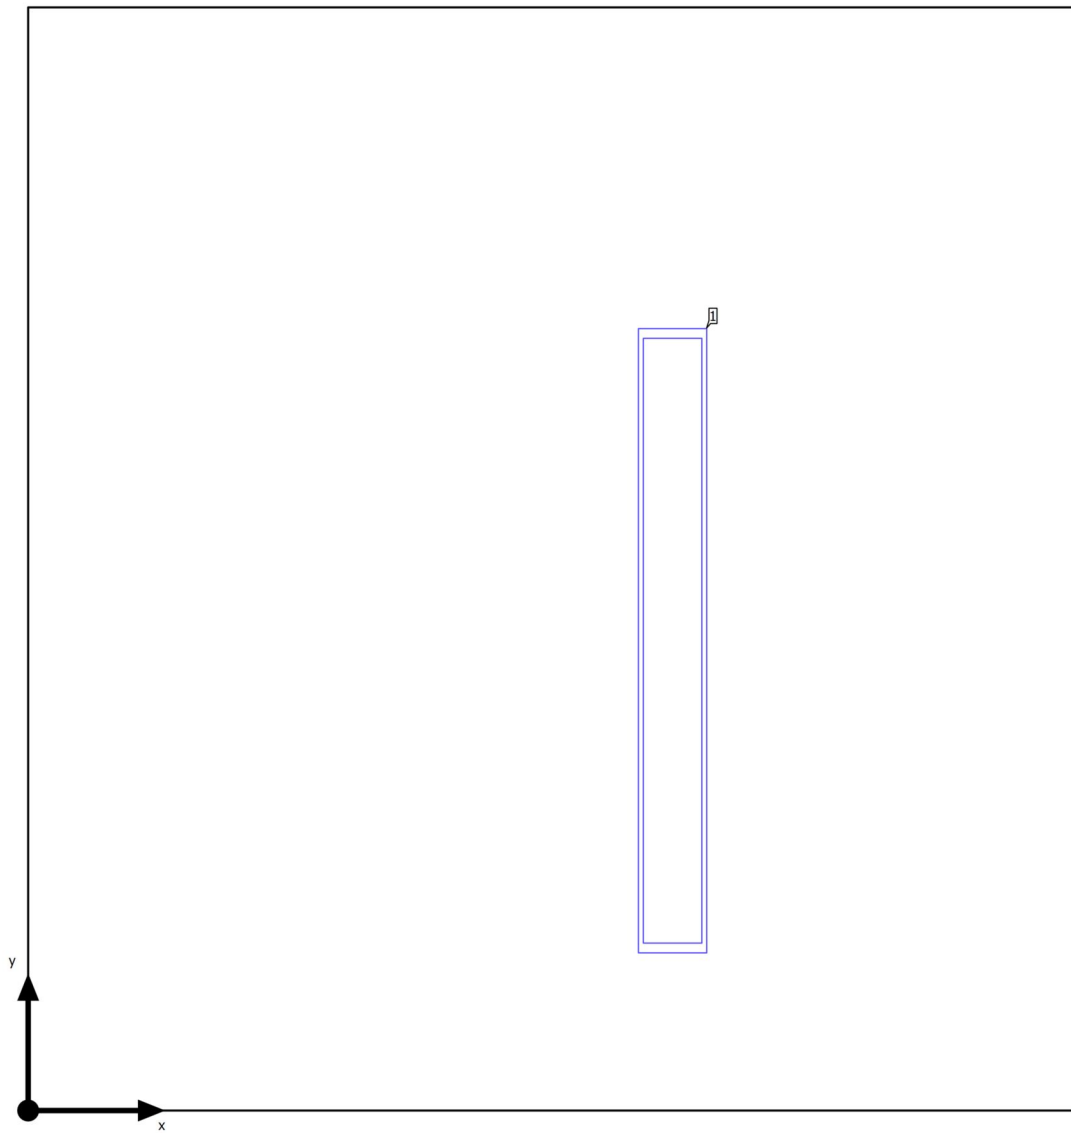

Building B · GROUND FOOR · 107 SHOWER

Luminaire layout plan



|              |               |                        |         |
|--------------|---------------|------------------------|---------|
| Manufacturer | Philips       | P                      | 76.0 W  |
| Article name | 2x36W         | Φ <sub>Luminaire</sub> | 4663 lm |
| Fitting      | 2x T8 36W/827 |                        |         |

Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.322 m | 0.963 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 107 SHOWER

**Luminaire list**


|                                  |                              |                                |
|----------------------------------|------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>4663 lm | $P_{\text{total}}$<br>76.0 W | Luminous efficacy<br>61.4 lm/W |
|----------------------------------|------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P      | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|--------|---------|-------------------|
| 1    | Philips      |             | 2x36W        | 76.0 W | 4663 lm | 61.4 lm/W         |



Building B · GROUND FOOR · 107 SHOWER (Light scene 1)

## Calculation objects

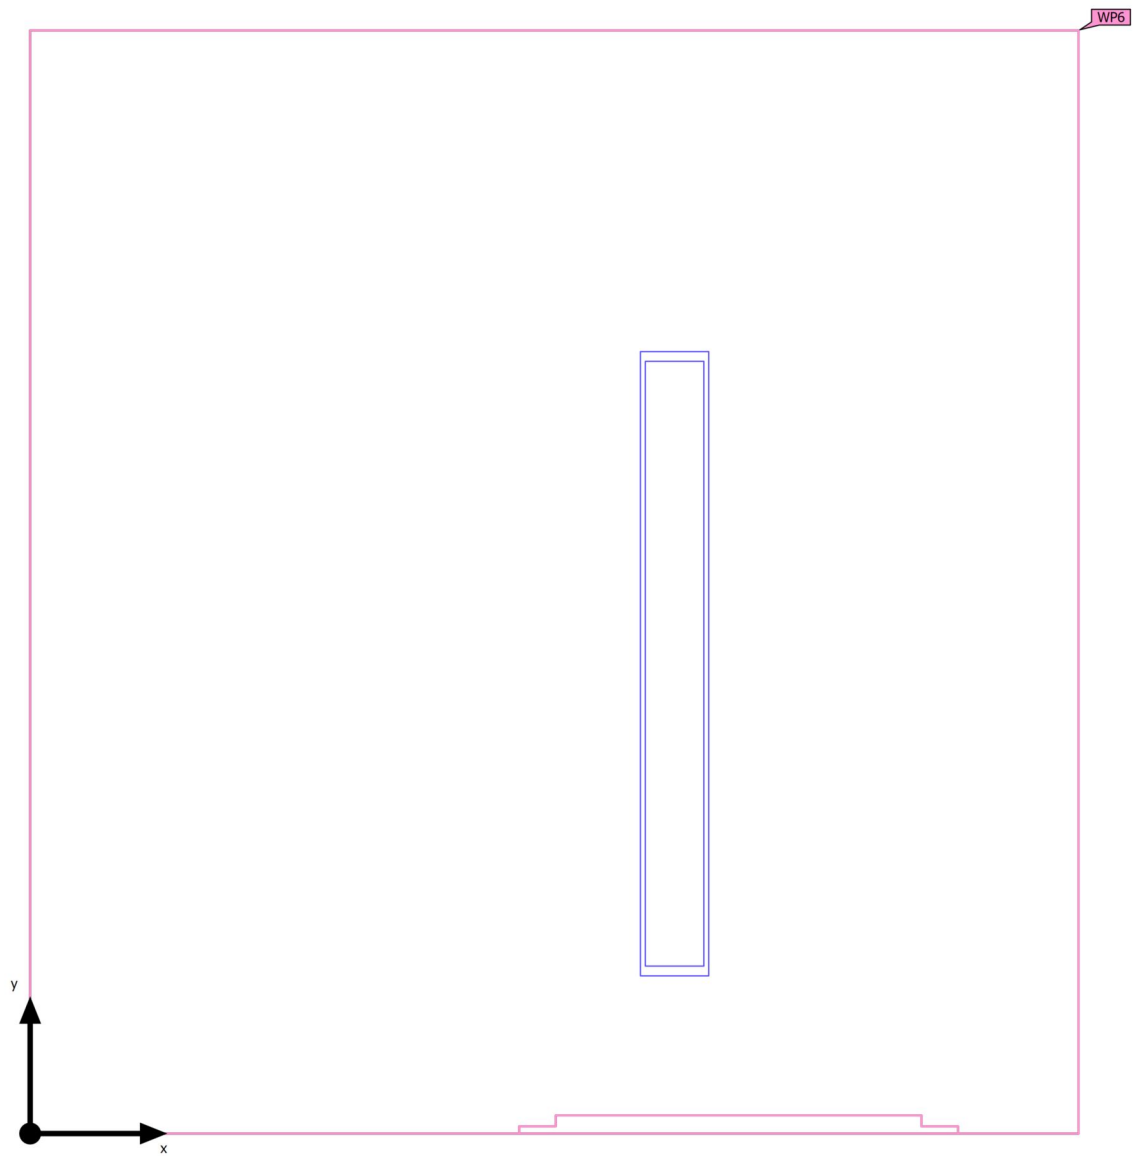

Building B · GROUND FOOR · 107 SHOWER (Light scene 1)

**Calculation objects**



## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (107 SHOWER)           | 187 lx                | 155 lx    | 211 lx    | 0.83                    | 0.73  | WP6   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 107 SHOWER (Light scene 1)

## Working plane (107 SHOWER)

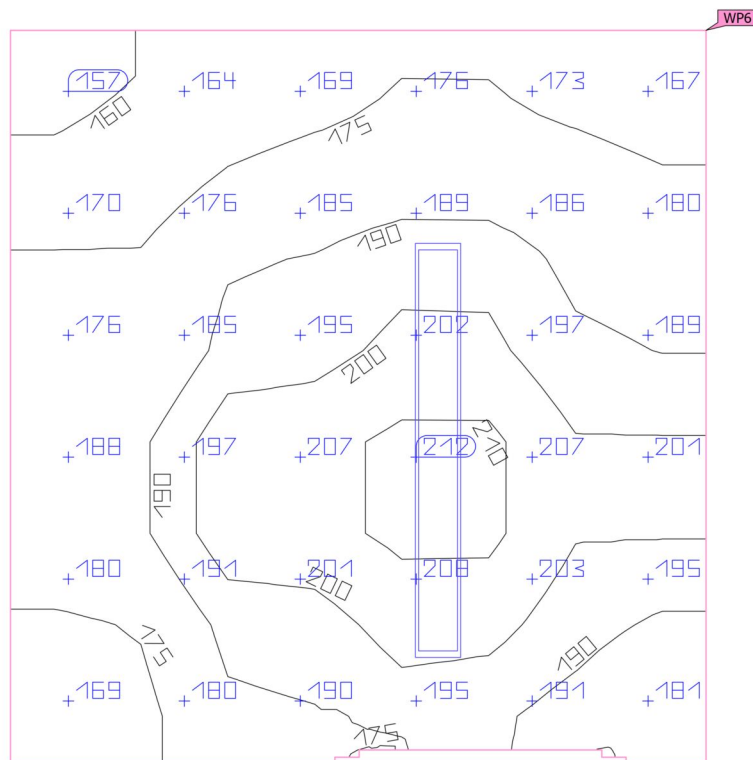


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (107 SHOWER)           | 187 lx                | 155 lx    | 211 lx    | 0.83                    | 0.73  | WP6   |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 108 OFFICE (Light scene 1)

## Summary

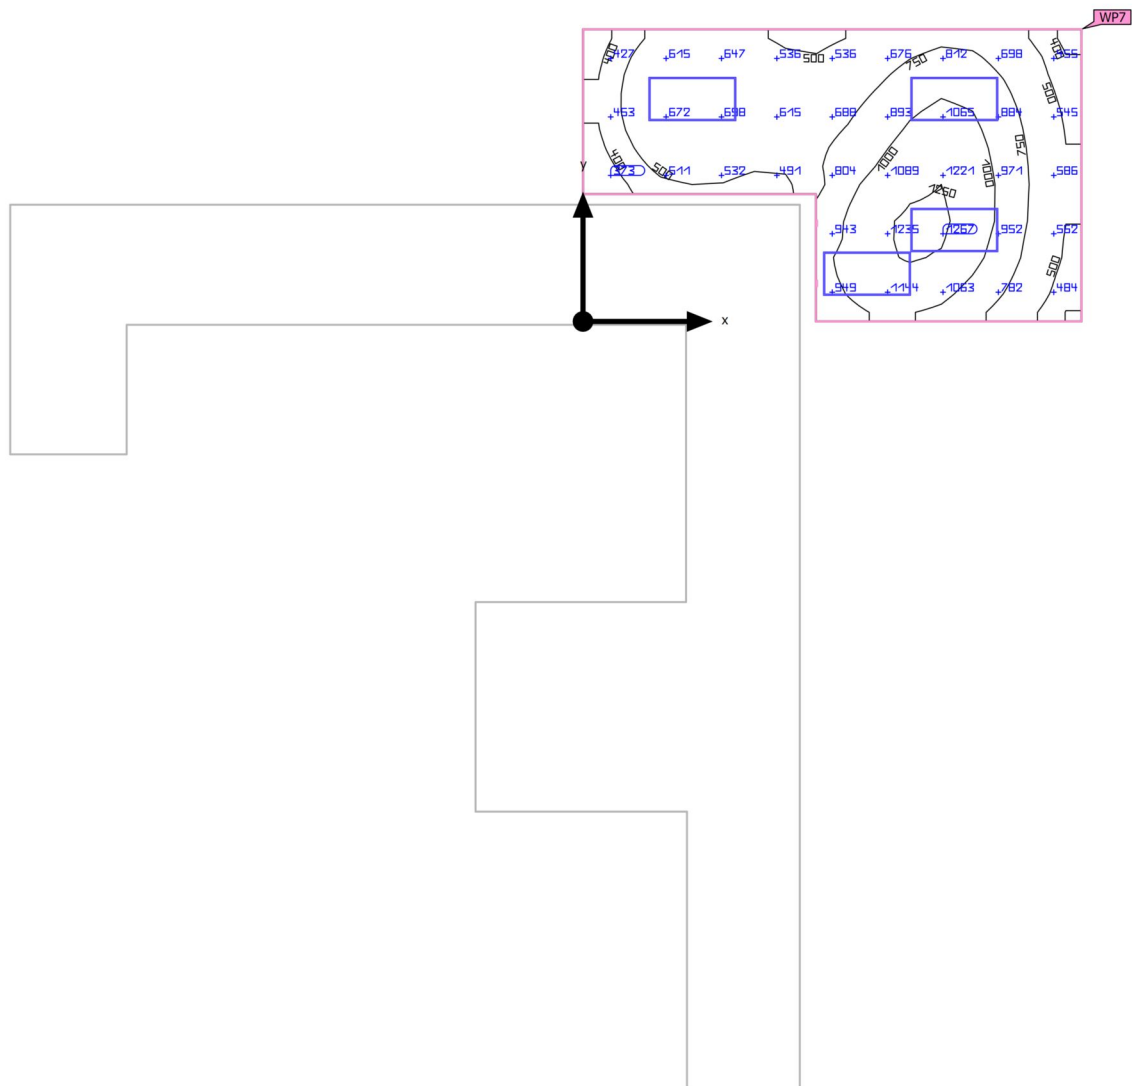

|                    |                                                     |                                    |         |
|--------------------|-----------------------------------------------------|------------------------------------|---------|
| Ground area        | 21.90 m²                                            | Clearance height                   | 2.700 m |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Mounting height                    | 2.700 m |
| Maintenance factor | 0.76 (fixed)                                        | Height <sub>Working plane</sub>    | 0.700 m |
|                    |                                                     | Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 108 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target         | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|----------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 753 lx                        | $\geq 500$ lx  | ✓     | WP7   |
|                                  | $U_o (g_1)$                      | 0.43                          | $\geq 0.60$    | ✗     | WP7   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 19                            | $\leq 19$      | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [923 - 1465] kWh/a            | max. 800 kWh/a | ✗     |       |
| Space                            | Lighting power density           | 27.03 W/m <sup>2</sup>        | –              |       |       |
|                                  |                                  | 3.59 W/m <sup>2</sup> /100 lx | –              |       |       |

(1) Based on a rectangular space of 6.850 m x 4.015 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 19       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 108 OFFICE

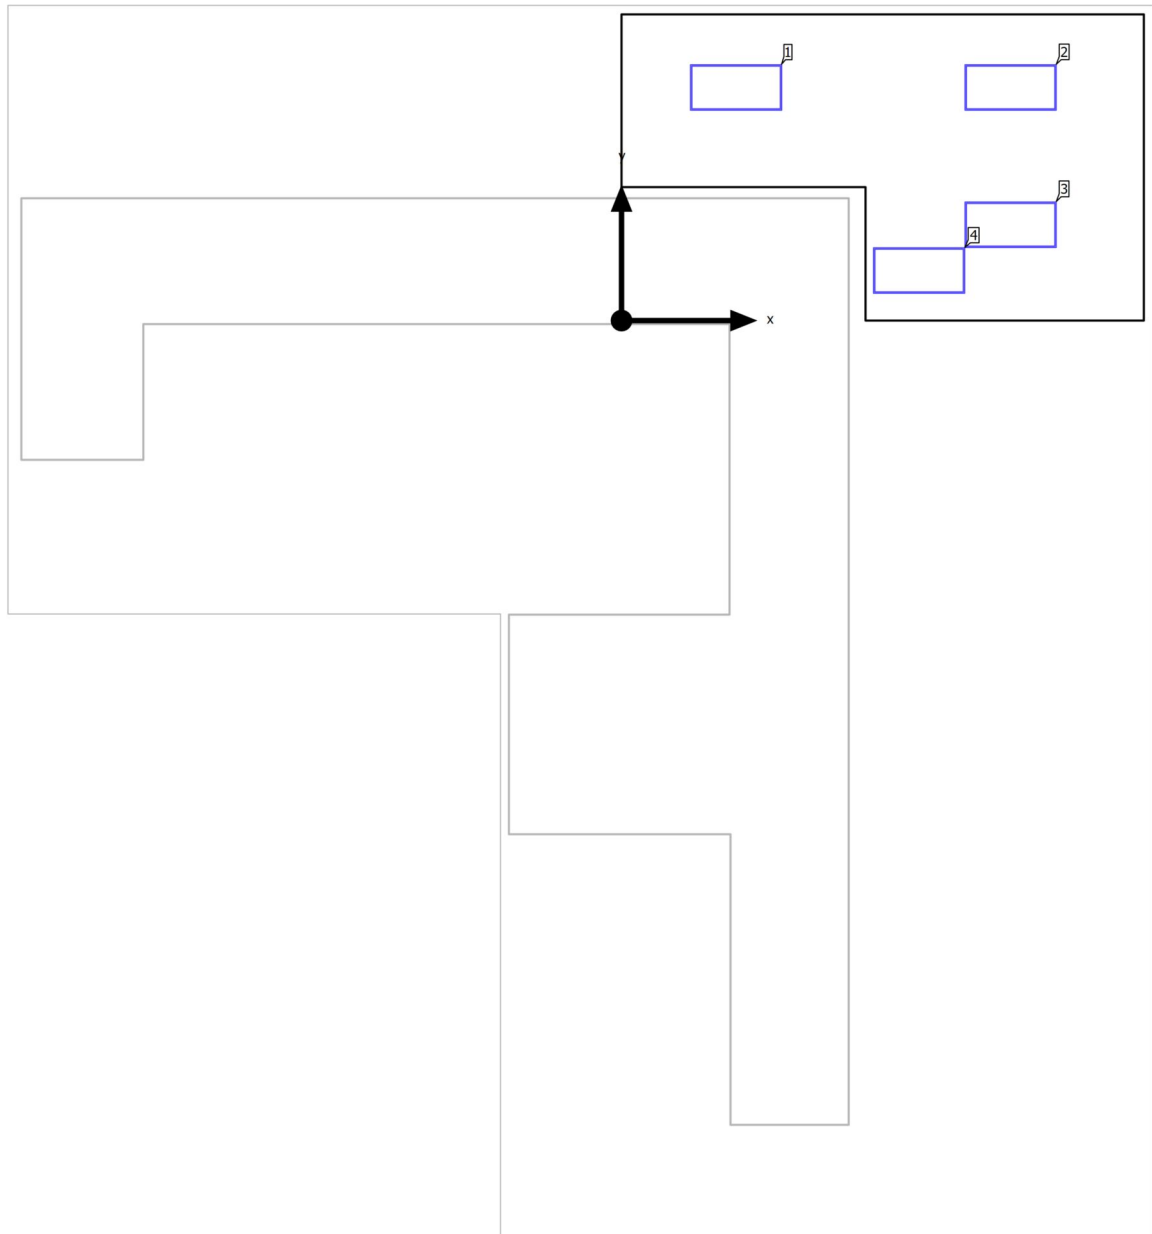**Luminaire layout plan**

Building B · GROUND FOOR · 108 OFFICE

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.503 m | 3.056 m | 2.700 m         | 1         |
| 5.103 m | 3.056 m | 2.700 m         | 2         |
| 5.103 m | 1.256 m | 2.700 m         | 3         |
| 3.903 m | 0.656 m | 2.700 m         | 4         |

Building B · GROUND FOOR · 108 OFFICE

**Luminaire list** $\Phi_{\text{total}}$ 

33072 lm

 $P_{\text{total}}$ 

592.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 108 OFFICE (Light scene 1)

## Calculation objects

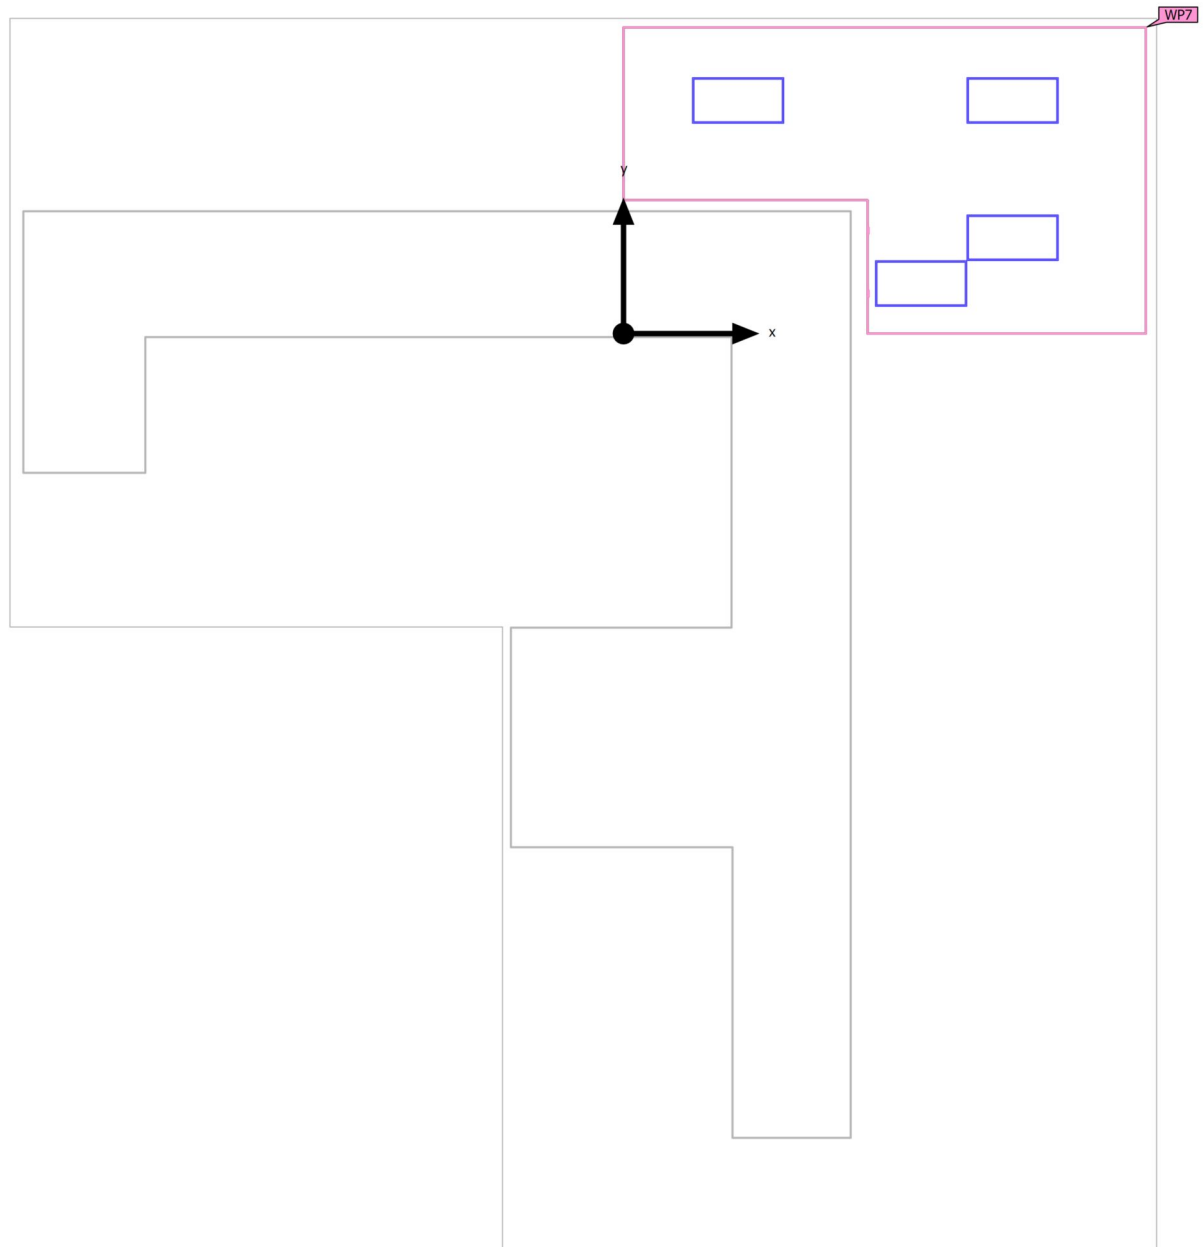

Building B · GROUND FOOR · 108 OFFICE (Light scene 1)

**Calculation objects**



## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (108 OFFICE)           | 753 lx                | 326 lx    | 1288 lx   | 0.43                    | 0.25  | WP7   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 108 OFFICE (Light scene 1)

## Working plane (108 OFFICE)

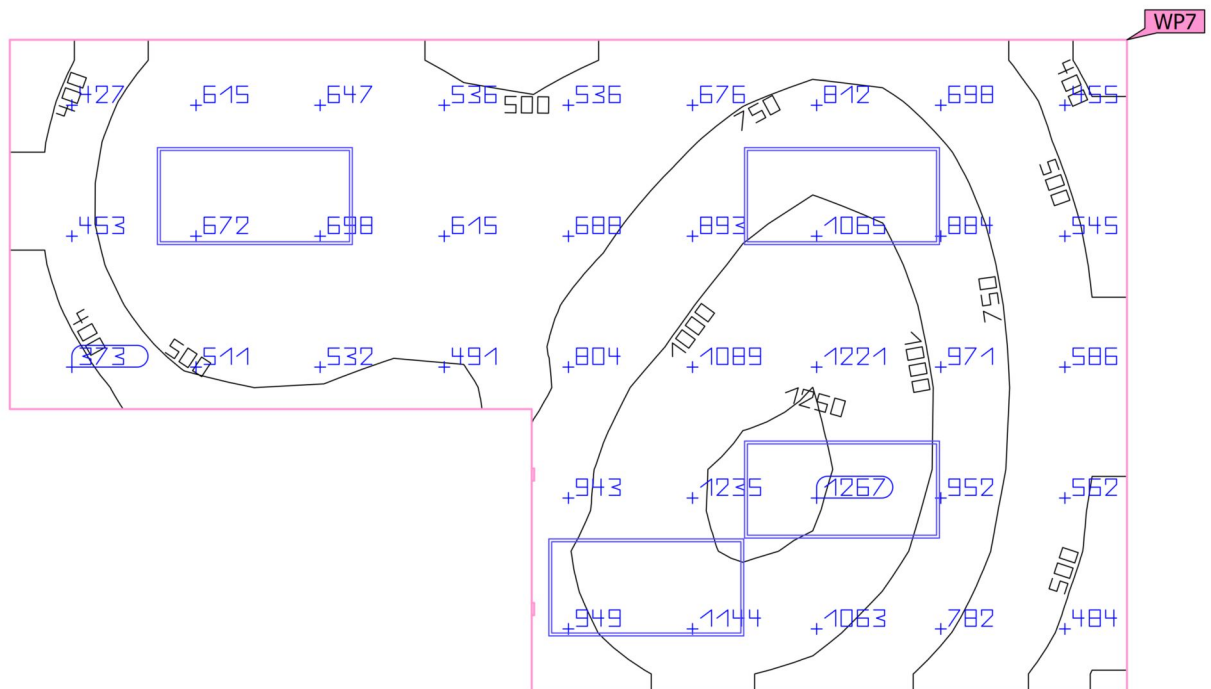


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (108 OFFICE)           | 753 lx                | 326 lx    | 1288 lx   | 0.43                    | 0.25  | WP7   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 109 OFFICE (Light scene 1)

Summary

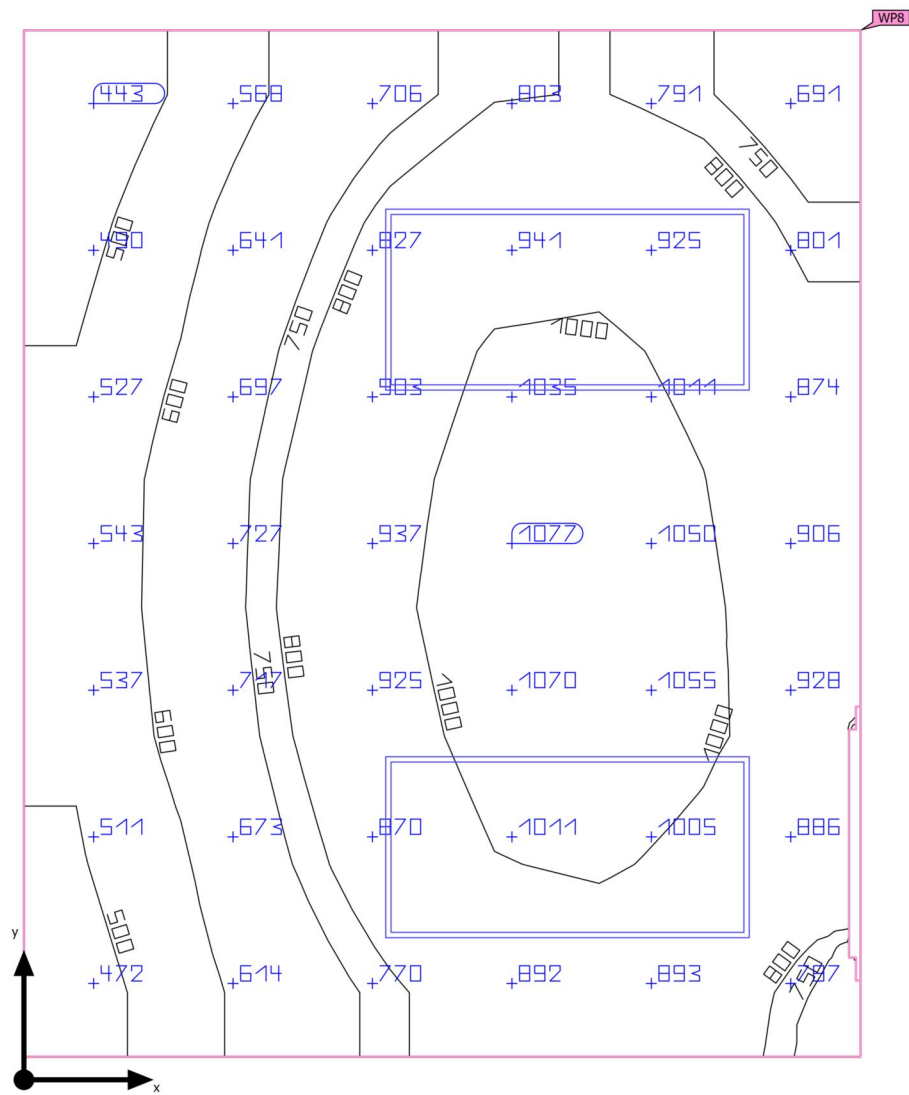

|                    |                                                     |                                    |         |
|--------------------|-----------------------------------------------------|------------------------------------|---------|
| Ground area        | 9.28 m <sup>2</sup>                                 | Clearance height                   | 2.700 m |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Mounting height                    | 2.700 m |
| Maintenance factor | 0.76 (fixed)                                        | Height <sub>Working plane</sub>    | 0.700 m |
|                    |                                                     | Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 109 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target         | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|----------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 801 lx                        | $\geq 500$ lx  | ✓     | WP8   |
|                                  | $U_o (g_1)$                      | 0.53                          | $\geq 0.60$    | ✗     | WP8   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$      | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | 733 kWh/a                     | max. 350 kWh/a | ✗     |       |
| Space                            | Lighting power density           | 31.90 W/m <sup>2</sup>        | –              |       |       |
|                                  |                                  | 3.98 W/m <sup>2</sup> /100 lx | –              |       |       |

(1) Based on a rectangular space of 3.375 m x 2.750 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 109 OFFICE

## Luminaire layout plan

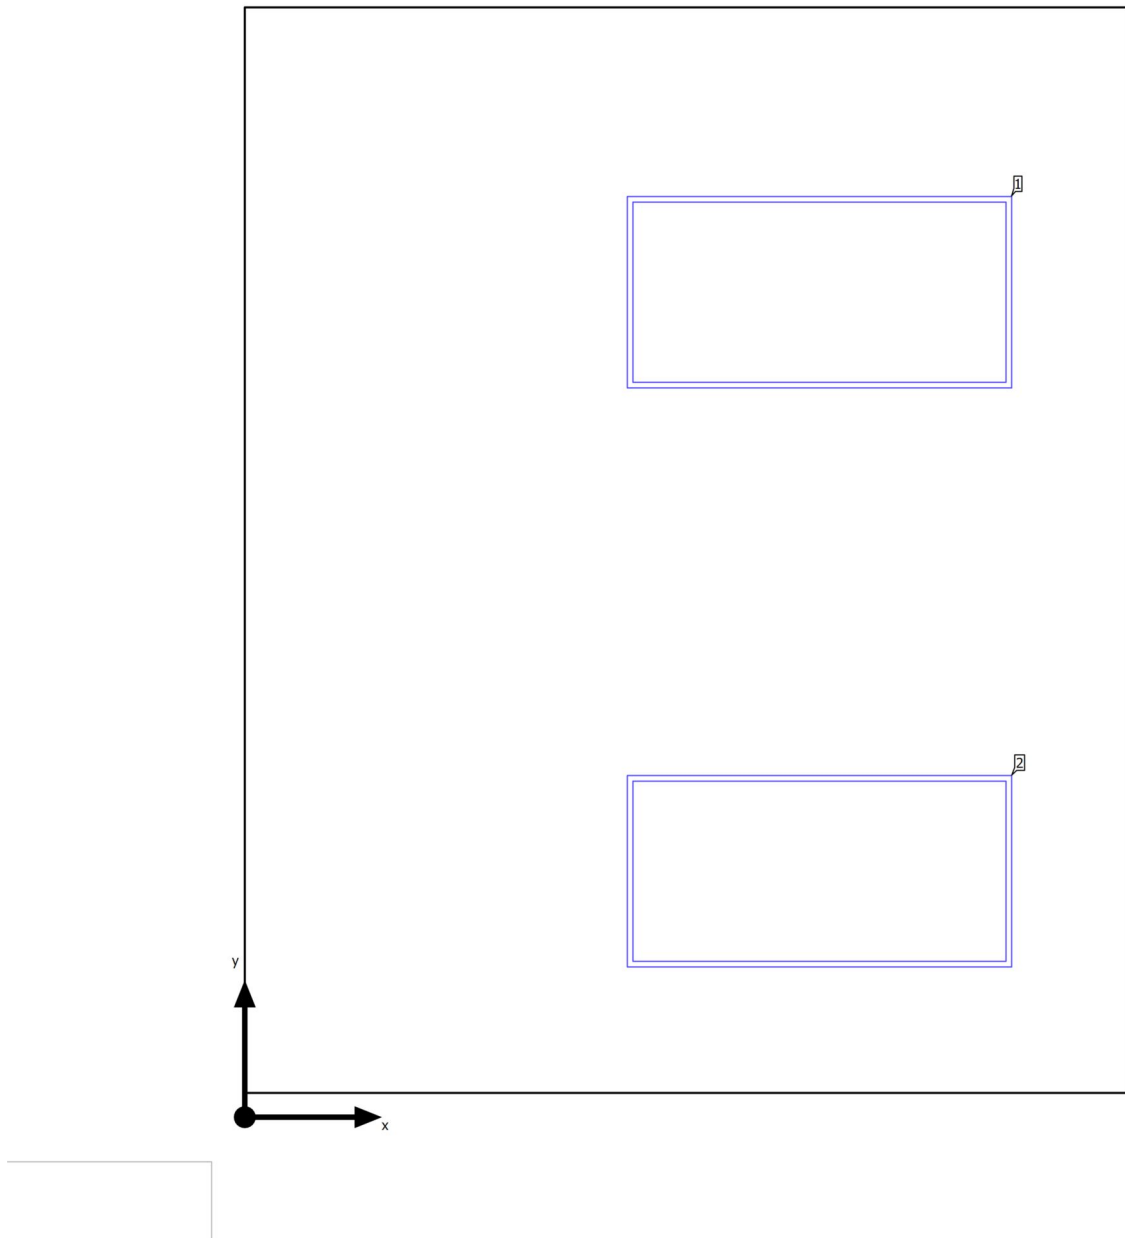

Building B · GROUND FOOR · 109 OFFICE

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.787 m | 2.565 m | 2.700 m         | 1         |
| 1.787 m | 0.765 m | 2.700 m         | 2         |

Building B · GROUND FOOR · 109 OFFICE

Luminaire list


|                            |                        |                                |
|----------------------------|------------------------|--------------------------------|
| $\Phi_{total}$<br>16536 lm | $P_{total}$<br>296.0 W | Luminous efficacy<br>55.9 lm/W |
|----------------------------|------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 109 OFFICE (Light scene 1)

## Calculation objects

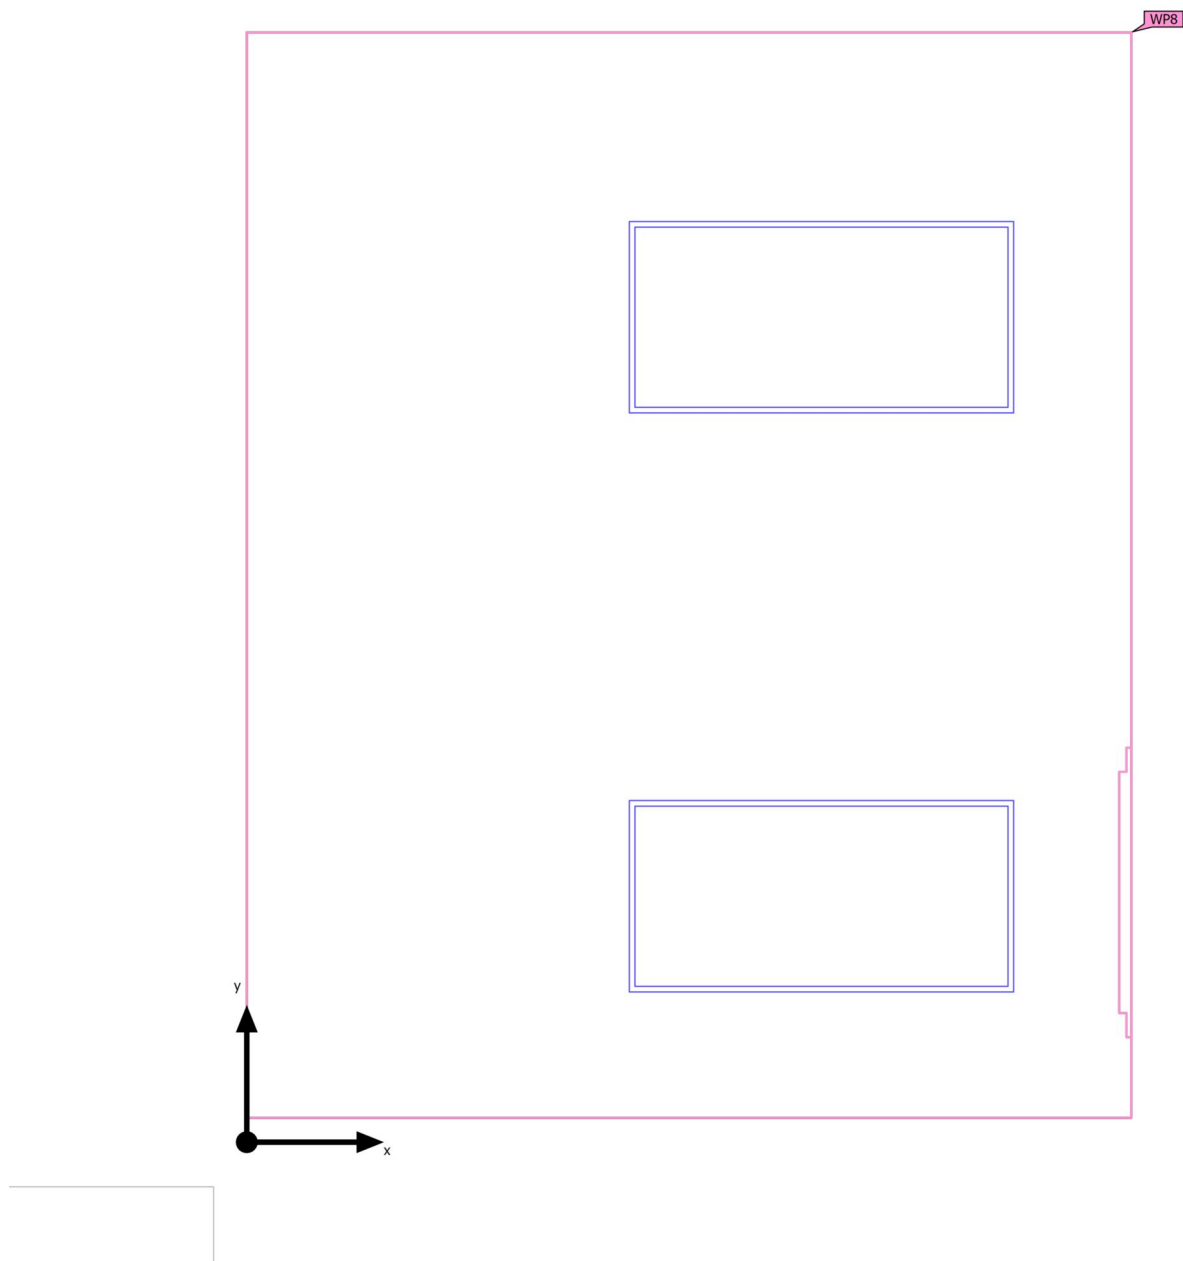

Building B · GROUND FOOR · 109 OFFICE (Light scene 1)

**Calculation objects**


## Working planes

| Properties                                                                                                | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|-----------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (109 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 801 lx<br>( $\geq 500$ lx)<br>✓ | 425 lx    | 1096 lx   | 0.53<br>( $\geq 0.60$ )<br>✗ | 0.39  | WP8   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 109 OFFICE (Light scene 1)

## Working plane (109 OFFICE)

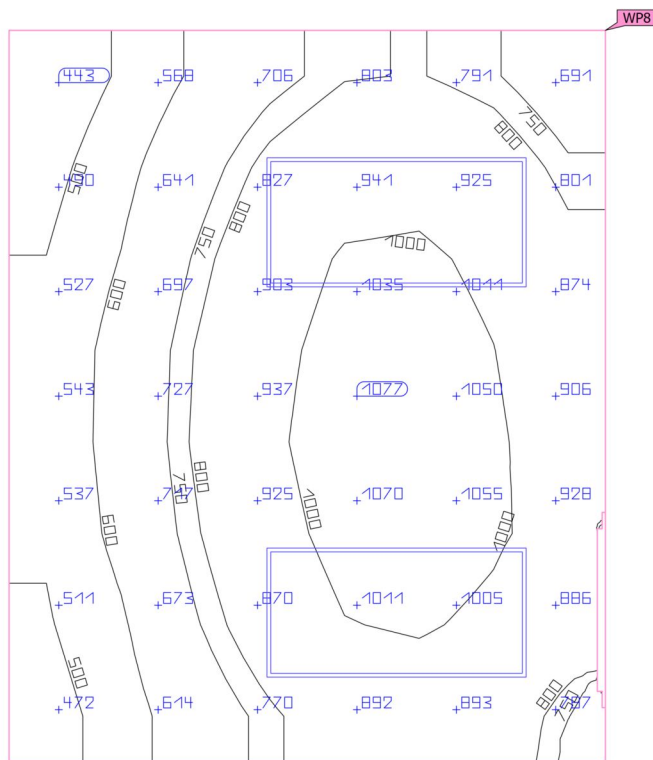


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (109 OFFICE)           | 801 lx                | 425 lx    | 1096 lx   | 0.53                    | 0.39  | WP8   |
| Perpendicular illuminance (adaptive) | $\geq 500$ lx         |           |           | $\geq 0.60$             |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 110 CAD (Light scene 1)

Summary

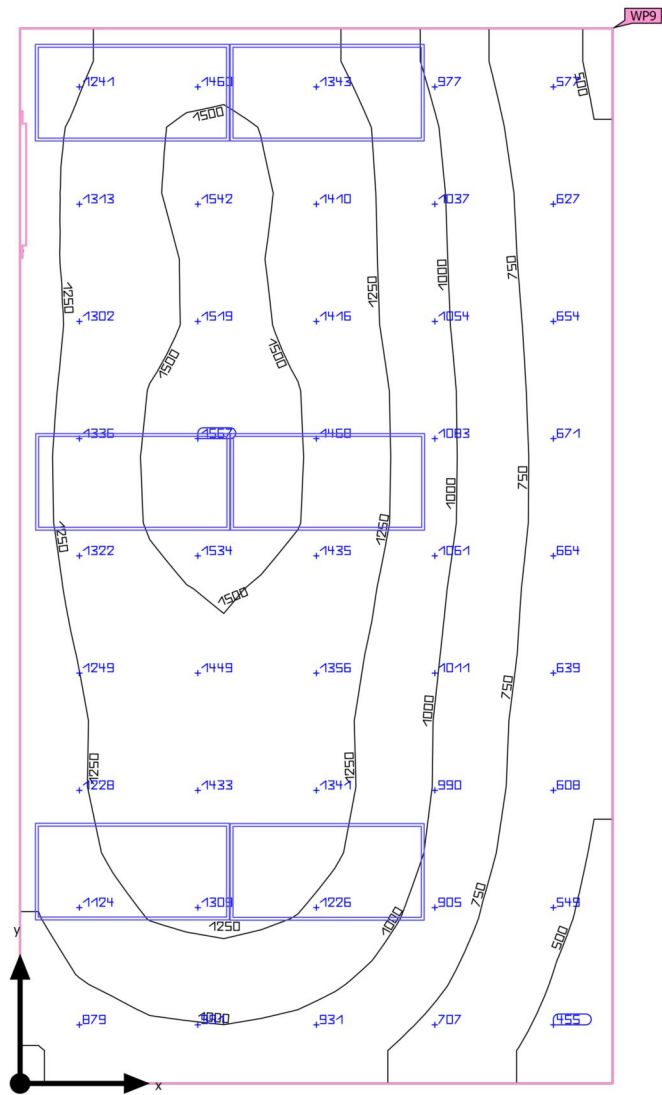

|                    |                                                     |                                    |         |
|--------------------|-----------------------------------------------------|------------------------------------|---------|
| Ground area        | 23.72 m <sup>2</sup>                                | Clearance height                   | 2.700 m |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Mounting height                    | 2.700 m |
| Maintenance factor | 0.76 (fixed)                                        | Height <sub>Working plane</sub>    | 0.700 m |
|                    |                                                     | Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 110 CAD (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 1107 lx                       | $\geq 500 \text{ lx}$ | ✓     | WP9   |
|                                  | $U_o (g_1)$                      | 0.34                          | $\geq 0.60$           | ✗     | WP9   |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 19                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [1385 - 2198] kWh/a           | max. 850 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 37.43 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 3.38 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 3.650 m x 6.500 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 6    | Philips      |             | 4x36W SLB    | 19       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 110 CAD

## Luminaire layout plan

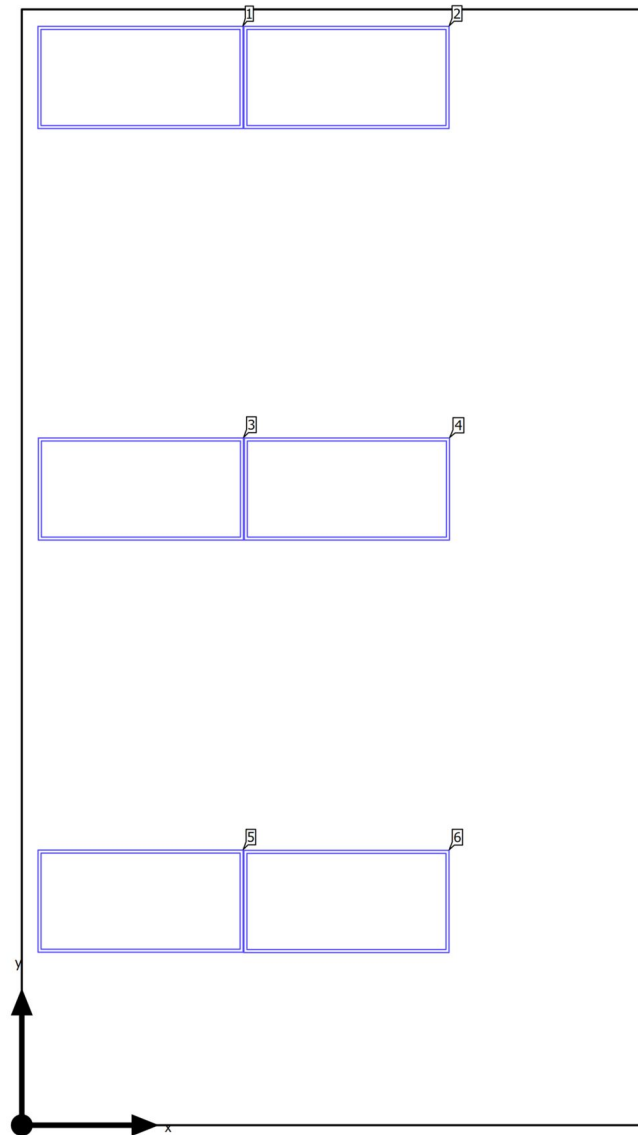

Building B · GROUND FOOR · 110 CAD

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.692 m | 6.103 m | 2.700 m         | 1         |
| 1.892 m | 6.103 m | 2.700 m         | 2         |
| 0.694 m | 3.706 m | 2.700 m         | 3         |
| 1.894 m | 3.706 m | 2.700 m         | 4         |
| 0.692 m | 1.305 m | 2.700 m         | 5         |
| 1.892 m | 1.303 m | 2.700 m         | 6         |

Building B · GROUND FOOR · 110 CAD

**Luminaire list** $\Phi_{\text{total}}$ 

49608 lm

 $P_{\text{total}}$ 

888.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 6    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 110 CAD (Light scene 1)

## Calculation objects

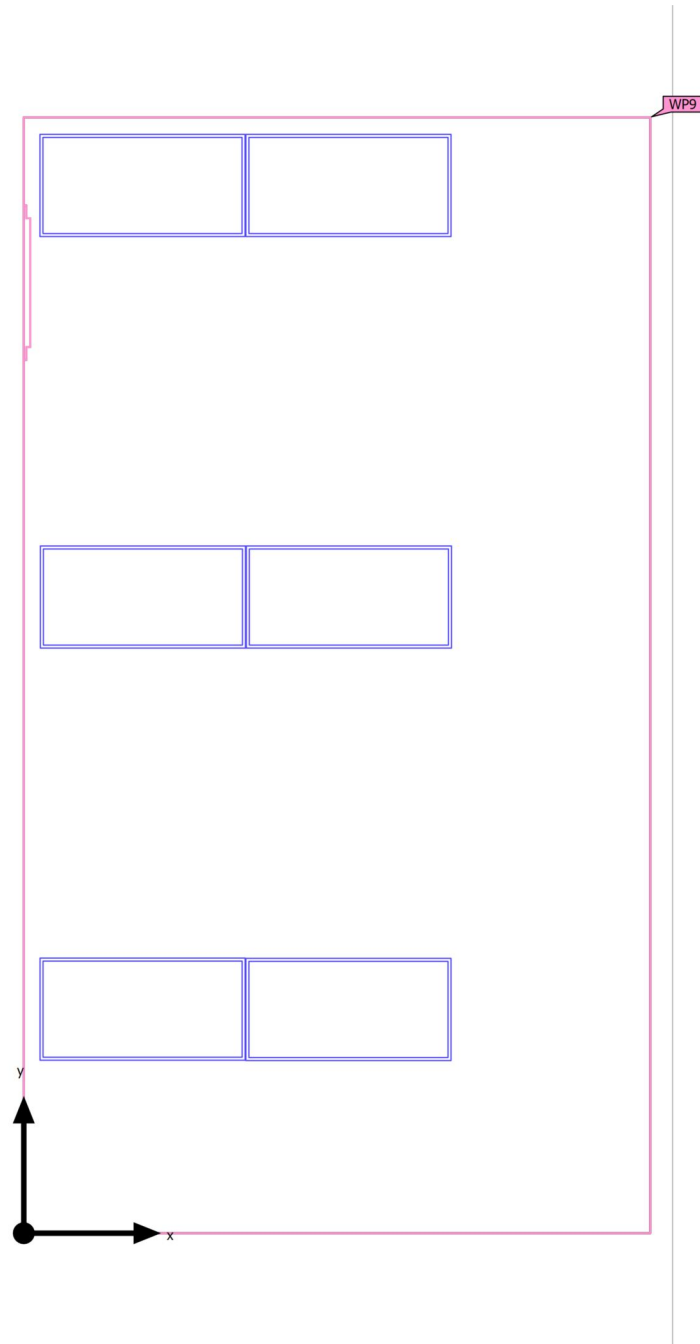

Building B · GROUND FOOR · 110 CAD (Light scene 1)

**Calculation objects**


## Working planes

| Properties                                                                                             | $\bar{E}$<br>(Target)            | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|--------------------------------------------------------------------------------------------------------|----------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (110 CAD)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 1107 lx<br>( $\geq 500$ lx)<br>✓ | 377 lx    | 1587 lx   | 0.34<br>( $\geq 0.60$ )<br>✗ | 0.24  | WP9   |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 110 CAD (Light scene 1)

## Working plane (110 CAD)

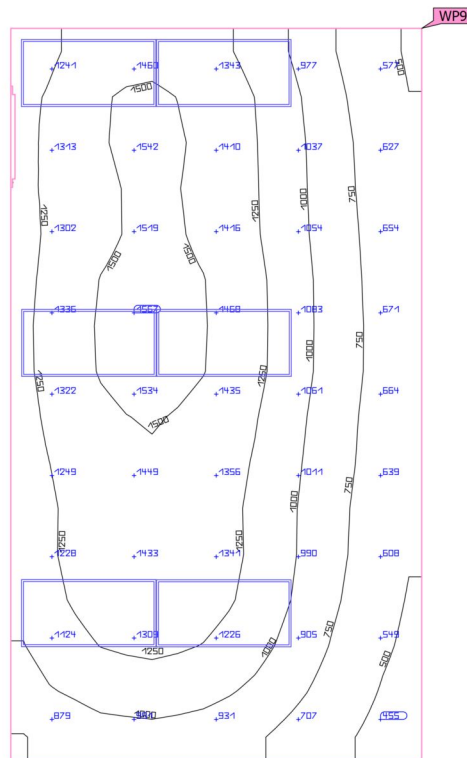


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (110 CAD)              | 1107 lx               | 377 lx    | 1587 lx   | 0.34                    | 0.24  | WP9   |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 111 MANAGER (Light scene 1)

Summary

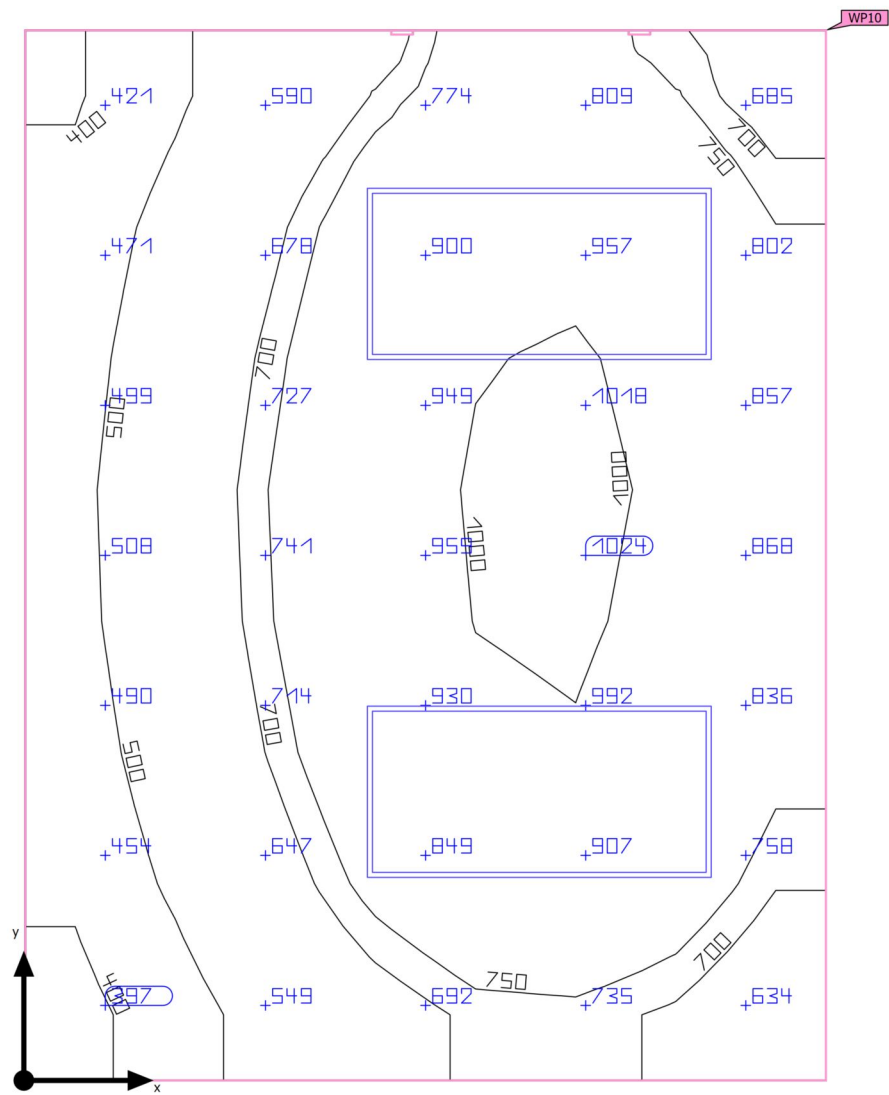

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 10.16 m <sup>2</sup>                                |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.700 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 111 MANAGER (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 740 lx                        | $\geq 500 \text{ lx}$ | ✓     | WP10  |
|                                  | $U_o (g_1)$                      | 0.50                          | $\geq 0.60$           | ✗     | WP10  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [462 - 733] kWh/a             | max. 400 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 29.14 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 3.94 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 2.783 m x 3.650 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 111 MANAGER

## Luminaire layout plan

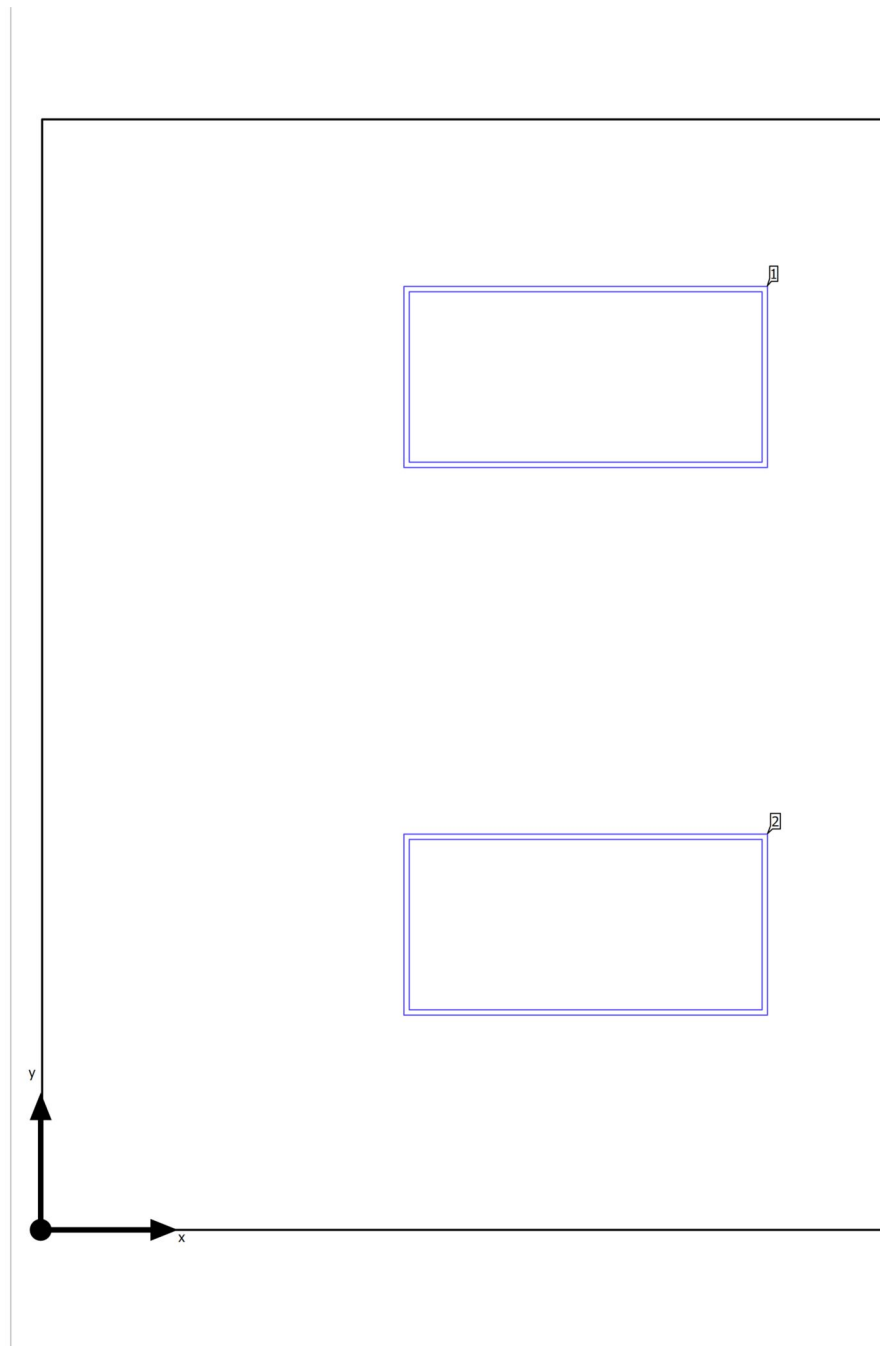

Building B · GROUND FOOR · 111 MANAGER

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.792 m | 2.803 m | 2.700 m         | 1         |
| 1.792 m | 1.003 m | 2.700 m         | 2         |

Building B · GROUND FOOR · 111 MANAGER

**Luminaire list**


|                                   |                               |                                |
|-----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>16536 lm | $P_{\text{total}}$<br>296.0 W | Luminous efficacy<br>55.9 lm/W |
|-----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 111 MANAGER (Light scene 1)

## Calculation objects

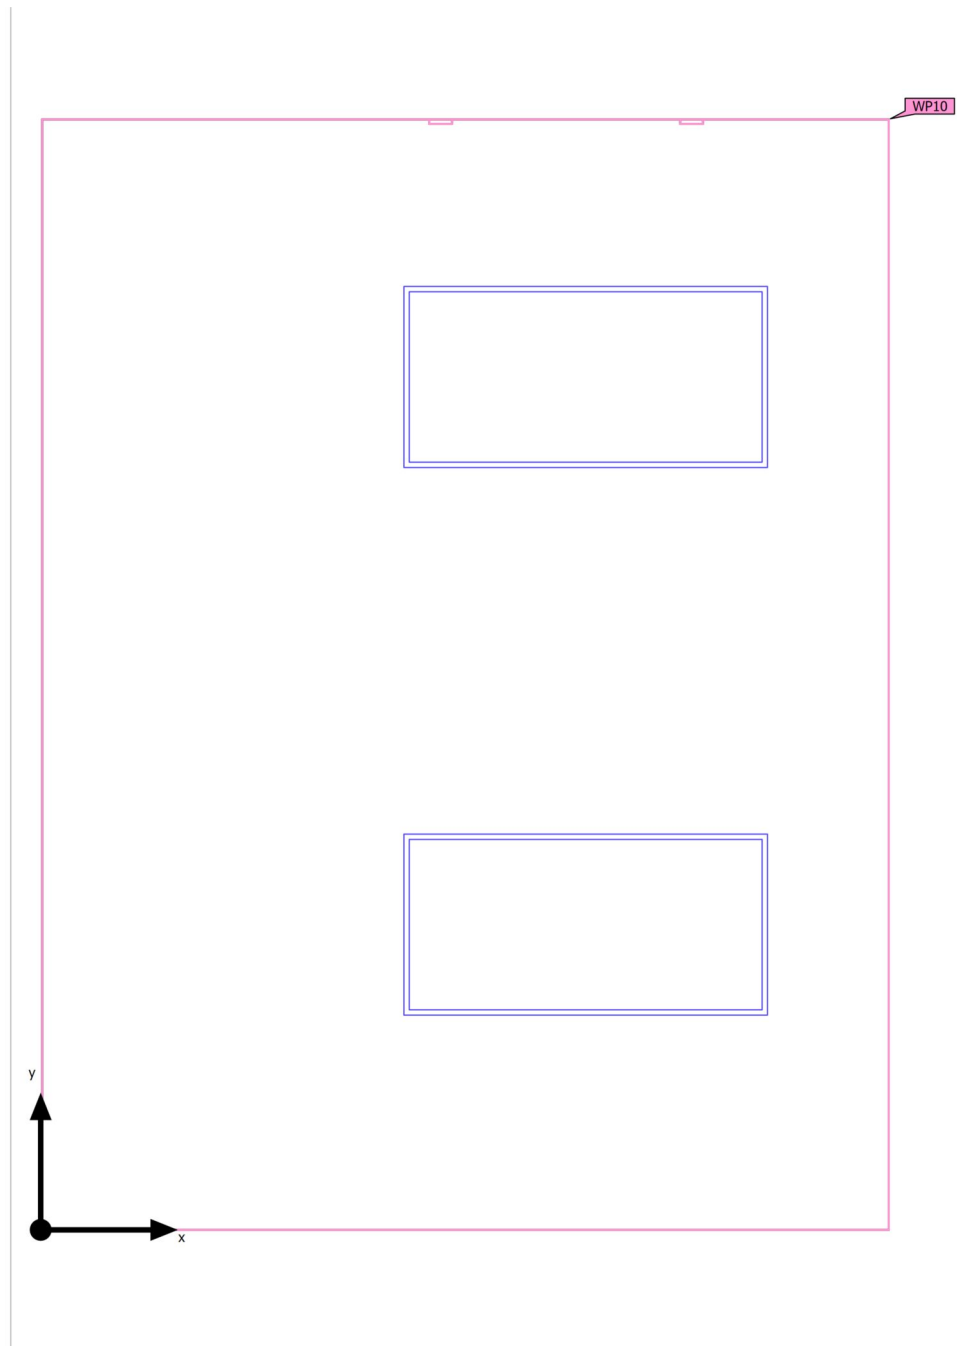

Building B · GROUND FOOR · 111 MANAGER (Light scene 1)

**Calculation objects**



## Working planes

| Properties                                                                                                 | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (111 MANAGER)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 740 lx<br>( $\geq 500$ lx)<br>✓ | 369 lx    | 1036 lx   | 0.50<br>( $\geq 0.60$ )<br>✗ | 0.36  | WP10  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 111 MANAGER (Light scene 1)

## Working plane (111 MANAGER)

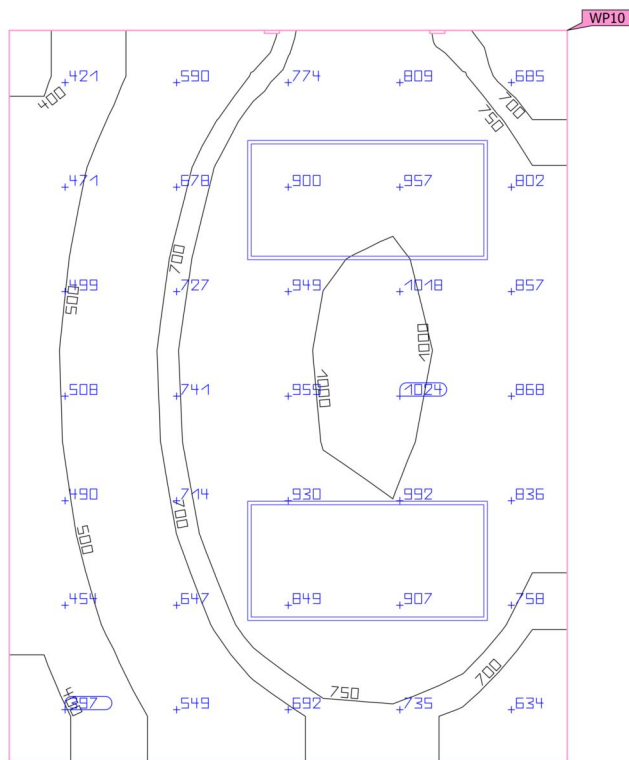


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (111 MANAGER)          | 740 lx                | 369 lx    | 1036 lx   | 0.50                    | 0.36  | WP10  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 112 MEETING (Light scene 1)

## Summary

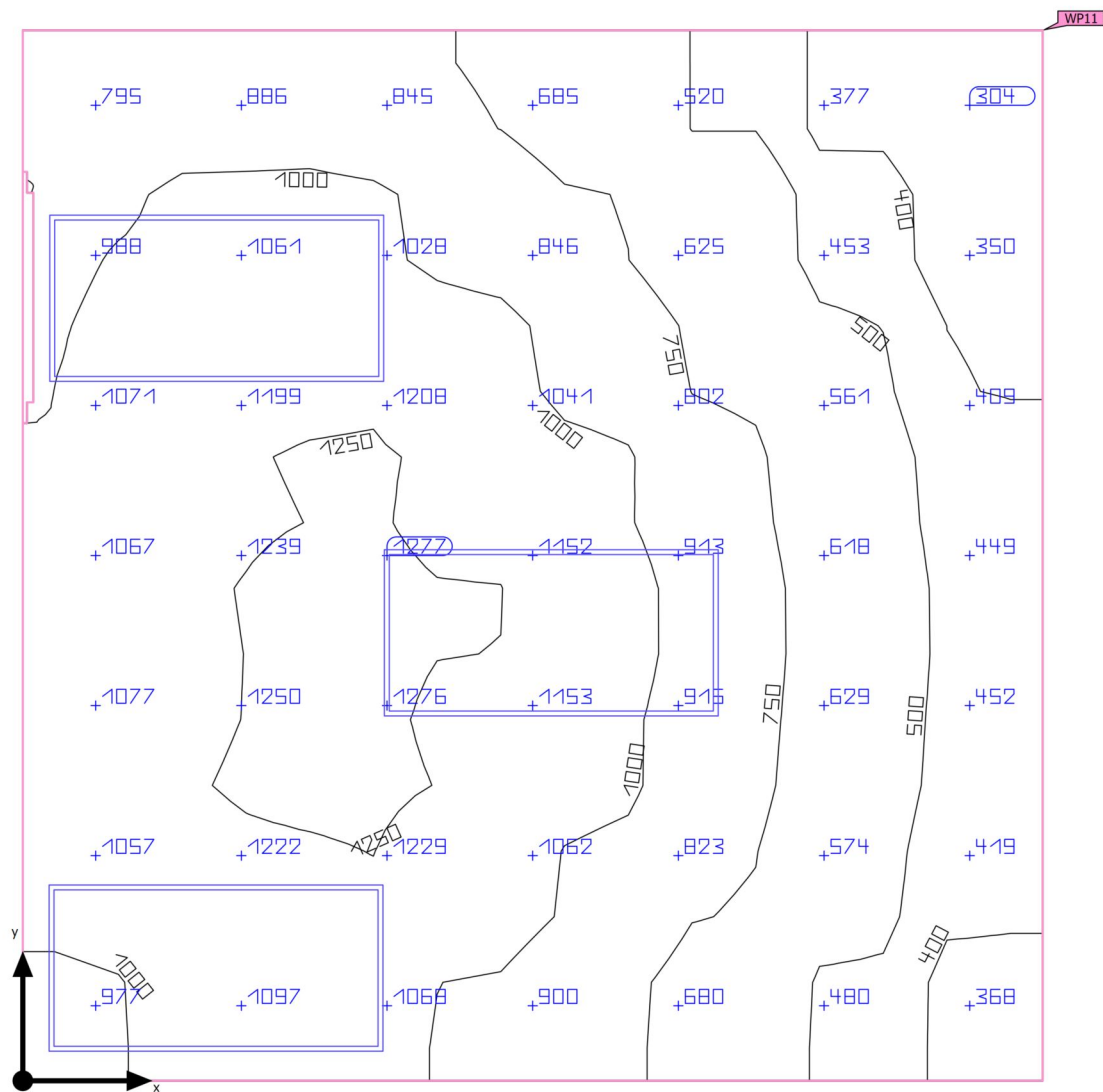

|                    |                                                     |                                    |         |
|--------------------|-----------------------------------------------------|------------------------------------|---------|
| Ground area        | 13.72 m <sup>2</sup>                                | Clearance height                   | 2.700 m |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Mounting height                    | 2.700 m |
| Maintenance factor | 0.76 (fixed)                                        | Height <sub>Working plane</sub>    | 0.700 m |
|                    |                                                     | Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 112 MEETING (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 865 lx                        | $\geq 500 \text{ lx}$ | ✓     | WP11  |
|                                  | $U_o (g_1)$                      | 0.35                          | $\geq 0.60$           | ✗     | WP11  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [692 - 1099] kWh/a            | max. 500 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 32.35 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 3.74 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 3.650 m x 3.760 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 3    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 112 MEETING

## Luminaire layout plan

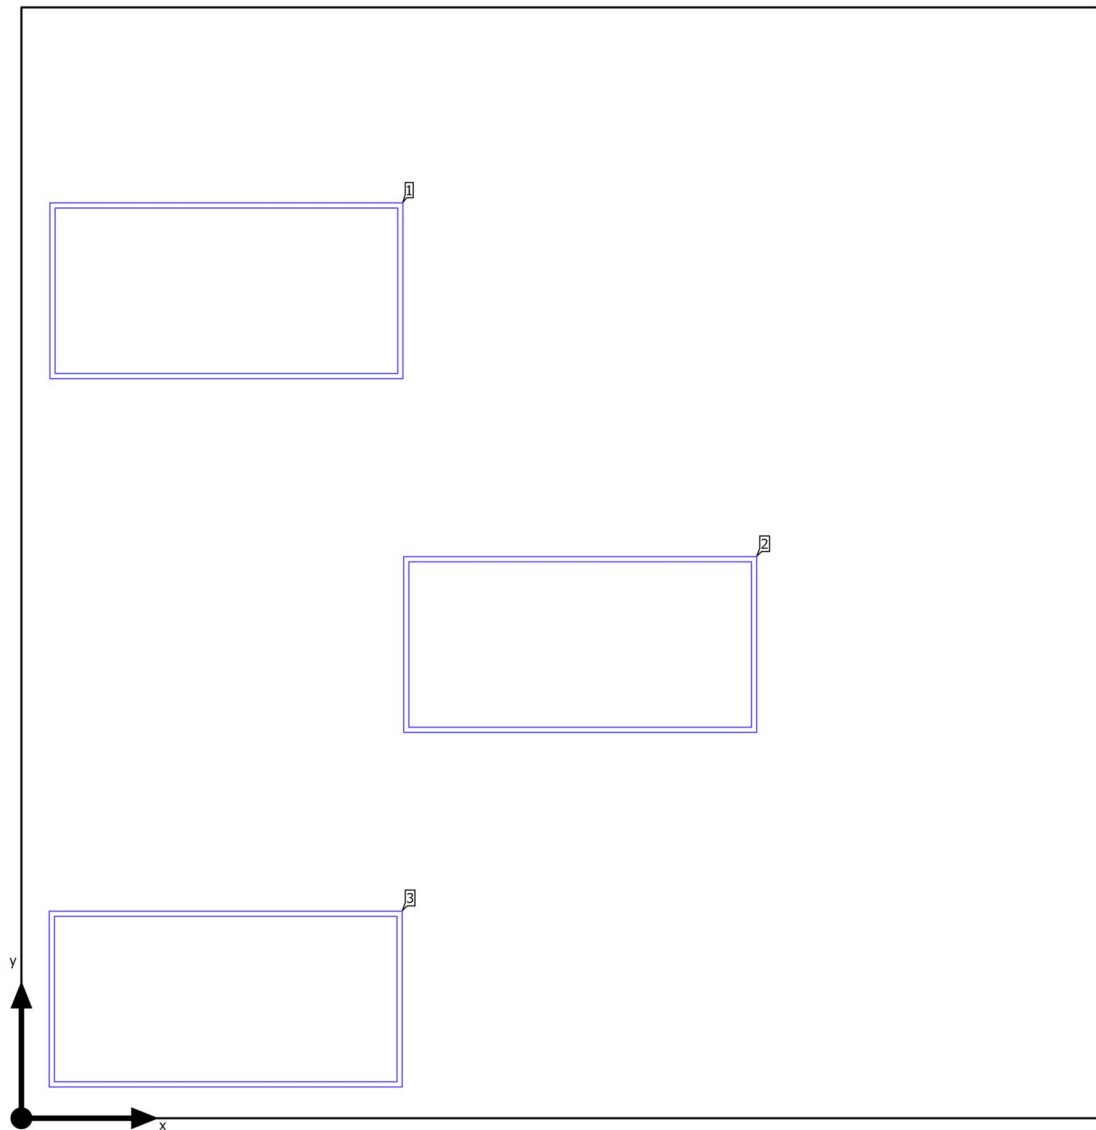

Building B · GROUND FOOR · 112 MEETING

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.694 m | 2.801 m | 2.700 m         | 1         |
| 1.892 m | 1.603 m | 2.700 m         | 2         |
| 0.692 m | 0.403 m | 2.700 m         | 3         |

Building B · GROUND FOOR · 112 MEETING

**Luminaire list** $\Phi_{\text{total}}$ 

24804 lm

 $P_{\text{total}}$ 

444.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 3    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 112 MEETING (Light scene 1)

## Calculation objects

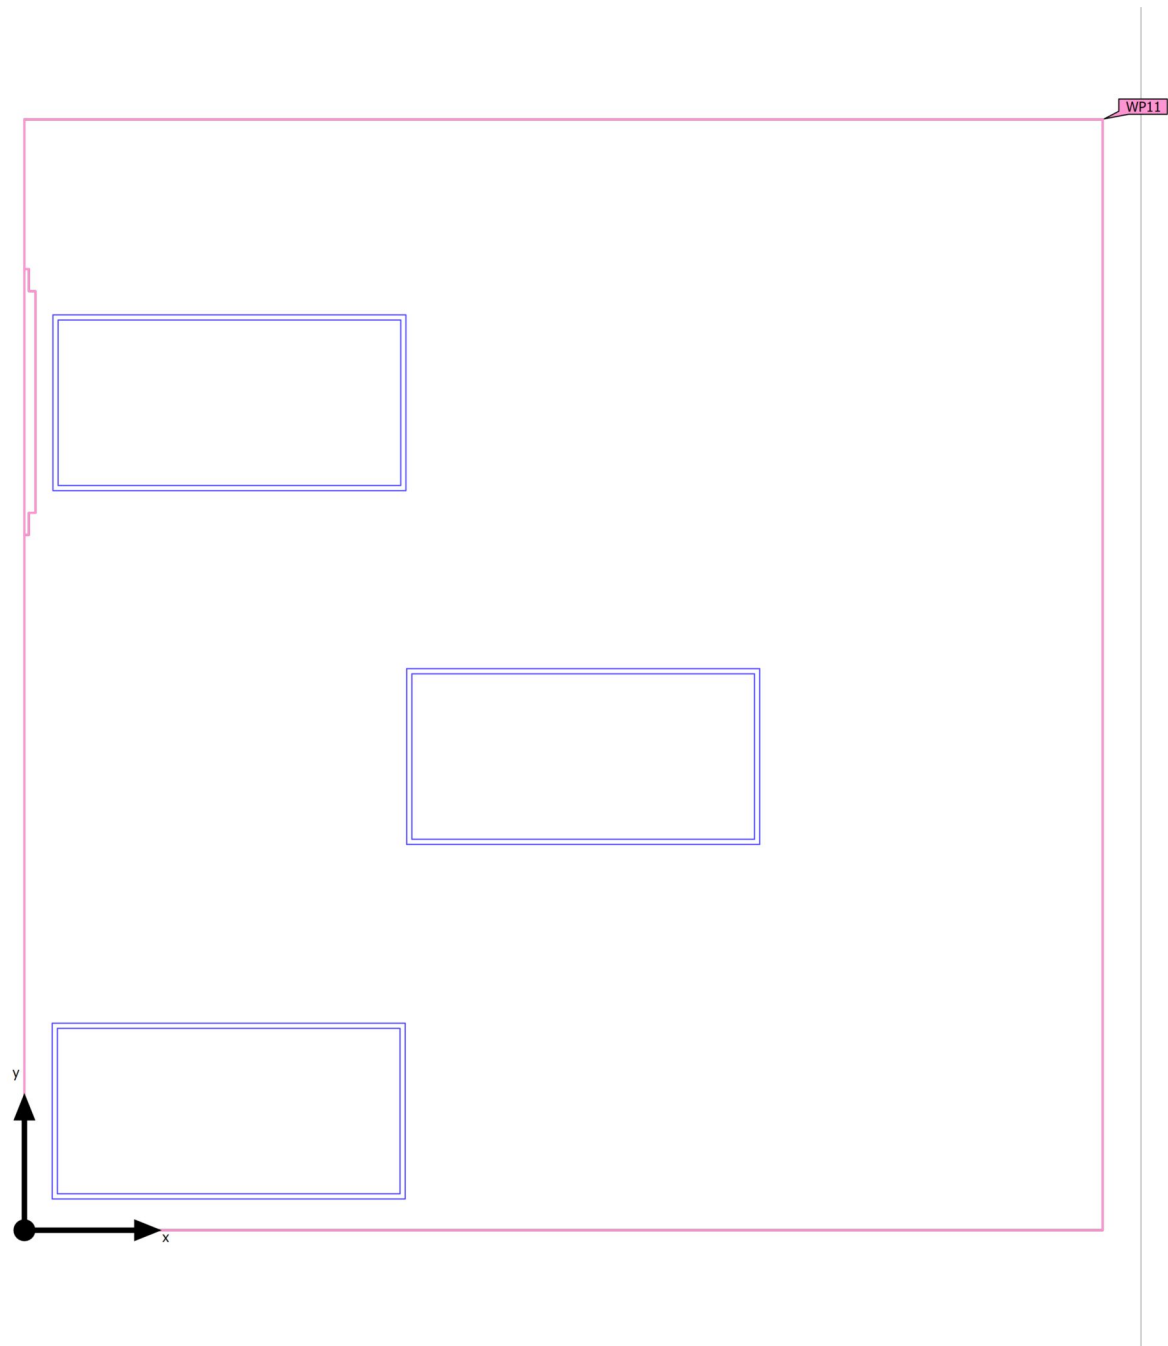

Building B · GROUND FOOR · 112 MEETING (Light scene 1)

**Calculation objects**



## Working planes

| Properties                                                                                                 | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (112 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 865 lx<br>( $\geq 500$ lx)<br>✓ | 303 lx    | 1311 lx   | 0.35<br>( $\geq 0.60$ )<br>✗ | 0.23  | WP11  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 112 MEETING (Light scene 1)

## Working plane (112 MEETING)

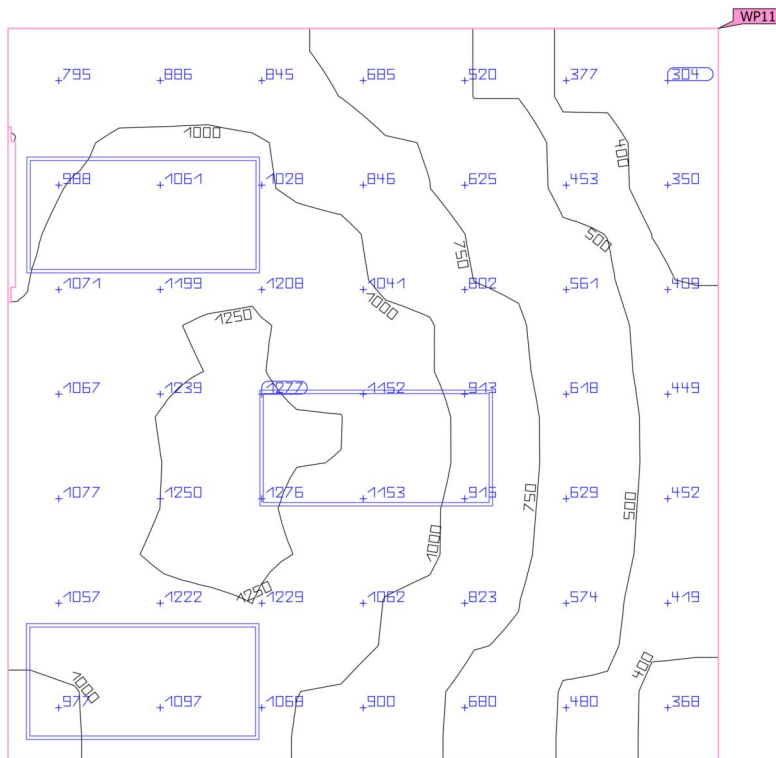


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (112 MEETING)          | 865 lx                | 303 lx    | 1311 lx   | 0.35                    | 0.23  | WP11  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE (Light scene 1)

Summary

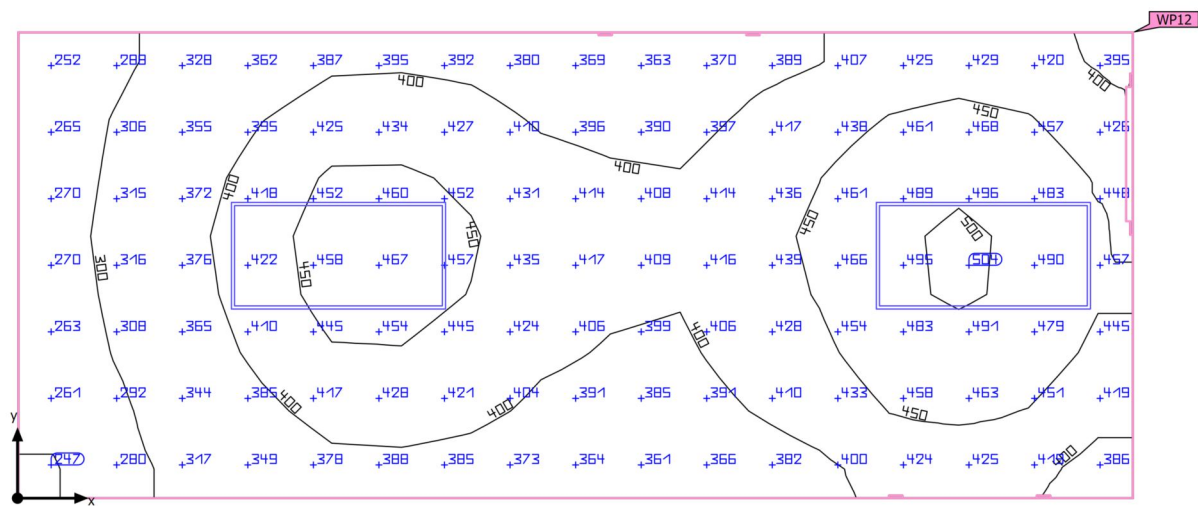

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 16.18 m <sup>2</sup>                                |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 403 lx                        | $\geq 500 \text{ lx}$ | ✗     | WP12  |
|                                  | $U_o (g_1)$                      | 0.61                          | $\geq 0.60$           | ✓     | WP12  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 19                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [462 - 733] kWh/a             | max. 600 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 18.30 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 4.54 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 6.221 m x 2.600 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 19       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE

## Luminaire layout plan

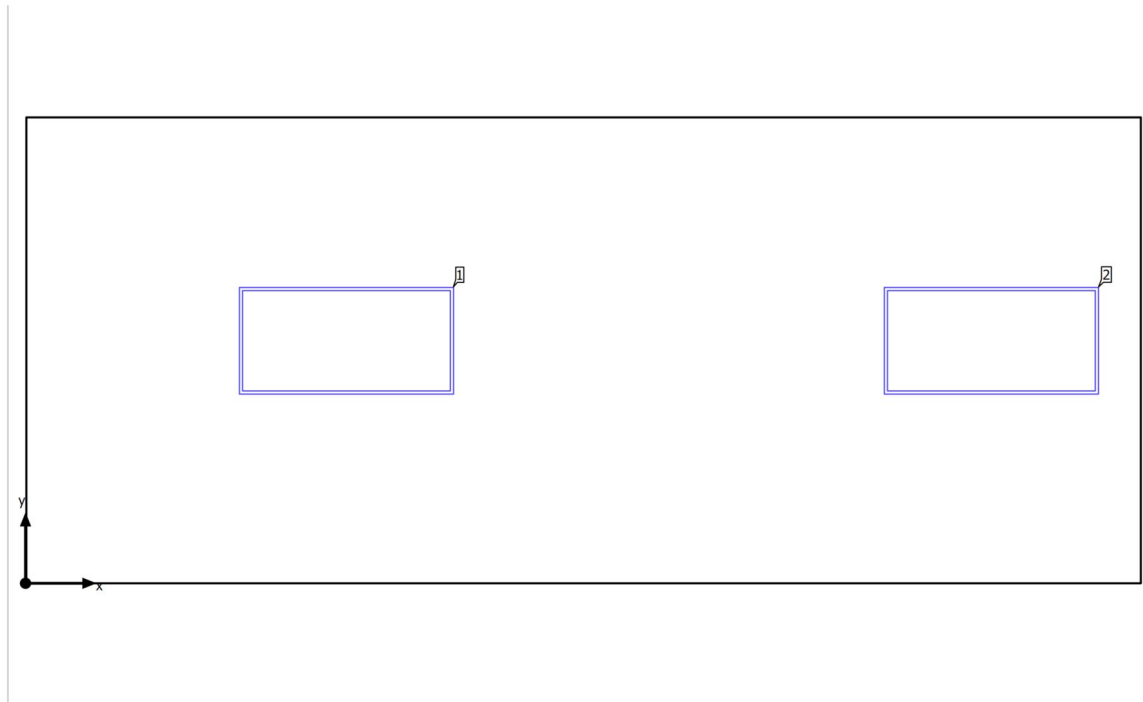

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.792 m | 1.353 m | 2.700 m         | 1         |
| 5.392 m | 1.353 m | 2.700 m         | 2         |

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE

**Luminaire list** $\Phi_{\text{total}}$ 

16536 lm

 $P_{\text{total}}$ 

296.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 113 CORRIDOR / COFFEE (Light scene 1)

## Calculation objects

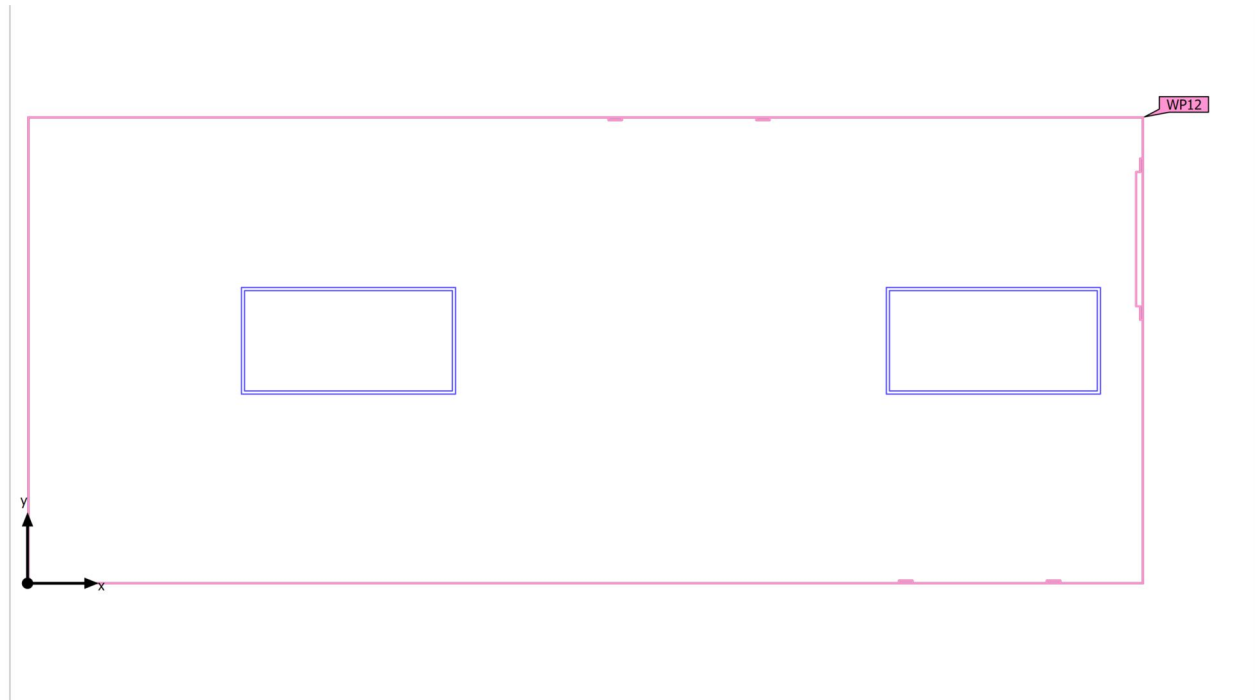

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE (Light scene 1)

**Calculation objects**


## Working planes

| Properties                                                                                                           | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|----------------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (113 CORRIDOR / COFFEE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 403 lx<br>( $\geq 500$ lx)<br>✗ | 246 lx    | 506 lx    | 0.61<br>( $\geq 0.60$ )<br>✓ | 0.49  | WP12  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 113 CORRIDOR / COFFEE (Light scene 1)

## Working plane (113 CORRIDOR / COFFEE)

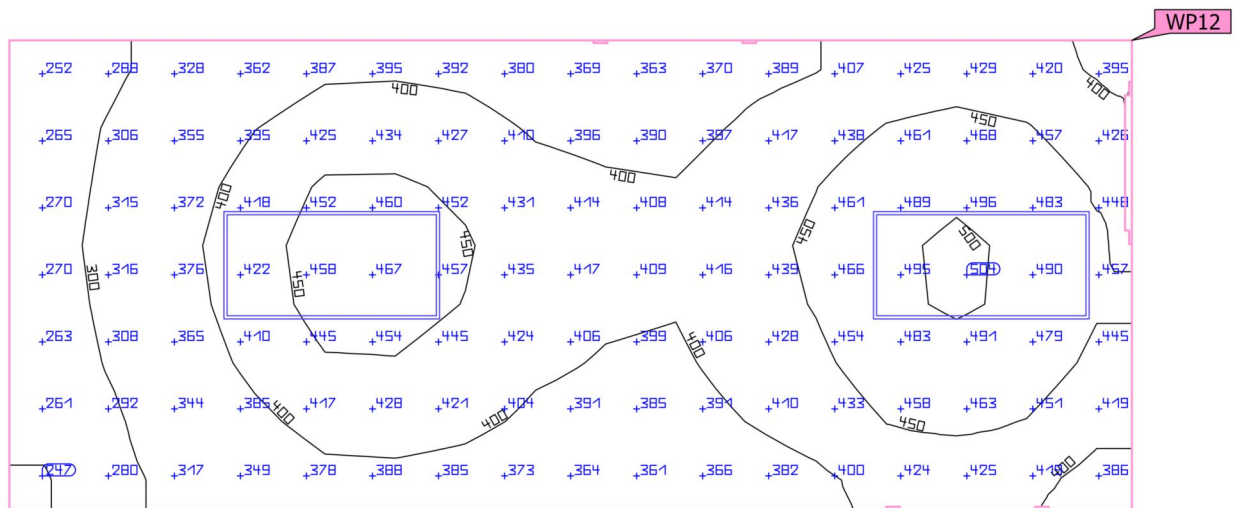


| Properties                            | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|---------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (113 CORRIDOR / COFFEE) | 403 lx                | 246 lx    | 506 lx    | 0.61                    | 0.49  | WP12  |
| Perpendicular illuminance (adaptive)  | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.000 m, Wall zone: 0.000 m   | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 114 STORAGE (Light scene 1)

Summary

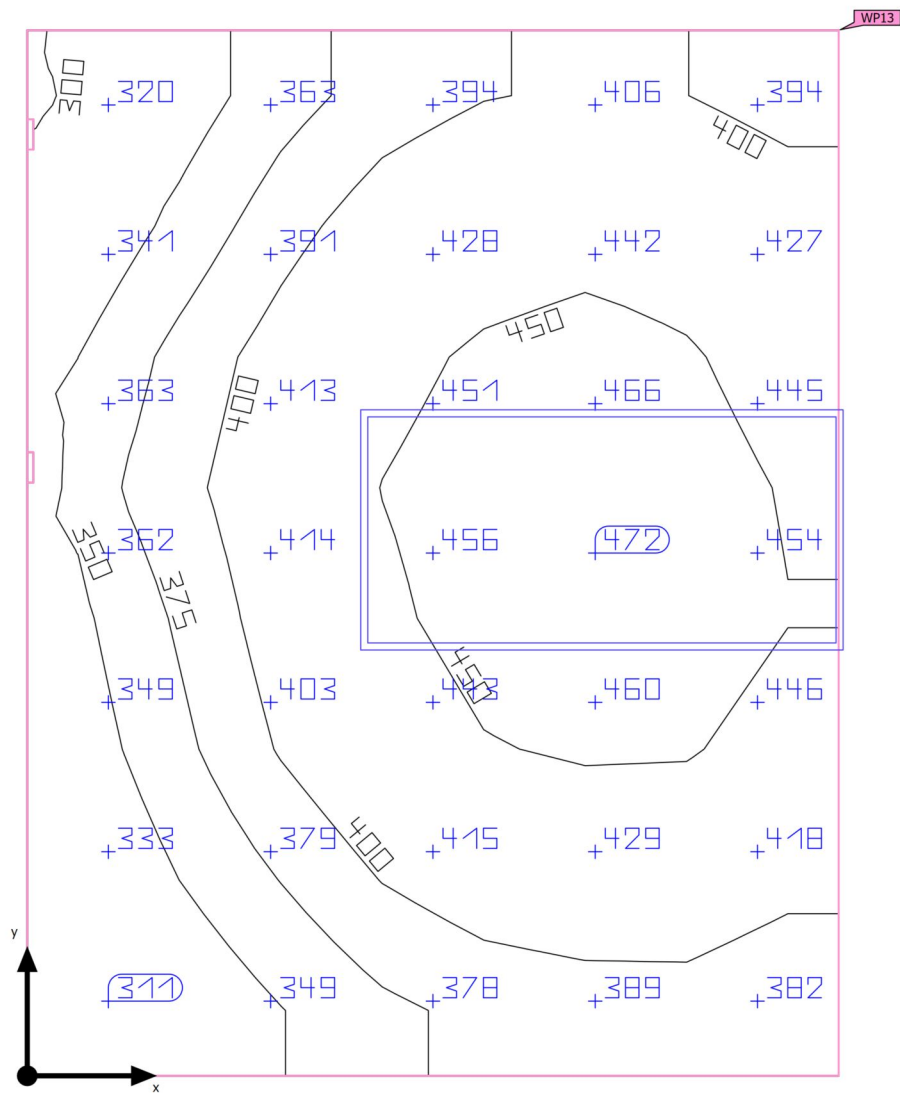

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 5.21 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 114 STORAGE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 403 lx                        | $\geq 500 \text{ lx}$ | ✗     | WP13  |
|                                  | $U_o (g_1)$                      | 0.74                          | $\geq 0.60$           | ✓     | WP13  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | 366 kWh/a                     | max. 200 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 28.43 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 7.05 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 2.010 m x 2.590 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 1    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |


Building B · GROUND FOOR · 114 STORAGE

## Luminaire layout plan

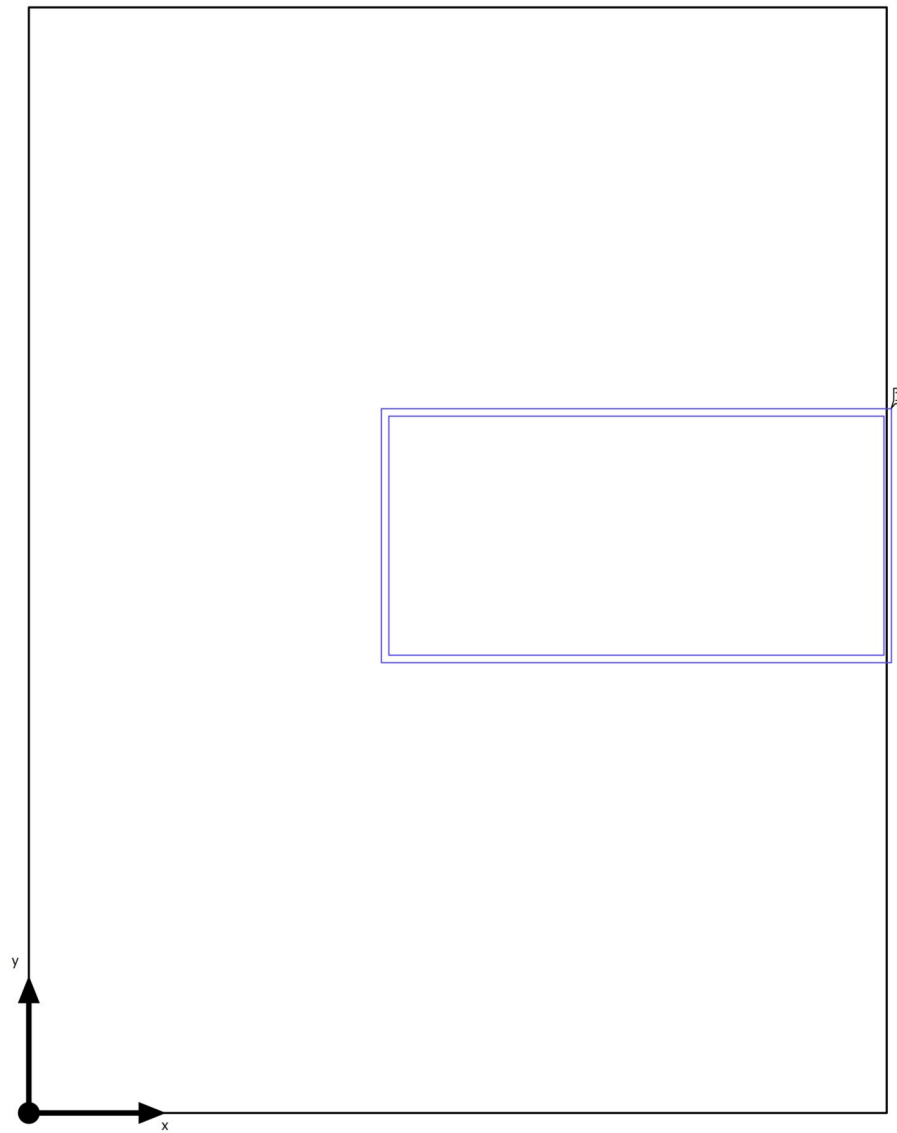

Building B · GROUND FOOR · 114 STORAGE

Luminaire layout plan



|              |             |                        |         |
|--------------|-------------|------------------------|---------|
| Manufacturer | Philips     | P                      | 148.0 W |
| Article name | 4x36W SLB   | Φ <sub>Luminaire</sub> | 8268 lm |
| Fitting      | 4x L36W/830 |                        |         |

Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.424 m | 1.352 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 114 STORAGE

Luminaire list


|                           |                        |                                |
|---------------------------|------------------------|--------------------------------|
| $\Phi_{total}$<br>8268 lm | $P_{total}$<br>148.0 W | Luminous efficacy<br>55.9 lm/W |
|---------------------------|------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 1    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 114 STORAGE (Light scene 1)

## Calculation objects

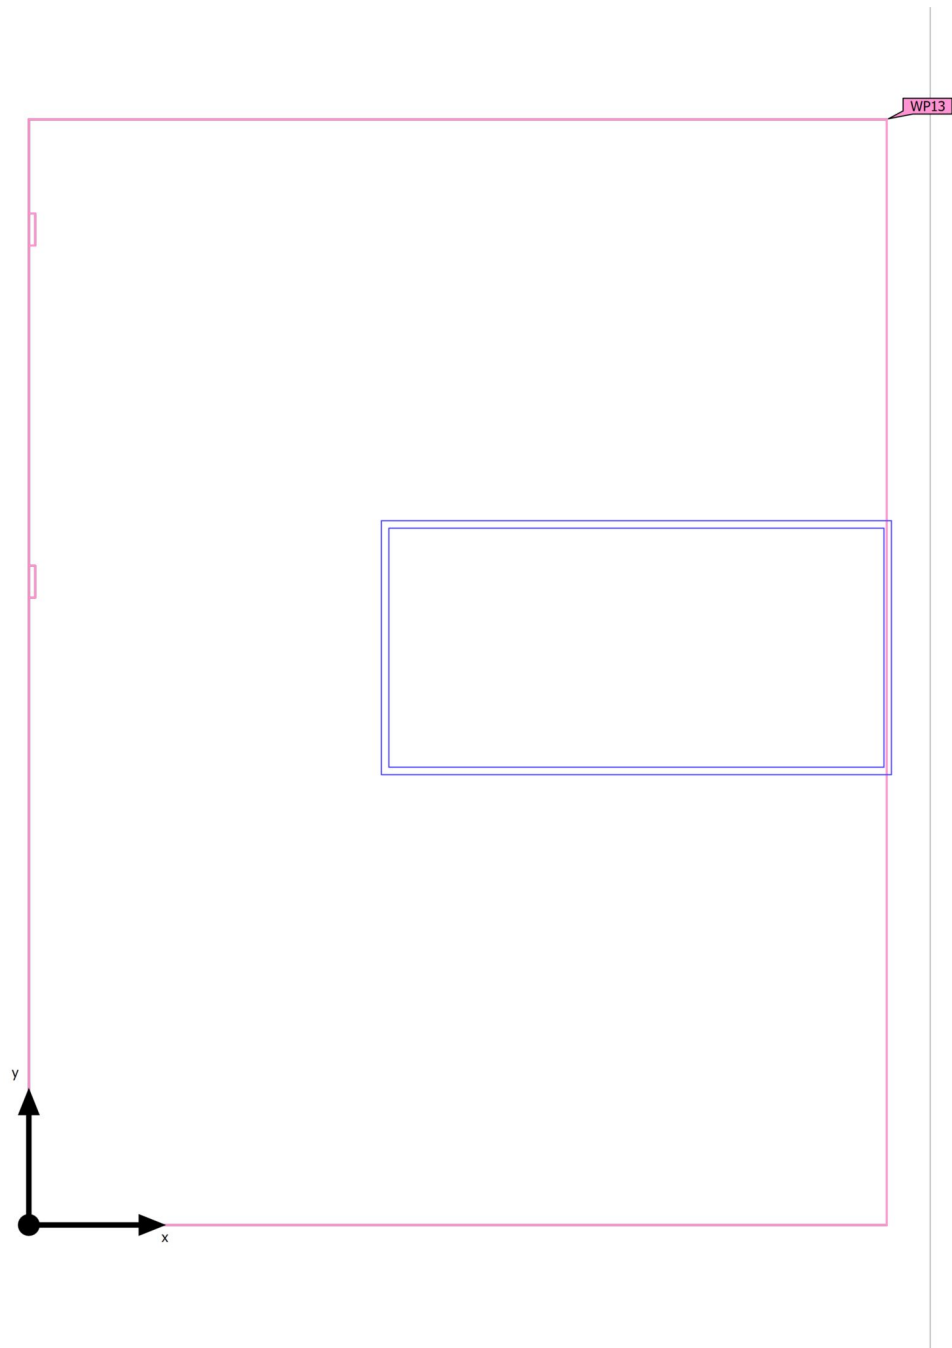

Building B · GROUND FOOR · 114 STORAGE (Light scene 1)

**Calculation objects**


## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (114 STORAGE)          | 403 lx                | 298 lx    | 472 lx    | 0.74                    | 0.63  | WP13  |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 114 STORAGE (Light scene 1)

## Working plane (114 STORAGE)

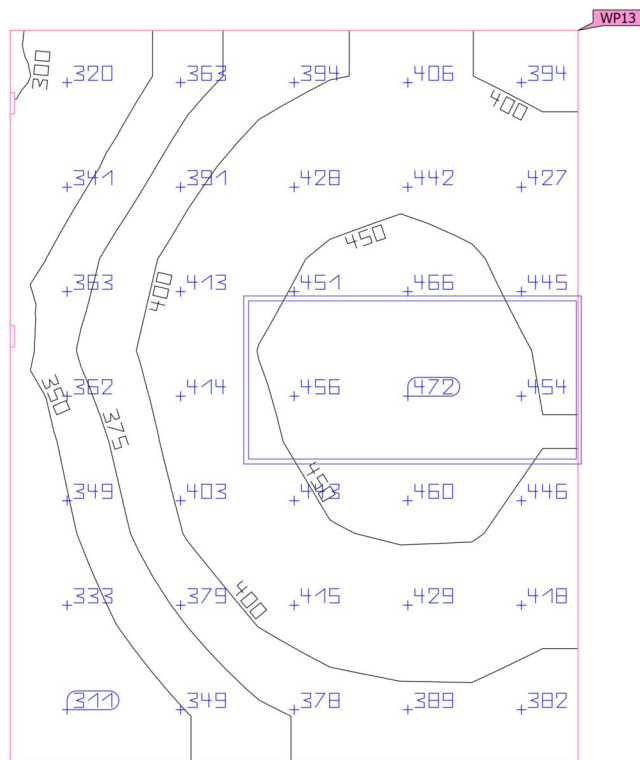


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (114 STORAGE)          | 403 lx                | 298 lx    | 472 lx    | 0.74                    | 0.63  | WP13  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.000 m, Wall zone: 0.000 m  | ✗                     |           |           | ✓                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 115 RECEPTION (Light scene 1)

## Summary

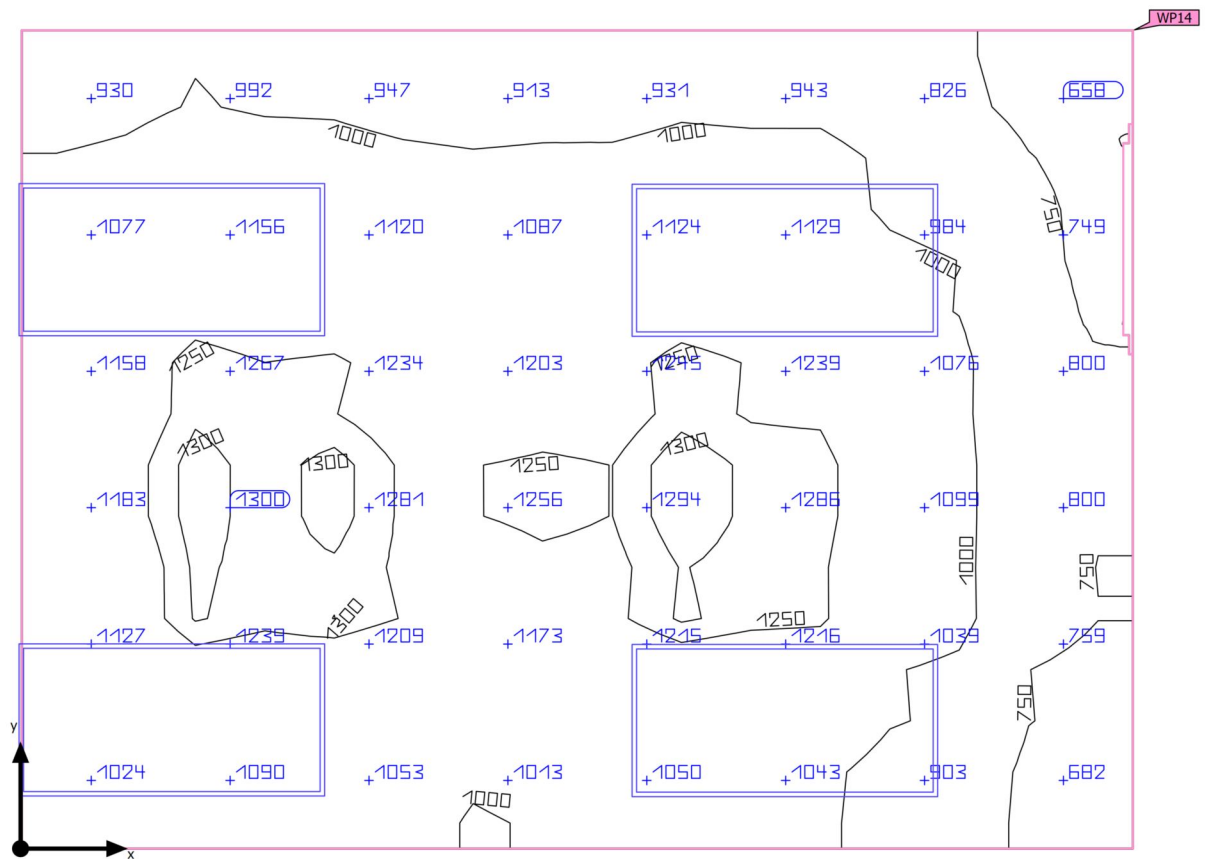

|                    |                                                     |                                    |         |
|--------------------|-----------------------------------------------------|------------------------------------|---------|
| Ground area        | 13.90 m²                                            | Clearance height                   | 2.700 m |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % | Mounting height                    | 2.700 m |
| Maintenance factor | 0.76 (fixed)                                        | Height <sub>Working plane</sub>    | 0.700 m |
|                    |                                                     | Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 115 RECEPTION (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 1069 lx                       | $\geq 500 \text{ lx}$ | ✓     | WP14  |
|                                  | $U_o (g_1)$                      | 0.52                          | $\geq 0.60$           | ✗     | WP14  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [923 - 1465] kWh/a            | max. 500 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 42.58 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 3.98 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 4.345 m x 3.200 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 115 RECEPTION

## Luminaire layout plan

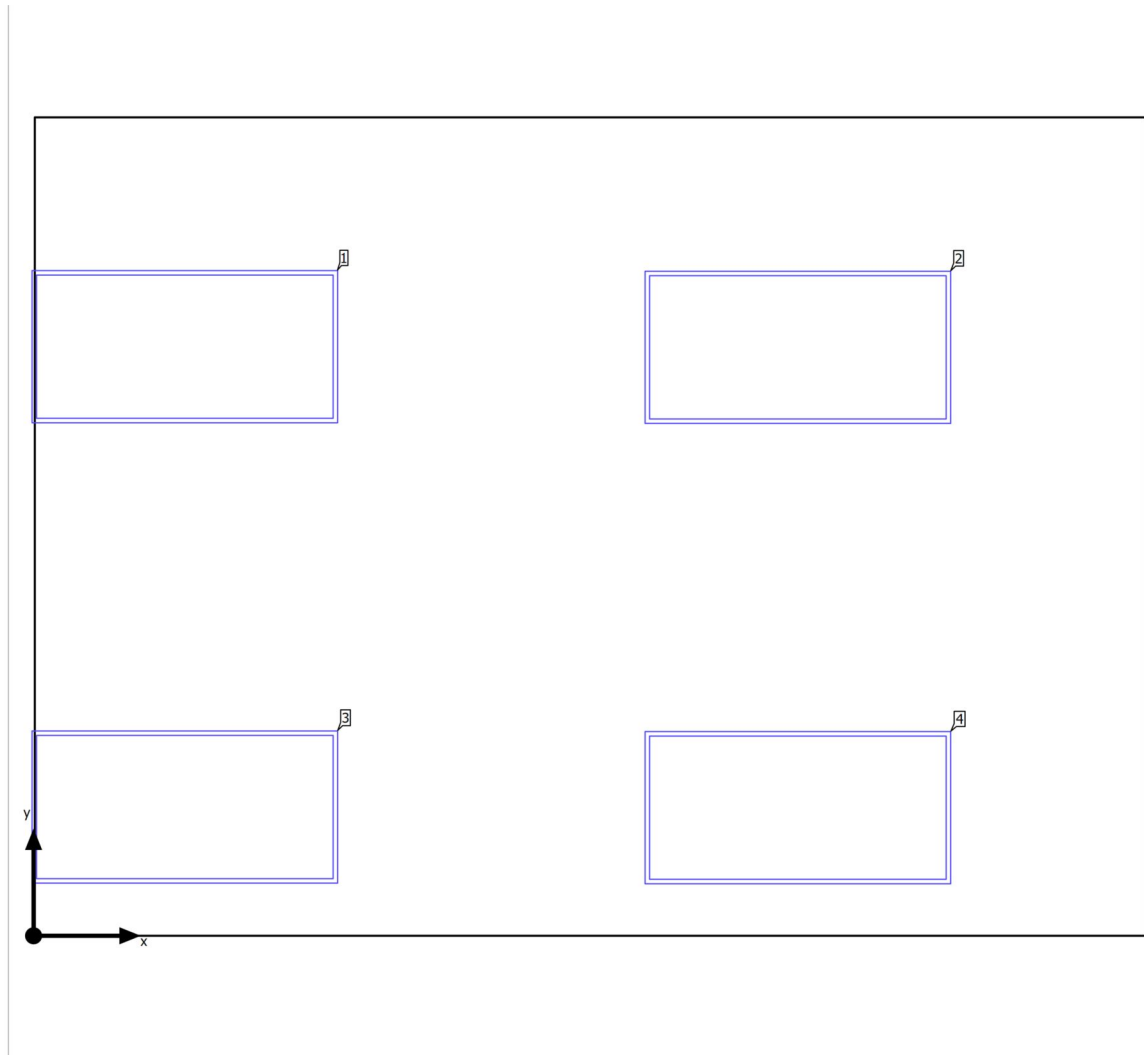

Building B · GROUND FOOR · 115 RECEPTION

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.592 m | 2.303 m | 2.700 m         | 1         |
| 2.989 m | 2.301 m | 2.700 m         | 2         |
| 0.592 m | 0.503 m | 2.700 m         | 3         |
| 2.989 m | 0.501 m | 2.700 m         | 4         |

Building B · GROUND FOOR · 115 RECEPTION

Luminaire list


|                            |                        |                                |
|----------------------------|------------------------|--------------------------------|
| $\Phi_{total}$<br>33072 lm | $P_{total}$<br>592.0 W | Luminous efficacy<br>55.9 lm/W |
|----------------------------|------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 115 RECEPTION (Light scene 1)

## Calculation objects

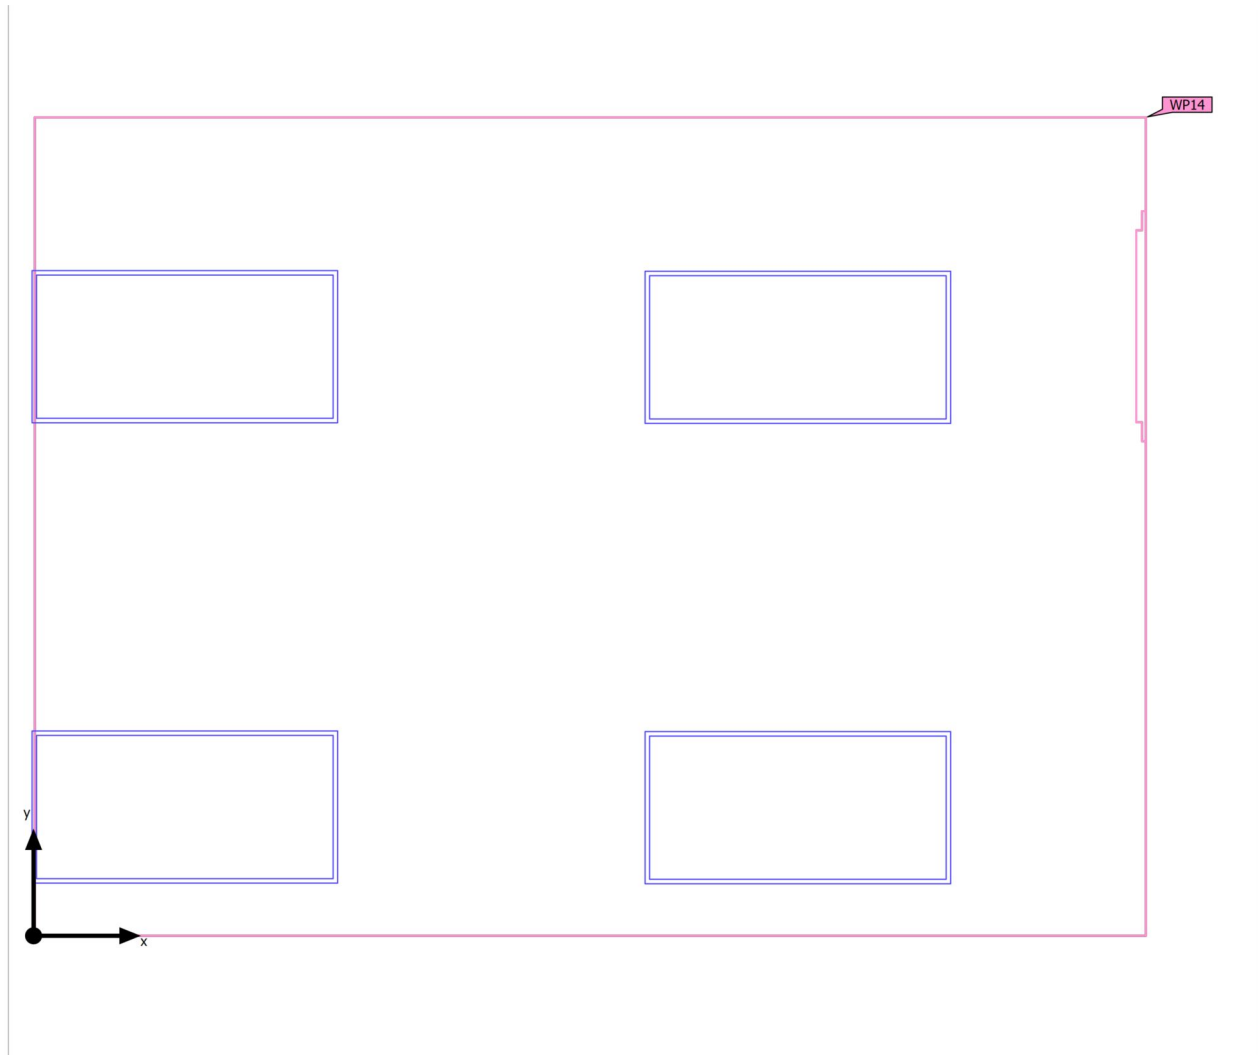

Building B · GROUND FOOR · 115 RECEPTION (Light scene 1)

**Calculation objects**


## Working planes

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (115 RECEPTION)        | 1069 lx               | 561 lx    | 1335 lx   | 0.52                    | 0.42  | WP14  |
| Perpendicular illuminance (adaptive) | ( $\geq 500$ lx)      |           |           | ( $\geq 0.60$ )         |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 115 RECEPTION (Light scene 1)

## Working plane (115 RECEPTION)

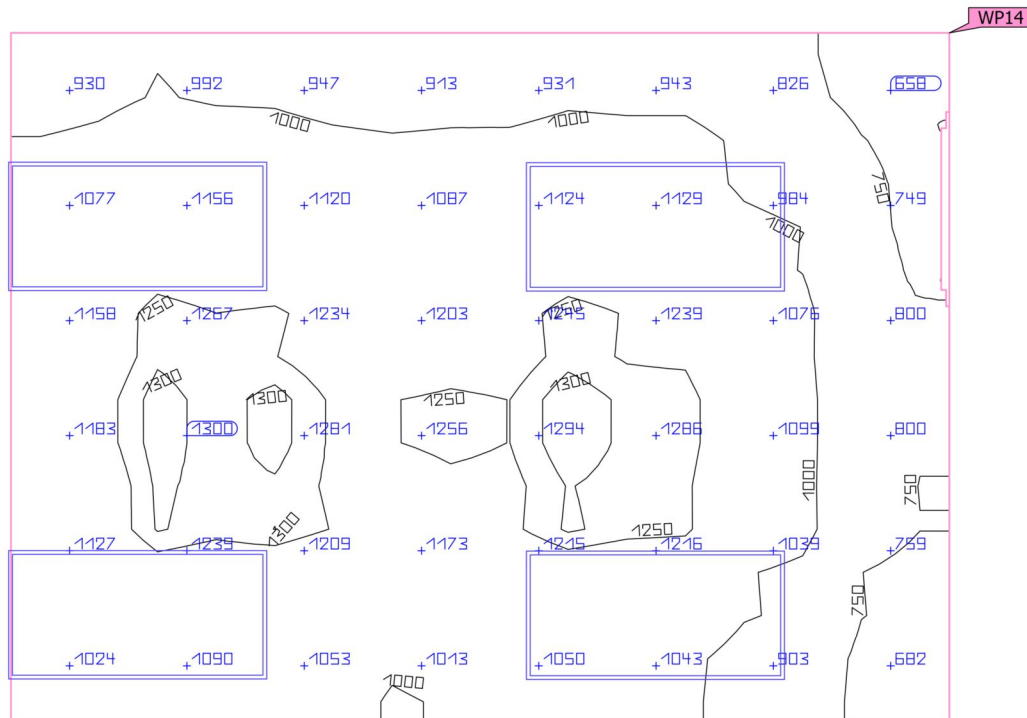


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (115 RECEPTION)        | 1069 lx               | 561 lx    | 1335 lx   | 0.52                    | 0.42  | WP14  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 116 MEETING (Light scene 1)

Summary

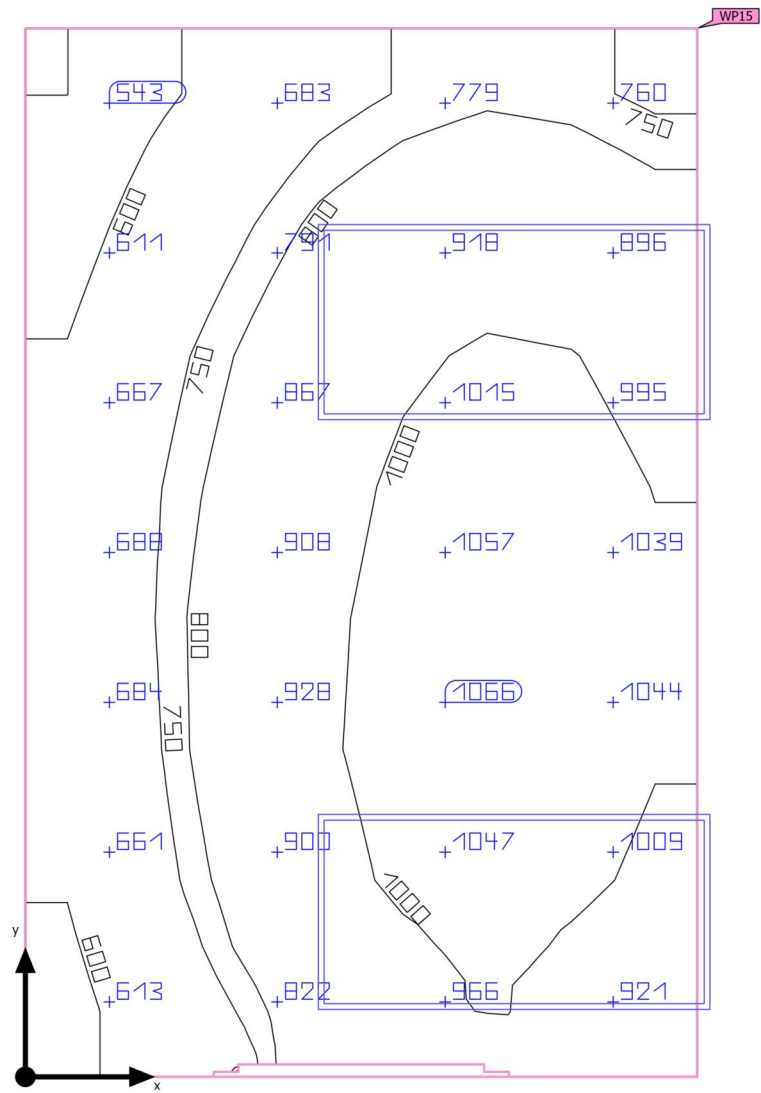

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 6.56 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.700 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 116 MEETING (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 854 lx                        | $\geq 500 \text{ lx}$ | ✓     | WP15  |
|                                  | $U_o (g_1)$                      | 0.59                          | $\geq 0.60$           | ✗     | WP15  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [462 - 733] kWh/a             | max. 250 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 45.12 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 5.28 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 2.050 m x 3.200 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 116 MEETING

## Luminaire layout plan

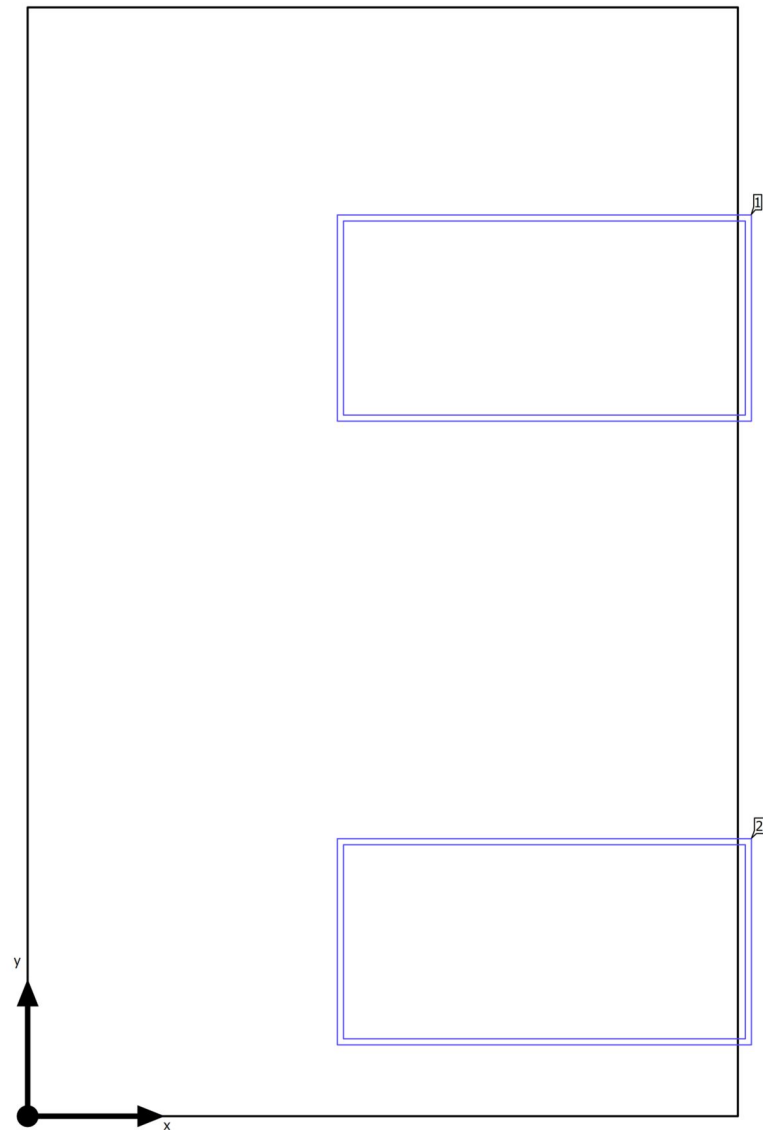

Building B · GROUND FOOR · 116 MEETING

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.492 m | 2.303 m | 2.700 m         | 1         |
| 1.492 m | 0.503 m | 2.700 m         | 2         |

Building B · GROUND FOOR · 116 MEETING

**Luminaire list** $\Phi_{\text{total}}$ 

16536 lm

 $P_{\text{total}}$ 

296.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 116 MEETING (Light scene 1)

## Calculation objects

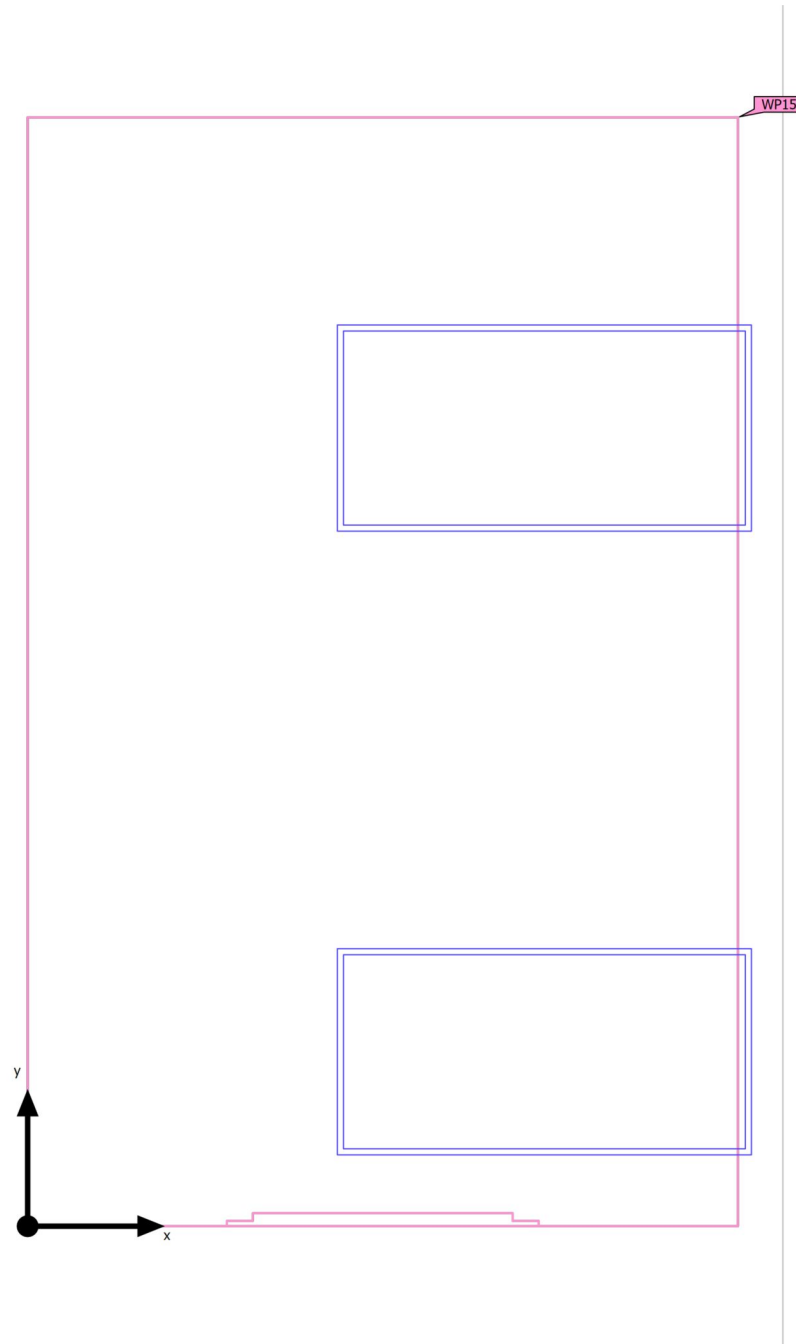

Building B · GROUND FOOR · 116 MEETING (Light scene 1)

**Calculation objects**


## Working planes

| Properties                                                                                                 | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (116 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 854 lx<br>( $\geq 500$ lx)<br>✓ | 500 lx    | 1088 lx   | 0.59<br>( $\geq 0.60$ )<br>✗ | 0.46  | WP15  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 116 MEETING (Light scene 1)

## Working plane (116 MEETING)

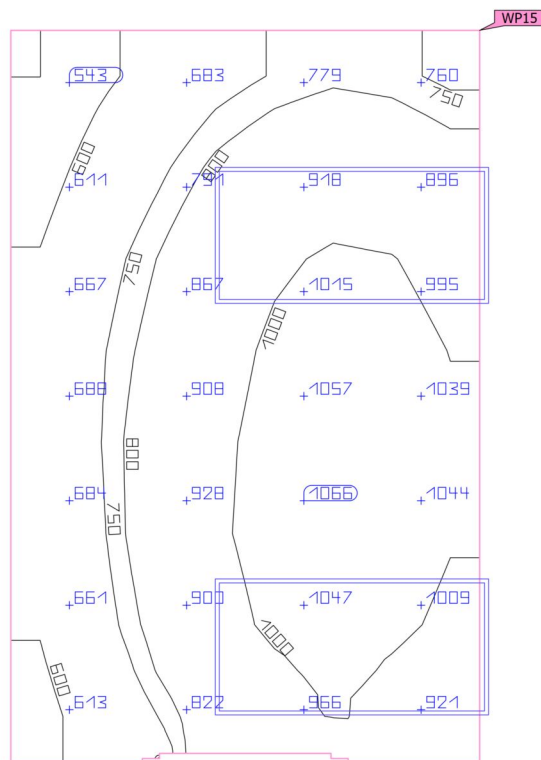


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (116 MEETING)          | 854 lx                | 500 lx    | 1088 lx   | 0.59                    | 0.46  | WP15  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 117 CORRIDOR (Light scene 1)

Summary

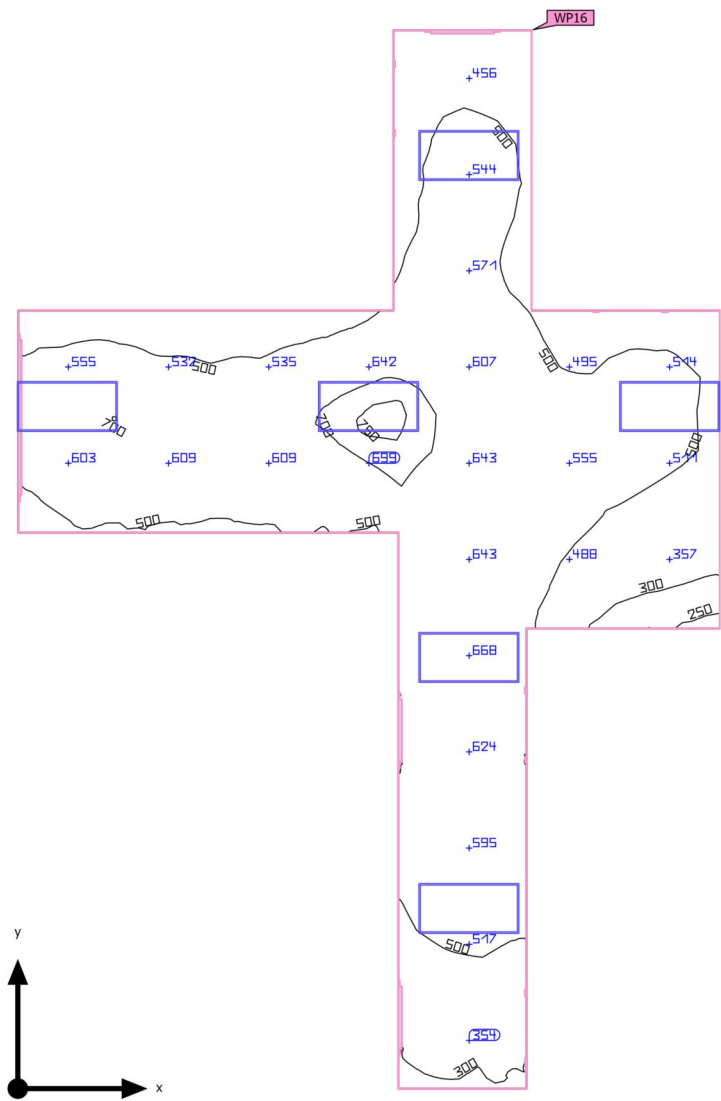

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 40.60 m <sup>2</sup>                                |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.000 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 117 CORRIDOR (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target          | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 538 lx                        | $\geq 500$ lx   | ✓     | WP16  |
|                                  | $U_o (g_1)$                      | 0.41                          | $\geq 0.60$     | ✗     | WP16  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 20                            | $\leq 19$       | ✗     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | 2198 kWh/a                    | max. 1450 kWh/a | ✗     |       |
| Space                            | Lighting power density           | 21.87 W/m <sup>2</sup>        | –               |       |       |
|                                  |                                  | 4.06 W/m <sup>2</sup> /100 lx | –               |       |       |

(1) Based on a rectangular space of 8.568 m x 11.696 m and SHR of 0.25.


(2) Calculated using DIN:18599-4.

Utilisation profile: DIALux presetting (5.26.2 Standard (office))


### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 6    | Philips      |             | 4x36W SLB    | 20       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 117 CORRIDOR

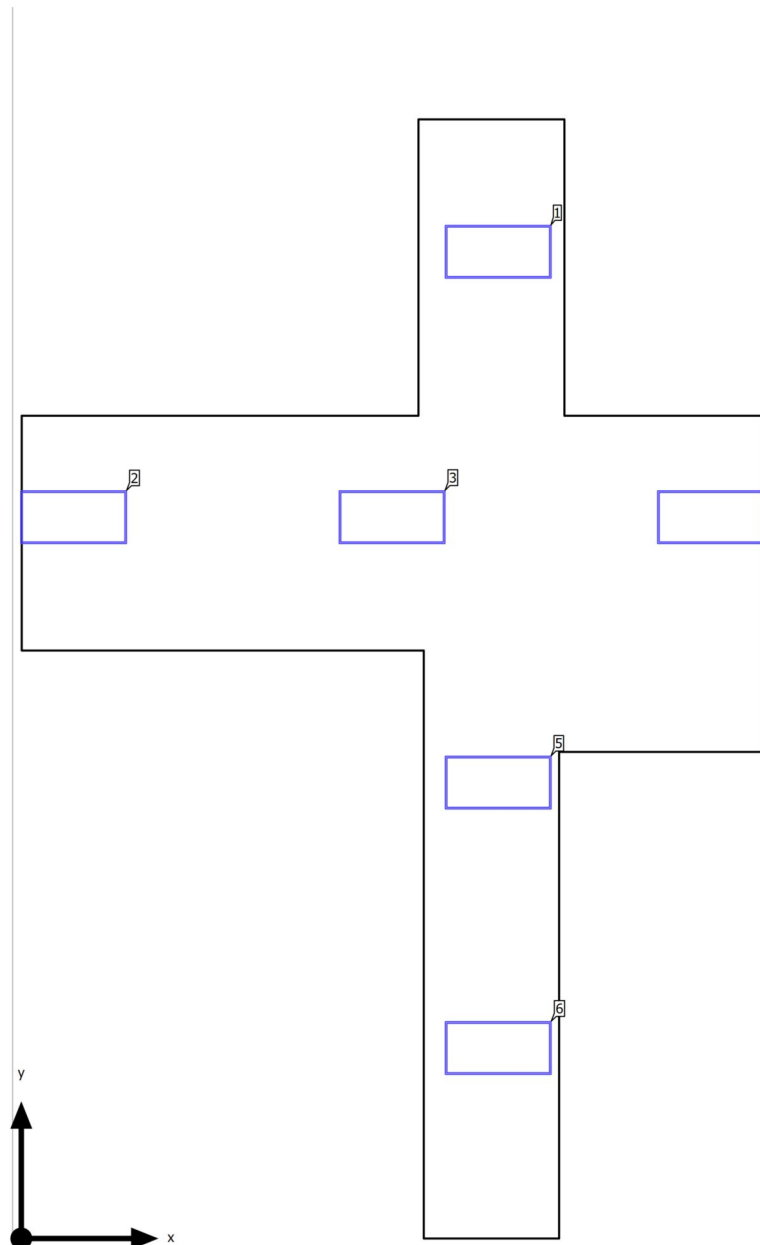**Luminaire layout plan**

Building B · GROUND FOOR · 117 CORRIDOR

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y        | Mounting height | Luminaire |
|---------|----------|-----------------|-----------|
| 5.392 m | 11.153 m | 2.700 m         | 1         |
| 0.592 m | 8.153 m  | 2.700 m         | 2         |
| 4.192 m | 8.153 m  | 2.700 m         | 3         |
| 7.792 m | 8.153 m  | 2.700 m         | 4         |
| 5.392 m | 5.153 m  | 2.700 m         | 5         |
| 5.392 m | 2.153 m  | 2.700 m         | 6         |

Building B · GROUND FOOR · 117 CORRIDOR

**Luminaire list** $\Phi_{\text{total}}$ 

49608 lm

 $P_{\text{total}}$ 

888.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 6    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 117 CORRIDOR (Light scene 1)

## Calculation objects

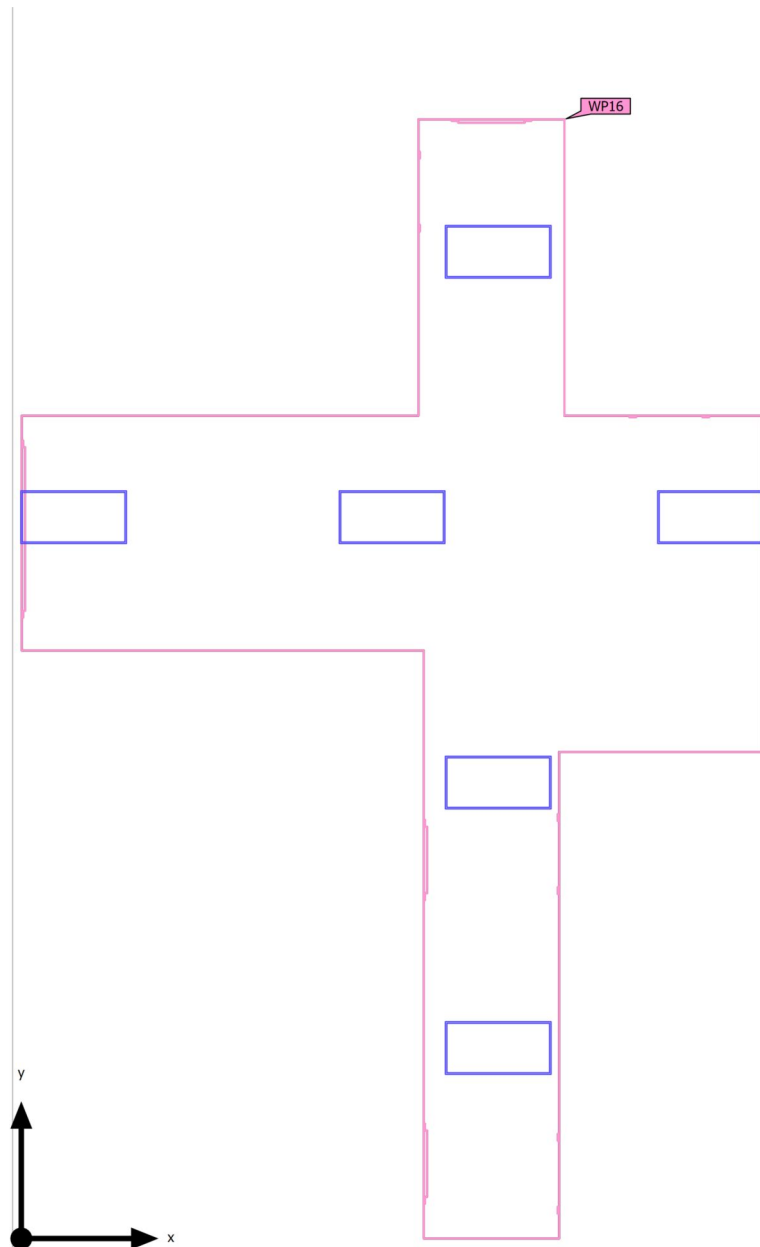

Building B · GROUND FOOR · 117 CORRIDOR (Light scene 1)

**Calculation objects**


## Working planes

| Properties                                                                                                  | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|-------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (117 CORRIDOR)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 538 lx<br>( $\geq 500$ lx)<br>✓ | 220 lx    | 778 lx    | 0.41<br>( $\geq 0.60$ )<br>✗ | 0.28  | WP16  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 117 CORRIDOR (Light scene 1)

Working plane (117 CORRIDOR)

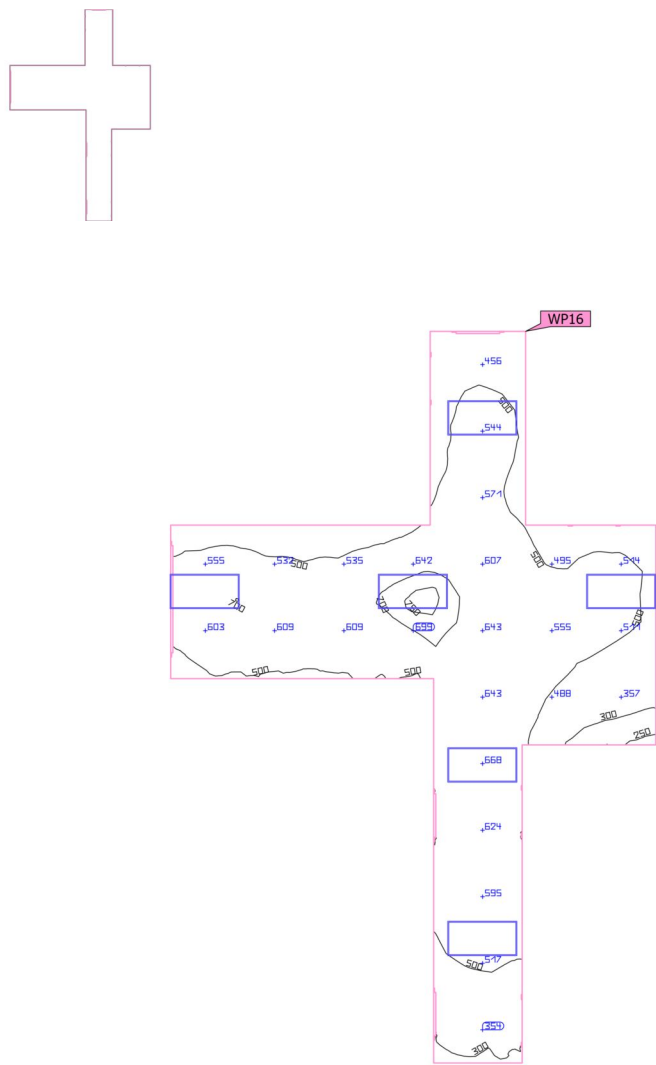


| Properties                                                                                                  | $\bar{E}$<br>(Target)     | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|-------------------------------------------------------------------------------------------------------------|---------------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (117 CORRIDOR)<br>Perpendicular illuminance (adaptive)<br>Height: 0.000 m, Wall zone: 0.000 m | 538 lx<br>(≥ 500 lx)<br>✓ | 220 lx    | 778 lx    | 0.41<br>(≥ 0.60)<br>✗   | 0.28  | WP16  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 118 OFFICE (Light scene 1)

## Summary

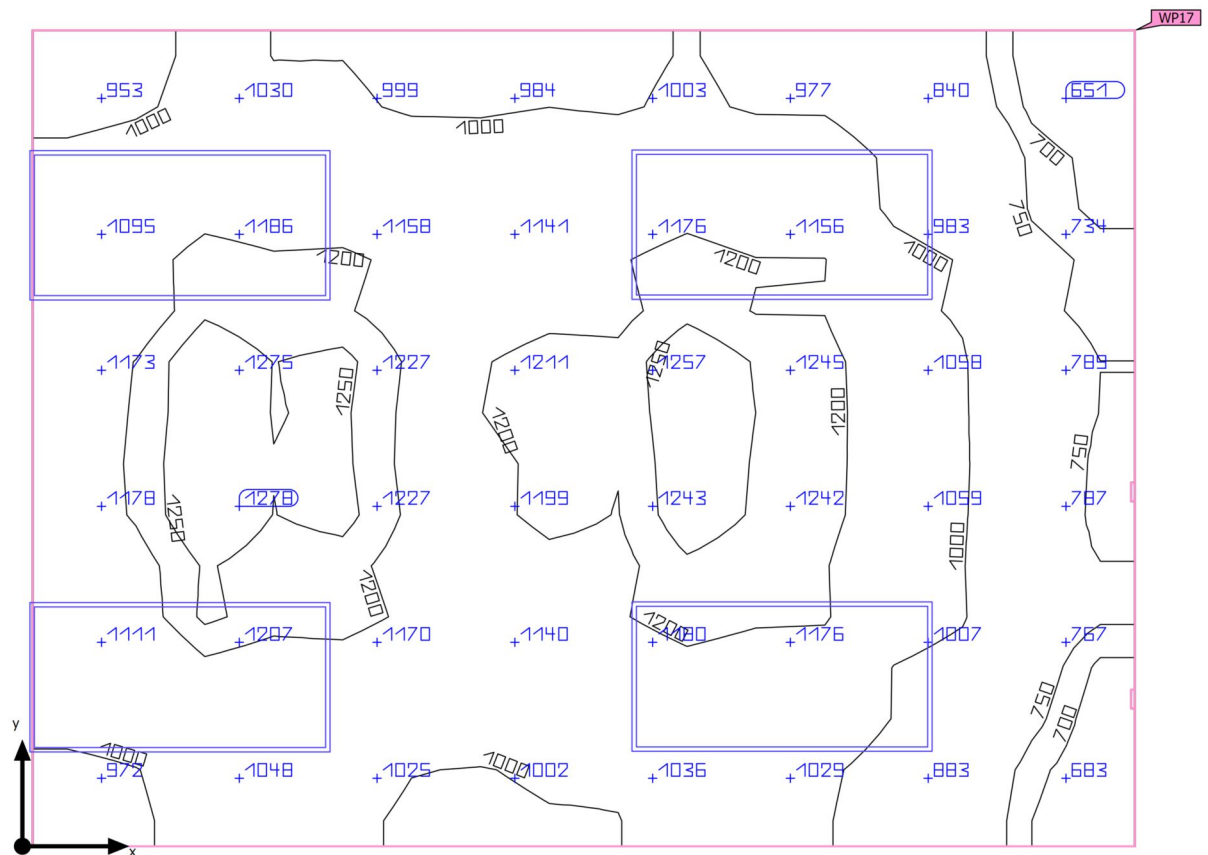

|                    |                                               |                                    |         |
|--------------------|-----------------------------------------------|------------------------------------|---------|
| Ground area        | 14.27 m²                                      | Clearance height                   | 2.700 m |
| Reflection factors | Ceiling: 70.0 %, Walls: 50.0 %, Floor: 20.0 % | Mounting height                    | 2.700 m |
|                    |                                               | Height <sub>Working plane</sub>    | 0.700 m |
| Maintenance factor | 0.76 (fixed)                                  | Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 118 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 1064 lx                       | $\geq 500 \text{ lx}$ | ✓     | WP17  |
|                                  | $U_o (g_1)$                      | 0.57                          | $\geq 0.60$           | ✗     | WP17  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [923 - 1465] kWh/a            | max. 550 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 41.50 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 3.90 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 3.250 m x 4.389 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list

| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |


Building B · GROUND FOOR · 118 OFFICE

## Luminaire layout plan

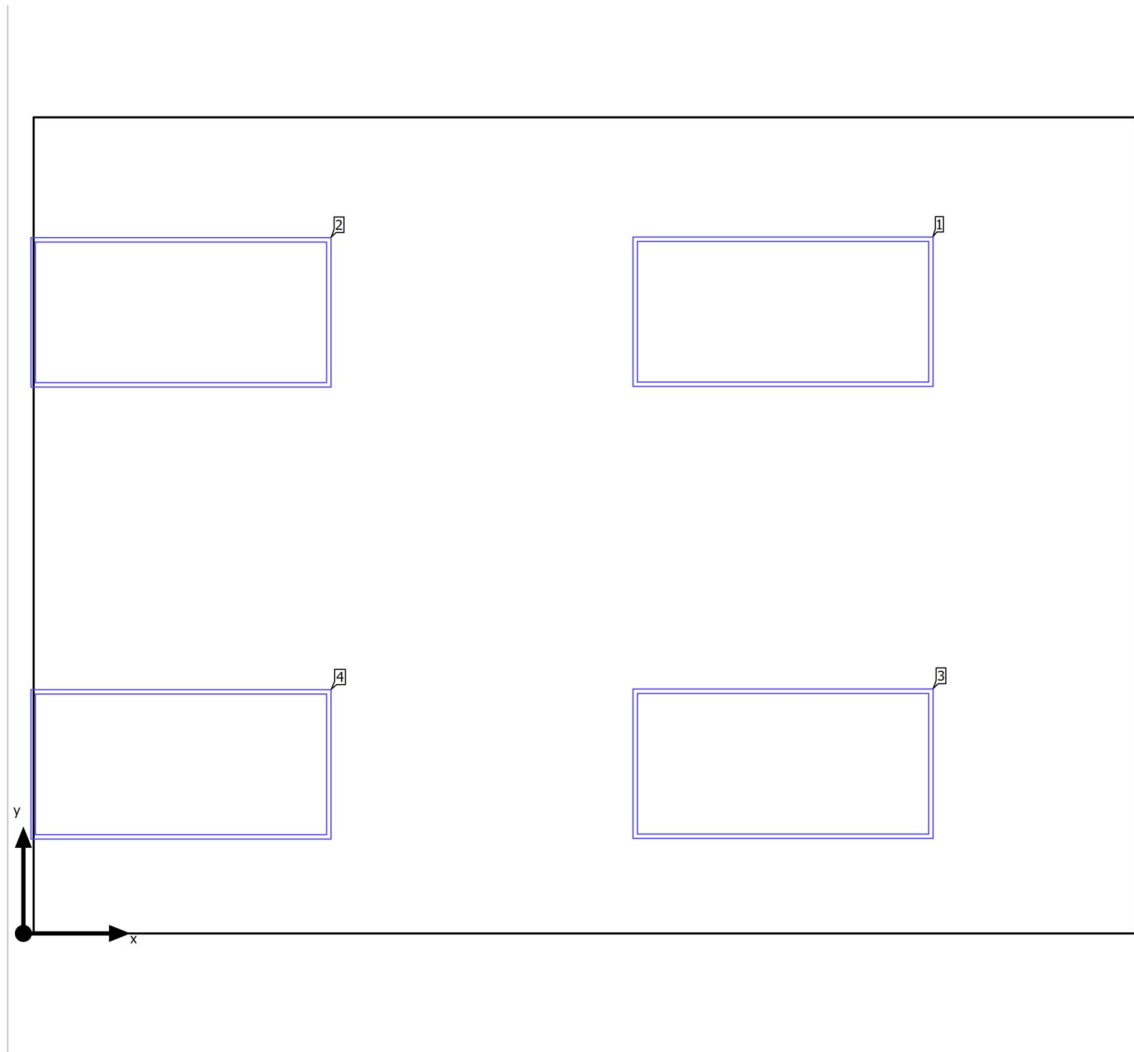

Building B · GROUND FOOR · 118 OFFICE

Luminaire layout plan



|              |             |                        |         |
|--------------|-------------|------------------------|---------|
| Manufacturer | Philips     | P                      | 148.0 W |
| Article name | 4x36W SLB   | Φ <sub>Luminaire</sub> | 8268 lm |
| Fitting      | 4x L36W/830 |                        |         |

Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 3.025 m | 2.476 m | 2.700 m         | 1         |
| 0.628 m | 2.473 m | 2.700 m         | 2         |
| 3.025 m | 0.676 m | 2.700 m         | 3         |
| 0.628 m | 0.673 m | 2.700 m         | 4         |

Building B · GROUND FOOR · 118 OFFICE

**Luminaire list** $\Phi_{\text{total}}$ 

33072 lm

 $P_{\text{total}}$ 

592.0 W

Luminous efficacy


55.9 lm/W

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 118 OFFICE (Light scene 1)

## Calculation objects

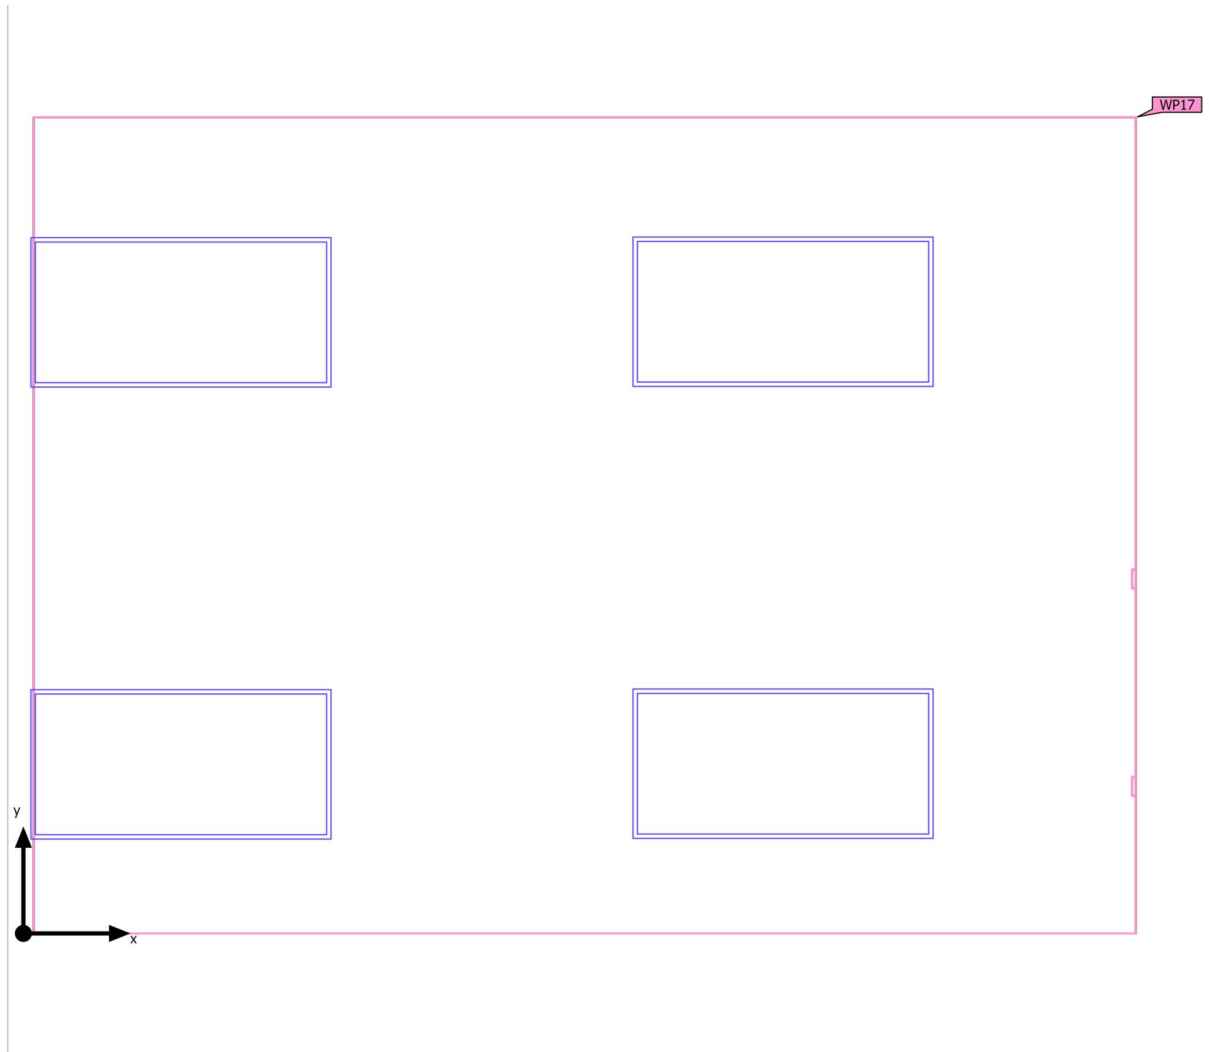

Building B · GROUND FOOR · 118 OFFICE (Light scene 1)

**Calculation objects**


## Working planes

| Properties                                                                                                | $\bar{E}$<br>(Target)            | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|-----------------------------------------------------------------------------------------------------------|----------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (118 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 1064 lx<br>( $\geq 500$ lx)<br>✓ | 610 lx    | 1291 lx   | 0.57<br>( $\geq 0.60$ )<br>✗ | 0.47  | WP17  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 118 OFFICE (Light scene 1)

## Working plane (118 OFFICE)

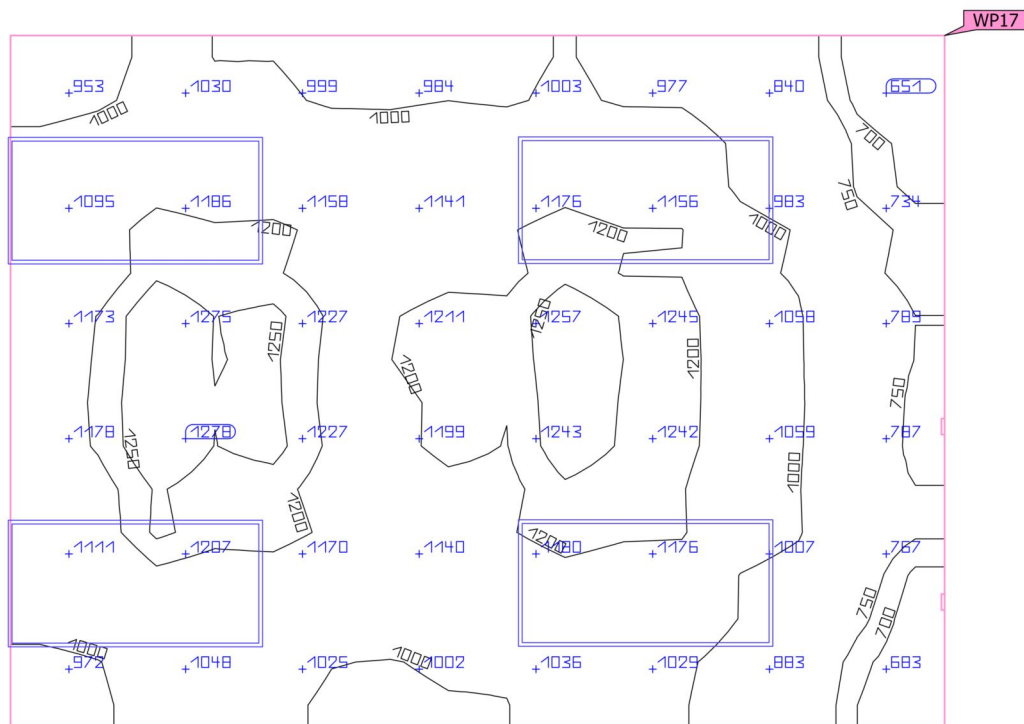


| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (118 OFFICE)           | 1064 lx               | 610 lx    | 1291 lx   | 0.57                    | 0.47  | WP17  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 119 MEETING (Light scene 1)

Summary

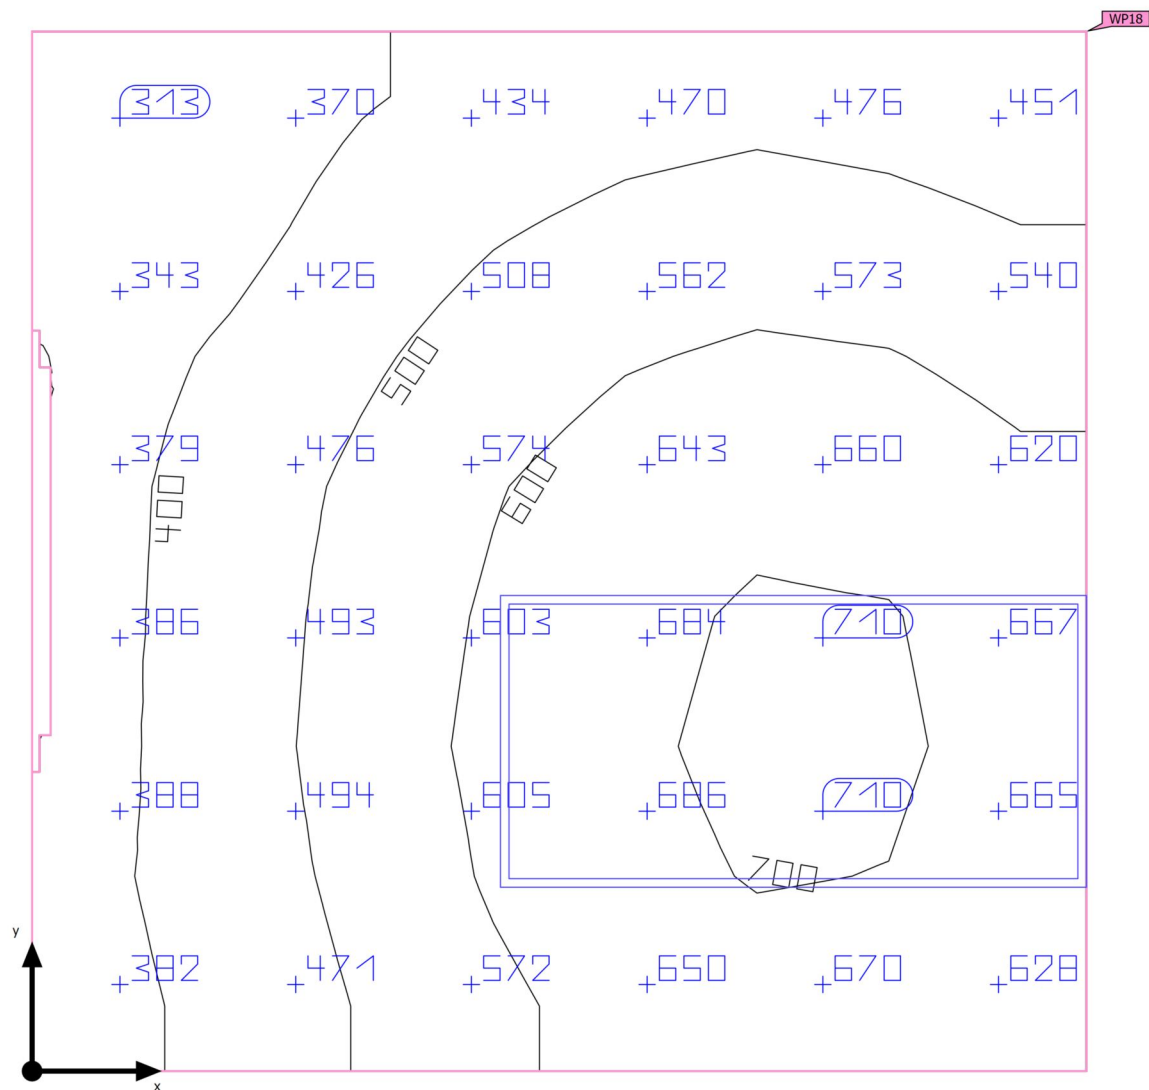

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 4.56 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.700 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 119 MEETING (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 538 lx                        | $\geq 500 \text{ lx}$ | ✓     | WP18  |
|                                  | $U_o (g_1)$                      | 0.49                          | $\geq 0.60$           | ✗     | WP18  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [231 - 366] kWh/a             | max. 200 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 32.47 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 6.04 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 2.150 m x 2.120 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 1    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 119 MEETING

## Luminaire layout plan

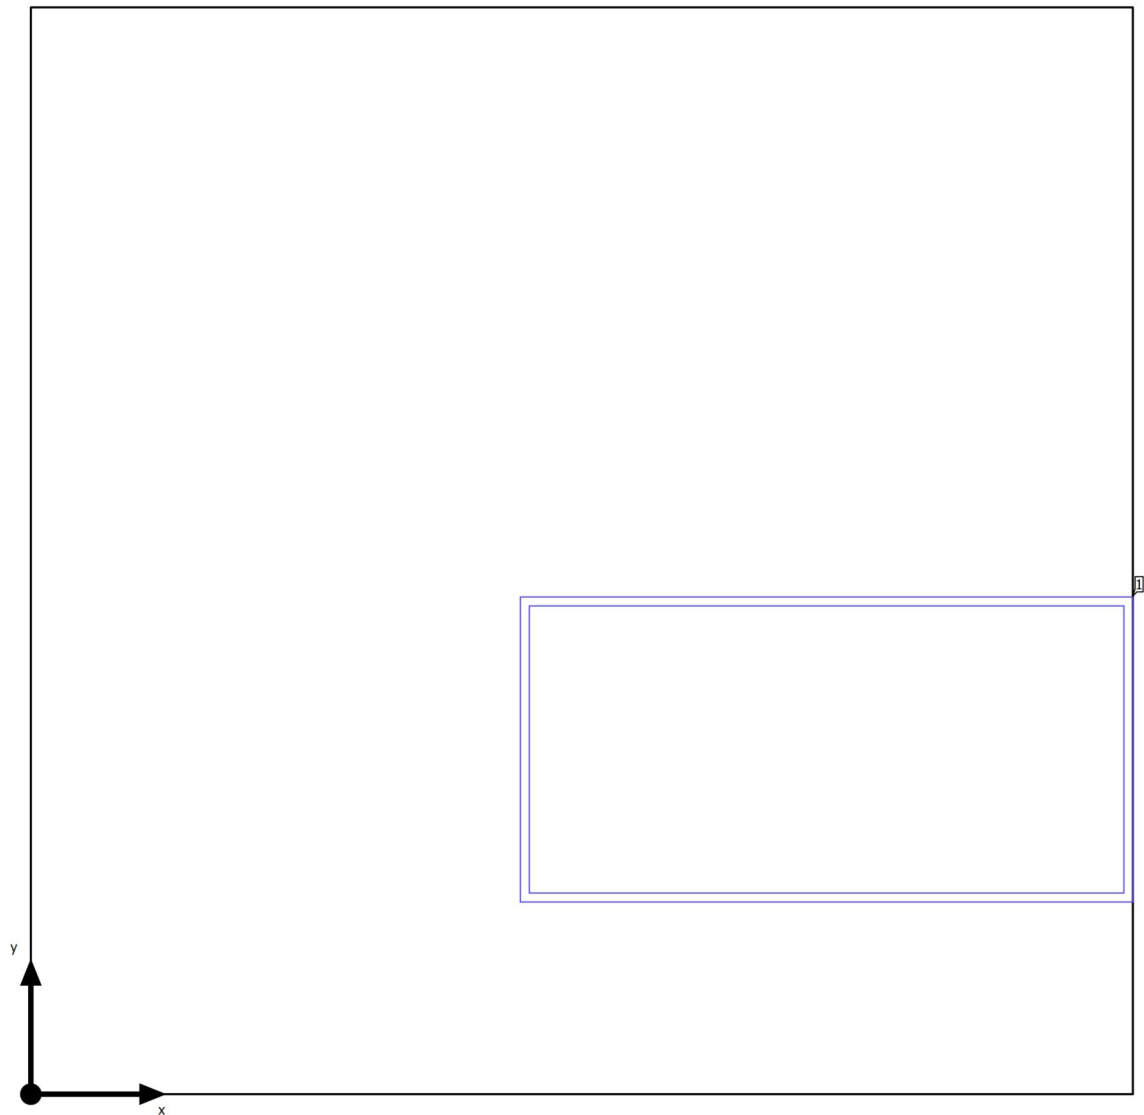

Building B · GROUND FOOR · 119 MEETING

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.552 m | 0.672 m | 2.700 m         | 1         |

Building B · GROUND FOOR · 119 MEETING

**Luminaire list**


|                                  |                               |                                |
|----------------------------------|-------------------------------|--------------------------------|
| $\Phi_{\text{total}}$<br>8268 lm | $P_{\text{total}}$<br>148.0 W | Luminous efficacy<br>55.9 lm/W |
|----------------------------------|-------------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 1    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 119 MEETING (Light scene 1)

## Calculation objects

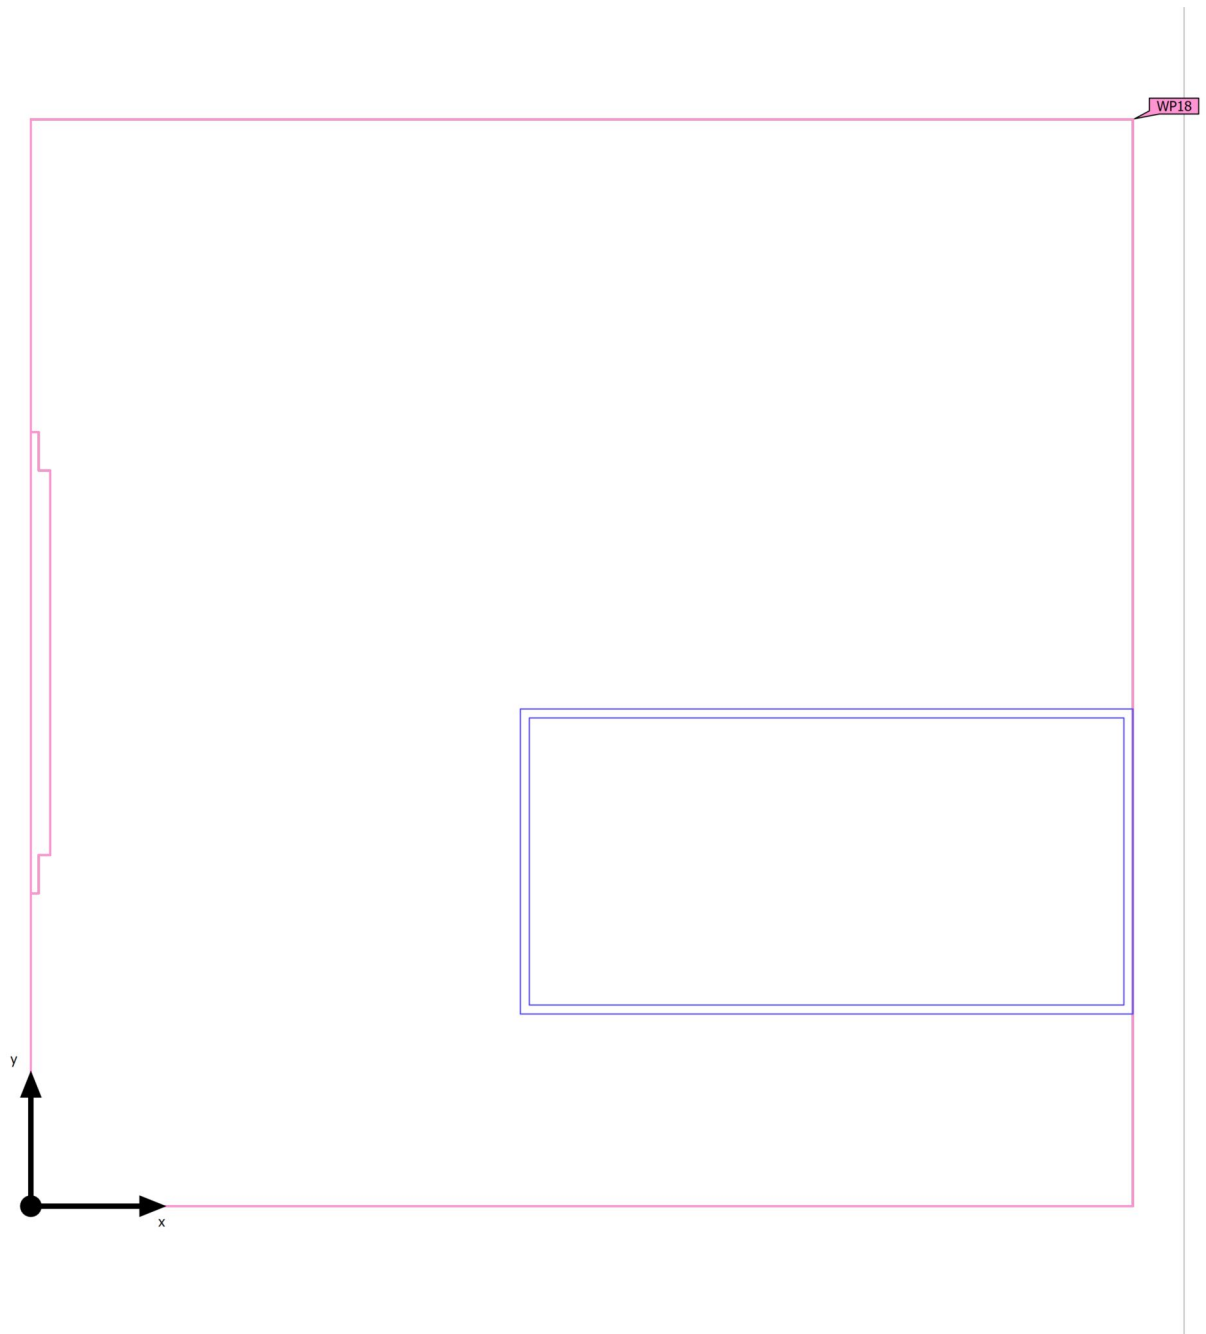

Building B · GROUND FOOR · 119 MEETING (Light scene 1)

**Calculation objects**



## Working planes

| Properties                                                                                                 | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (119 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 538 lx<br>( $\geq 500$ lx)<br>✓ | 264 lx    | 724 lx    | 0.49<br>( $\geq 0.60$ )<br>✗ | 0.36  | WP18  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 119 MEETING (Light scene 1)

Working plane (119 MEETING)

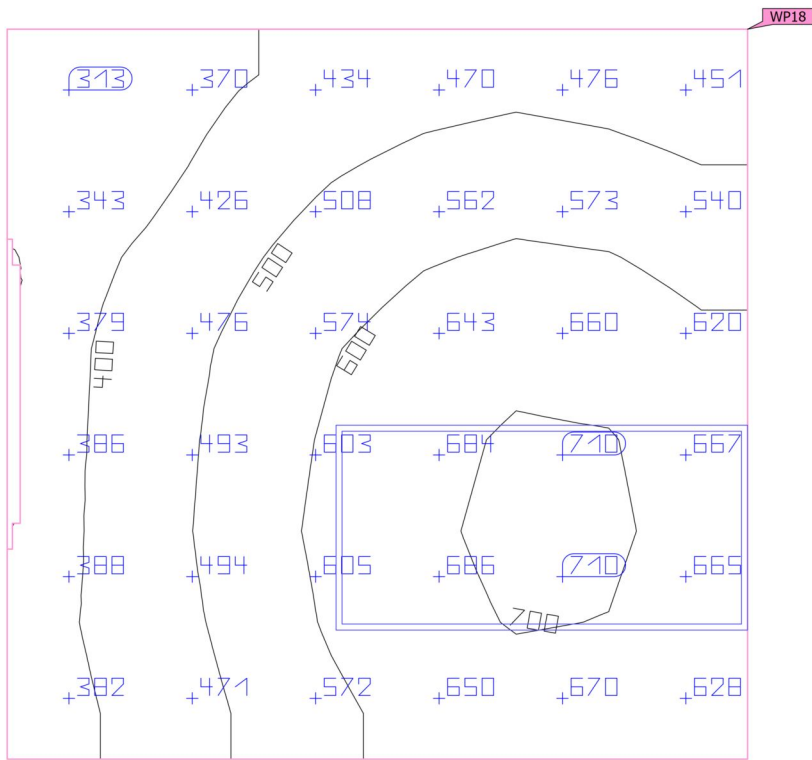


| Properties                                                                                                 | $\bar{E}$<br>(Target)     | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (119 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 538 lx<br>(≥ 500 lx)<br>✓ | 264 lx    | 724 lx    | 0.49<br>(≥ 0.60)<br>✗   | 0.36  | WP18  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 120 OFFICE (Light scene 1)

Summary

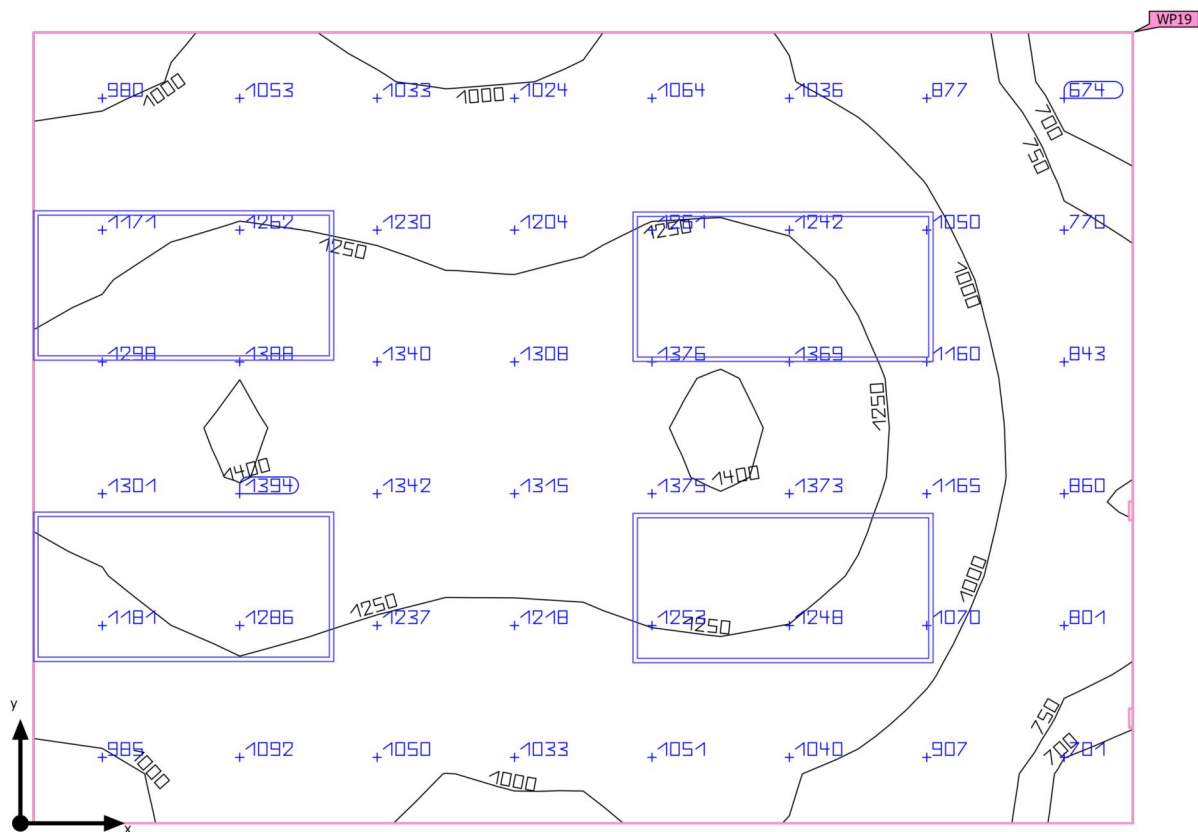

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 13.79 m <sup>2</sup>                                |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.700 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 120 OFFICE (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 1133 lx                       | $\geq 500 \text{ lx}$ | ✓     | WP19  |
|                                  | $U_o (g_1)$                      | 0.56                          | $\geq 0.60$           | ✗     | WP19  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [923 - 1465] kWh/a            | max. 500 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 42.93 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 3.79 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 4.377 m x 3.150 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 120 OFFICE

## Luminaire layout plan

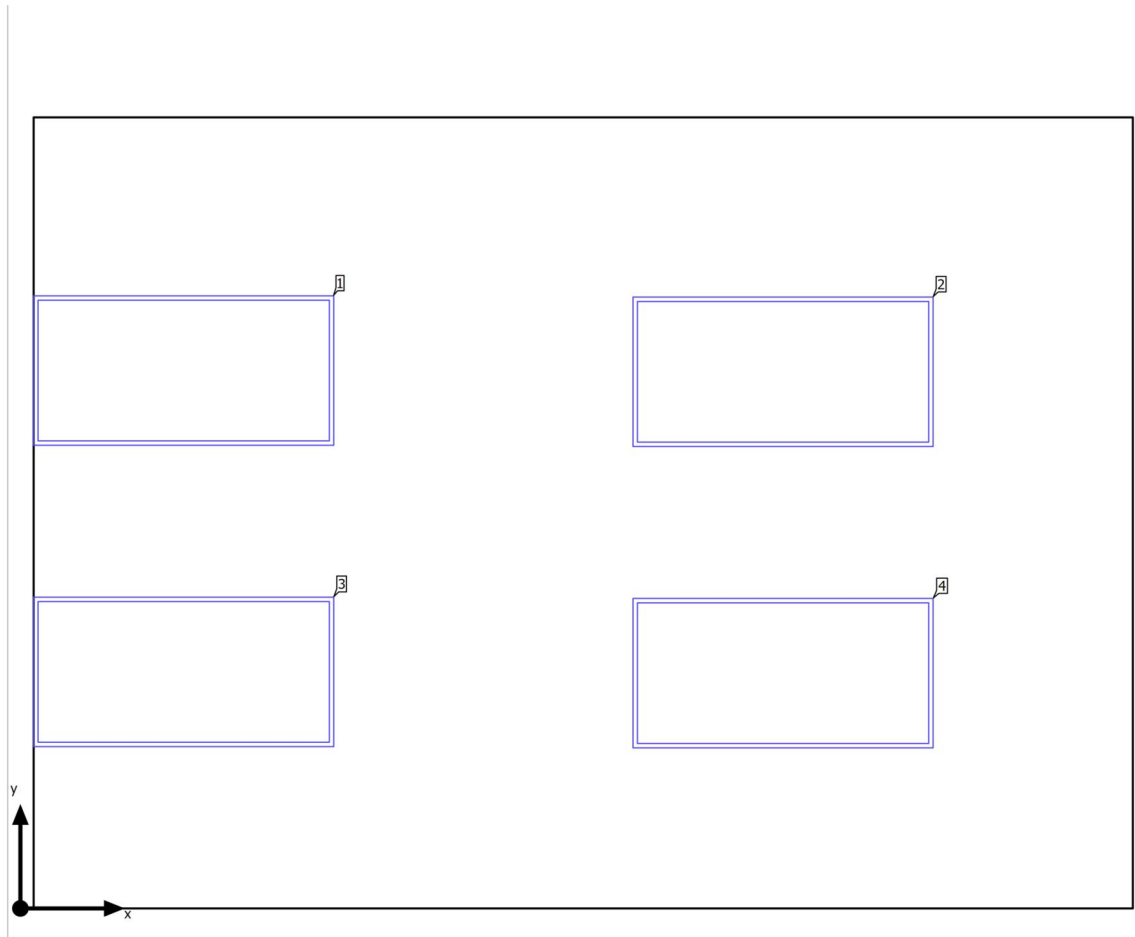

Building B · GROUND FOOR · 120 OFFICE

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 0.650 m | 2.142 m | 2.700 m         | 1         |
| 3.037 m | 2.137 m | 2.700 m         | 2         |
| 0.650 m | 0.942 m | 2.700 m         | 3         |
| 3.037 m | 0.937 m | 2.700 m         | 4         |

Building B · GROUND FOOR · 120 OFFICE

Luminaire list


|                            |                        |                                |
|----------------------------|------------------------|--------------------------------|
| $\Phi_{total}$<br>33072 lm | $P_{total}$<br>592.0 W | Luminous efficacy<br>55.9 lm/W |
|----------------------------|------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 4    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 120 OFFICE (Light scene 1)

## Calculation objects

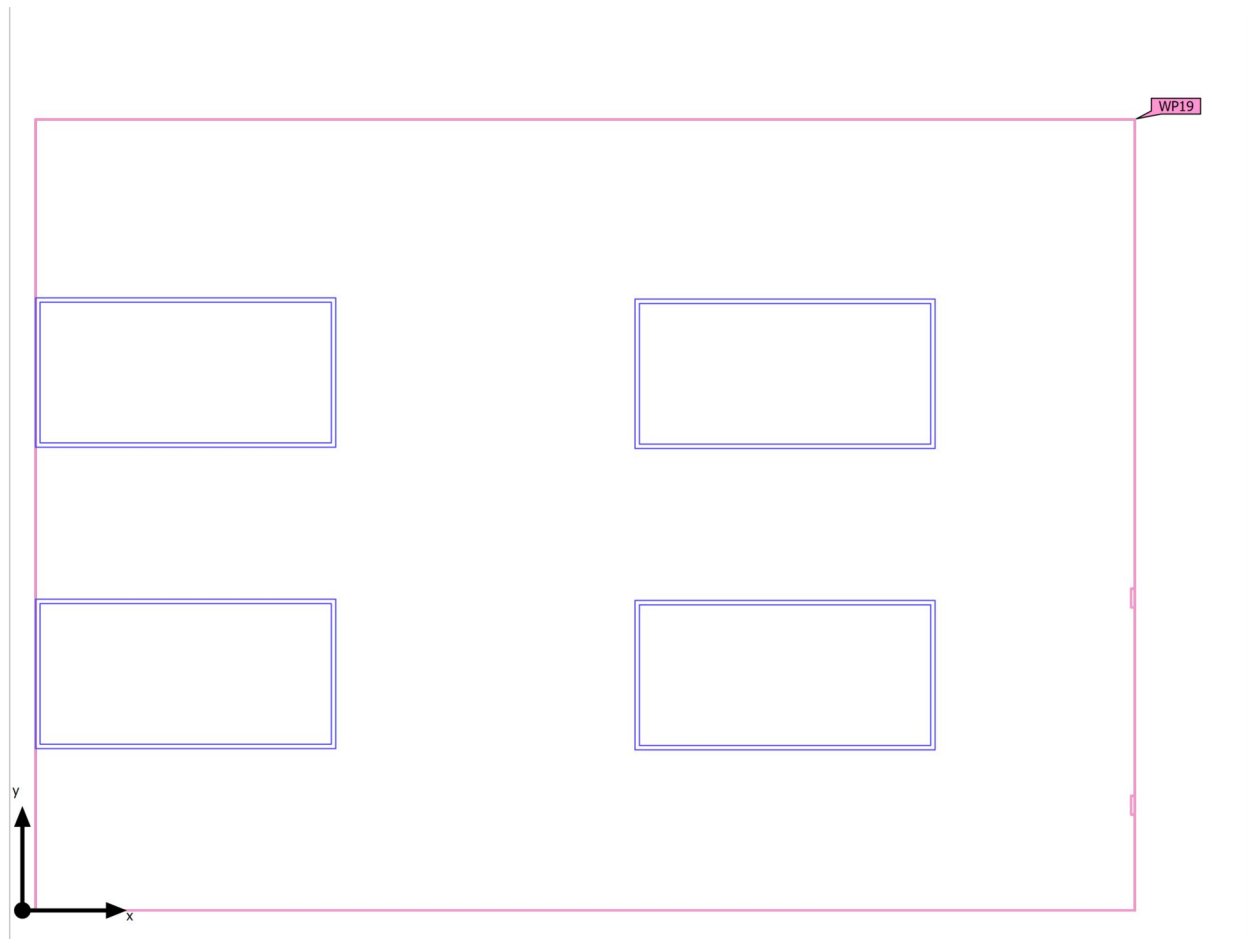

Building B · GROUND FOOR · 120 OFFICE (Light scene 1)


**Calculation objects**

## Working planes

| Properties                                                                                                | $\bar{E}$<br>(Target)            | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|-----------------------------------------------------------------------------------------------------------|----------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (120 OFFICE)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 1133 lx<br>( $\geq 500$ lx)<br>✓ | 636 lx    | 1410 lx   | 0.56<br>( $\geq 0.60$ )<br>✗ | 0.45  | WP19  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 120 OFFICE (Light scene 1)

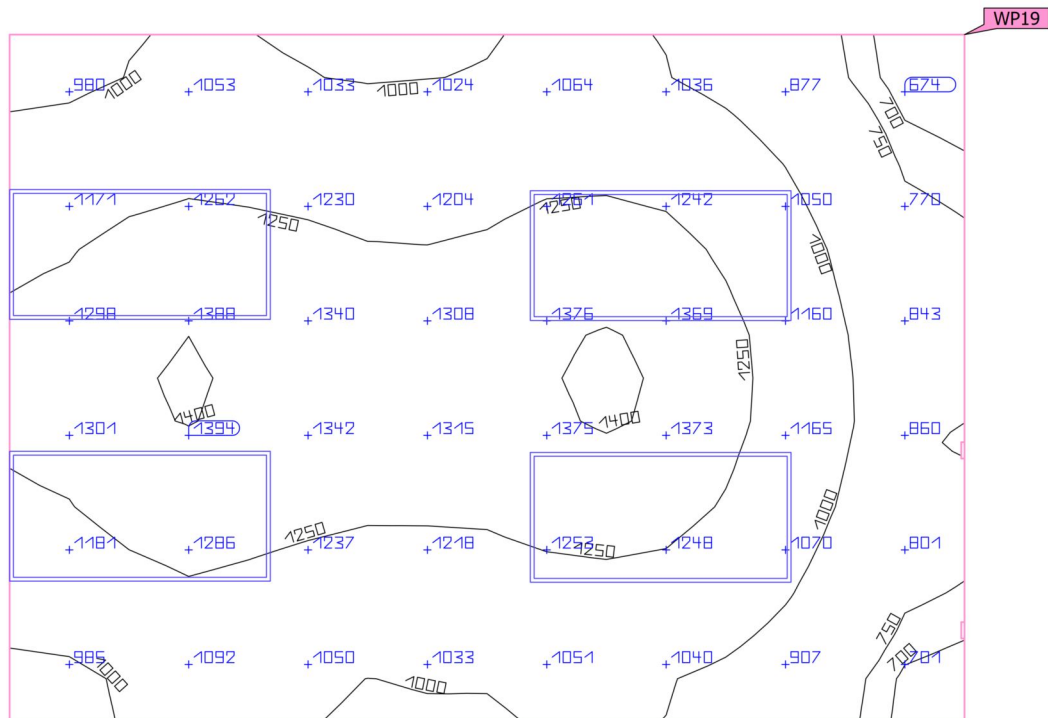
**Working plane (120 OFFICE)**

| Properties                           | $\bar{E}$<br>(Target) | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|--------------------------------------|-----------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (120 OFFICE)           | 1133 lx               | 636 lx    | 1410 lx   | 0.56                    | 0.45  | WP19  |
| Perpendicular illuminance (adaptive) | (≥ 500 lx)            |           |           | (≥ 0.60)                |       |       |
| Height: 0.700 m, Wall zone: 0.000 m  | ✓                     |           |           | ✗                       |       |       |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 121 MEETING (Light scene 1)

Summary

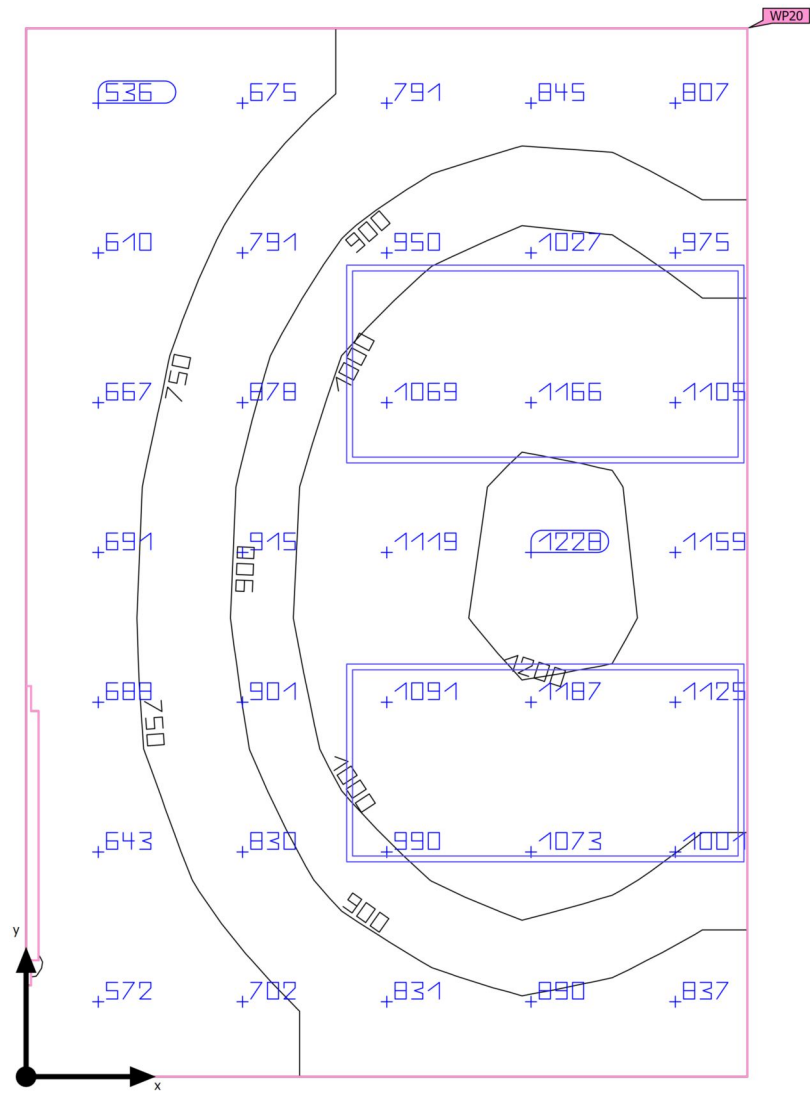

|                    |                                                     |
|--------------------|-----------------------------------------------------|
| Ground area        | 6.84 m <sup>2</sup>                                 |
| Reflection factors | Ceiling: 70.0 %,<br>Walls: 50.0 %,<br>Floor: 20.0 % |
| Maintenance factor | 0.76 (fixed)                                        |

|                                    |         |
|------------------------------------|---------|
| Clearance height                   | 2.700 m |
| Mounting height                    | 2.700 m |
| Height <sub>Working plane</sub>    | 0.700 m |
| Wall zone <sub>Working plane</sub> | 0.000 m |

Building B · GROUND FOOR · 121 MEETING (Light scene 1)

## Summary

### Results

|                                  | Symbol                           | Calculated                    | Target                | Check | Index |
|----------------------------------|----------------------------------|-------------------------------|-----------------------|-------|-------|
| Working plane                    | $\bar{E}_{\text{perpendicular}}$ | 900 lx                        | $\geq 500 \text{ lx}$ | ✓     | WP20  |
|                                  | $U_o (g_1)$                      | 0.54                          | $\geq 0.60$           | ✗     | WP20  |
| Glare valuation <sup>(1)</sup>   | $R_{UG, \text{max}}$             | 18                            | $\leq 19$             | ✓     |       |
| Energy estimation <sup>(2)</sup> | Consumption                      | [462 - 733] kWh/a             | max. 250 kWh/a        | ✗     |       |
| Space                            | Lighting power density           | 43.25 W/m <sup>2</sup>        | –                     |       |       |
|                                  |                                  | 4.80 W/m <sup>2</sup> /100 lx | –                     |       |       |

(1) Based on a rectangular space of 2.170 m x 3.154 m and SHR of 0.25.

(2) Calculated using DIN:18599-4.


Utilisation profile: DIALux presetting (5.26.2 Standard (office))

### Luminaire list


| pcs. | Manufacturer | Article No. | Article name | $R_{UG}$ | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|----------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 18       | 148.0 W | 8268 lm | 55.9 lm/W         |

Building B · GROUND FOOR · 121 MEETING

## Luminaire layout plan

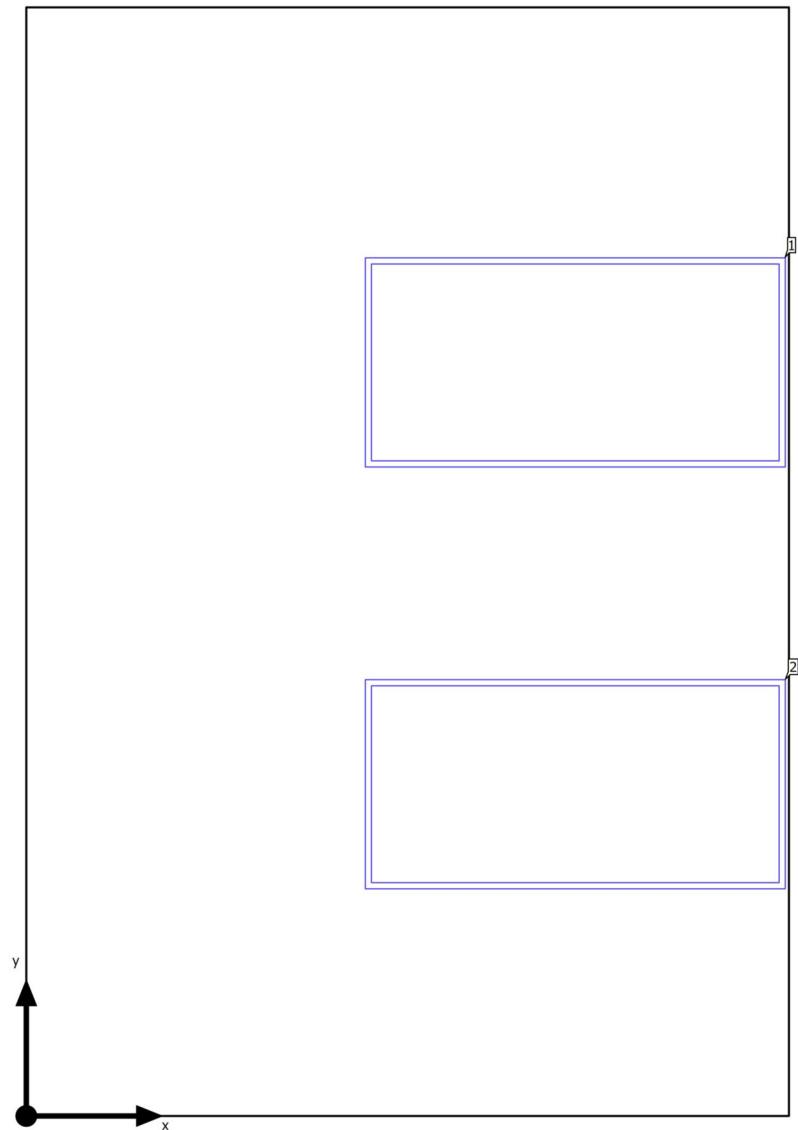

Building B · GROUND FOOR · 121 MEETING

**Luminaire layout plan**

|              |             |                           |         |
|--------------|-------------|---------------------------|---------|
| Manufacturer | Philips     | P                         | 148.0 W |
| Article name | 4x36W SLB   | $\Phi_{\text{Luminaire}}$ | 8268 lm |
| Fitting      | 4x L36W/830 |                           |         |

## Individual luminaires

| X       | Y       | Mounting height | Luminaire |
|---------|---------|-----------------|-----------|
| 1.562 m | 2.144 m | 2.700 m         | 1         |
| 1.562 m | 0.944 m | 2.700 m         | 2         |

Building B · GROUND FOOR · 121 MEETING

Luminaire list


|                            |                        |                                |
|----------------------------|------------------------|--------------------------------|
| $\Phi_{total}$<br>16536 lm | $P_{total}$<br>296.0 W | Luminous efficacy<br>55.9 lm/W |
|----------------------------|------------------------|--------------------------------|

| pcs. | Manufacturer | Article No. | Article name | P       | $\Phi$  | Luminous efficacy |
|------|--------------|-------------|--------------|---------|---------|-------------------|
| 2    | Philips      |             | 4x36W SLB    | 148.0 W | 8268 lm | 55.9 lm/W         |



Building B · GROUND FOOR · 121 MEETING (Light scene 1)

## Calculation objects

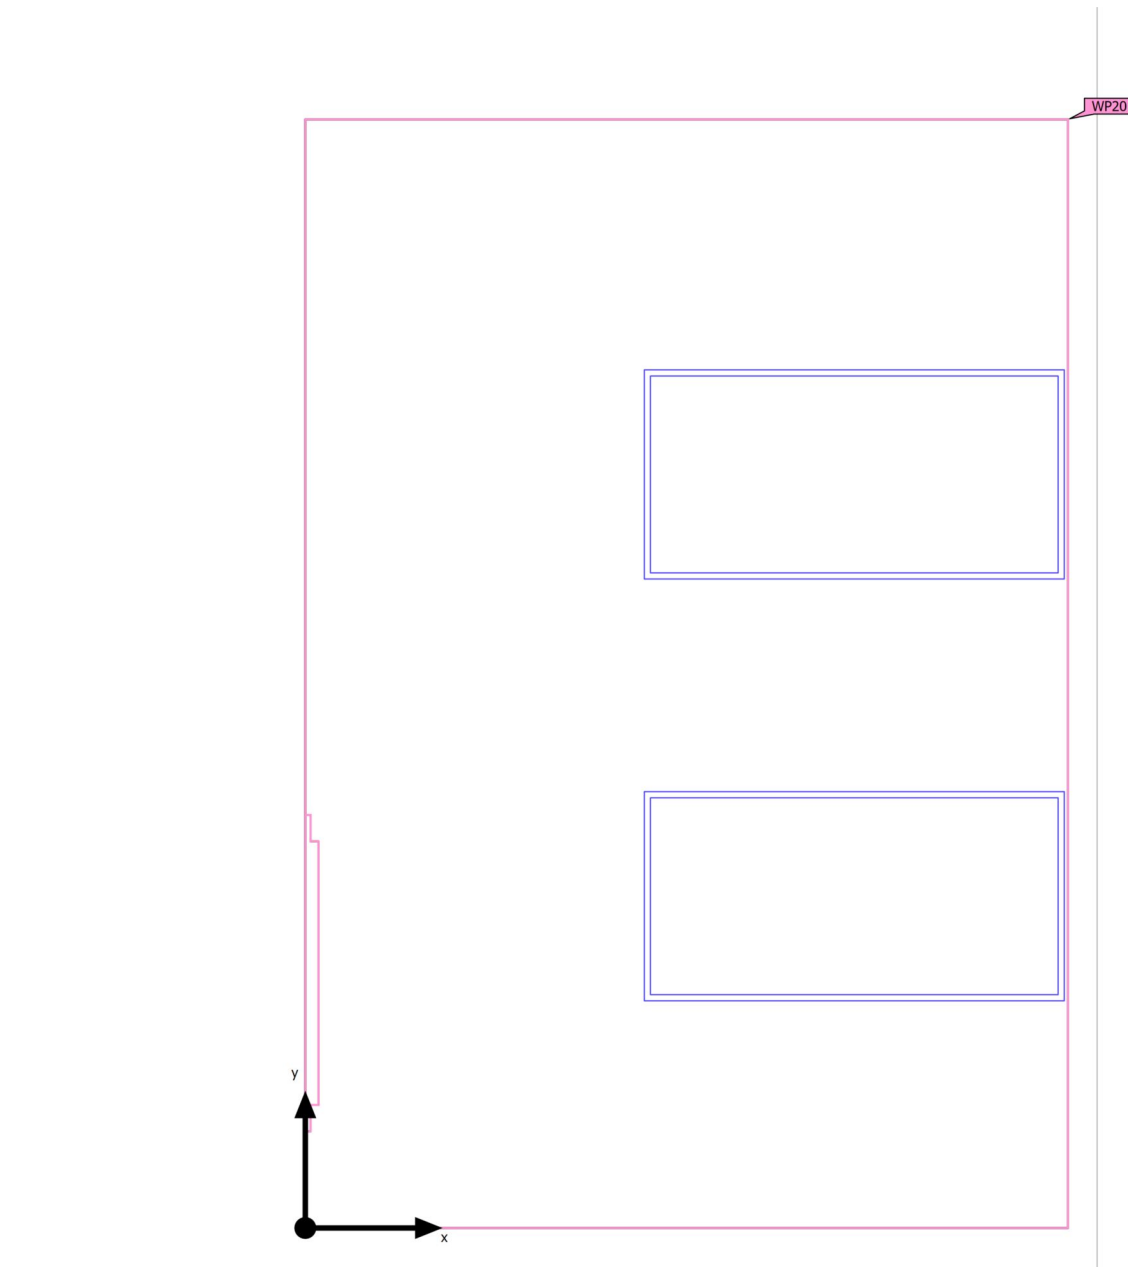

Building B · GROUND FOOR · 121 MEETING (Light scene 1)

**Calculation objects**



## Working planes

| Properties                                                                                                 | $\bar{E}$<br>(Target)           | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target)      | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------------|-----------|-----------|------------------------------|-------|-------|
| Working plane (121 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 900 lx<br>( $\geq 500$ lx)<br>✓ | 487 lx    | 1231 lx   | 0.54<br>( $\geq 0.60$ )<br>✗ | 0.40  | WP20  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))

Building B · GROUND FOOR · 121 MEETING (Light scene 1)

Working plane (121 MEETING)

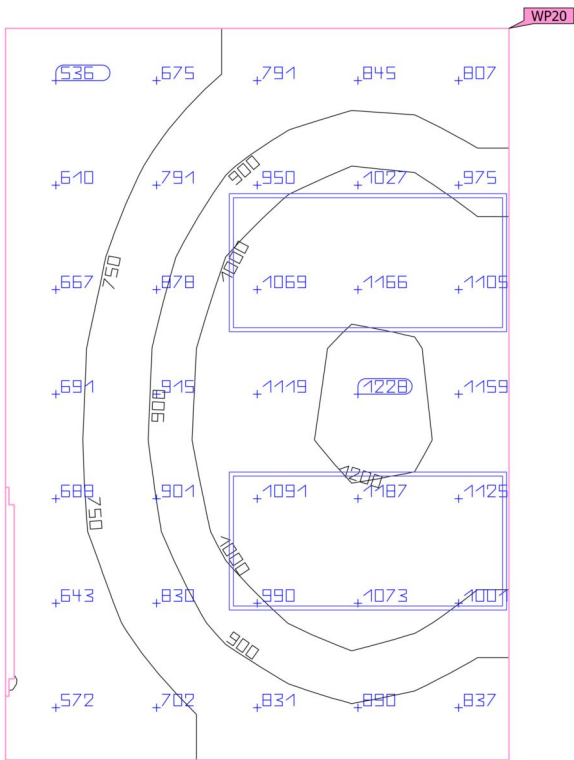

| Properties                                                                                                 | $\bar{E}$<br>(Target)     | $E_{min}$ | $E_{max}$ | $U_o (g_1)$<br>(Target) | $g_2$ | Index |
|------------------------------------------------------------------------------------------------------------|---------------------------|-----------|-----------|-------------------------|-------|-------|
| Working plane (121 MEETING)<br>Perpendicular illuminance (adaptive)<br>Height: 0.700 m, Wall zone: 0.000 m | 900 lx<br>(≥ 500 lx)<br>✓ | 487 lx    | 1231 lx   | 0.54<br>(≥ 0.60)<br>✗   | 0.40  | WP20  |

Utilisation profile: DIALux presetting (5.26.2 Standard (office))