


Supplementary Figure S2. Realized seizure-rhythm distributions

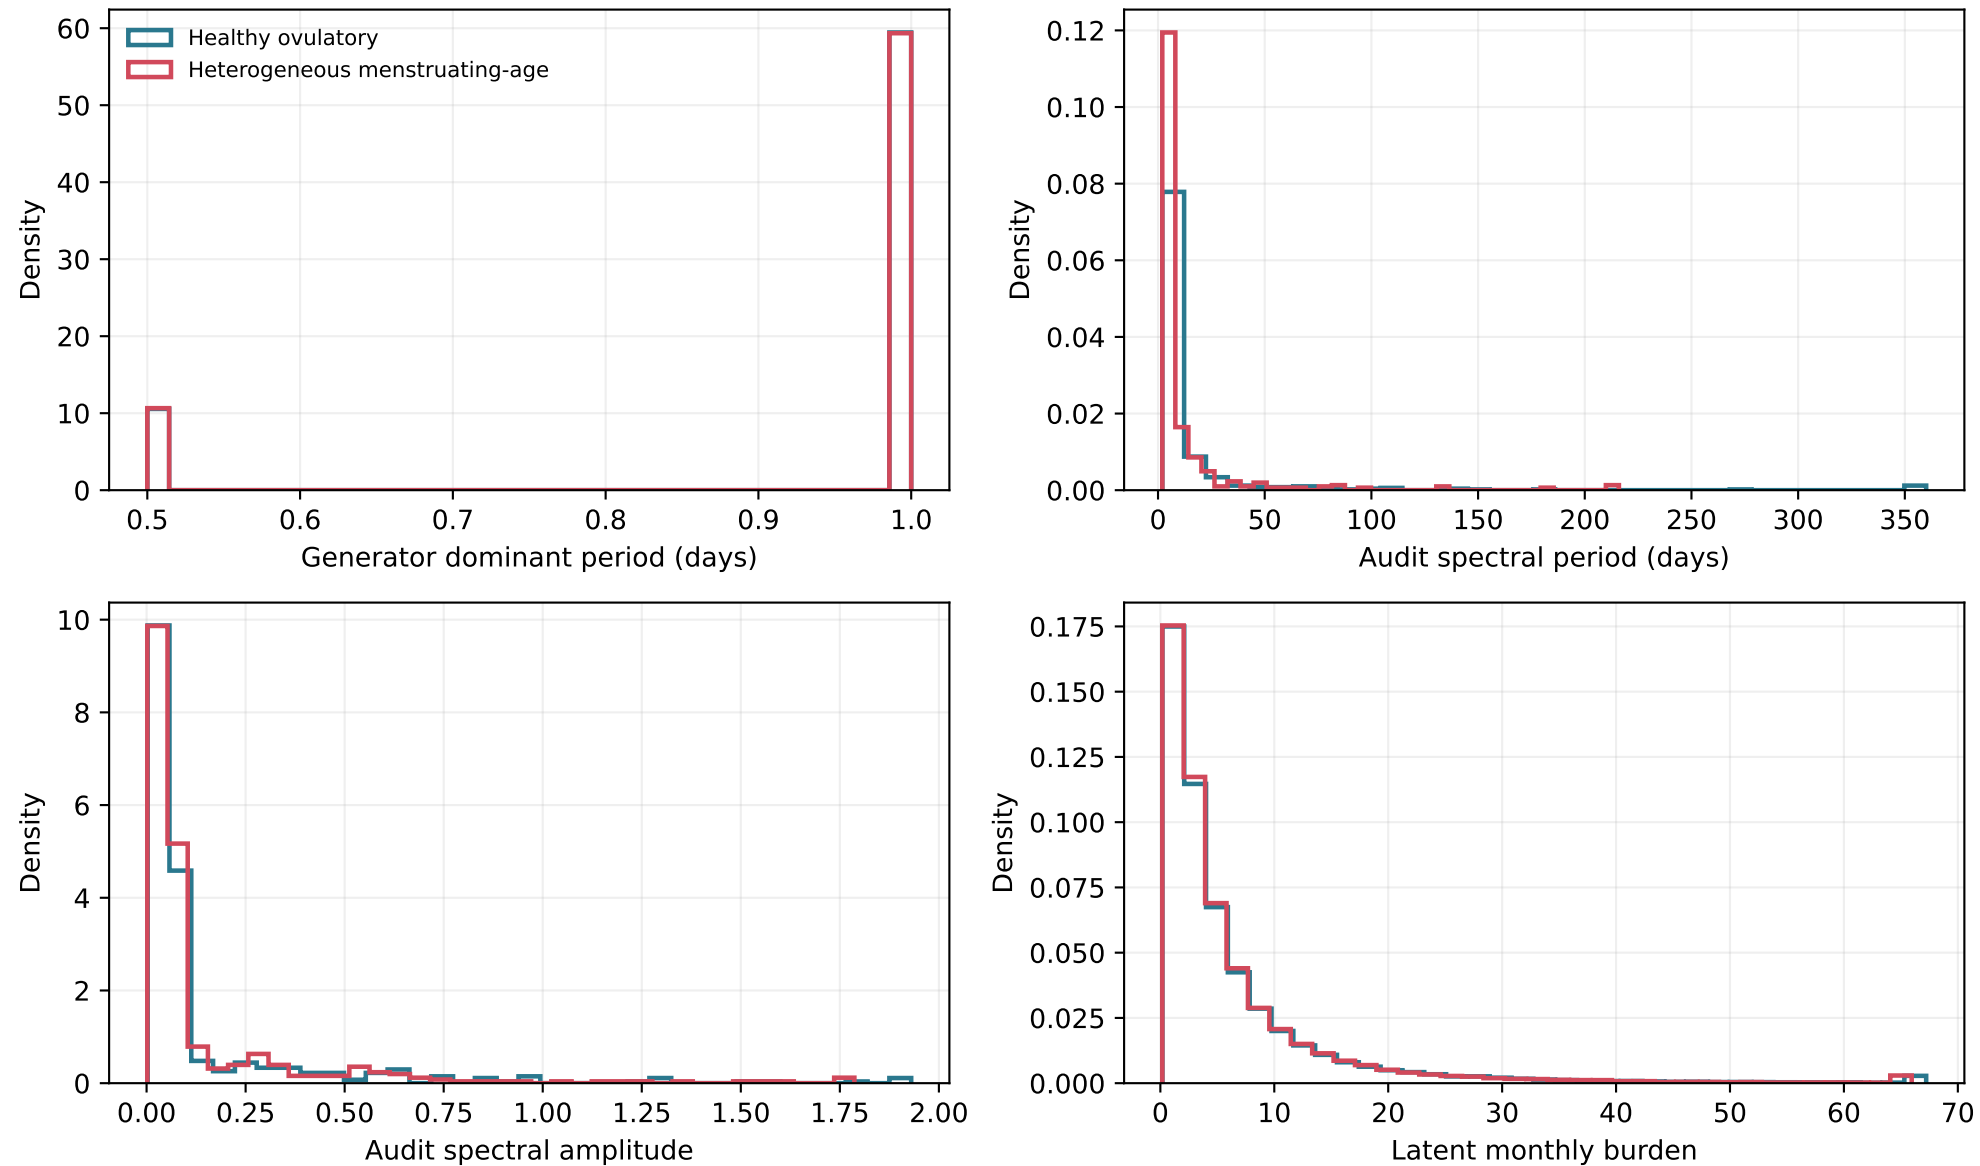

Completed-run distributions; extreme 0.5% tails are winsorized for display. These panels are descriptive calibration outputs, not external empirical validation.