
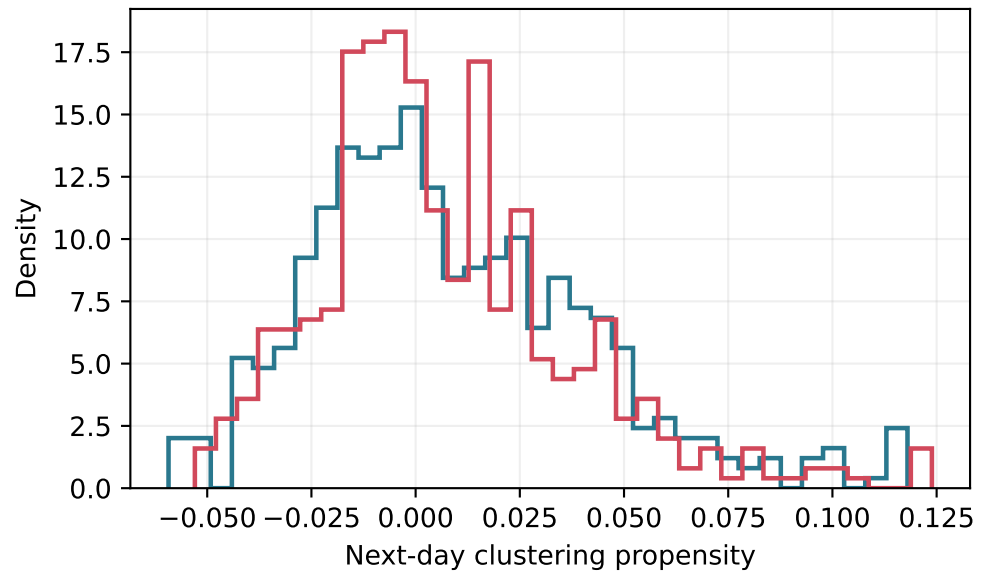
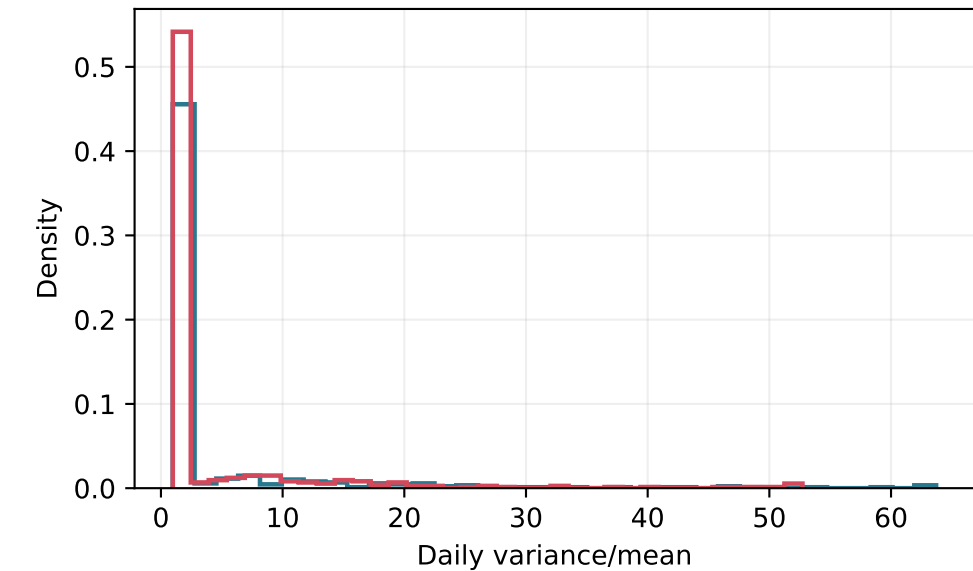
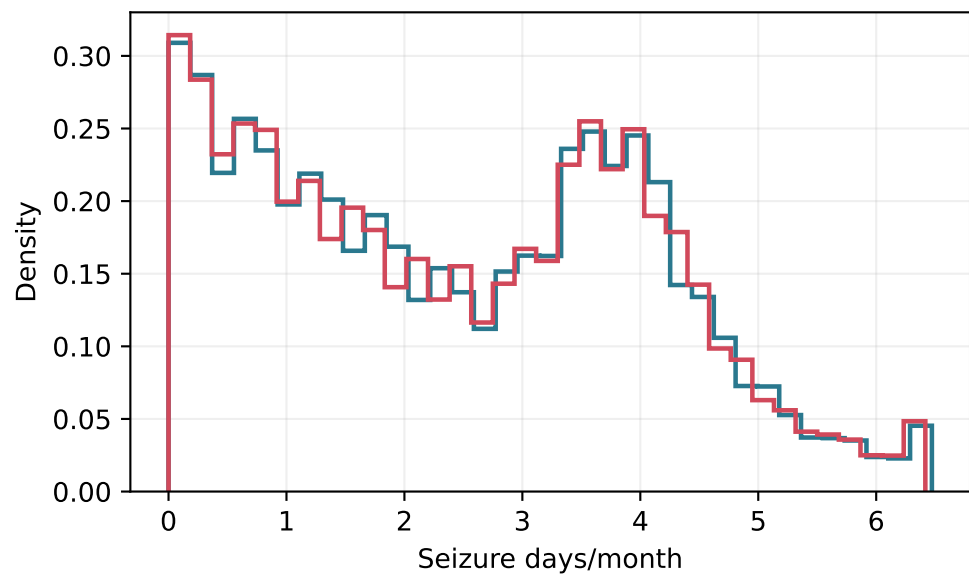


Supplementary Figure S1. Realized seizure-process distributions

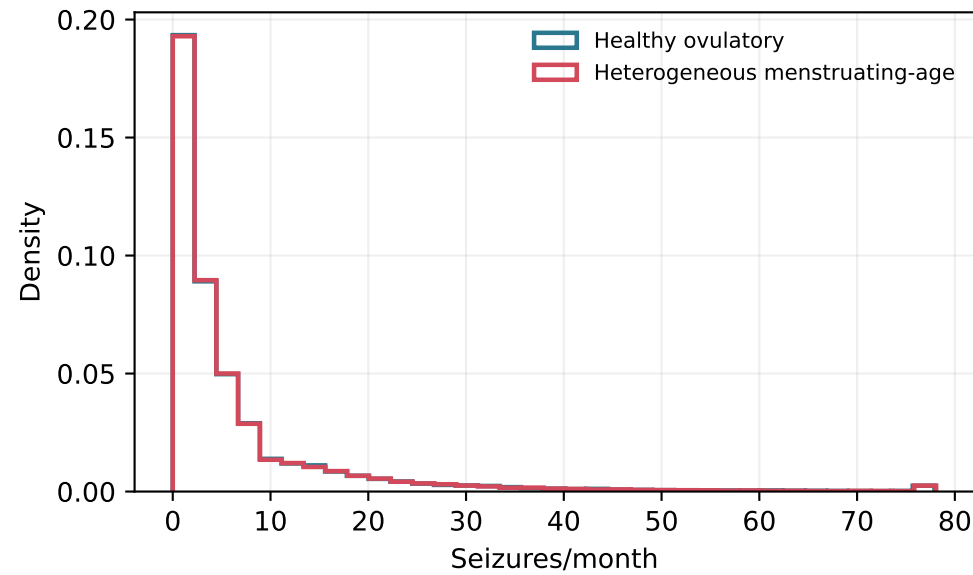

Completed-run distributions; extreme 0.5% tails are winsorized for display. These panels are descriptive calibration outputs, not external empirical validation.