

Transformer SE3_TP3

Transformer's age: 27

Load and Power Factor

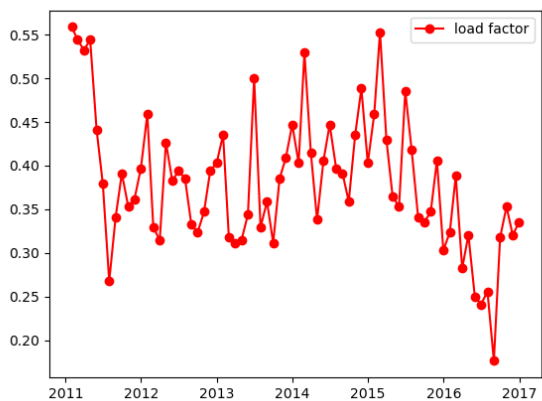


Figure 1: Graphic with load factor

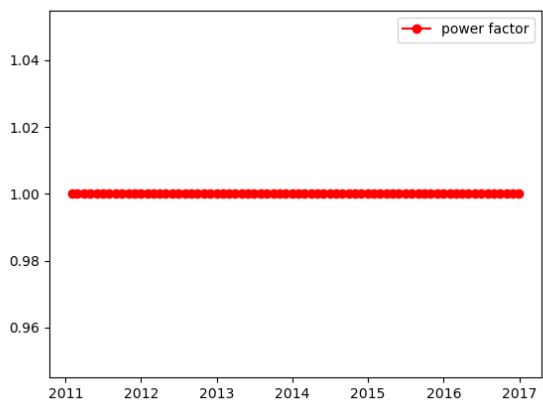


Figure 2: Graphic with power factor

Furfural

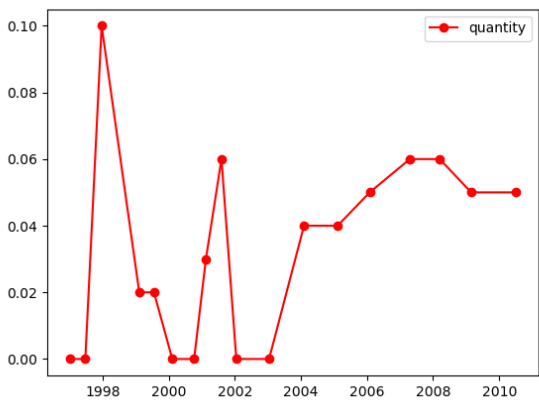


Figure 3: Graphic with quantity

Oil Quality

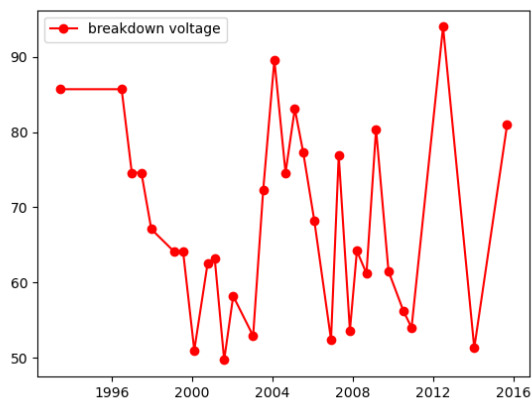


Figure 4: Graphic with breakdown voltage

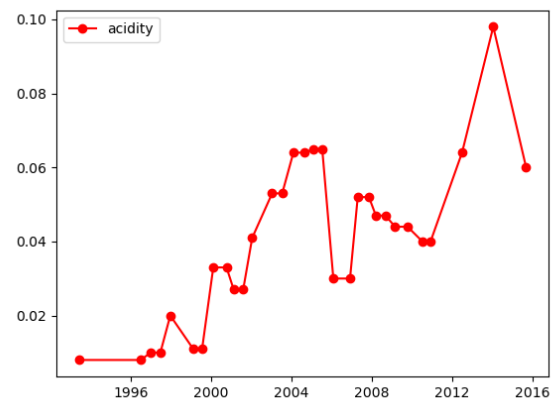


Figure 5: Graphic with acidity

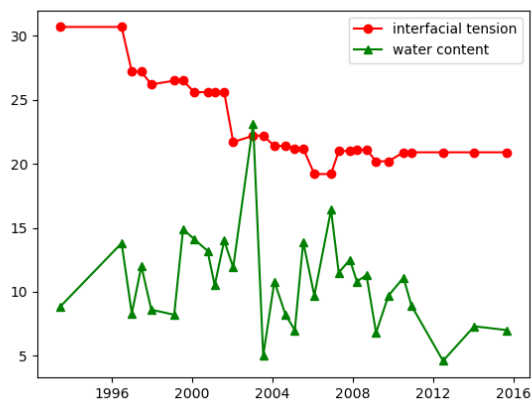


Figure 6: Graphic with interfacial tension, water content

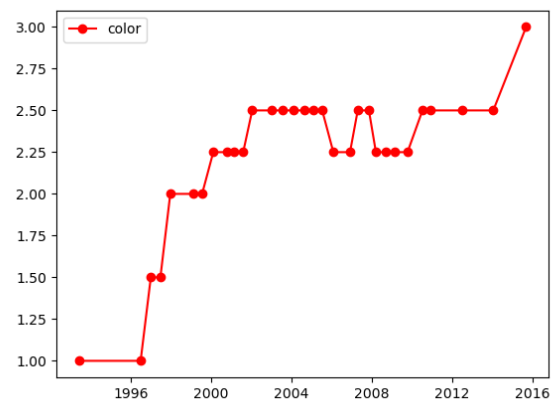


Figure 7: Graphic with color

Dissolved Gases

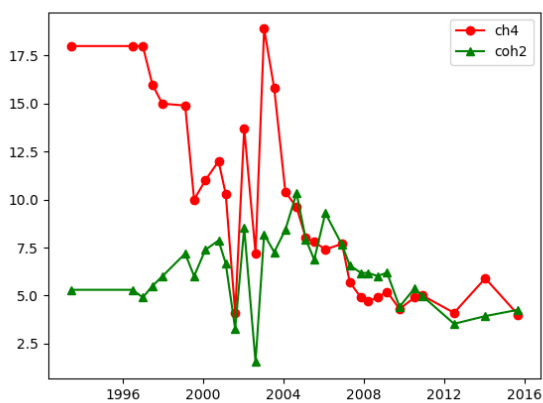


Figure 8: Graphic with ch4, coh2

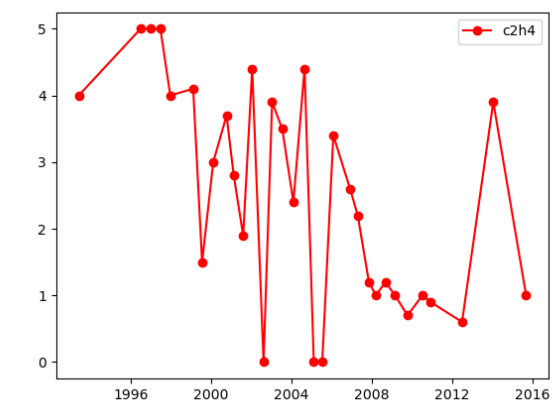


Figure 9: Graphic with c2h4

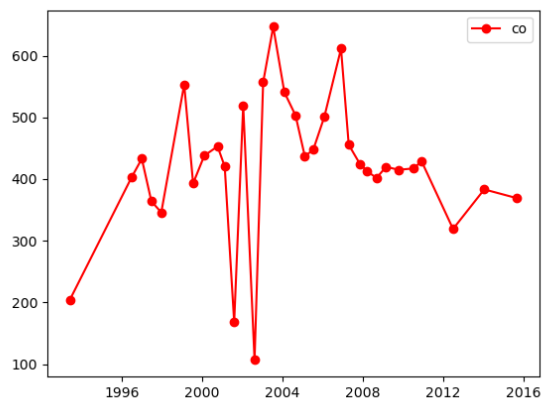


Figure 10: Graphic with co

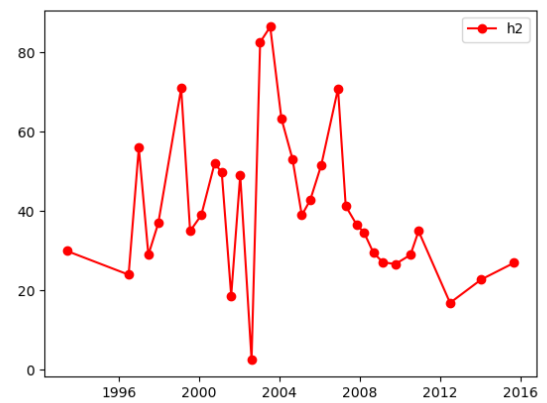


Figure 11: Graphic with h2

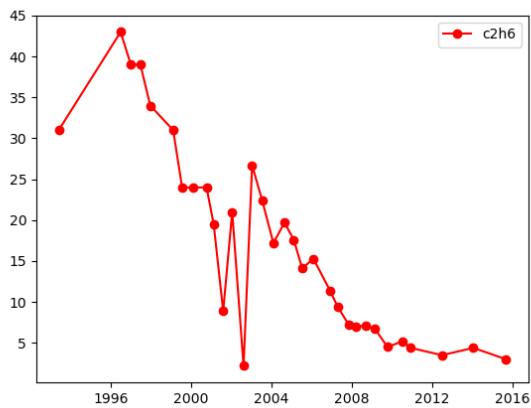


Figure 12: Graphic with c2h6

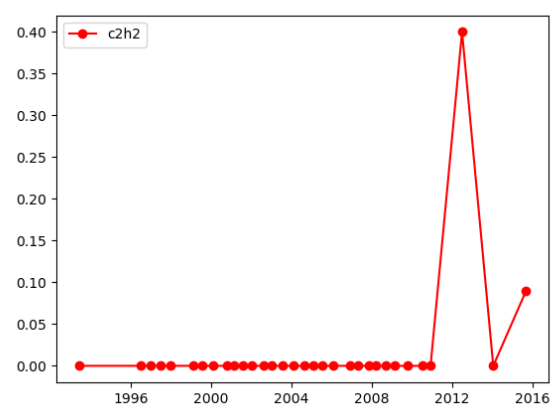


Figure 13: Graphic with c2h2

Overall Condition

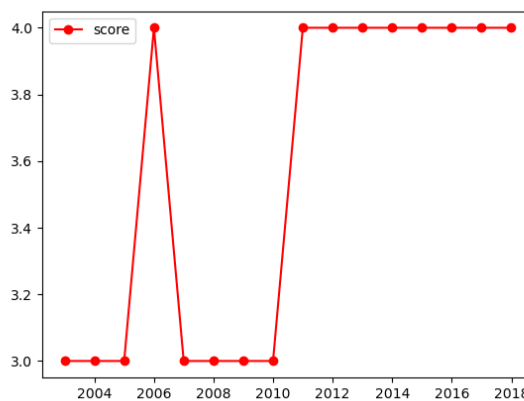


Figure 14: Graphic with score

Health Index

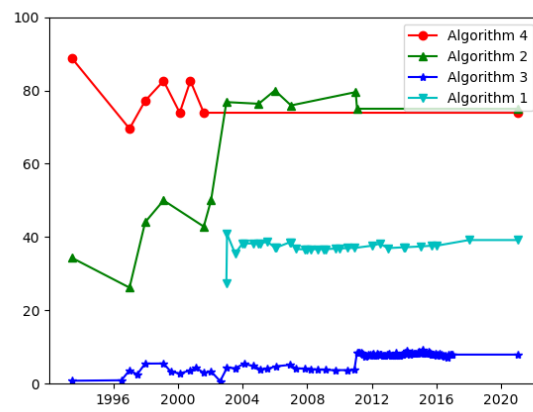


Figure 15: Graphic with Algorithm 4, Algorithm 2, Algorithm 3, Algorithm 1