
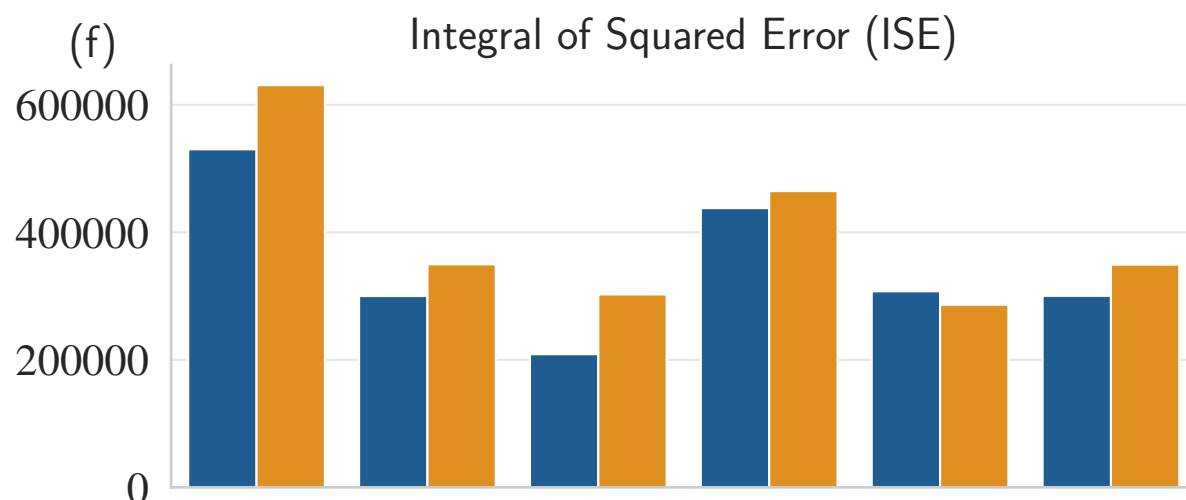
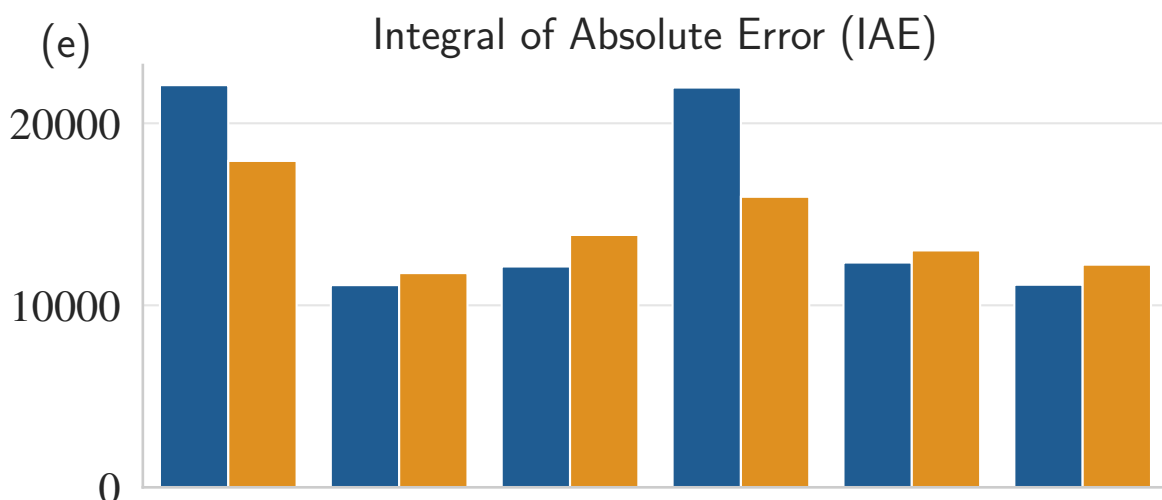
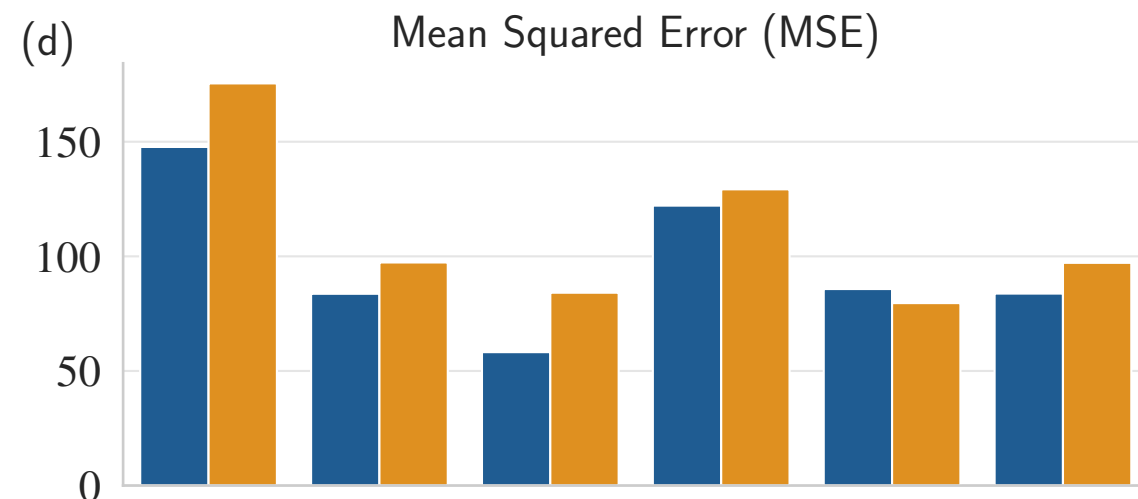
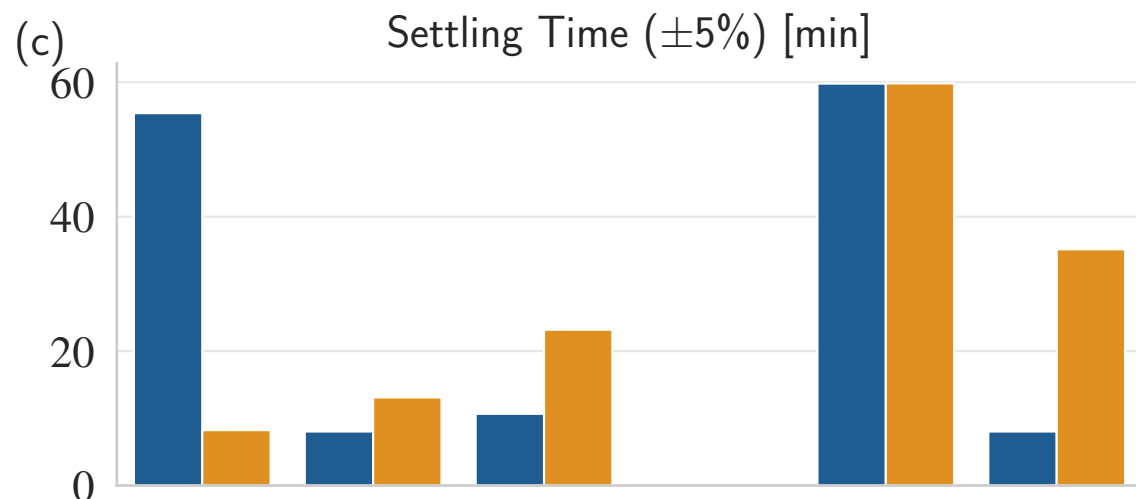
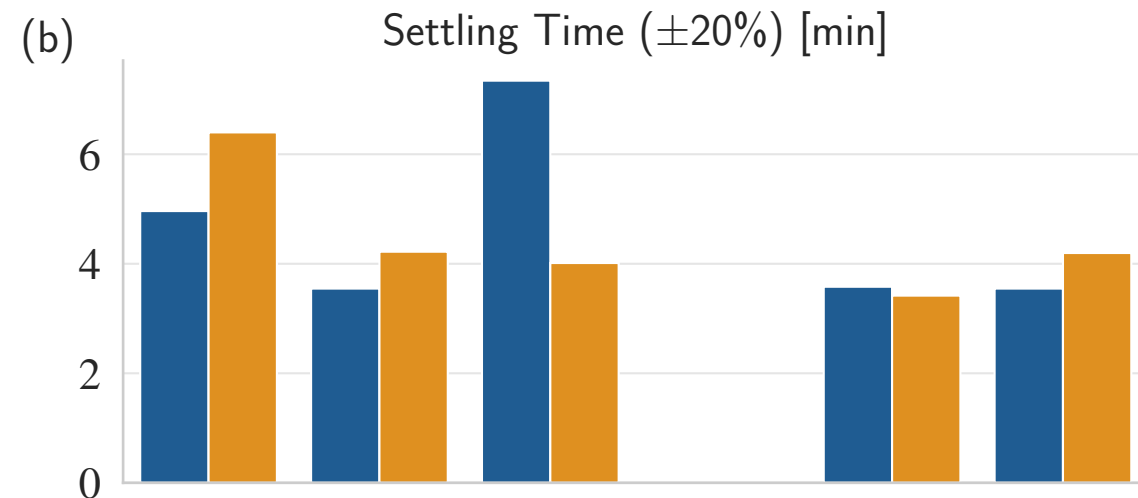


SVM-based PID

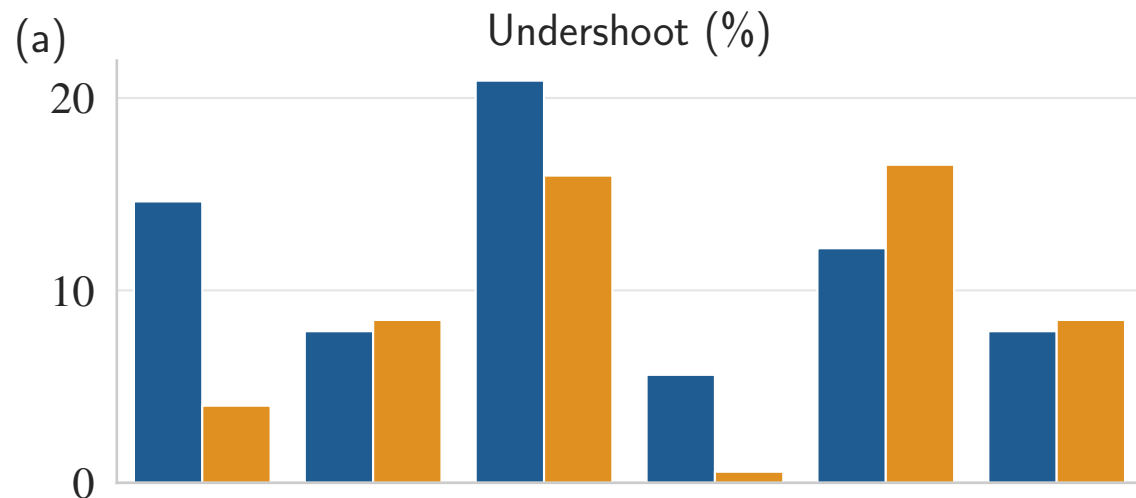

Ref 40 Ref 50 Ref 60 Ref Triangular Gaussian Noise Infusion Loss

Experiment Condition

Ref 40 Ref 50 Ref 60 Ref Triangular Gaussian Noise Infusion Loss

Experiment Condition