


2023

**JOURNEYMAN
OPEN
BOOK
EXAM #4**

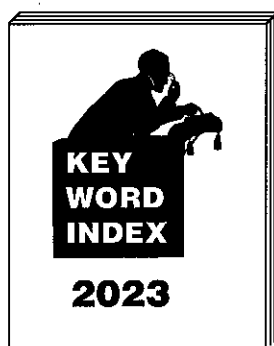

**25 QUESTIONS
TIME LIMIT - 1 HOUR**

TIME SPENT **MINUTES**

SCORE **%**

JOURNEYMAN OPEN BOOK EXAM #4 25 Questions One Hour Time Limit

1. One who has skills and knowledge related to the construction and operation of the electrical equipment and installations and has received safety training to recognize and avoid the hazards involved, is defined as a/an ____ person.

(a) grandfather (b) acceptable (c) qualified (d) parts changer

2. All outdoor outlets for dwellings, that are supplied by single-phase branch circuits rated 150 volts to ground or less, ____ amperes or less, shall have GFCI protection for personnel.

(a) 50 (b) 60 (c) 70 (d) 75

3. Type NM cable is permitted for use under all the following conditions or locations except ____.

**(a) in Type V construction (b) in a multifamily dwelling unit
(c) as a feeder (d) in a damp or wet location**

4. Direct-buried cables located in a trench below 2" of concrete shall have a minimum cover of ____.

(a) 6" (b) 12" (c) 18" (d) 24"

5. A 125 volt, 15 amp rated receptacle located in a hallway of a dwelling unit is required to be ____.

**(a) GFCI protected (b) on a dedicated circuit
(c) in need of a 20 amp receptacle (d) listed tamper-resistant**

6. Residential in sink electrically operated kitchen waste disposers shall be permitted to be cord-and-plug connected however, the flexible cord is to be not less than 18" in length and not over ____ in length.

(a) 24" (b) 30" (c) 36" (d) 48"

7. Isolated ground receptacles that incorporate an isolating equipment grounding conductor connection intended for the reduction of electrical noise or electromagnetic interference, shall be clearly identified by a/an ____ located on the face of the receptacle.

(a) green dot (b) yellow circle (c) red triangle (d) orange triangle

8. All conductors of a multiwire branch circuit shall originate from the same panelboard, simultaneously disconnect all ungrounded conductors and supply only line-to- ____ loads.

(a) line (b) ungrounded (c) primary (d) neutral

9. An unintentional, electrically conducting connection between an ungrounded conductor of an electrical circuit and the normally non-current-carrying conductors, metallic enclosures, metallic raceways, metallic equipment or earth is referred to as a/an ____.

(a) ground fault (b) open circuit (c) short circuit (d) circuit bypass

10. For temporary wiring, a box, conduit body, or other enclosure shall ____ for splices at tree lots and similar installations.

(a) not be permitted (b) be permitted (c) be required (d) not be required

11. Where no GFCI protection is provided, the mounting height of a paddle fan located above a spa or hot tub shall not be less than ____ feet.

(a) 6 (b) 8 (c) 10 (d) 12

12. Rooms or areas of dwelling units shall be protected by a listed combination-type arc-fault circuit interrupter to provide protection of the entire ____.

(a) feeder (b) branch circuit (c) service (d) load center

13. Equipment or materials to which has been attached a symbol, or other identifying mark of an organization that is acceptable to the authority having jurisdiction. This mark is ____.

(a) labeled (b) suitable (c) acceptable (d) identified

14. All 15 and 20 amp, 125 and 250 volt, nonlocking receptacles located in a wet location shall be listed ____ type.

(a) weather proof (b) water proof (c) water resistant (d) weather resistant

15. The permitted demand factor for five household clothes dryers in a multifamily dwelling is ____.

(a) 70% (b) 75% (c) 80% (d) 85%

16. A controller that includes motor overload protection ____ for group motor application shall be marked with the motor overload protection and the maximum branch-circuit short-circuit and ground-fault protection for such applications.

(a) required (b) recognized (c) permitted (d) suitable

17. Type UF cable is permitted to be used ____.

- (a) as service entrance (b) in commercial garages
(c) where subject to physical damage (d) for wiring in wet, dry, or corrosive locations

18. Cables with entirely nonmetallic sheaths shall be permitted to enter the top of a surface-mounted enclosure through one or more nonflexible raceways not less than ____ and not more than 10 feet in length, provided all conditions are met.

- (a) 12" (b) 16" (c) 18" (d) 24"

19. Utilization equipment weighing not more than 6 pounds shall be permitted to be supported on other boxes or plaster rings that are secured to other boxes, provided the equipment or its supporting yoke is secured to the box with no fewer than two ____ or larger screws.

- (a) #6 (b) #8 (c) #10 (d) #12

20. Nonmetallic cable trays shall be made of ____ material.

- (a) watertight (b) waterproof (c) fire-resistant (d) flame-retardant

21. For dwelling units, outdoor receptacles that are not ____ and are supplied by a branch circuit dedicated to snow-melting equipment are required to have GFCI protection for personnel.

- (a) accessible (b) guarded (c) covered (d) readily accessible

22. For a service rated 100 through 400 amps, the service conductors supplying the entire load of a one family dwelling shall be permitted to have an ampacity of ____ of the service rating.

- (a) 83% (b) 80% (c) 75% (d) 70%

23. AFCI protection is required for all 15 and 20 amp receptacles located in all the following except ____.

- (a) residential garages (b) patient sleeping rooms (c) dormitory closets (d) guest suites

24. One or more metal in-ground support structure(s) in direct contact with the earth vertically for ____ feet or more, with or without concrete encasement is a permitted grounding electrode.

- (a) 6 (b) 8 (c) 10 (d) 12

25. Which of the following cord types is permitted in wet location and is sunlight resistant?

- (a) SPT-2 (b) STOOW (c) THWN (d) XHWN

