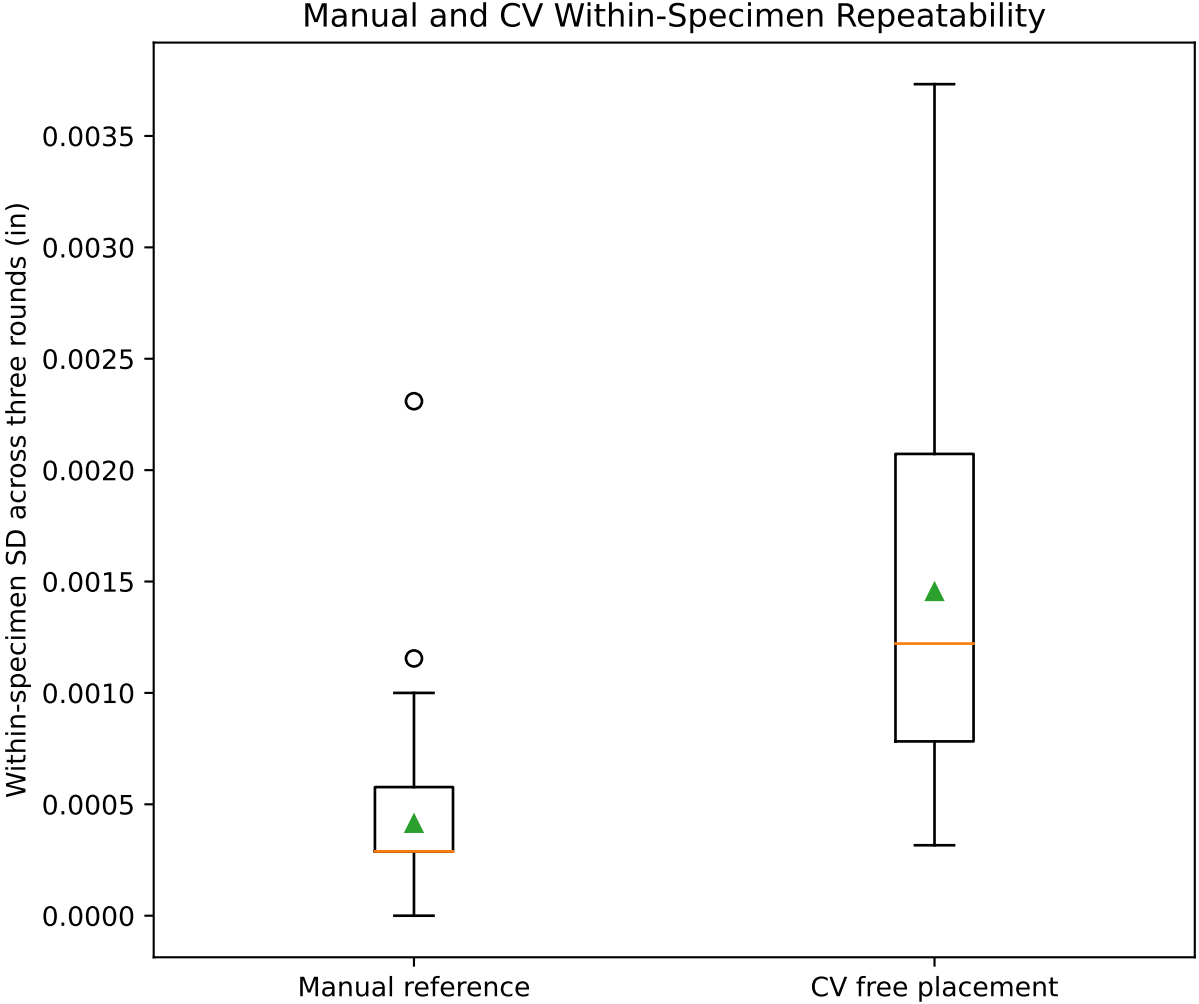
Manual and CV Within-Specimen Repeatability
Within-specimen SD across three rounds (in)
0.0035
0.0030
0.0025
0.0020
0.0015
0.0010
0.0005
0.0000
Manual reference
CV free placement