


Open19 power distribution update



Joniak 1/20/2022

Updates on power shelf connection

- Received updated panel with available space from Vertiv team
 - Finalized fit into given panel with vertiv
 - 10mm space for finger access to latch
 - Moved wall for clearance of 7mm diameter M3 washer

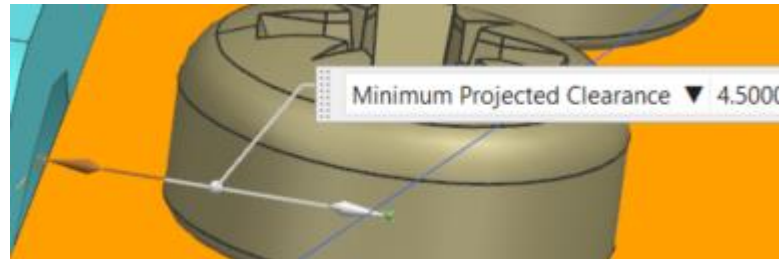

Power shelf locations


- Power shelf locations on top and bottom of rack
 - cables going up on lower shelf
 - cables going down on upper rack

48		
47		
46	Reserved for hotel	Reserved for hotel
45		
44		
43		Power shelf
42		
41		
40		
39	8u Cage OR Spine	
38	Infrastructure	8u Cage OR Spine
37		Infrastructure
36	Power shelf	
35		
34		
33		
32		
31		
30		
29		
28		
27	8u Cage	8u Cage
26	ToR	ToR
25	ToR	ToR
24		
23		
22		
21		
20		
19		
18		
17	8u Cage	8u Cage OR Spine Infrastructure
16		
15	Power shelf	
14		
13		
12		
11		
10		
9		8u Cage
8		
7	8u Cage	Power shelf
6		
5		
4		
3	Reserved for Cooling and/or	Reserved for Cooling and/or
2	Donate to ESU	Donate to ESU
1		

Up/up
Down/down


molex

Wiring chart for top and bottom power shelf location

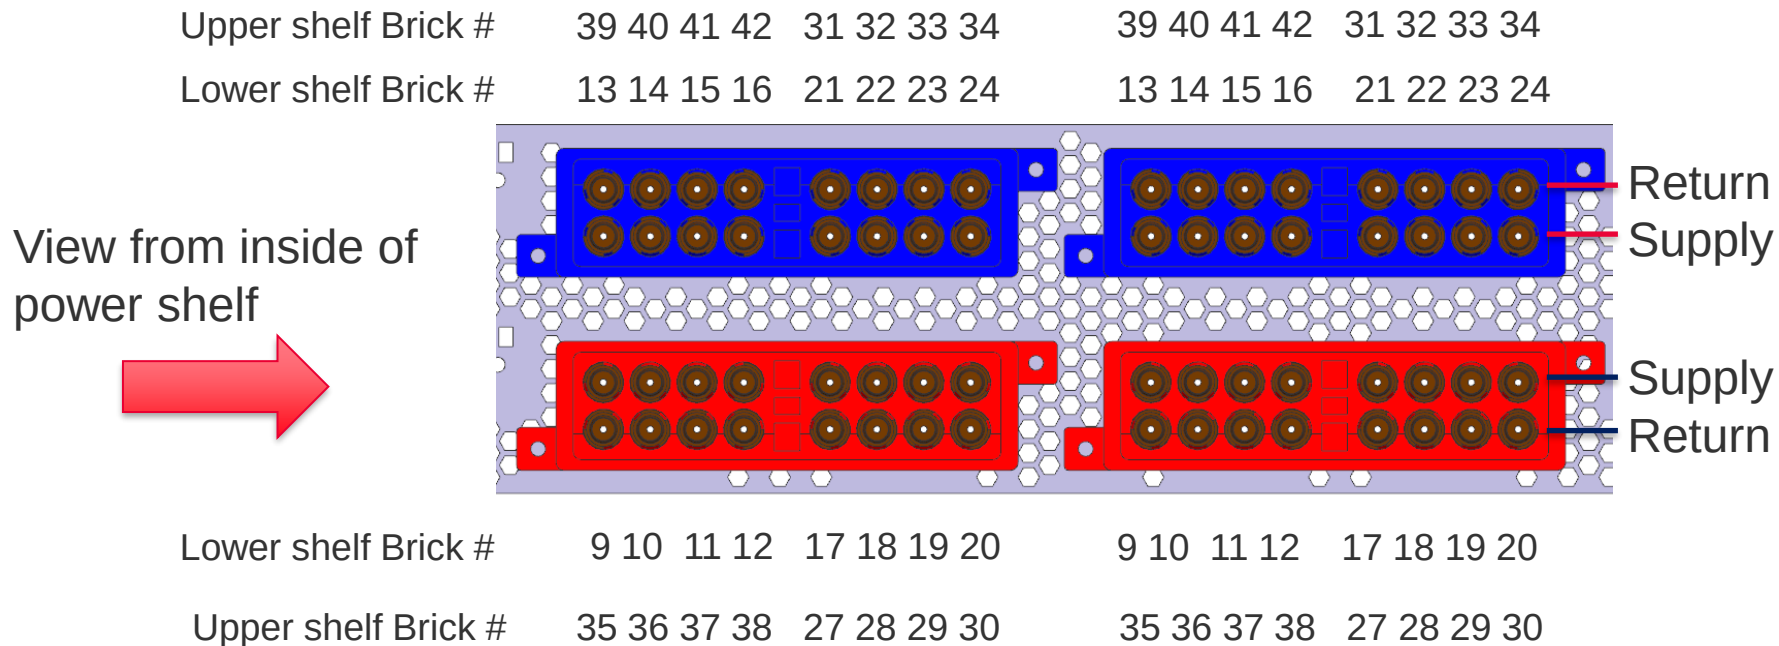


Updates on brick side connection


- Collaboration between brick vendors to add polarization on cable
- Adding keying to cable so 35 amp cable can not plug into 70 amp brick

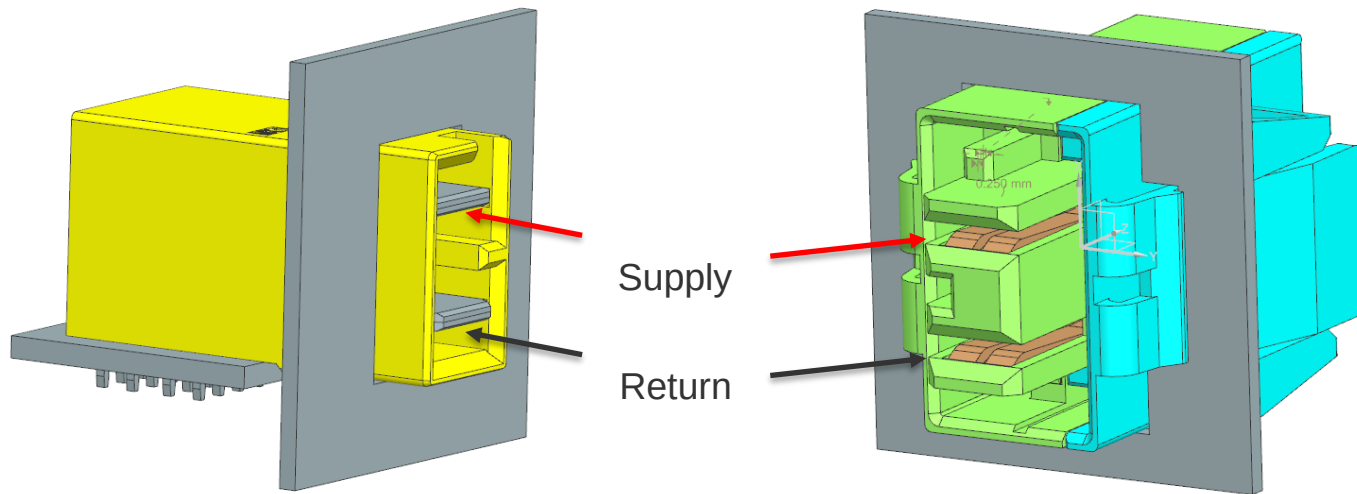


Brick key review

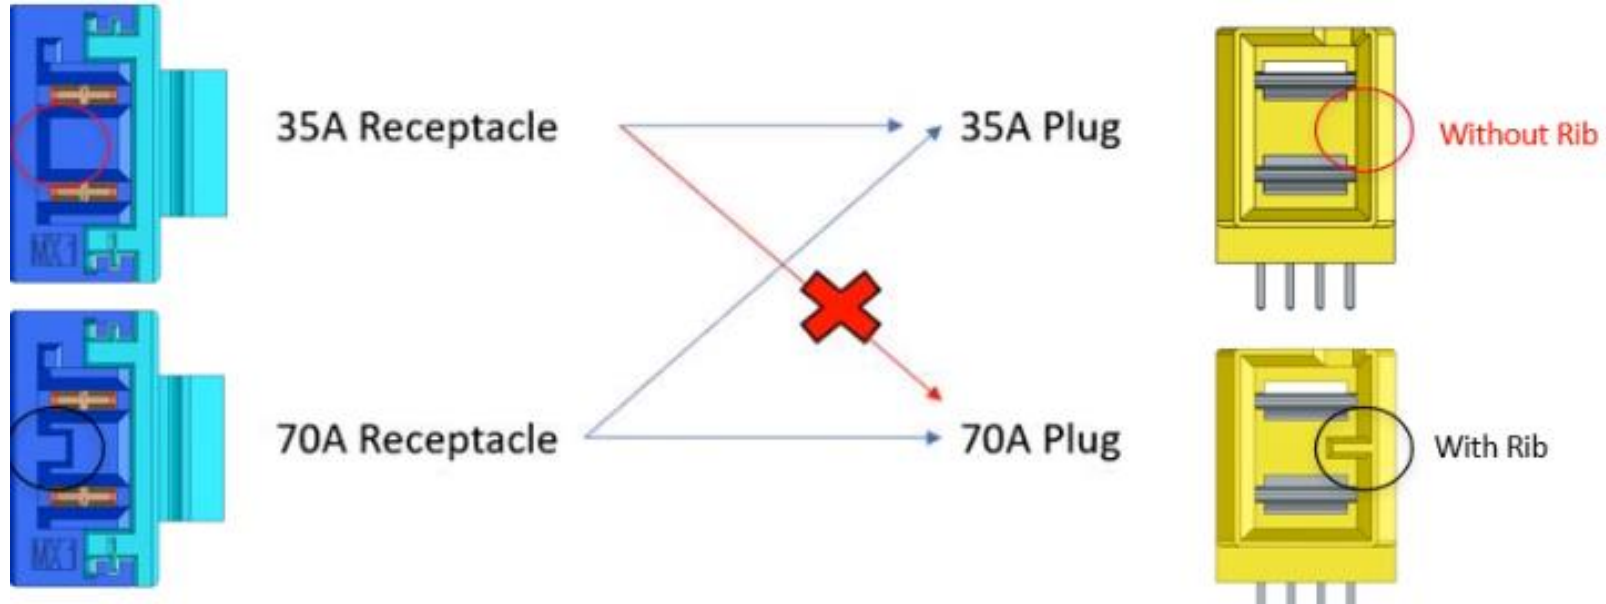

Updates on brick panel cutout new vs old


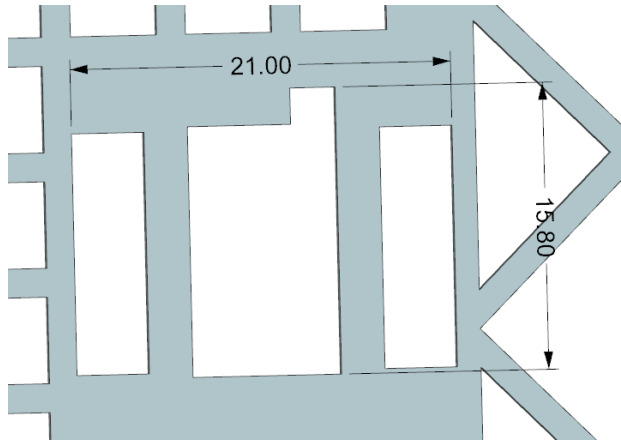


Old

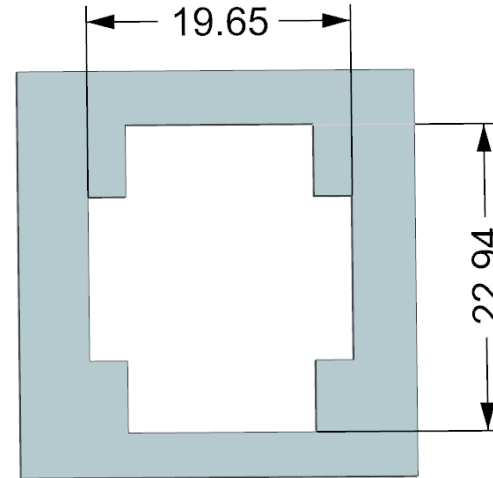

Proposed



Adding keying for cable polarization

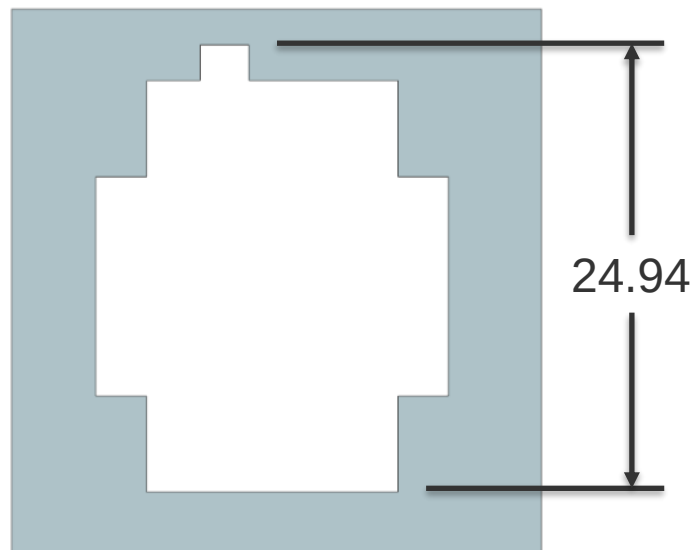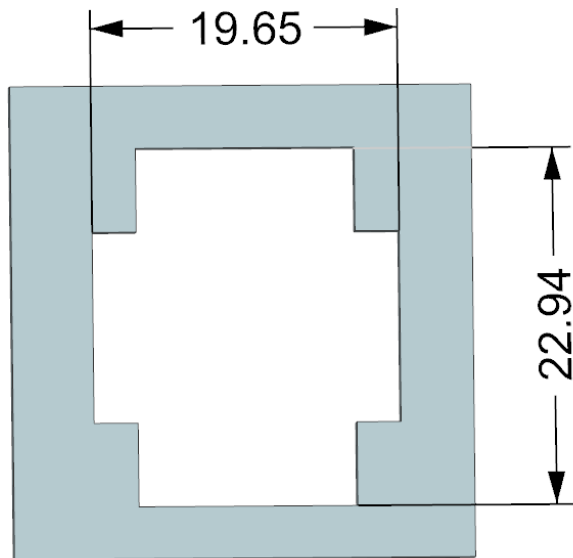

Added 2mm key


Supplying cable models

- Supplied models to be used for agreement on locations and interferences

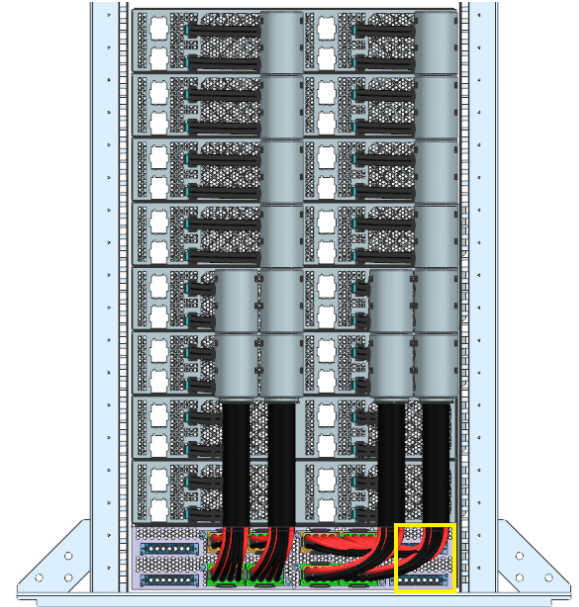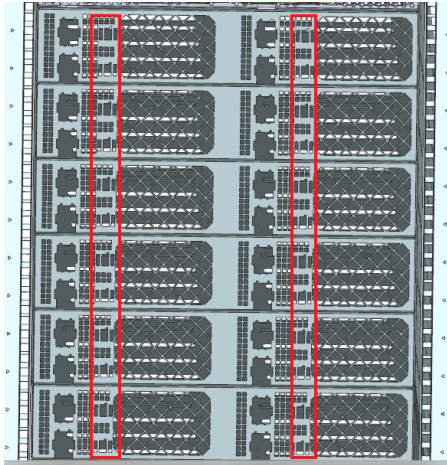

Prototypes

- Working towards a 60 pc cable sample build for Equinix build in June
- Have assembled power shelf male and female prototypes
- Have assembled brick side cable prototypes
 - Inserted into new panel cutout

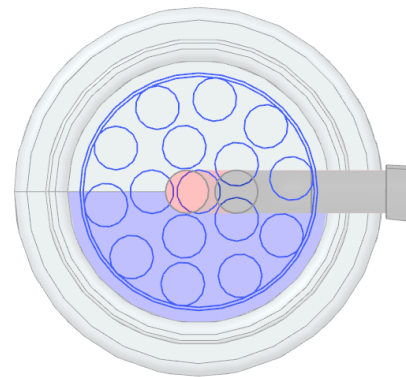


Used wire dia of 6.9mm.
Even all wires are placed
with enough clearance


Power shelf prototypes



Male cable end

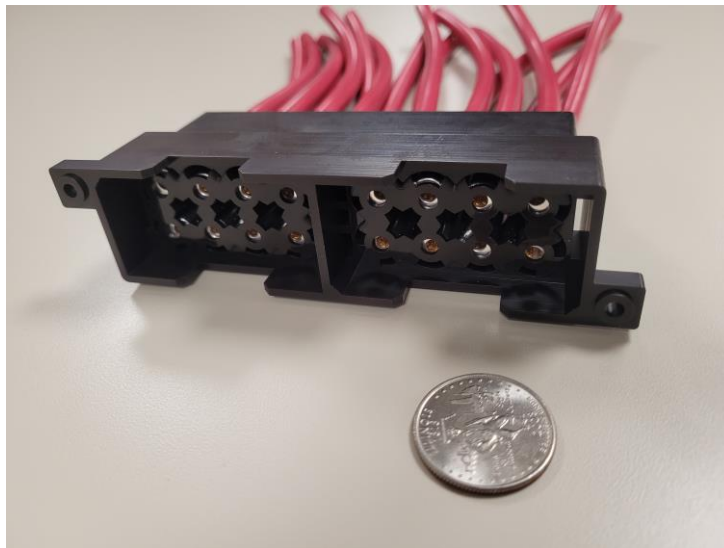


Female panel

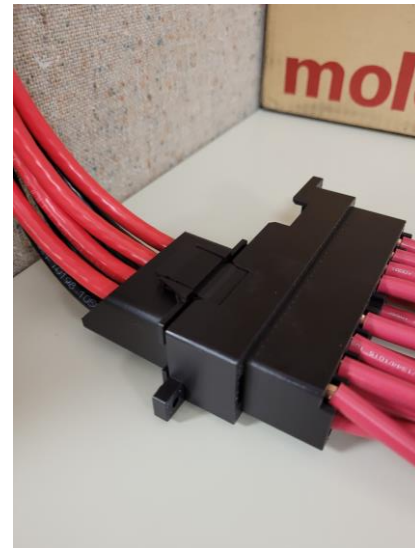

Mated

Brick side prototype

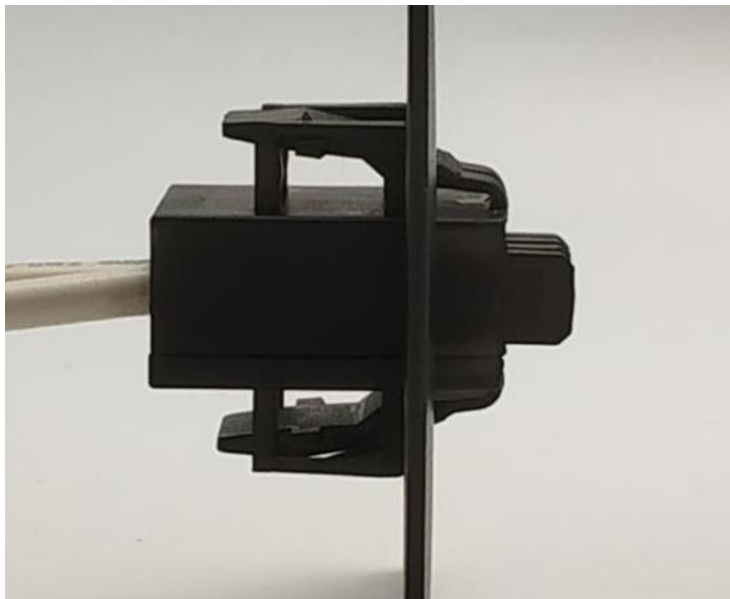

Proto used SLA housing and panel
With 10AWG wires due to available contacts

Cable management spine prototype



Liquid cooling questions



Has liquid cooling piping been rerouted , if not what is minimum distance for cable allowance?