OVERALL ONE-LINE DIAGRAM — TRANSMISSION INTERCONNECTION AND PRIMARY CAMPUS DISTRIBUTION

REV	DATE	DESCRIPTION	BY	CK
2	04/2026	ENHANCED CAD-STYLE DETAILING	JDS	RKM
1	04/2026	ISSUED FOR INTERCONNECTION REVIEW	JDS	RKM

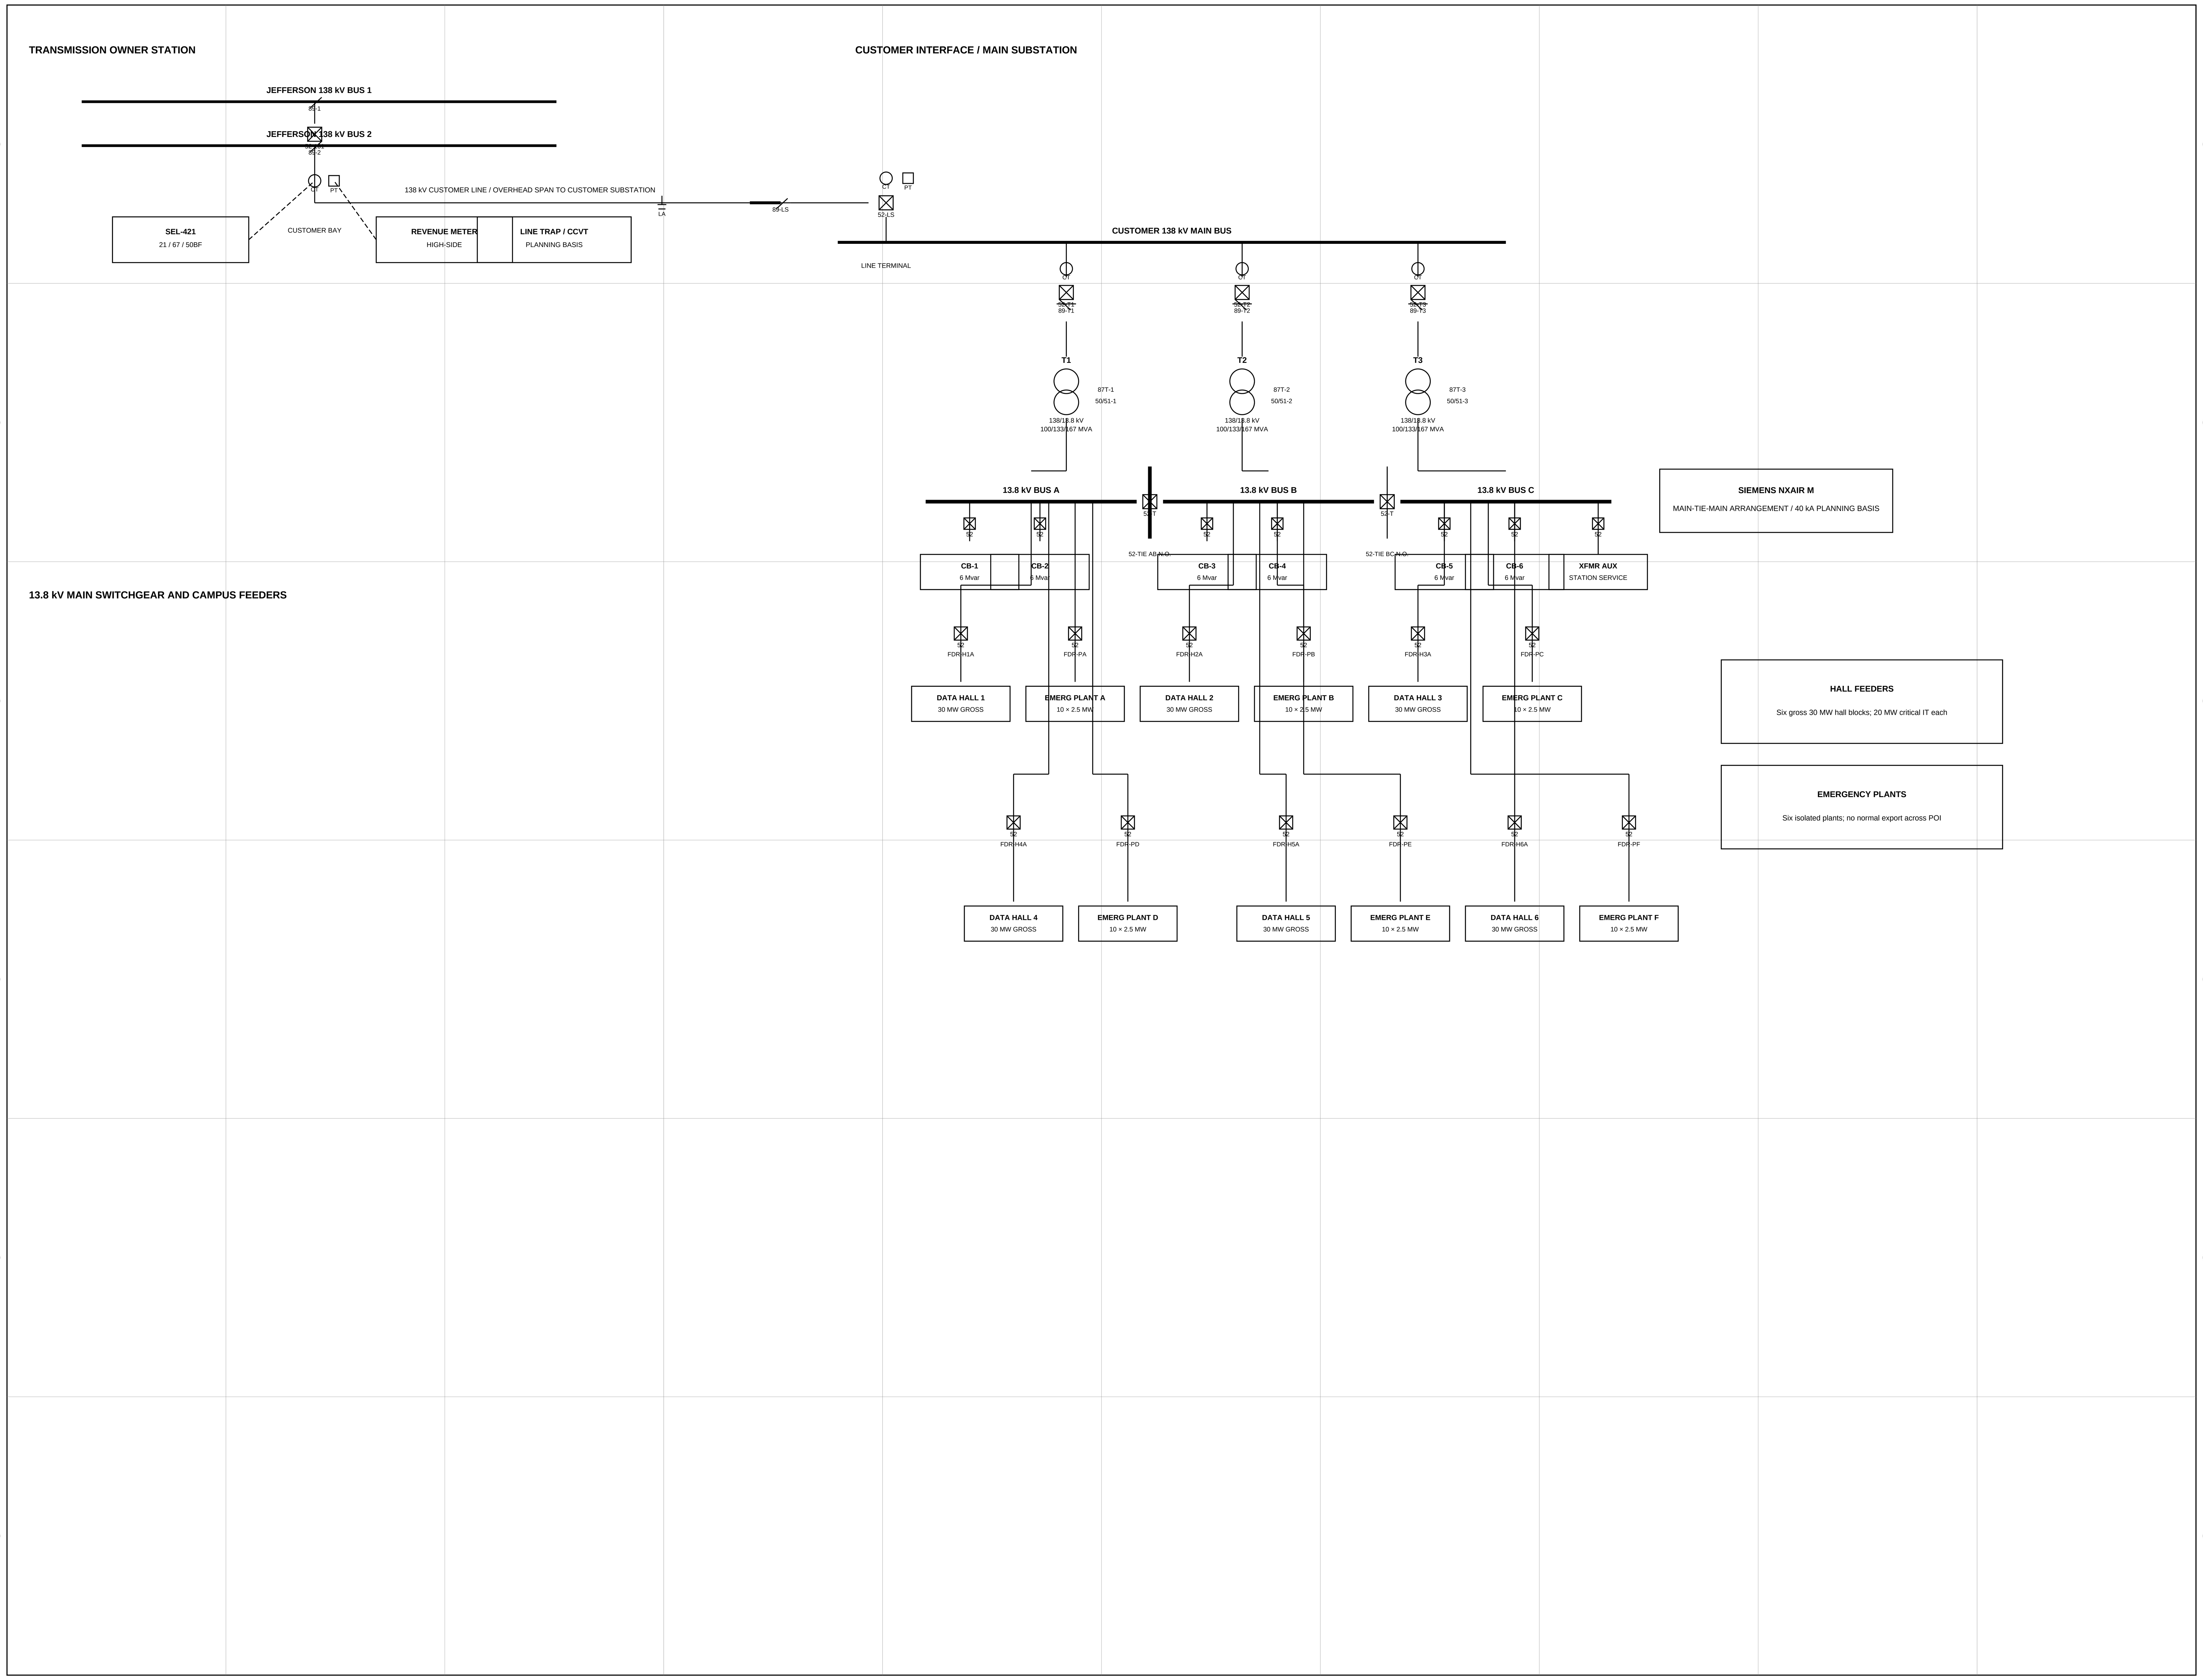

GENERAL NOTES

1. This one-line is a planning-level drawing intended to depict the proposed utility interconnection and primary campus distribution topology.
2. Device numbers, CT/PT ratios, and relay model families are shown to convey engineering intent only. Final values will be established during detailed design and utility review.
3. Tie breakers between main 13.8 kV bus sections are normally open except during approved transfer, maintenance, or commissioning conditions.
4. Emergency generation is for standby service only. No routine export or merchant operation across the point of interconnection is proposed.

SYSTEM	RATING / BASIS	QTY
Main transformers	138/13.8 kV, 100/133/167 MVA	3
Main switchgear buses	13.8 kV sectionalized	3
Capacitor steps	6 Mvar each	6
Hall feeder groups	30 MW gross / 20 MW IT	6
Emergency plants	10 × 2.5 MW each	6

ABBREV.	DESCRIPTION
52	AC CIRCUIT BREAKER
89	DISCONNECT SWITCH
CT	CURRENT TRANSFORMER
PT	POTENTIAL TRANSFORMER
LA	SURGE ARRESTER
87T	TRANSFORMER DIFFERENTIAL
50/51	INSTANTANEOUS / TIME OVERCURRENT
50BF	BREAKER FAILURE

BURNS & McDONNELL

PRAIRIE HORIZON DATA CAMPUS

OVERALL ONE-LINE DIAGRAM — TRANSMISSION INTERCONNECTION AND PRIMARY CAMPUS DISTRIBUTION

OWNER: Prairie Horizon Digital Infrastructure LLC | SITE: Fayette County, Ohio | ENGINEER: Burns & McDonnell Engineering Company, Inc.

PROJECT NO.	DRAWN	CHK	DATE	REV	STATUS	SCALE	SHEET	ISSUE
PHDC-LL-2026-017	JDS	RKM	04/2026	2	PRELIM	NTS	E-101	ISSUED FOR INTERCONNECTION REVIEW

138 kV INTERCONNECTION BAY, RELAYING, AND REVENUE METERING — FUNCTIONAL ONE-LINE

REV	DATE	DESCRIPTION	BY	CK
2	04/2026	ENHANCED CAD-STYLE DETAILING	JDS	RKM
1	04/2026	ISSUED FOR INTERCONNECTION REVIEW	JDS	RKM

UTILITY STATION / CUSTOMER BAY FUNCTIONAL ARRANGEMENT

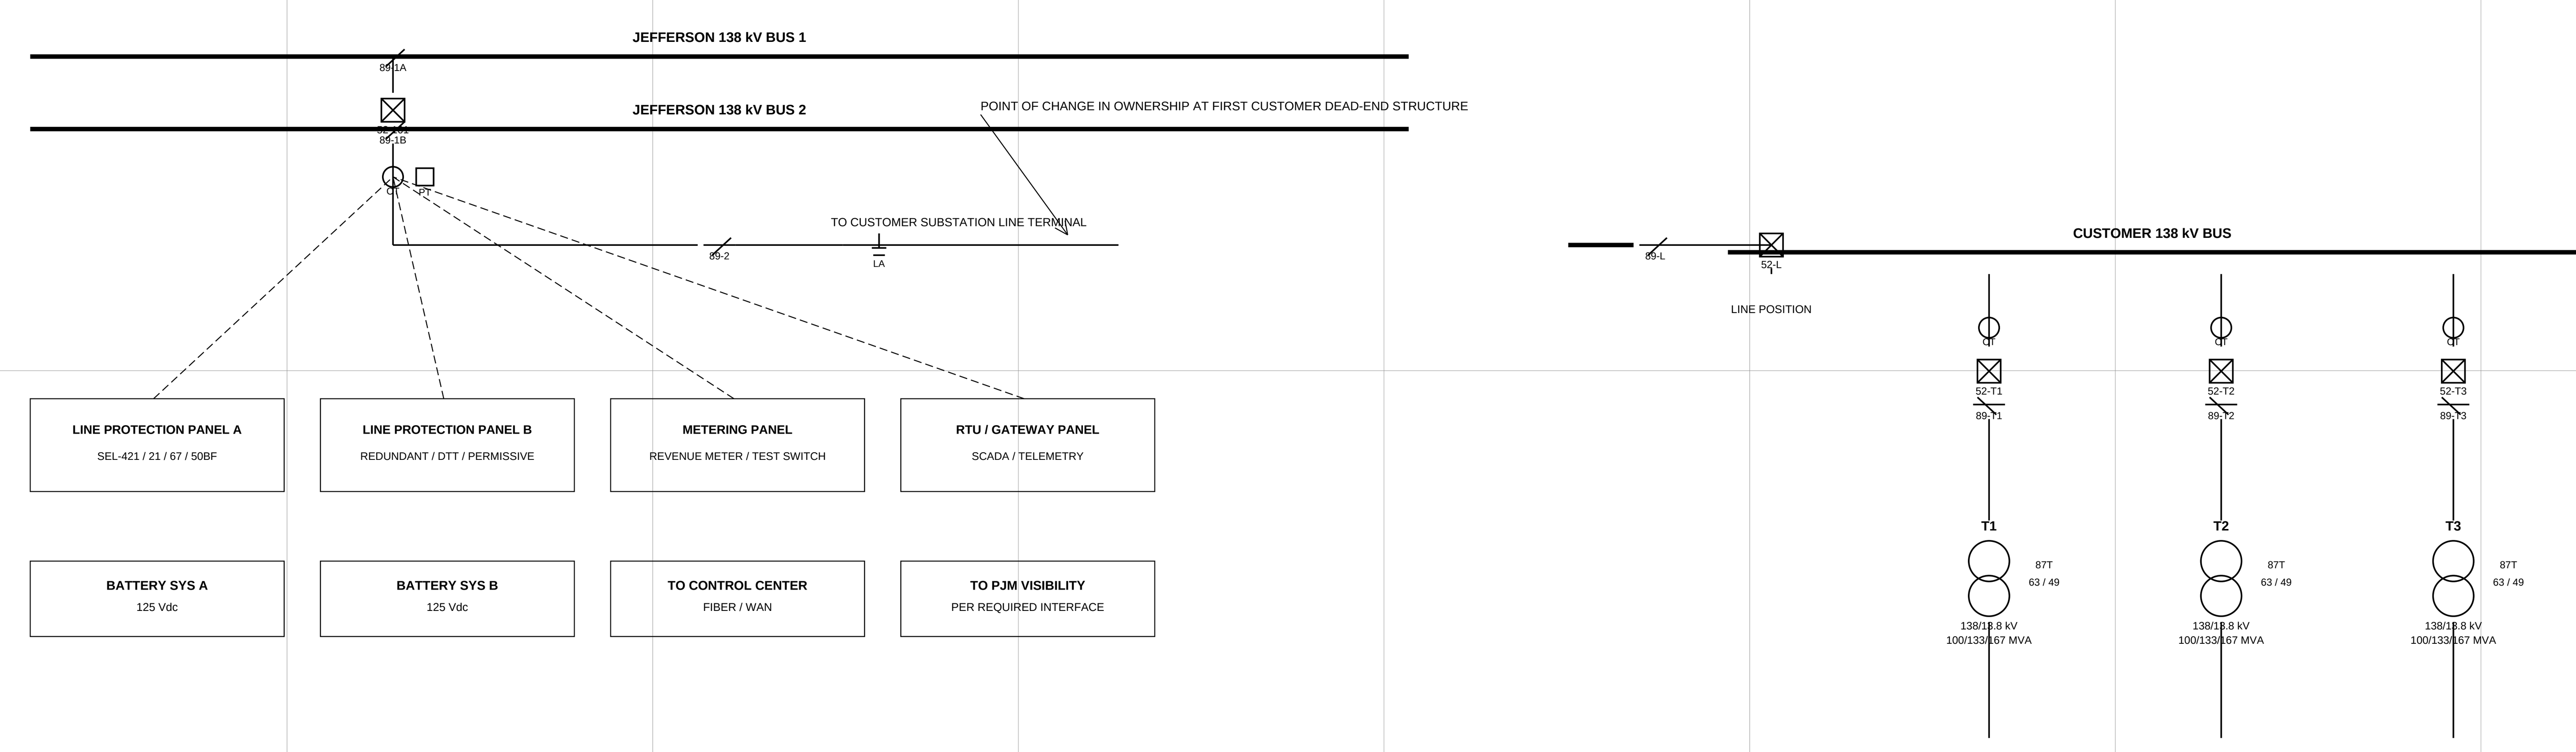

DEVICE	DESCRIPTION	ASSUMED FUNCTION
52-101	CUSTOMER BAY BREAKER	Primary bay interrupting device at Jefferson 138 kV Station
89-1A/1B	BUS DISCONNECTS	Breaker-and-a-half bay isolation
89-2	LINE DISCONNECT	Customer line isolation
METERING PANEL	REVENUE METER AND TEST SWITCH	Settlement metering using high-side CT/PT
RTU / GATEWAY	OPERATIONS TELEMETRY	MW, Mvar, V, I, breaker status, alarms

METERING / RELAYING NOTES

1. Revenue metering is shown at the high side of the customer interconnection in accordance with the planning basis for TO-approved settlement metering.
2. Redundant line-protection panels are indicated to represent a typical utility-grade application using communications-assisted tripping.
3. RTU / gateway panel provides real-time operations visibility to the transmission owner and other approved interfaces.
4. Final current-transformer ratios, potential-transformer ratios, and protective-relay settings will be established during detailed design.

SIGNAL	SOURCE
POI MW / Mvar	Revenue meter / RTU
POI kV	PT input
Breaker status	52-101 / 52-L / 52-T1-3
Alarms	Relay panels / battery systems
Event records	Protection relays / SOE

BURNS & McDONNELL

PRAIRIE HORIZON DATA CAMPUS

138 kV INTERCONNECTION BAY, RELAYING, AND REVENUE METERING — FUNCTIONAL ONE-LINE

OWNER: Prairie Horizon Digital Infrastructure LLC | SITE: Fayette County, Ohio | ENGINEER: Burns & McDonnell Engineering Company, Inc.

PROJECT NO.	DRAWN	CHK	DATE	REV	STATUS	SCALE	SHEET	ISSUE
PHDC-LL-2026-017	JDS	RKM	04/2026	2	PRELIM	NTS	E-102	ISSUED FOR INTERCONNECTION REVIEW

TYPICAL DATA HALL A/B POWER PATHS AND EMERGENCY GENERATION — FUNCTIONAL ONE-LINE

REV	DATE	DESCRIPTION	BY	CK
2	04/2026	ENHANCED CAD-STYLE DETAILING	JDS	RKM
1	04/2026	ISSUED FOR INTERCONNECTION REVIEW	JDS	RKM

TYPICAL NORMAL POWER PATHS (A AND B)

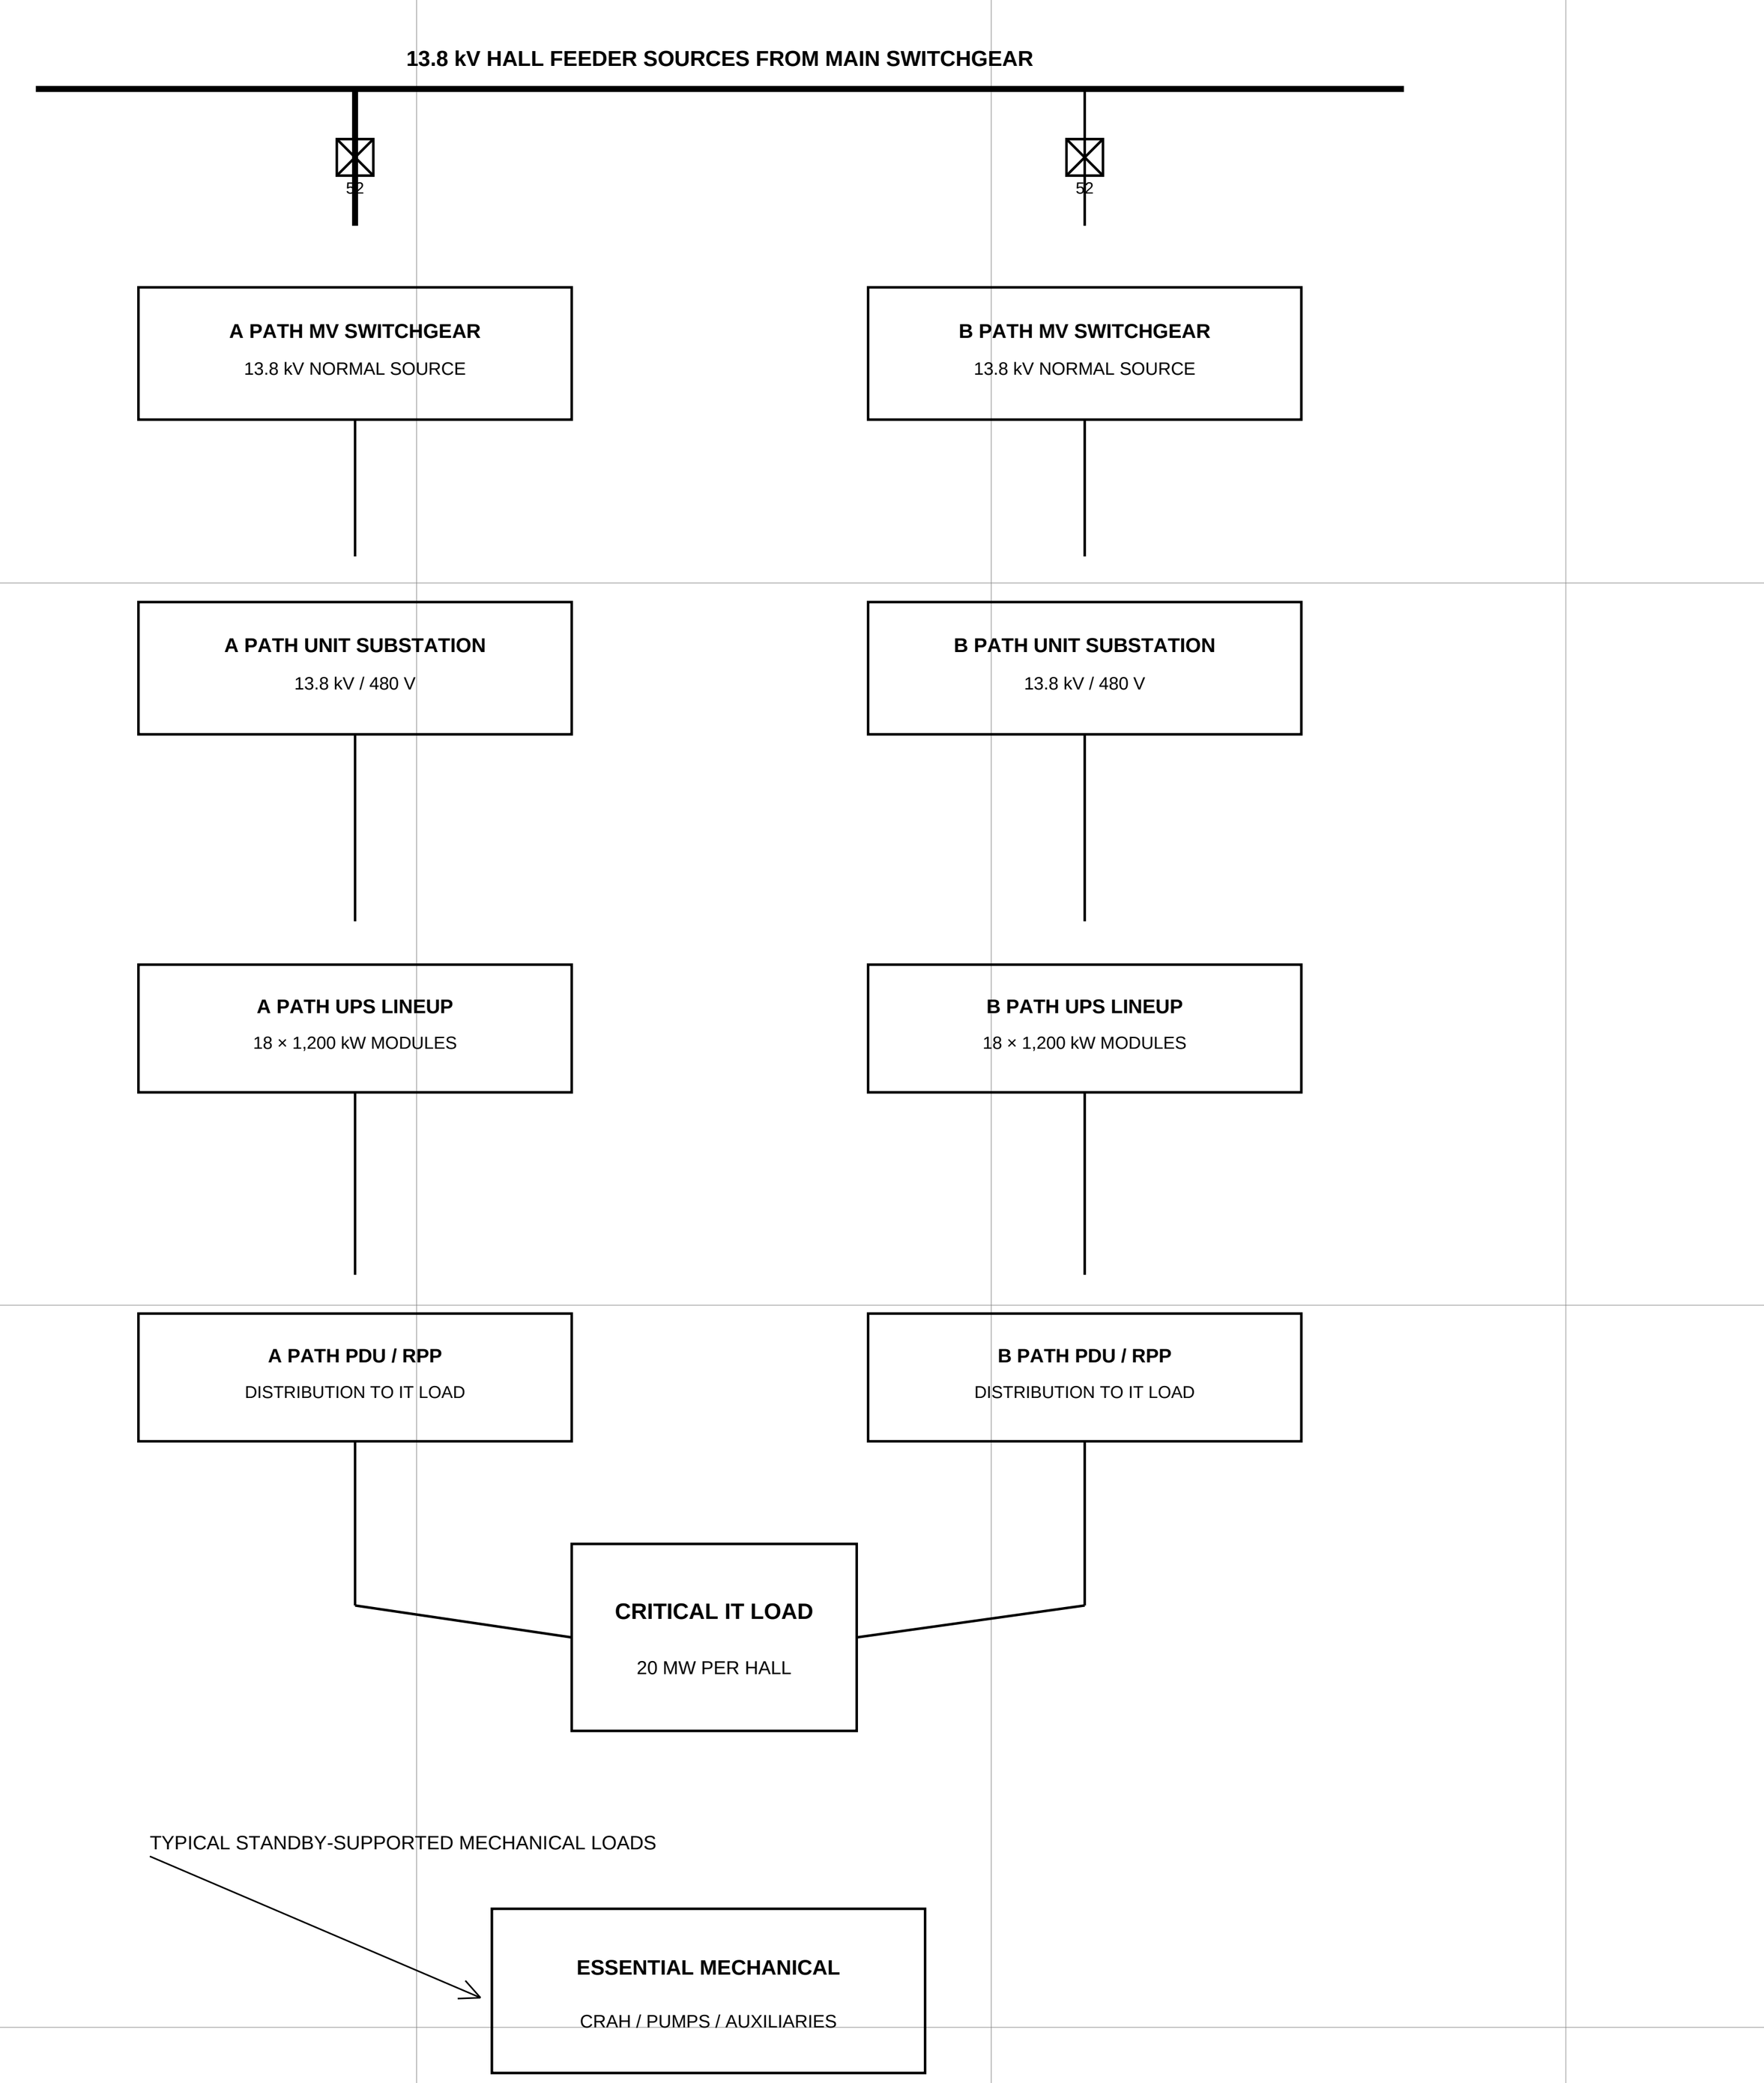

TYPICAL HALL EMERGENCY POWER PLANT

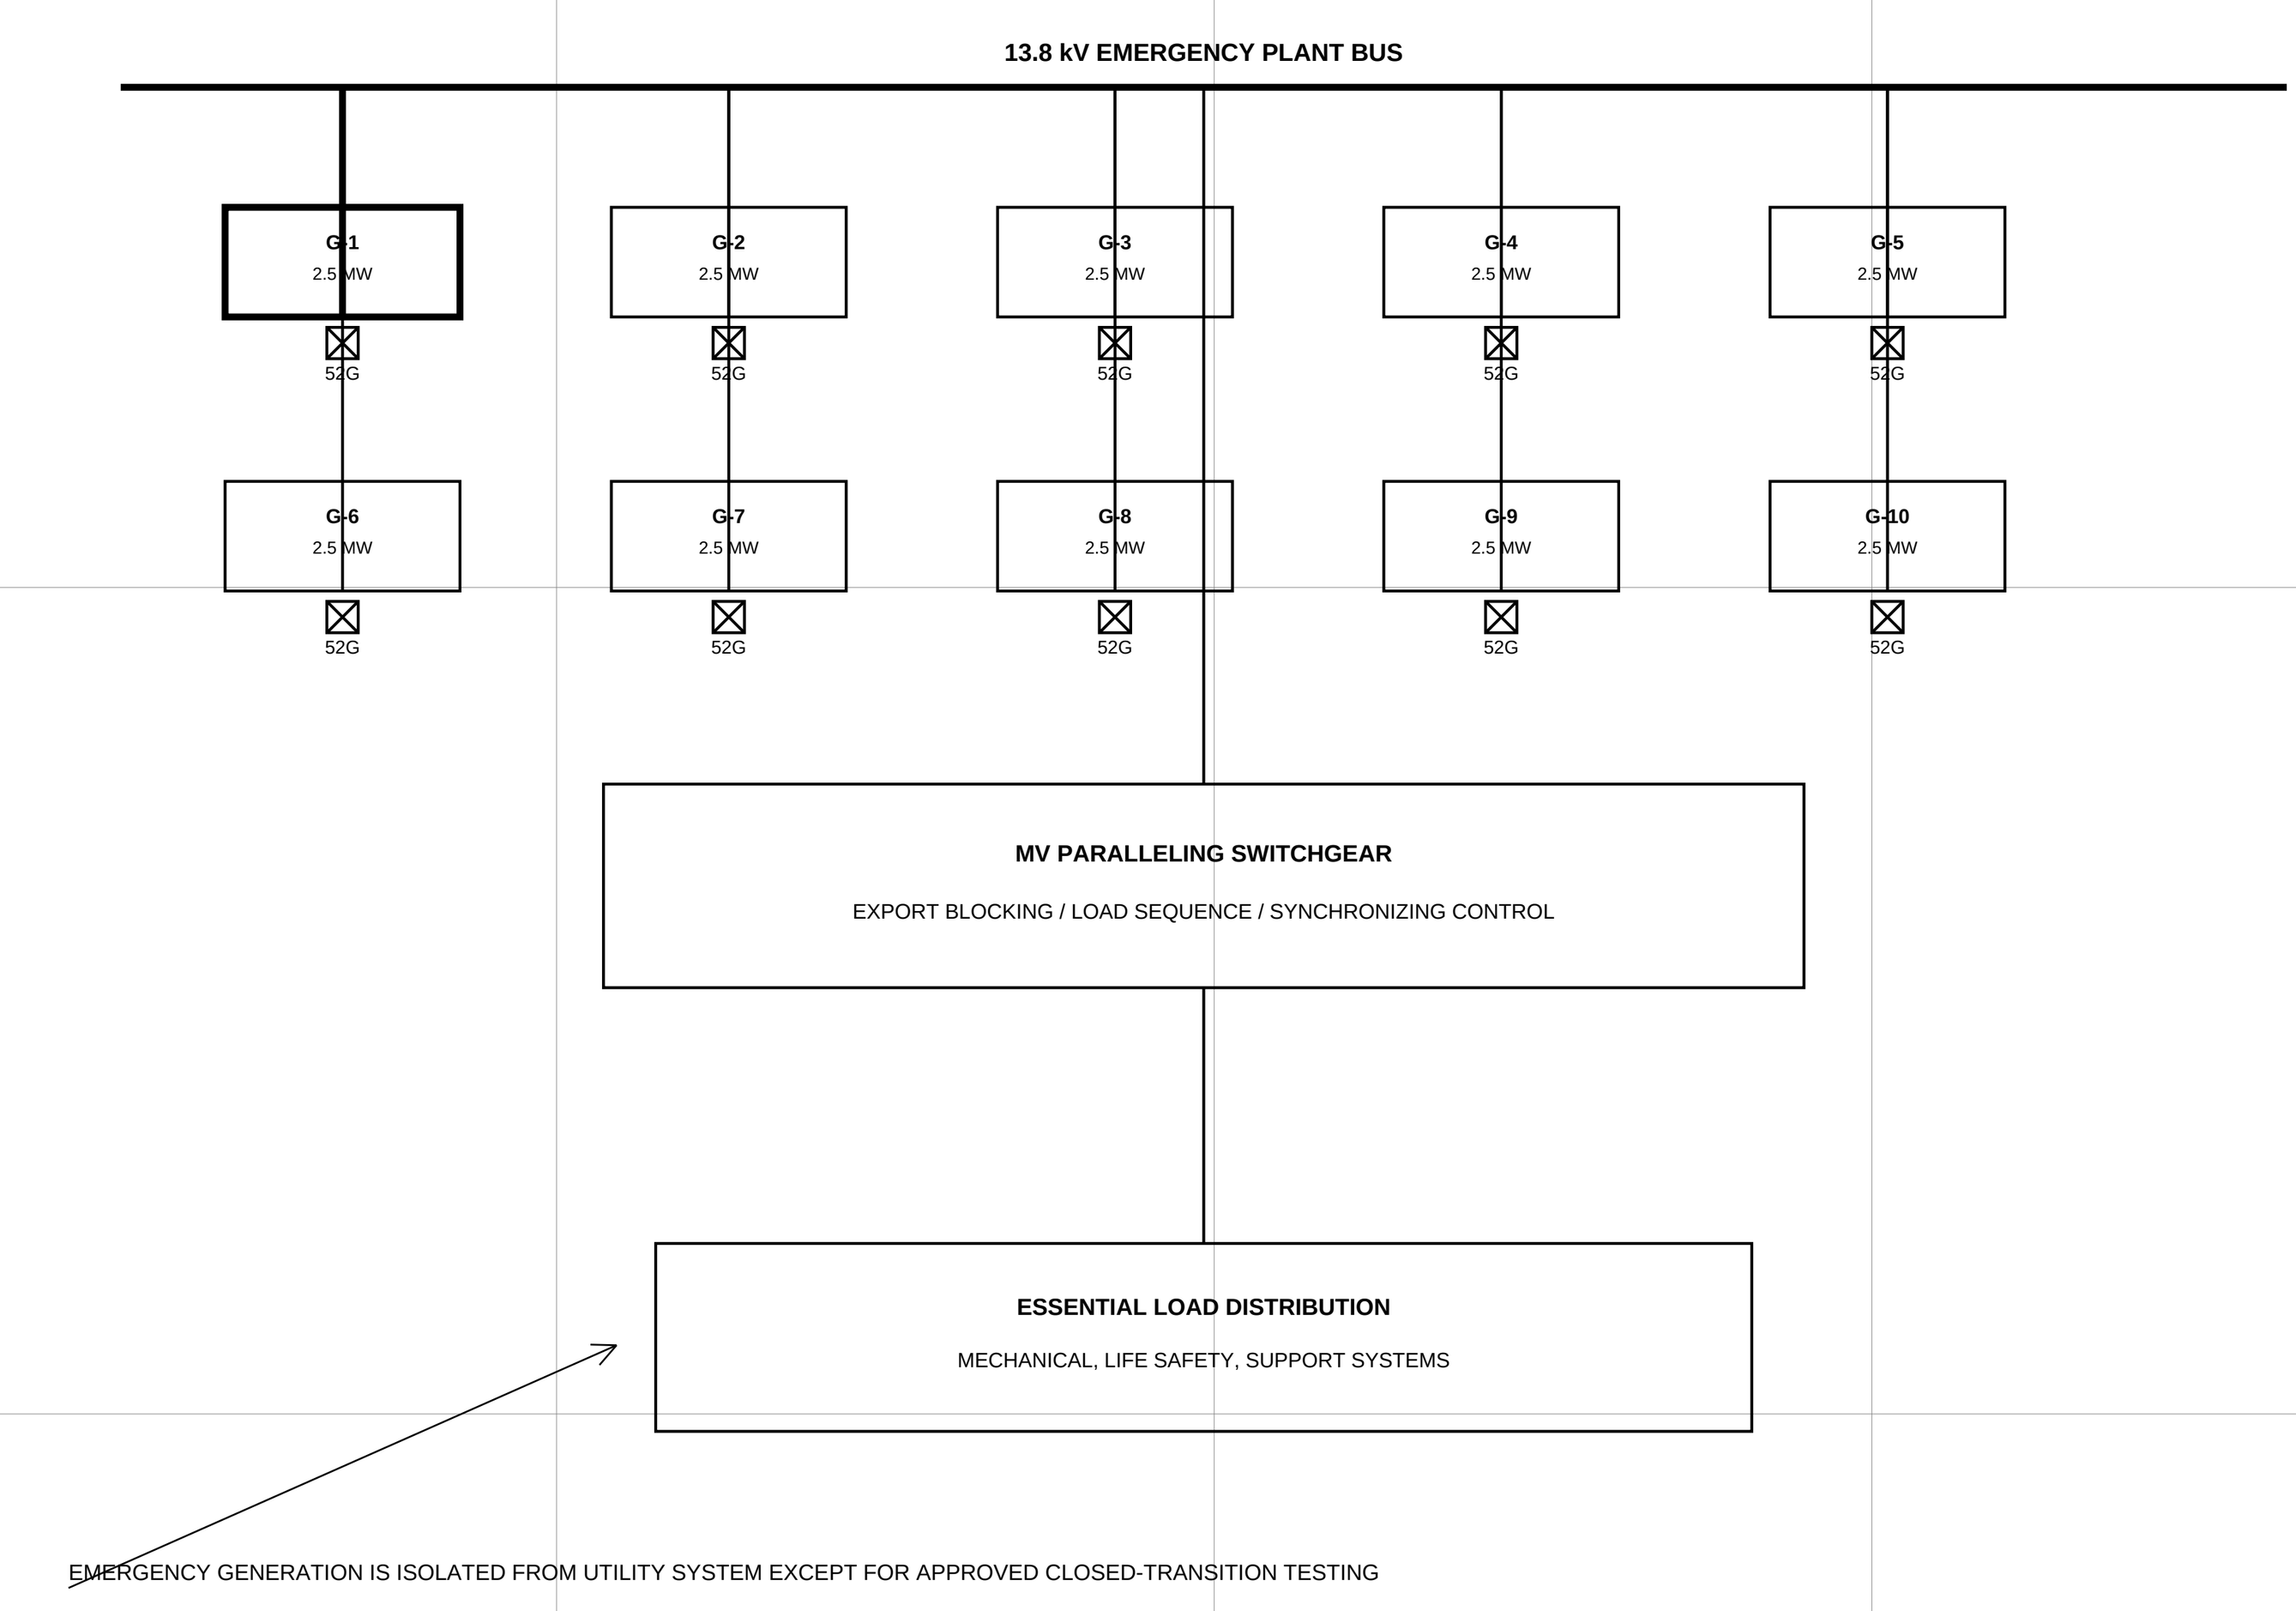

ABBREV.	DESCRIPTION
UPS	UNINTERRUPTIBLE POWER SUPPLY
PDU	POWER DISTRIBUTION UNIT
RPP	REMOTE POWER PANEL
MV	MEDIUM VOLTAGE
STS	STATIC TRANSFER SWITCH (WHERE APPLICABLE)

TYPICAL HALL ITEM	PLANNING BASIS
Hall gross load	30 MW
Critical IT load	20 MW
UPS modules	36 total per hall; 18 per A path and 18 per B path
Emergency generators	10 per hall emergency plant
Normal service voltage	13.8 kV
UPS output distribution	480 V critical power distribution

DETAIL NOTES

1. Sheet depicts a functional one-line for a representative data hall and its associated emergency power plant. It is intended to describe the design basis only.
2. Critical IT load is served by dual A/B UPS paths. Essential mechanical and support loads are coordinated with the emergency power plant as shown.
3. Downstream switchboards, PDUs, RPPs, static transfer details, and final low-voltage protective devices are omitted from this functional diagram.

BURNS & McDONNELL	PRAIRIE HORIZON DATA CAMPUS	PROJECT NO.	DRAWN	CHK	DATE	REV	STATUS	SCALE	SHEET	ISSUE
	TYPICAL DATA HALL A/B POWER PATHS AND EMERGENCY GENERATION — FUNCTIONAL ONE-LINE	PHDC-LL-2026-017	JDS	RKM	04/2026	2	PRELIM	NTS	E-103	ISSUED FOR INTERCONNECTION REVIEW
	OWNER: Prairie Horizon Digital Infrastructure LLC | SITE: Fayette County, Ohio | ENGINEER: Burns & McDonnell Engineering Company, Inc.									