


OVERALL CIVIL / ELECTRICAL SITE PLAN

REV	DATE	DESCRIPTION	BY	CK
2	04/2026	ENHANCED CAD-STYLE DETAILING	JDS	RKM
1	04/2026	ISSUED FOR INTERCONNECTION REVIEW	JDS	RKM

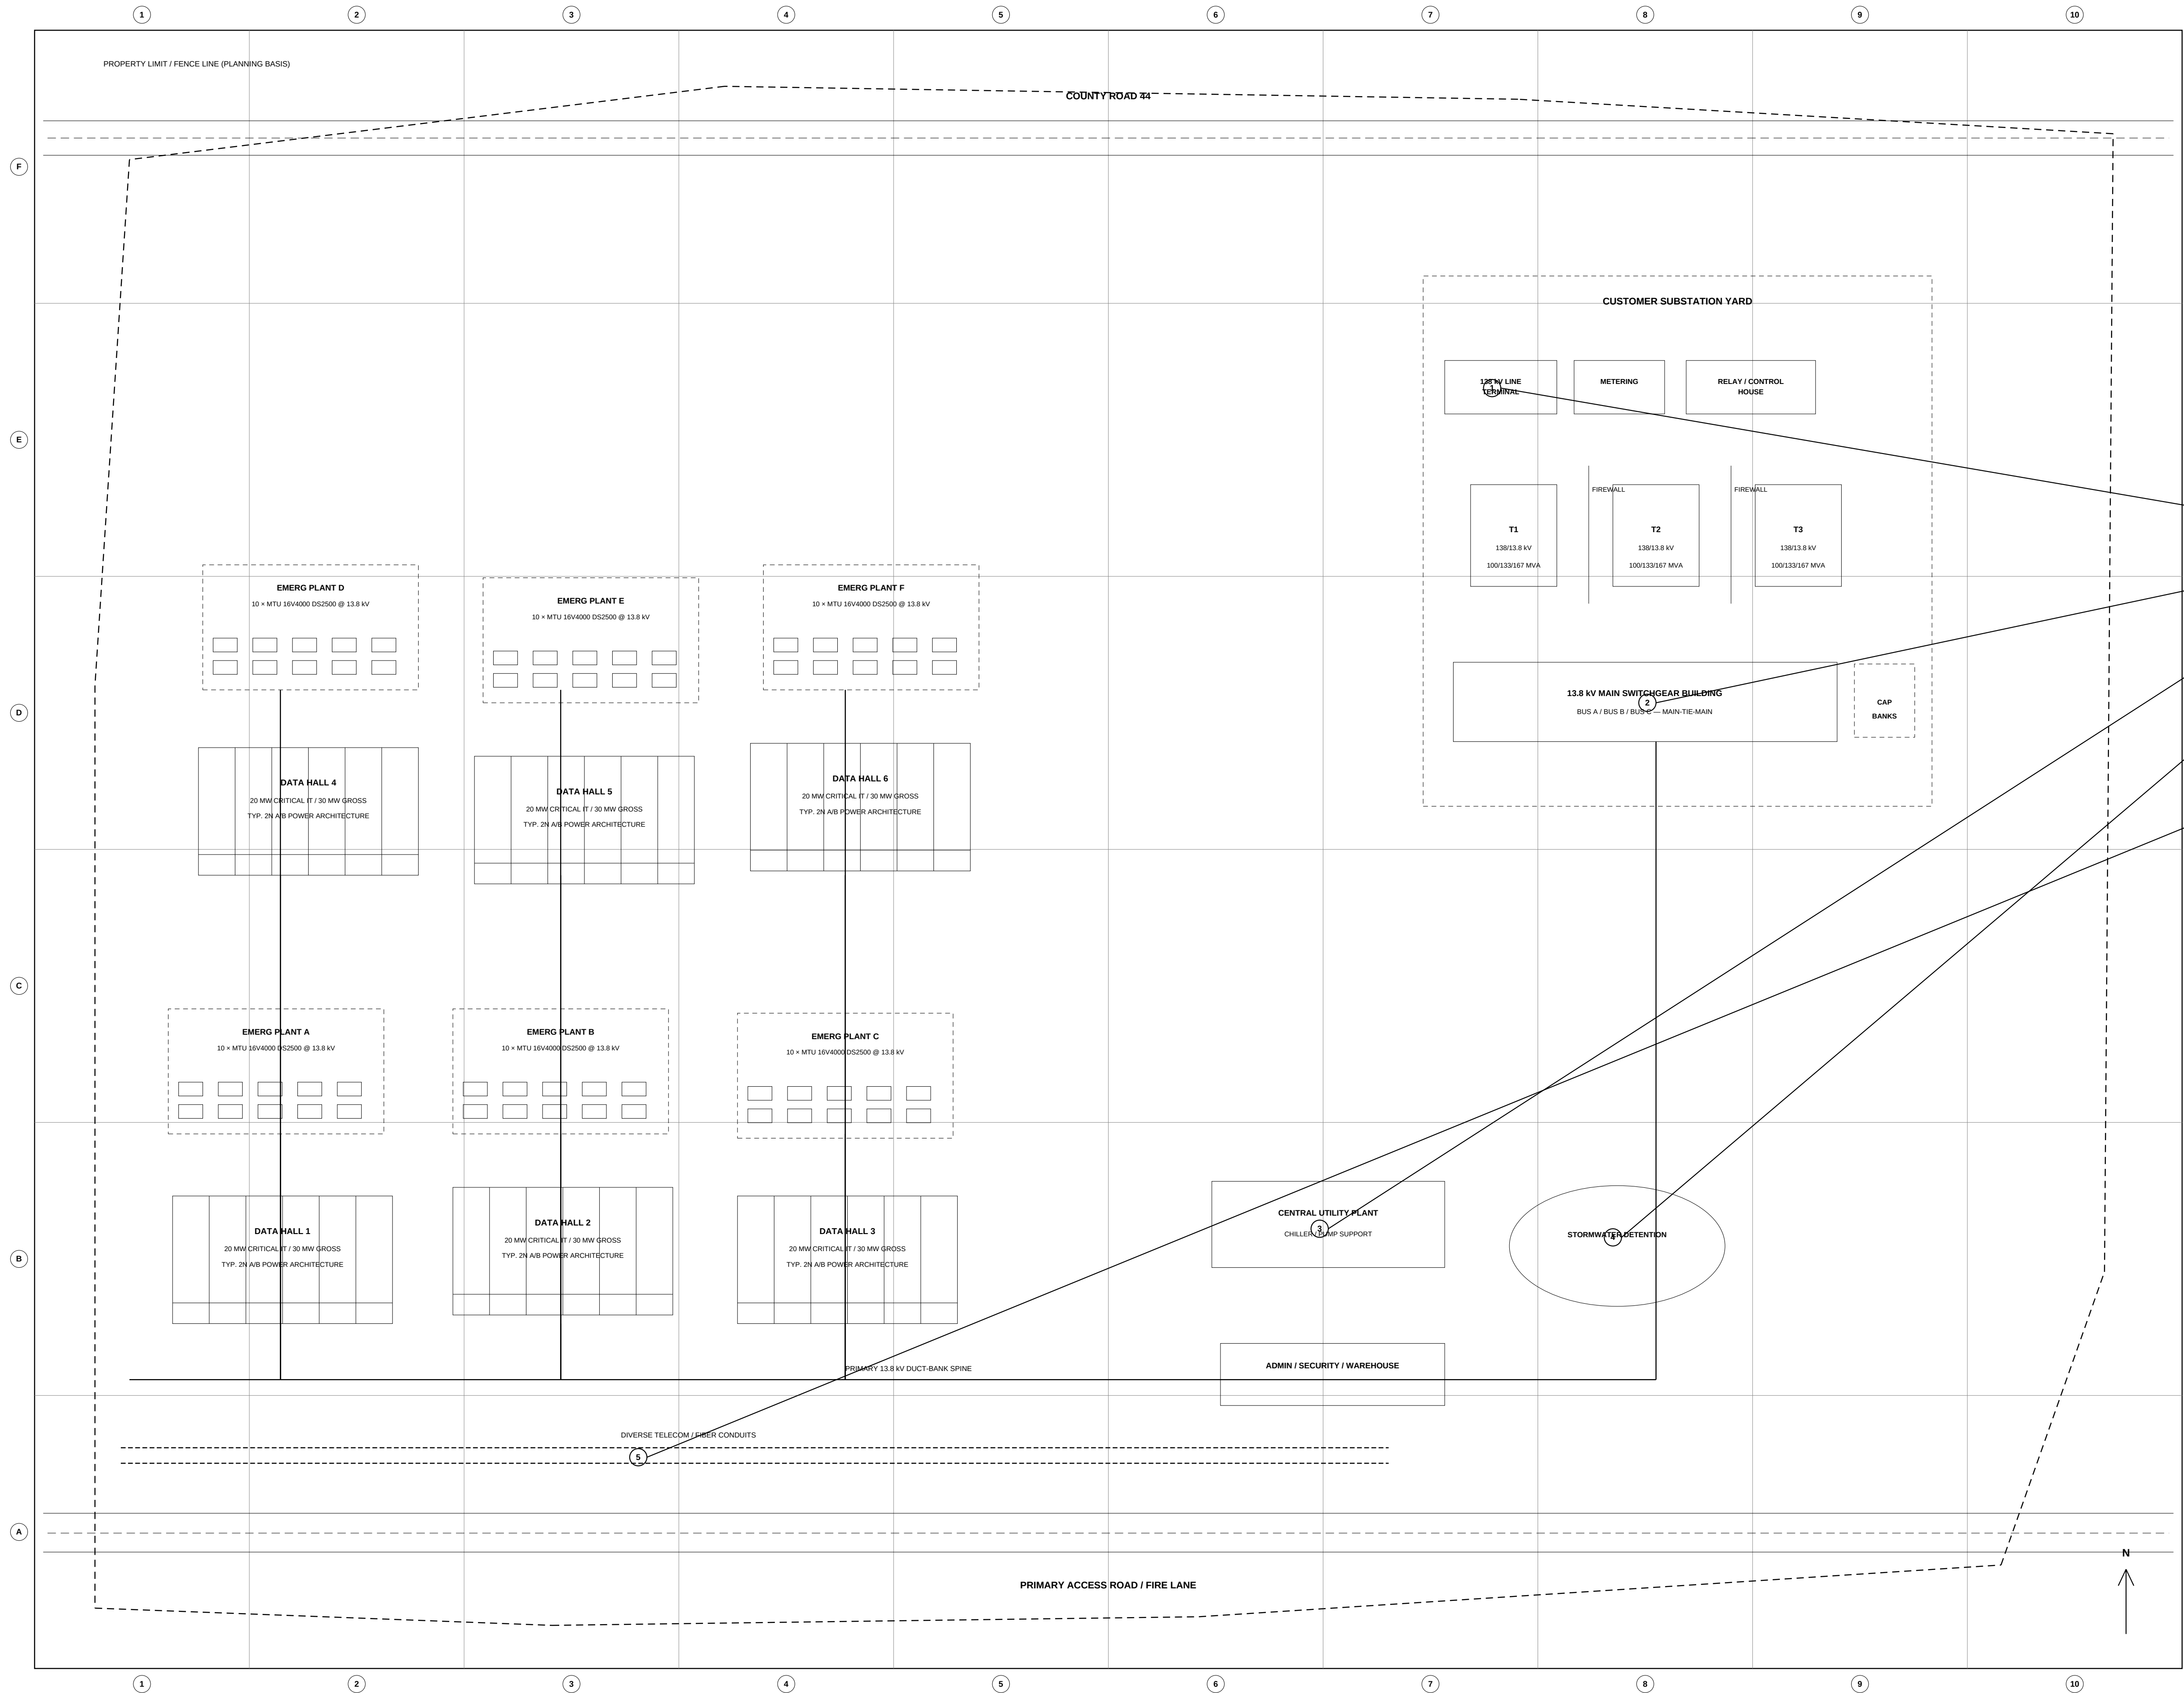

GENERAL NOTES

- Drawing depicts the planning-level civil and electrical arrangement of the proposed campus and is intended to support interconnection review only.
- Final grading, drainage, conduit routing, grounding, and equipment foundations will be developed under the detailed design package.
- Interconnection equipment shown at the customer substation is coordinated with the one-line and protection drawings in this package.
- Standby generator compounds are emergency-use facilities and are not intended for routine export operation.

KEY	DESCRIPTION
1	Customer 138 kV line terminal / utility interface
2	13.8 kV switchgear building
3	Central utility plant
4	Stormwater detention feature
5	Telecom / fiber corridor

BURNS &
McDONNELL

PRAIRIE HORIZON DATA CAMPUS

OVERALL CIVIL / ELECTRICAL SITE PLAN

OWNER: Prairie Horizon Digital Infrastructure LLC | SITE: Fayette County, Ohio | ENGINEER: Burns & McDonnell Engineering Company, Inc.

PROJECT NO.

DRAWN

CHK

DATE

REV

STATUS

SCALE

SHEET

ISSUE

PHDC-LL-2026-017

JDS

RKM

04/2026

2


PRELIM

1" =
200'

C-201

ISSUED FOR INTERCONNECTION REVIEW

REV	DATE	DESCRIPTION	BY	CK
2	04/2026	ENHANCED CAD STYLE DETAILING	JDS	RKM
1	04/2026	ISSUED FOR INTERCONNECTION REVIEW	JDS	RKM

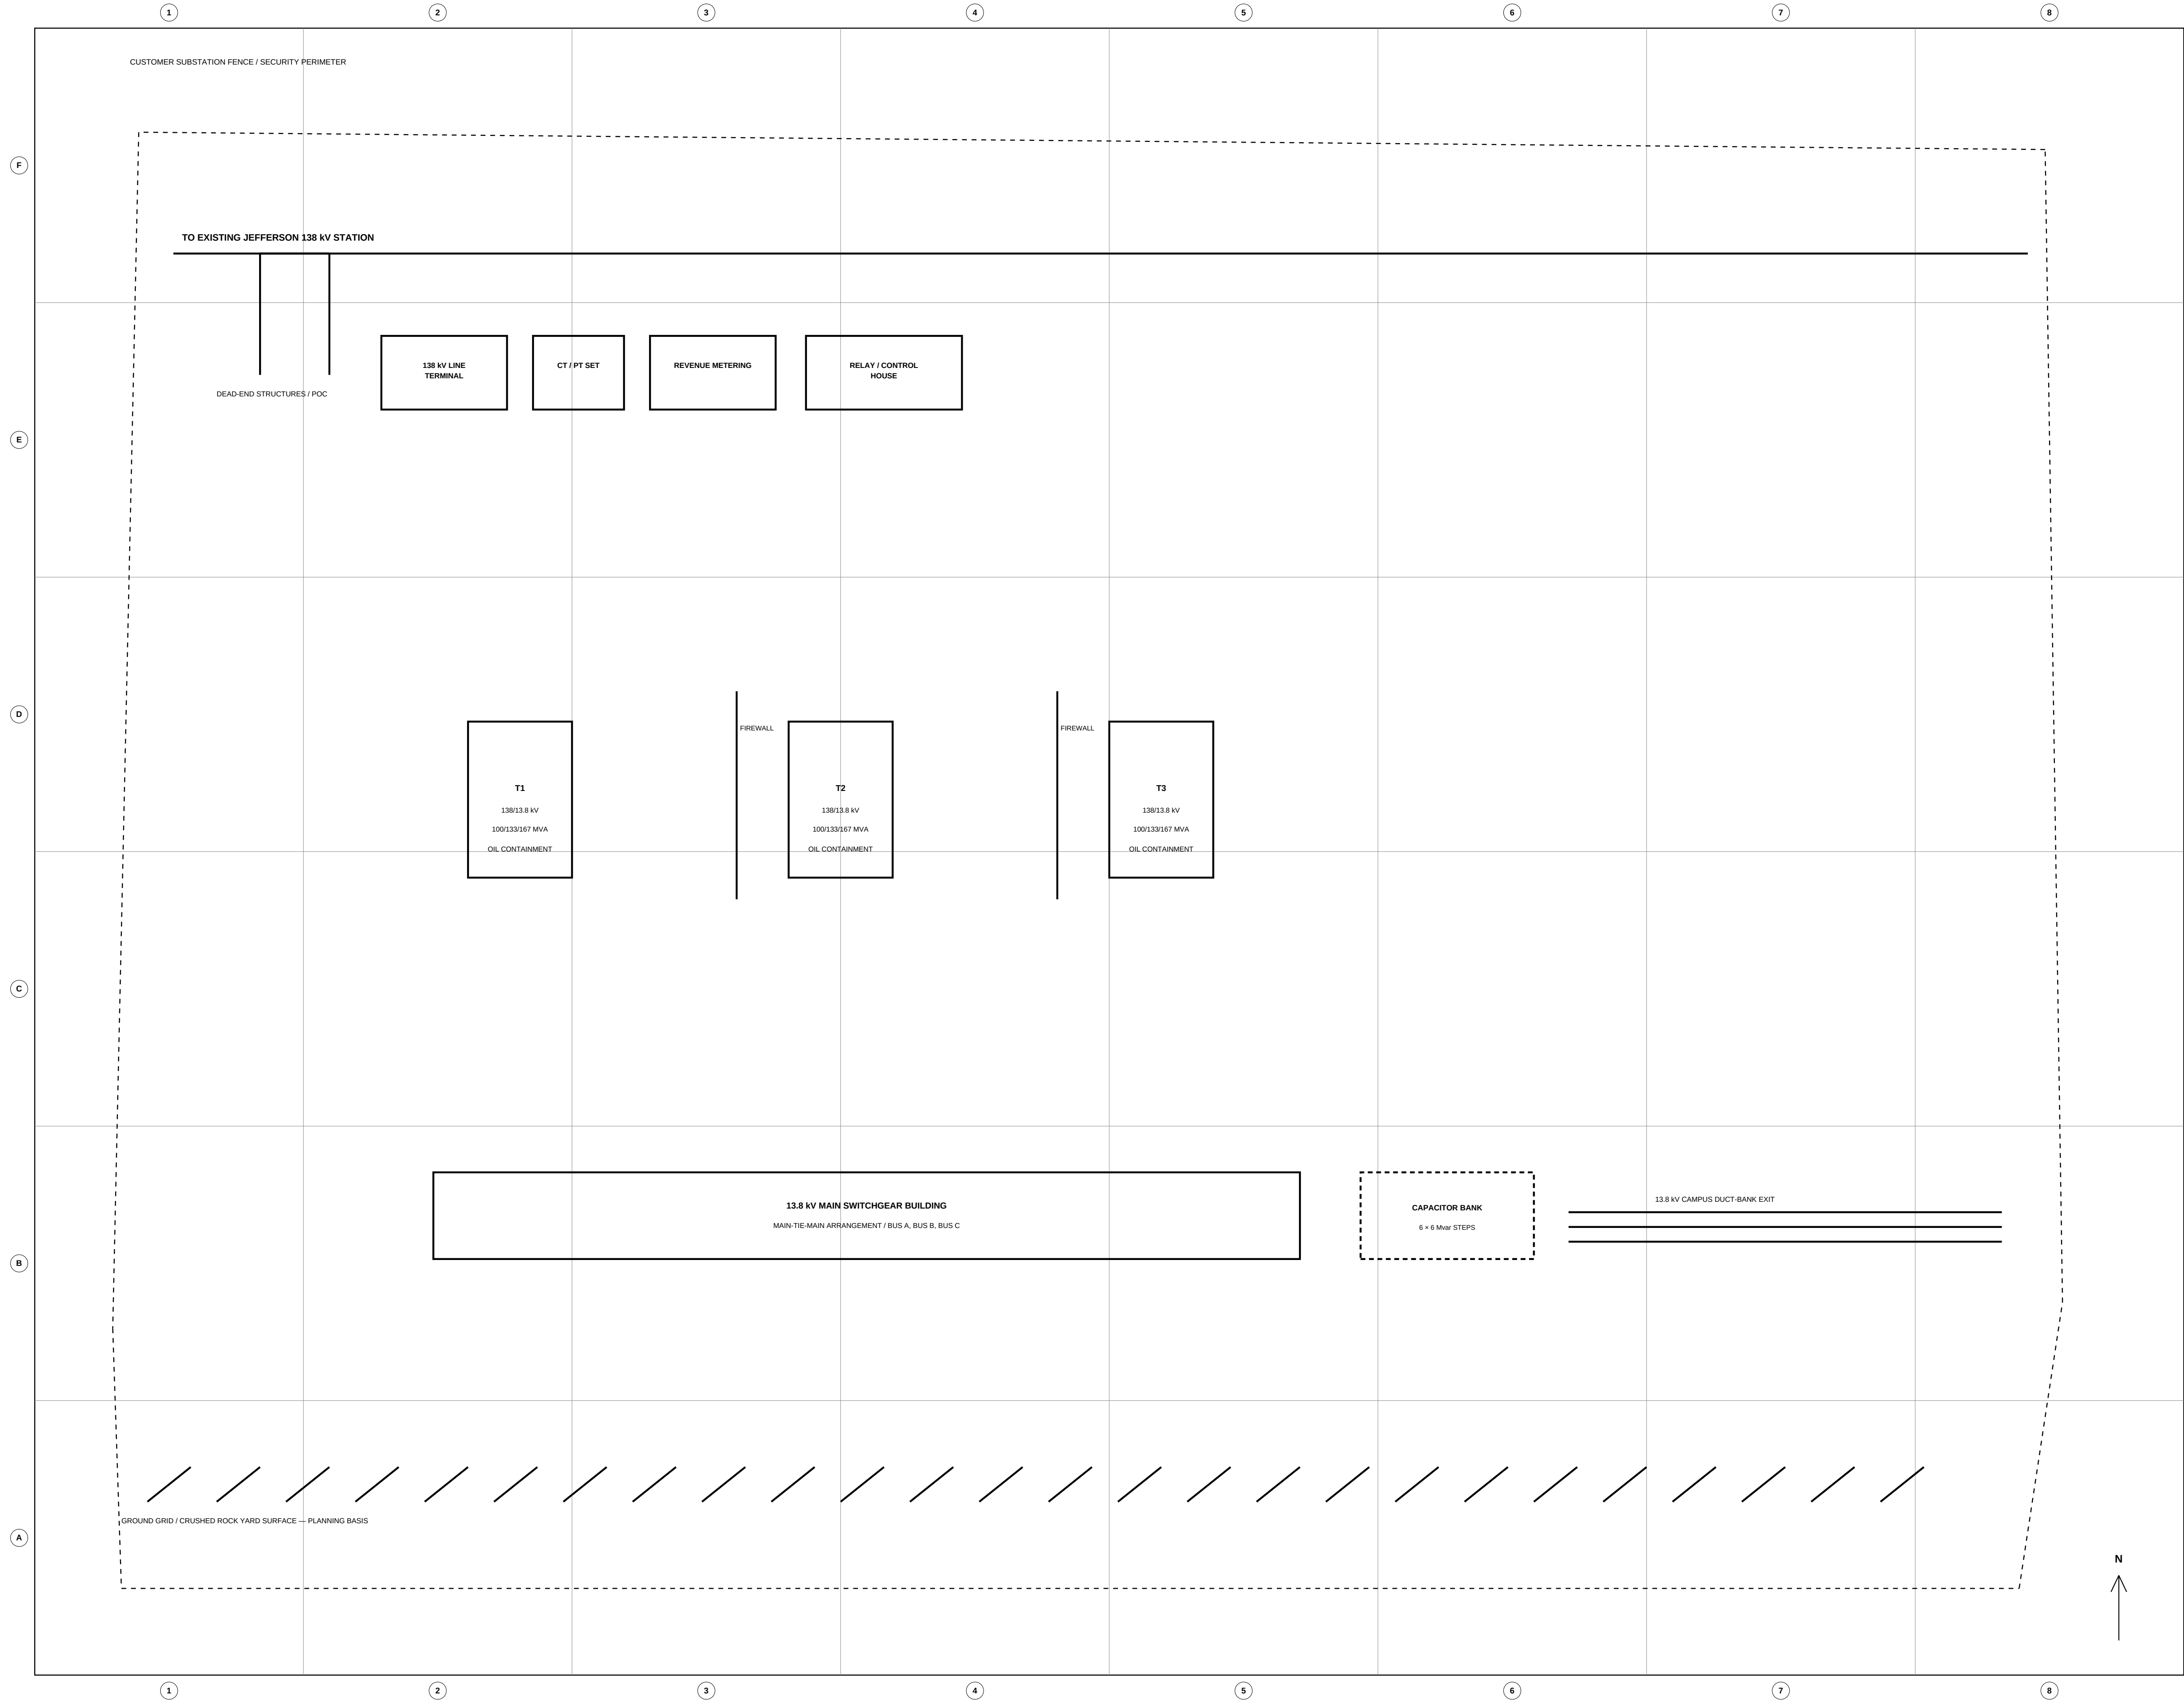


GENERAL NOTES

- Plan depicts the planning-level physical arrangement of the customer utility interface and associated substation equipment.
- Final foundation geometry, grounding, control-cable routing, and line-lay details will follow transmission-owner standards and detailed design.
- Metering interfaces, CT/PT ratios, protective-relay settings, and telecom demarcation remain subject to utility review and approval.

AREA	DESCRIPTION
A	Incoming 138 kV line terminal
B	Metering / relay house zone
C	Transformer bank and firewalls
D	13.8 kV switchgear building
E	Capacitor bank yard
F	Campus duct bank exit corridor

DIMENSION	PLANNING VALUE
Approx. fence width	570 ft
Approx. fence depth	420 ft
Main transformer spacing	per firewall and containment layout
Main switchgear building footprint	approx. 10,000 sq ft planning basis



BURNS &
McDONNELL

PRAIRIE HORIZON DATA CAMPUS

ENLARGED CUSTOMER SUBSTATION / UTILITY INTERFACE PLAN

OWNER: Prairie Horizon Digital Infrastructure LLC | SITE: Fayette County, Ohio | ENGINEER: Burns & McDonnell Engineering Company, Inc.

PROJECT NO.

DRAWN

CHK

DATE

REV

STATUS

SCALE

SHEET

ISSUE

PHDC-LL-2026-017

JDS

RKM

04/2026

2

PRELIM

1" = 60'

C-202

ISSUED FOR INTERCONNECTION REVIEW