
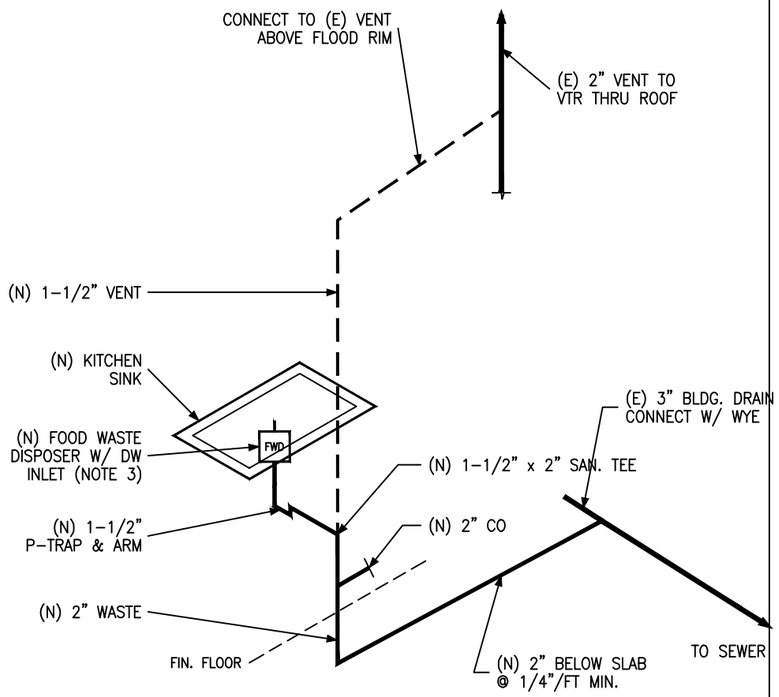


1 KITCHEN DWV RISER DIAGRAM

SCALE: NTS

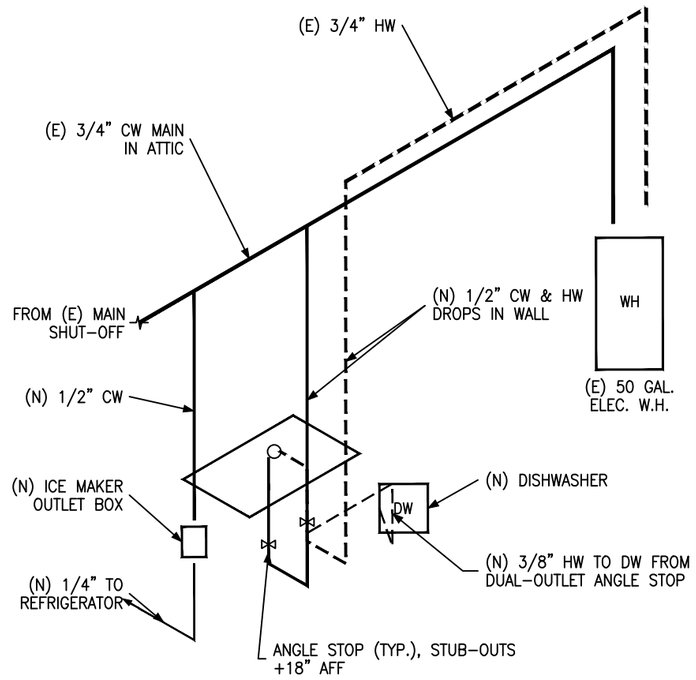

2 KITCHEN WATER SUPPLY RISER

SCALE: NTS

PLUMBING LEGEND

- SANITARY WASTE (N) – PVC SCH 40 DWV
- VENT (N) – PVC SCH 40 DWV
- EXISTING WASTE / VENT TO REMAIN (E)
- COLD WATER (N) – PEX / CPVC, MATCH (E)
- HOT WATER (N) – PEX / CPVC, MATCH (E)
- ⋈ ANGLE STOP VALVE
- CLEANOUT (CO)

(N) NEW (E) EXISTING AFF = ABOVE FIN. FLOOR

FIXTURE CONNECTION SCHEDULE

FIXTURE	DFU	TRAP	WASTE	VENT	CW	HW
KITCHEN SINK (N)	2	1-1/2"	2"	1-1/2"	1/2"	1/2"
W/ FWD + DW	–	–	–	–	–	3/8"
ICE MAKER (N)	–	–	–	–	1/4"	–

PLUMBING NOTES

1. ALL WORK SHALL COMPLY WITH 2023 FBC PLUMBING, 8TH ED. AND LOCAL AMENDMENTS.
2. DRAINAGE PIPING 2-1/2" AND SMALLER: 1/4" PER FT MIN. SLOPE. 3" AND LARGER: 1/8" PER FT MIN.
3. DW DISCHARGE: HIGH LOOP FASTENED TO UNDERSIDE OF COUNTER OR DECK-MOUNTED AIR GAP, TO FWD INLET.
4. VERIFY (E) PIPE SIZES, MATERIAL AND LOCATIONS IN FIELD. REPORT DISCREPANCIES BEFORE WORK.
5. PROVIDE ACCESS TO CLEANOUTS AND SHUT-OFF VALVES.
6. TEST DWV AND WATER PIPING BEFORE CONCEALMENT.

SERGEI GRISHUTOV
QUANTITY SURVEYOR / CAD DRAFTER
PERMIT & CONSTRUCTION DRAWINGS

SAMPLE SHEET
FORMAT / QUALITY SAMPLE ONLY
FICTITIOUS PROJECT DATA
NOT FOR CONSTRUCTION

PROJECT:
SINGLE-FAMILY RESIDENCE
KITCHEN REMODEL

ADDRESS:
(SAMPLE – NOT A REAL SITE)


APPLICABLE CODES:
2023 FBC RESIDENTIAL, 8TH ED.
2023 FBC PLUMBING, 8TH ED.
NEC 2020 (NFPA 70)

CONTRACTOR:

LICENSE NO.:

REVISIONS:

NO.	DATE	DESCRIPTION
0	11/01/26	ISSUED AS SAMPLE

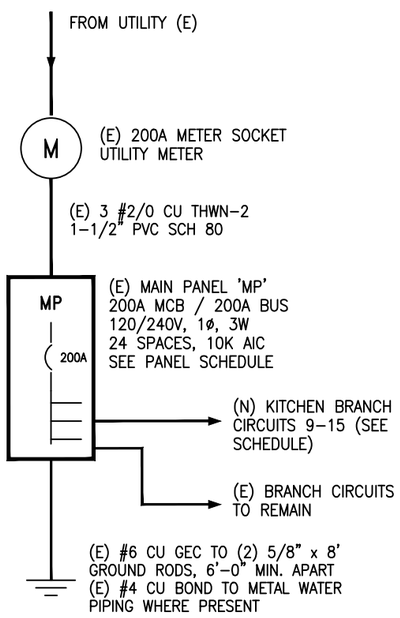

3 ELECTRICAL RISER

SCALE: NTS

PANEL SCHEDULE – 'MP' (E)

LOCATION: GARAGE (E) MOUNTING: SURFACE FED FROM: METER (E)
VOLTAGE: 120/240V, 1ø, 3W MAIN: 200A MCB BUS: 200A AIC: 10,000 SPACES: 24

DESCRIPTION	WIRE	BKR	TYPE	VA	CKT	PH	CKT	VA	TYPE	BKR	WIRE	DESCRIPTION
RANGE (E)	#6	50/2	–	6,000	1	A	2	2,500	–	30/2	#10	DRYER (E)
(2-POLE)				6,000	3	B	4	2,500				(2-POLE)
WATER HEATER (E)	#10	30/2	–	2,250	5	A	6	2,150	–	30/2	#10	A/C UNIT + AHU (E)
(2-POLE)				2,250	7	B	8	2,150				(2-POLE)
KITCHEN SABC #1 (N)	#12	20/1	DF	1,500	9	A	10	1,200	DF	20/1	#12	DISHWASHER (N)
KITCHEN SABC #2 (N)	#12	20/1	DF	1,500	11	B	12	900	AF	20/1	#12	DISPOSER (N)
MICROWAVE/HOOD (N)	#12	20/1	AF	1,500	13	A	14	720	AF	20/1	#12	REFRIGERATOR (N)
KITCHEN LIGHTING (N)	#14	15/1	AF	400	15	B	16	1,500	AF	20/1	#12	LAUNDRY (E)
LIVING/DINING (E)	#14	15/1	AF	1,200	17	A	18	1,500	GF	20/1	#12	BATH RECEPT. (E)
BEDROOMS (E)	#14	15/1	AF	1,200	19	B	20	1,000	GF	20/1	#12	GARAGE/EXT. RCPT (E)
SMOKE/CO ALARMS (E)	#14	15/1	AF	100	21	A	22	–	–	20/1	–	SPARE
SPACE					23	B	24					SPACE

CONNECTED LOAD: øA = 20,620 VA øB = 19,400 VA TOTAL = 40,020 VA

BREAKER TYPE: AF = AFCI, GF = GFCI, DF = DUAL-FUNCTION AFCI/GFCI, – = STANDARD.
ALL KITCHEN 120V 15/20A BRANCH CIRCUITS AFCI PROTECTED (NEC 210.12). COUNTERTOP AND DISHWASHER OUTLETS GFCI PROTECTED (NEC 210.8). TWO 20A SMALL-APPLIANCE BRANCH CIRCUITS (SABC) SERVE KITCHEN COUNTERTOP RECEPTACLES (NEC 210.11(C)(1), 210.52(B)).
CONNECTED VA SHOWN FOR BALANCING ONLY – SERVICE LOAD PER NEC 220.83, SEE DETAIL 5.

4 PANEL SCHEDULE

SCALE: NONE

SERVICE LOAD CALCULATION

NEC 2020, 220.83(A) – EXISTING DWELLING UNIT.
NO ADDITIONAL A/C OR ELECTRIC HEAT INSTALLED.
LIVING AREA: 1,850 SF (SAMPLE VALUE)

(1) GENERAL LIGHTING & RECEPT.	5,550 VA
(2) SMALL-APPLIANCE CIRCUITS	3,000 VA
LAUNDRY CIRCUIT	1,500 VA
(3) RANGE (E)	12,000 VA
(4) FIXED / DEDICATED APPLIANCES:	
DISHWASHER (N)	1,200 VA
FOOD WASTE DISPOSER (N)	900 VA
MICROWAVE / HOOD (N)	1,500 VA
REFRIGERATOR (N)	720 VA
WATER HEATER (E)	4,500 VA
CLOTHES DRYER (E)	5,000 VA
A/C UNIT + AIR HANDLER (E)	4,300 VA
TOTAL CONNECTED LOAD	**40,170 VA**
FIRST 8,000 VA @ 100%	8,000 VA
REMAINDER 32,170 VA @ 40%	12,868 VA
CALCULATED LOAD	**20,868 VA**
20,868 VA / 240 V	87.0 A

(E) 200A SERVICE >= 87.0 A – ADEQUATE

5 LOAD CALCULATION

NEC 2020, 220.83(A)

DRAWN BY: S. GRISHUTOV
CHECKED BY: S. GRISHUTOV
DATE: 11/01/2026
SCALE: AS NOTED
SHEET SIZE: 11" x 17" (ANSI B)

SHEET TITLE:
PLUMBING RISER DIAGRAMS, ELECTRICAL RISER, PANEL SCHEDULE & LOAD CALC.

SHEET:

SMP-1