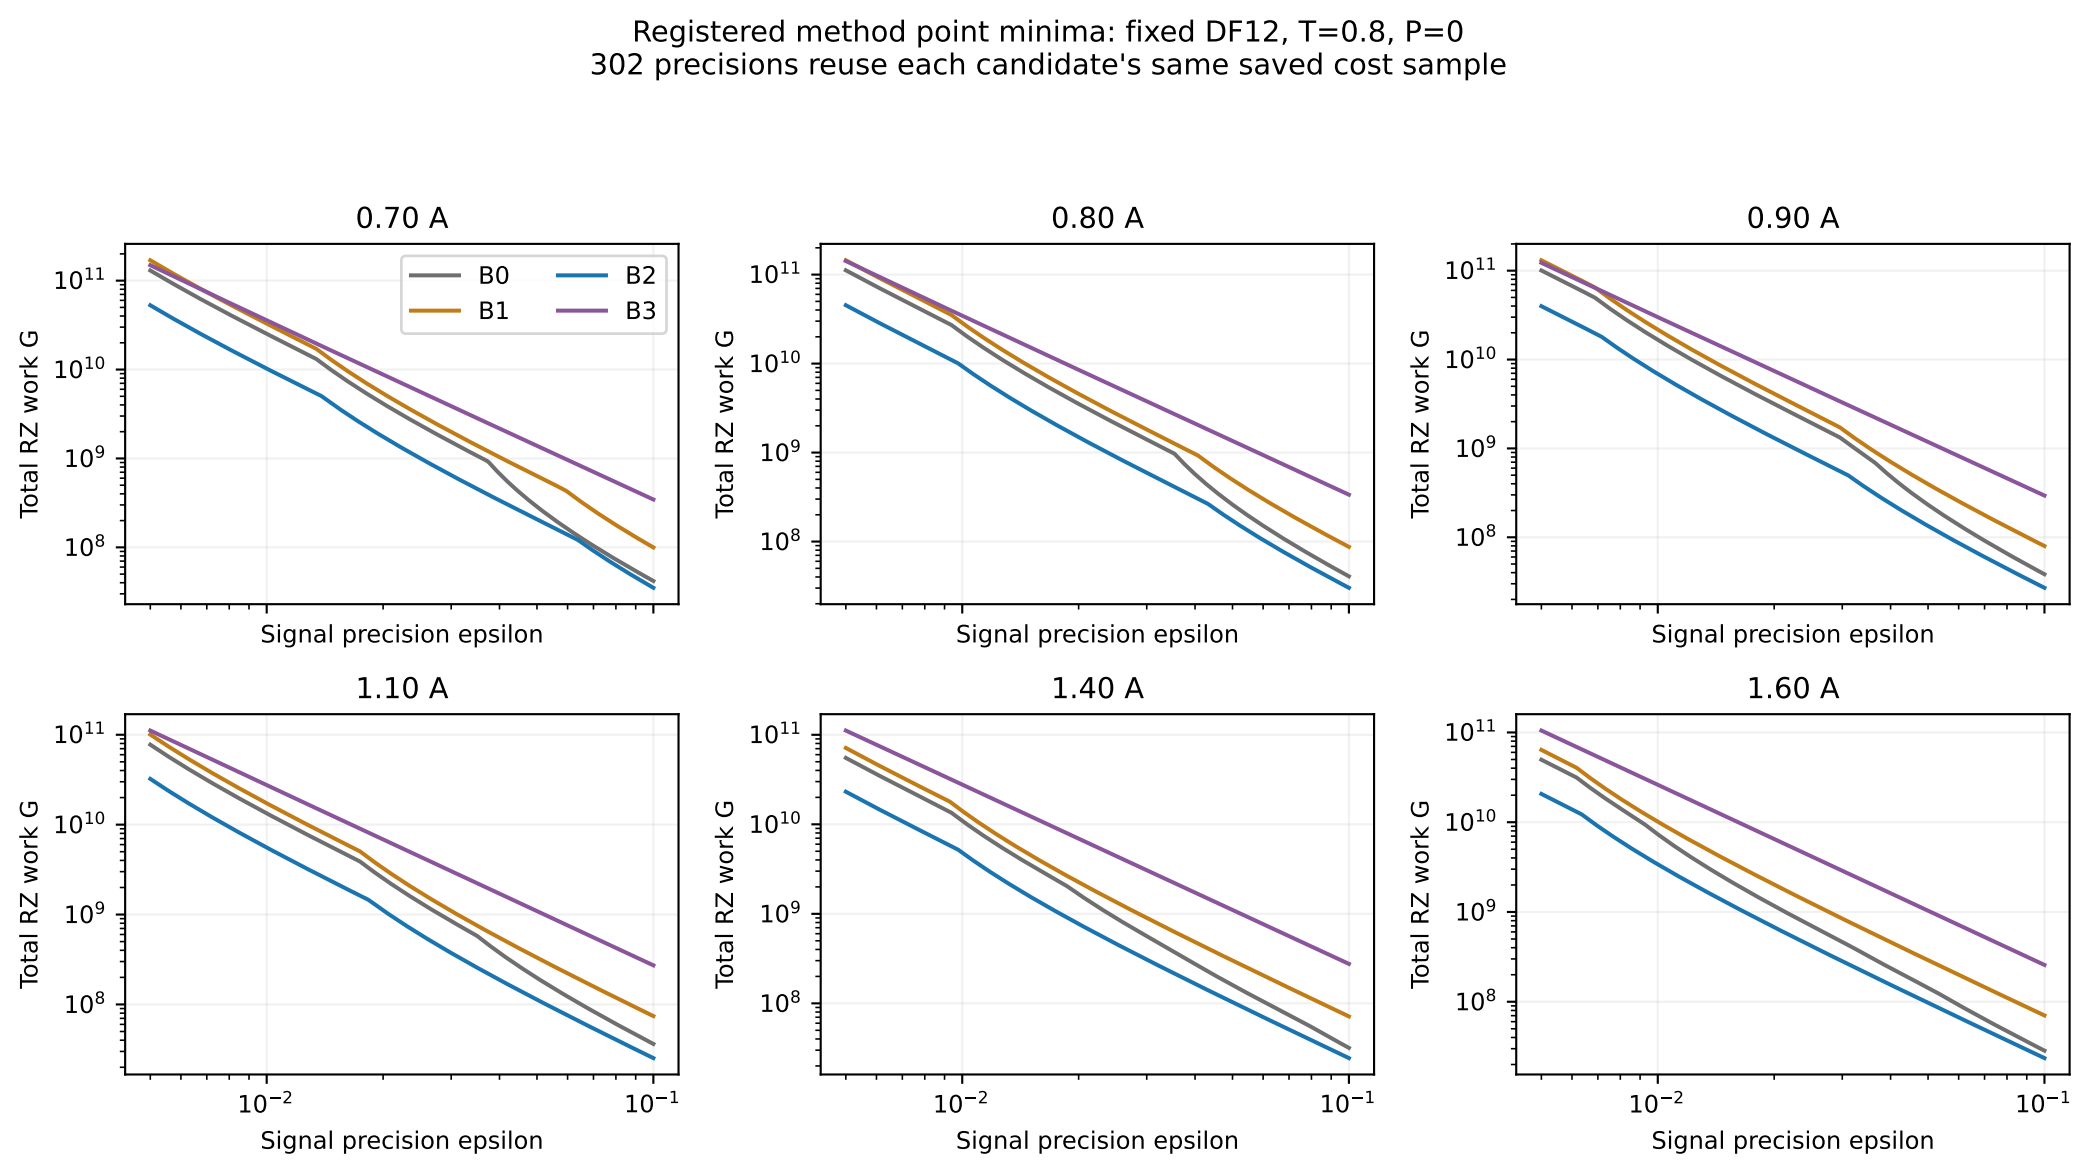
Registered method point minima: fixed DF12, T=0.8, P=0
302 precisions reuse each candidate's same saved cost sample
0.70 A
0.80 A
0.90 A
1.10 A
1.40 A
1.60 A
B0
B1
B2
B3
Total RZ work G
Signal precision epsilon