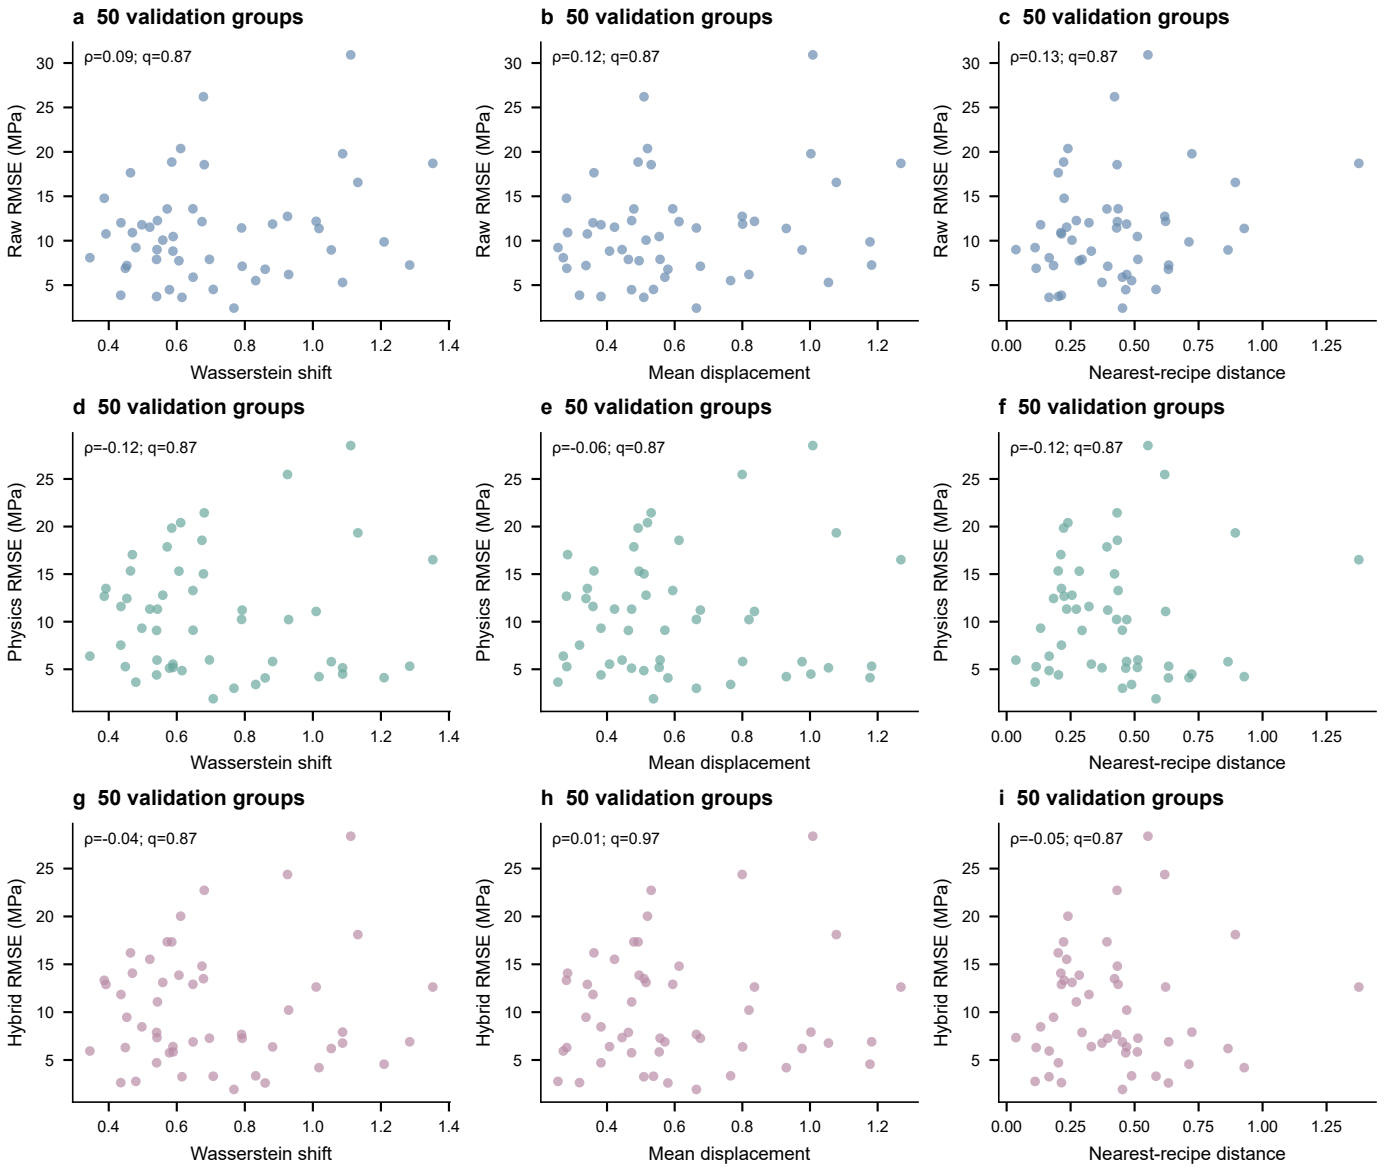

a 50 validation groups
ρ=0.09; q=0.87
Raw RMSE (MPa)
Wasserstein shift
b 50 validation groups
ρ=0.12; q=0.87
Raw RMSE (MPa)
Mean displacement
c 50 validation groups
ρ=0.13; q=0.87
Raw RMSE (MPa)
Nearest-recipe distance
d 50 validation groups
ρ=-0.12; q=0.87
Physics RMSE (MPa)
Wasserstein shift
e 50 validation groups
ρ=-0.06; q=0.87
Physics RMSE (MPa)
Mean displacement
f 50 validation groups
ρ=-0.12; q=0.87
Physics RMSE (MPa)
Nearest-recipe distance
g 50 validation groups
ρ=-0.04; q=0.87
Hybrid RMSE (MPa)
Wasserstein shift
h 50 validation groups
ρ=0.01; q=0.97
Hybrid RMSE (MPa)
Mean displacement
i 50 validation groups
ρ=-0.05; q=0.87
Hybrid RMSE (MPa)
Nearest-recipe distance