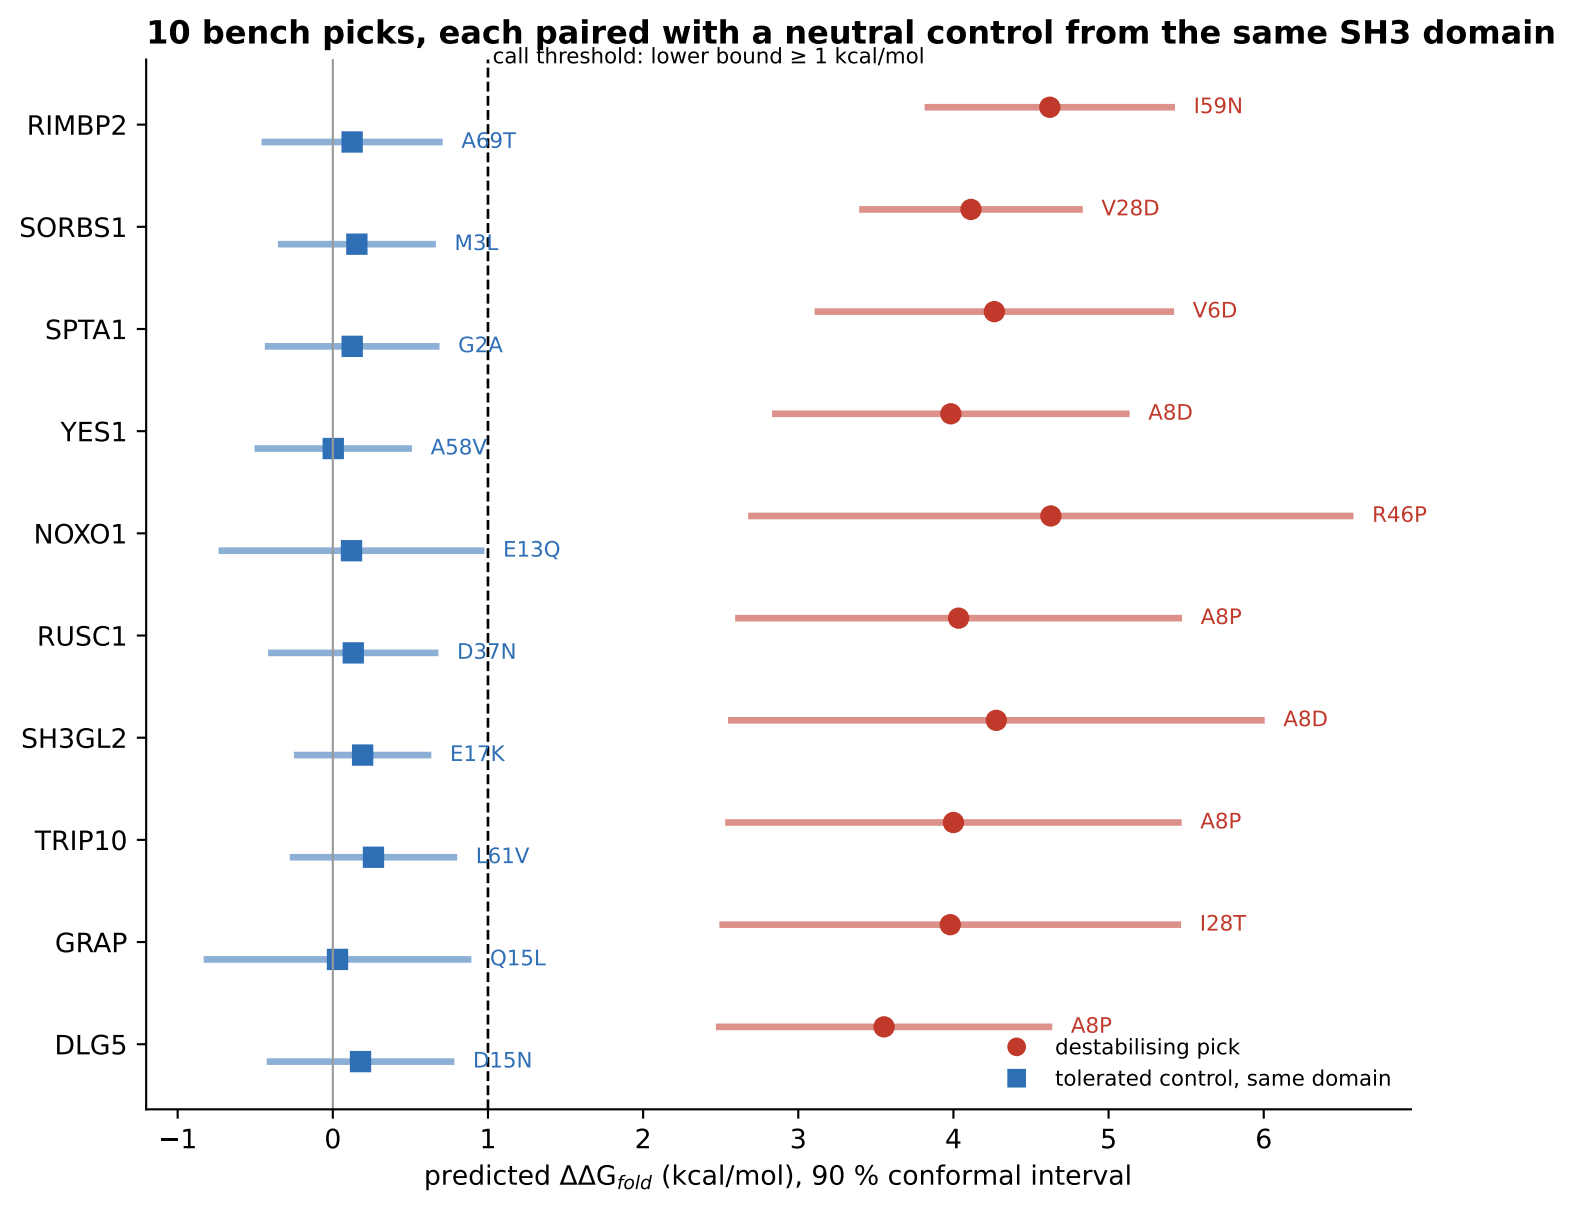
10 bench picks, each paired with a neutral control from the same SH3 domain
call threshold: lower bound ≥ 1 kcal/mol
RIMBP2
SORBS1
SPTA1
YES1
NOXO1
RUSC1
SH3GL2
TRIP10
GRAP
DLG5
A69T
M3L
G2A
A58V
E13Q
D37N
E17K
L61V
Q15L
D15N
I59N
V28D
V6D
A8D
R46P
A8P
A8D
A8P
I28T
A8P
destabilising pick
tolerated control, same domain
−1
0
1
2
3
4
5
6
predicted ΔΔG$_{fold}$ (kcal/mol), 90 % conformal interval