2. Planned controls and actual completion

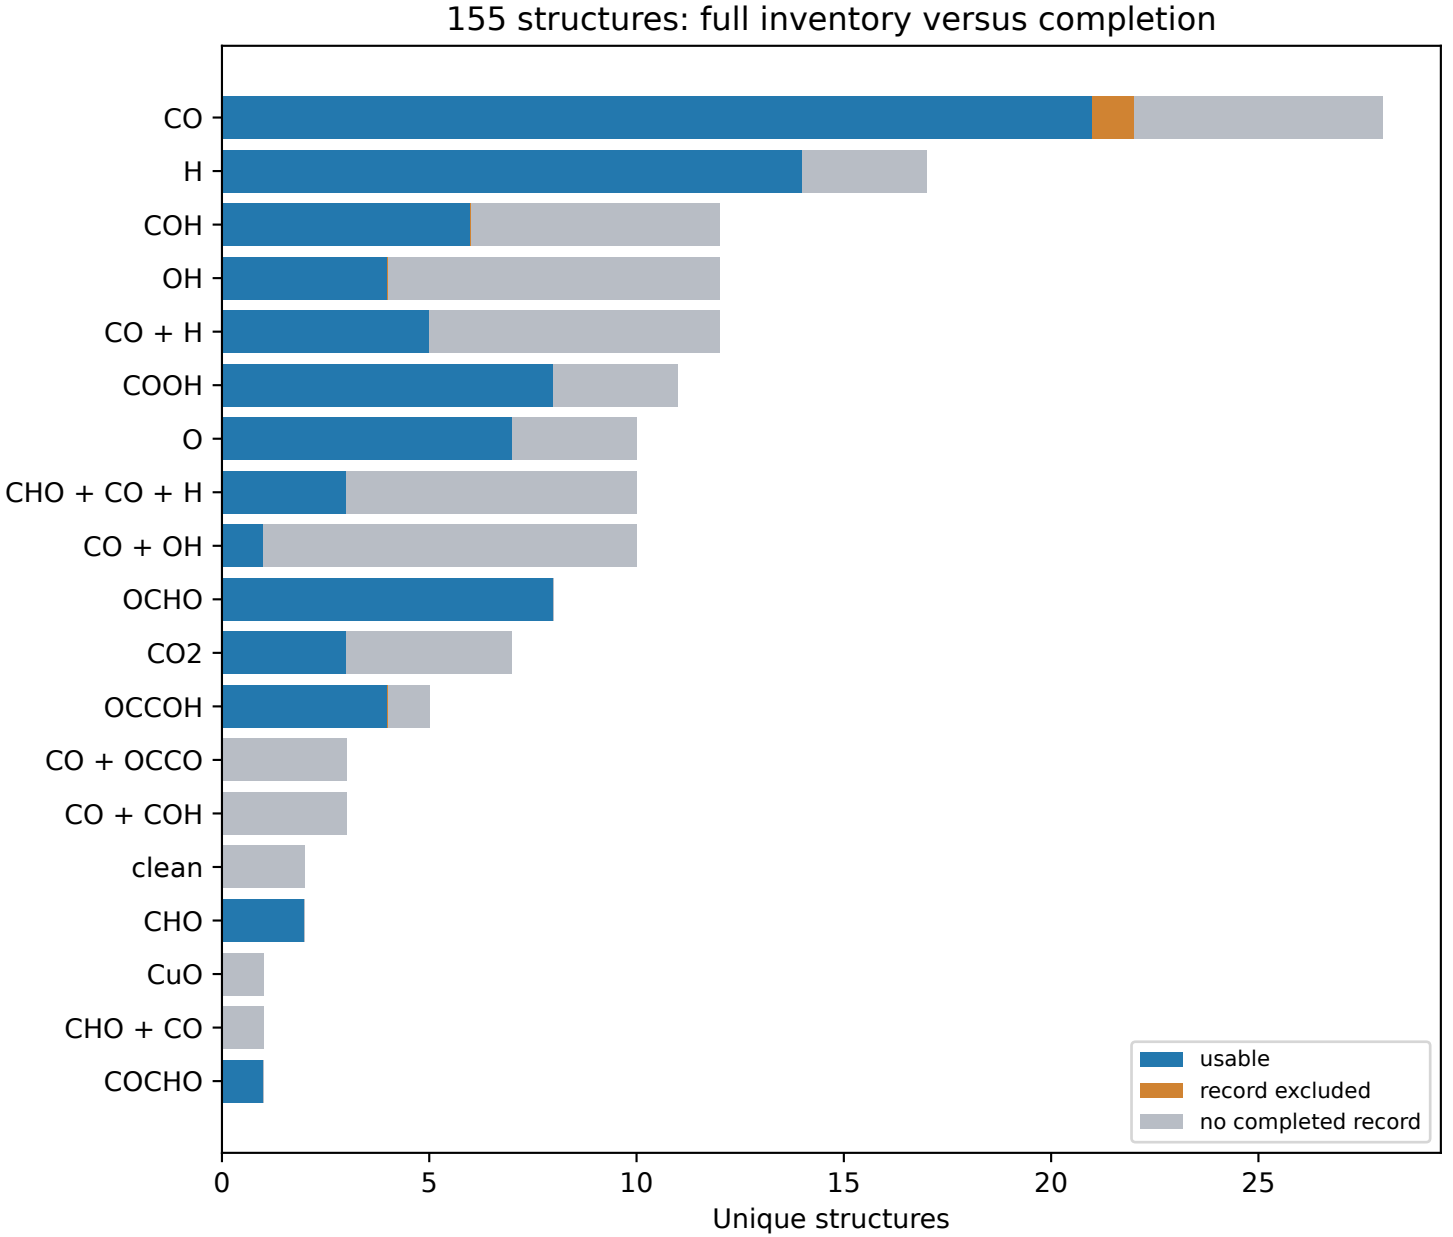

Planned parent	Minimum Cu:Au rows	Sources with inferred ratio
pure Cu(111)	1:0	0
pure Au(111)	0:1	0
Cu:Au 1:1	1:1	154
Cu:Au 2:1	2:1	0
Cu:Au 1:2	1:2	0
Cu:Au 6:2	6:2	0

Ratio matches do not establish all requested sites, coverages, distributions or independent parents.
Pure controls and absent cells remain priorities.
Row counts are inferred from initial coordinates.