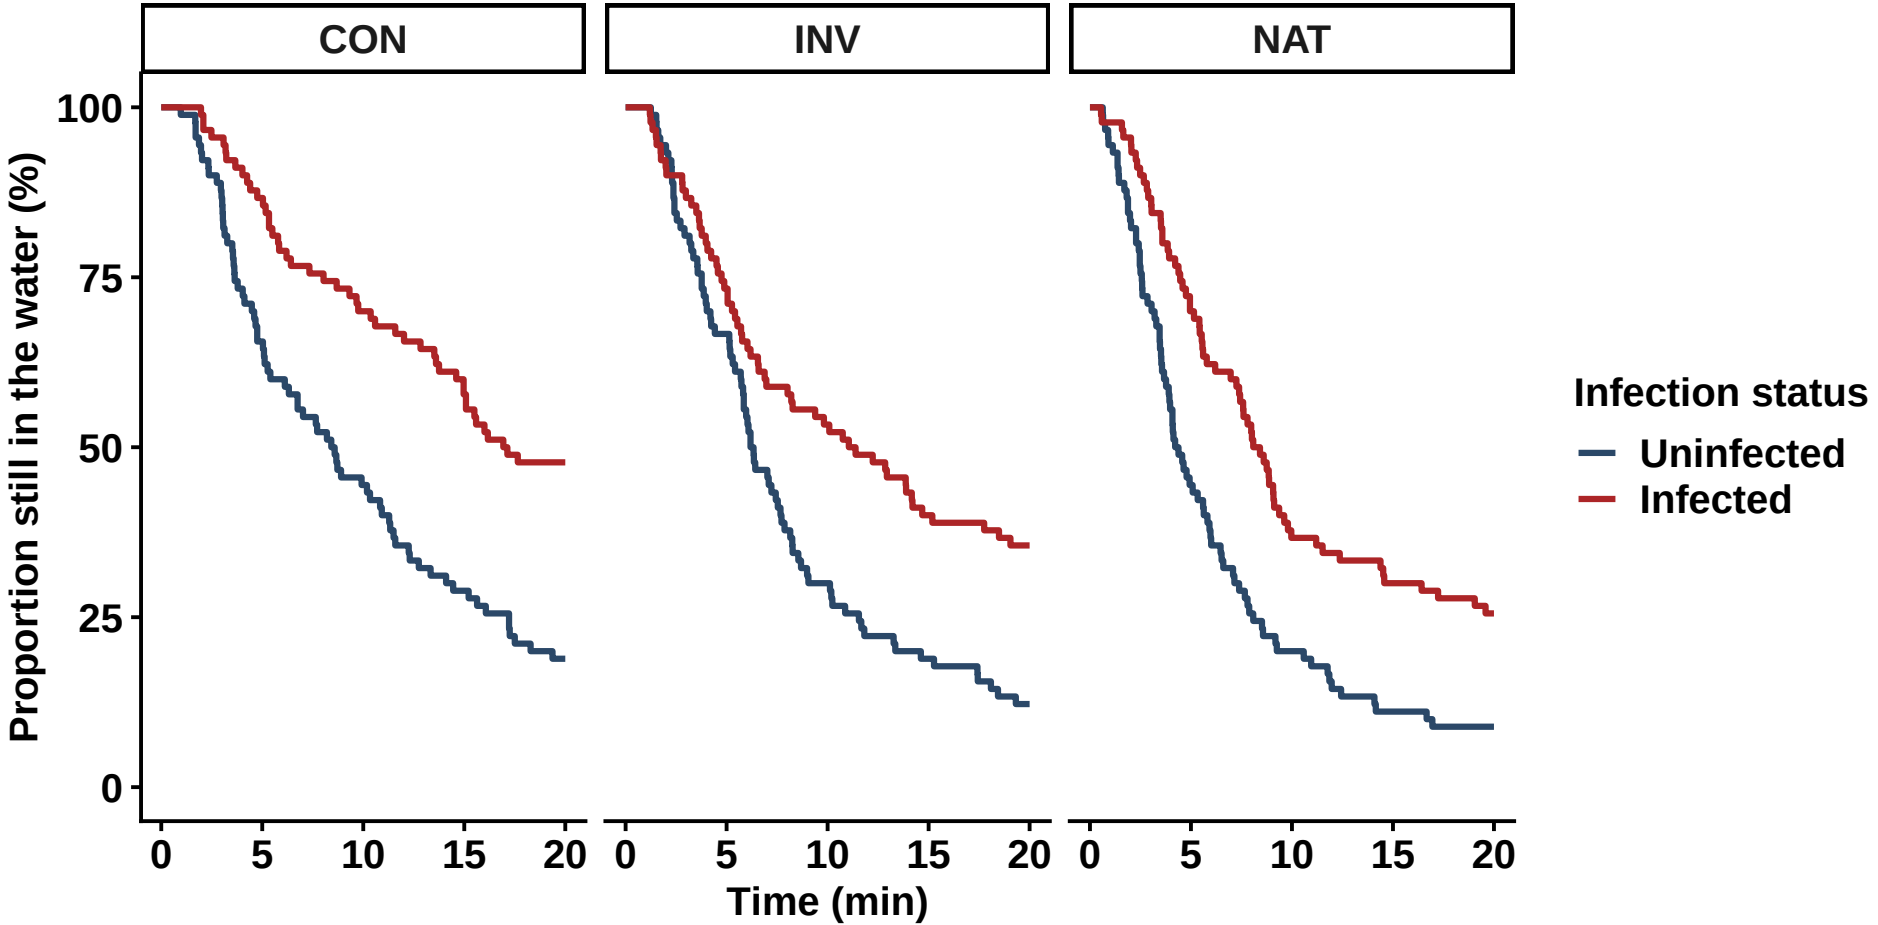
CON
INV
NAT
Proportion still in the water (%)
100
75
50
25
0
0
5
10
15
20
Time (min)
Infection status
Uninfected
Infected