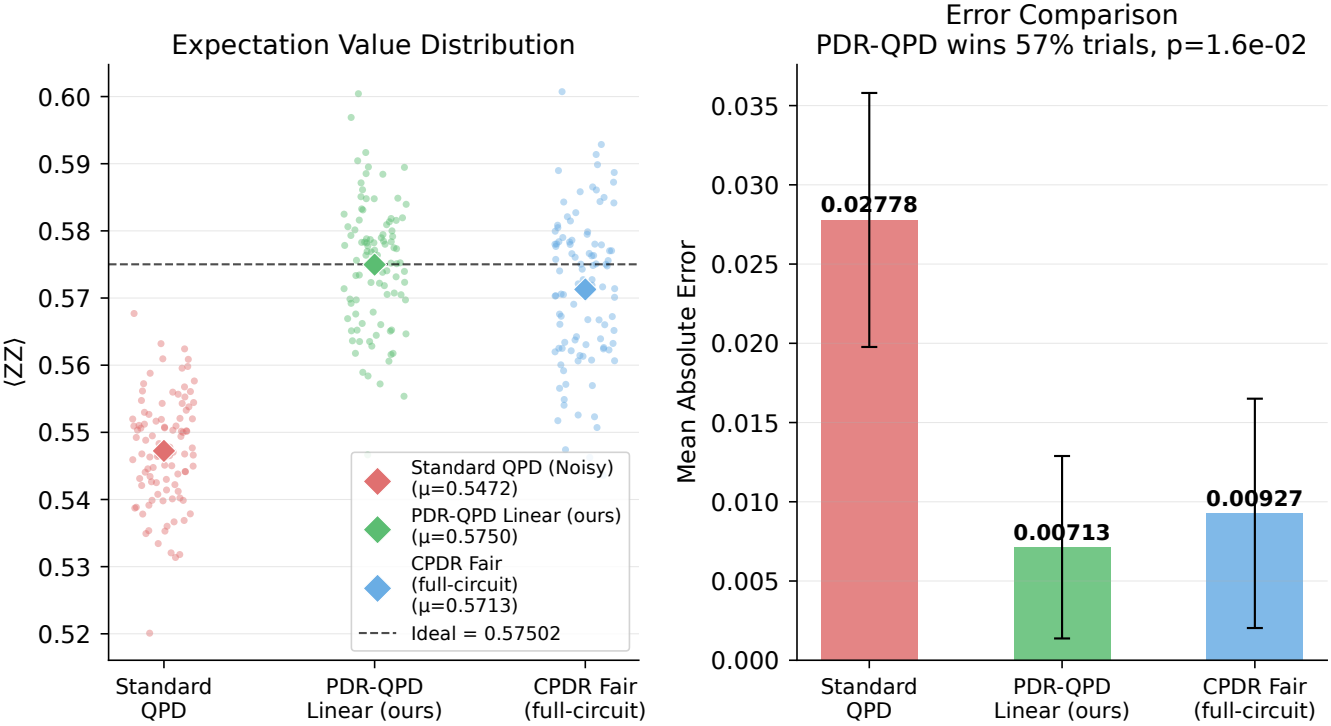
Expectation Value Distribution
⟨ZZ⟩
0.60
0.59
0.58
0.57
0.56
0.55
0.54
0.53
0.52
Standard QPD (Noisy) (μ=0.5472)
PDR-QPD Linear (ours) (μ=0.5750)
CPDR Fair (full-circuit) (μ=0.5713)
Ideal = 0.57502
Standard QPD
PDR-QPD Linear (ours)
CPDR Fair (full-circuit)
Error Comparison
PDR-QPD wins 57% trials, p=1.6e-02
Mean Absolute Error
0.035
0.030
0.025
0.020
0.015
0.010
0.005
0.000
0.02778
0.00713
0.00927
Standard QPD
PDR-QPD Linear (ours)
CPDR Fair (full-circuit)