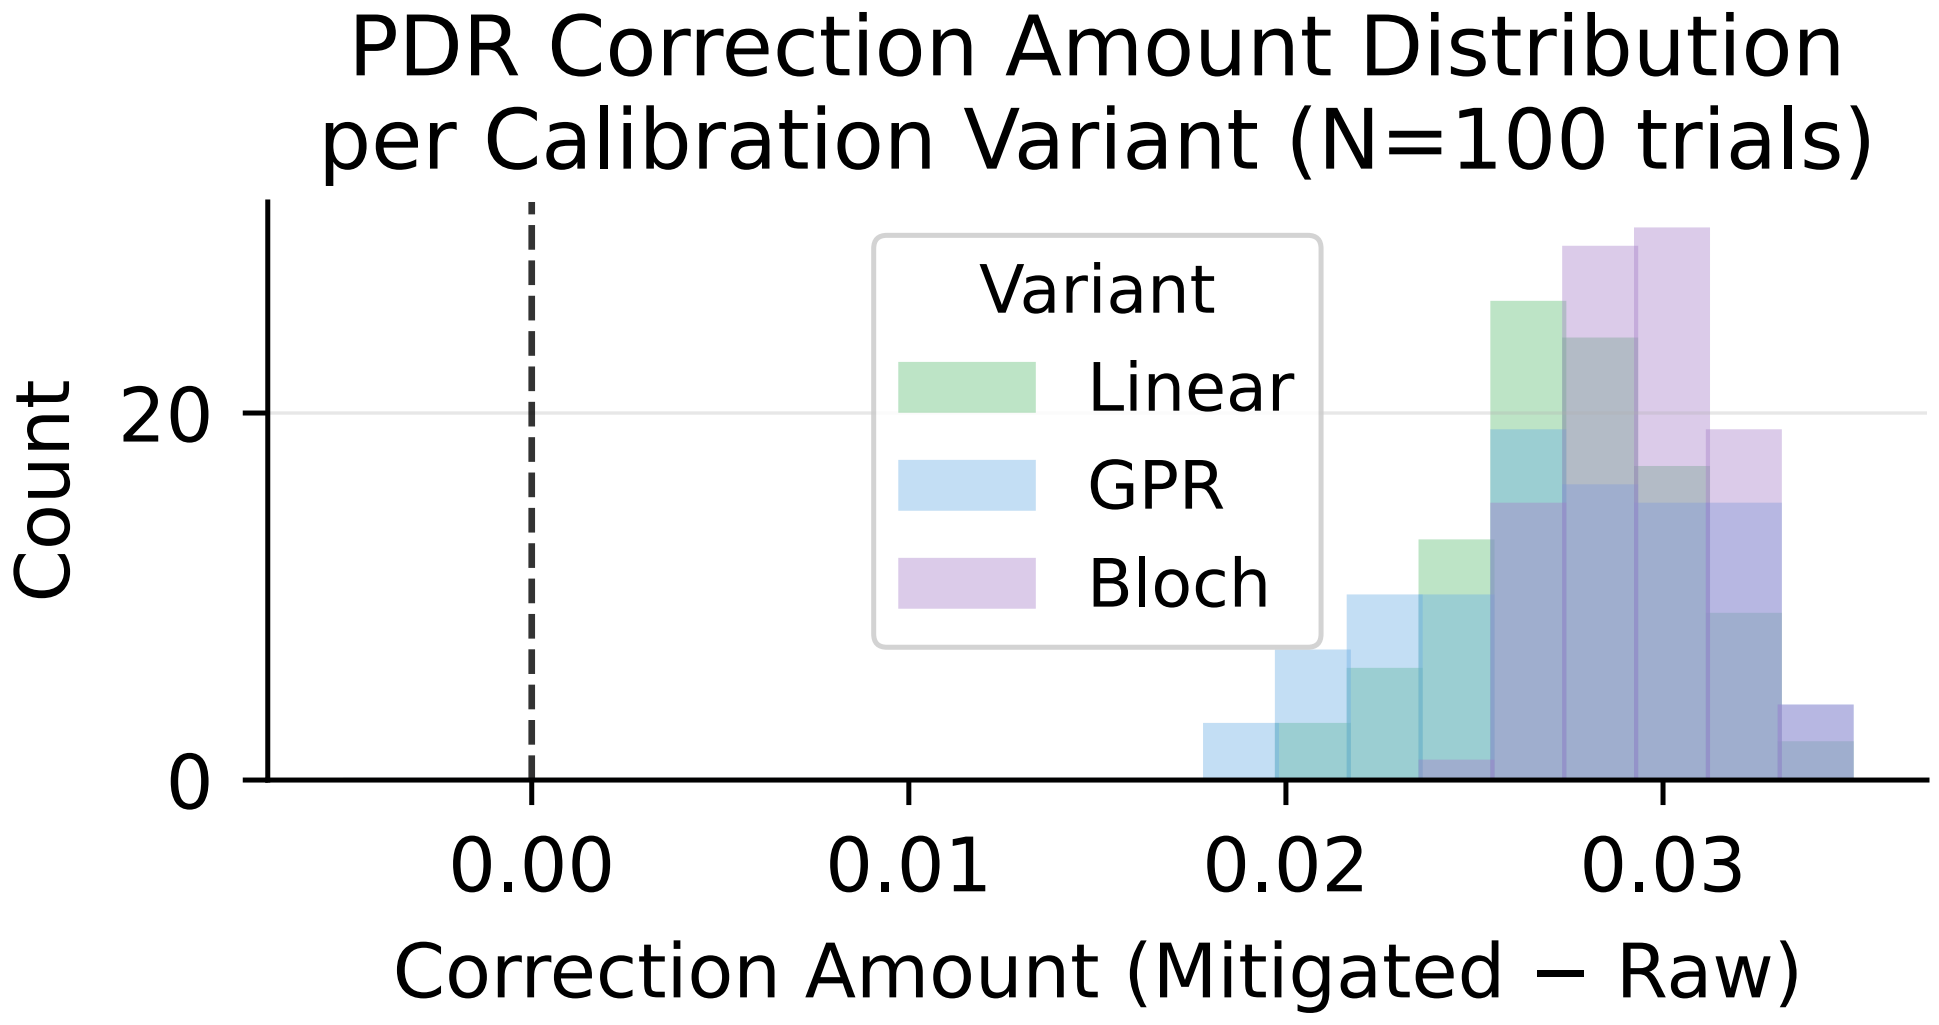
PDR Correction Amount Distribution
per Calibration Variant (N=100 trials)
Variant
Linear
GPR
Bloch
Count
20
0
0.00
0.01
0.02
0.03
Correction Amount (Mitigated − Raw)