


BUILDING 767



8

0

8

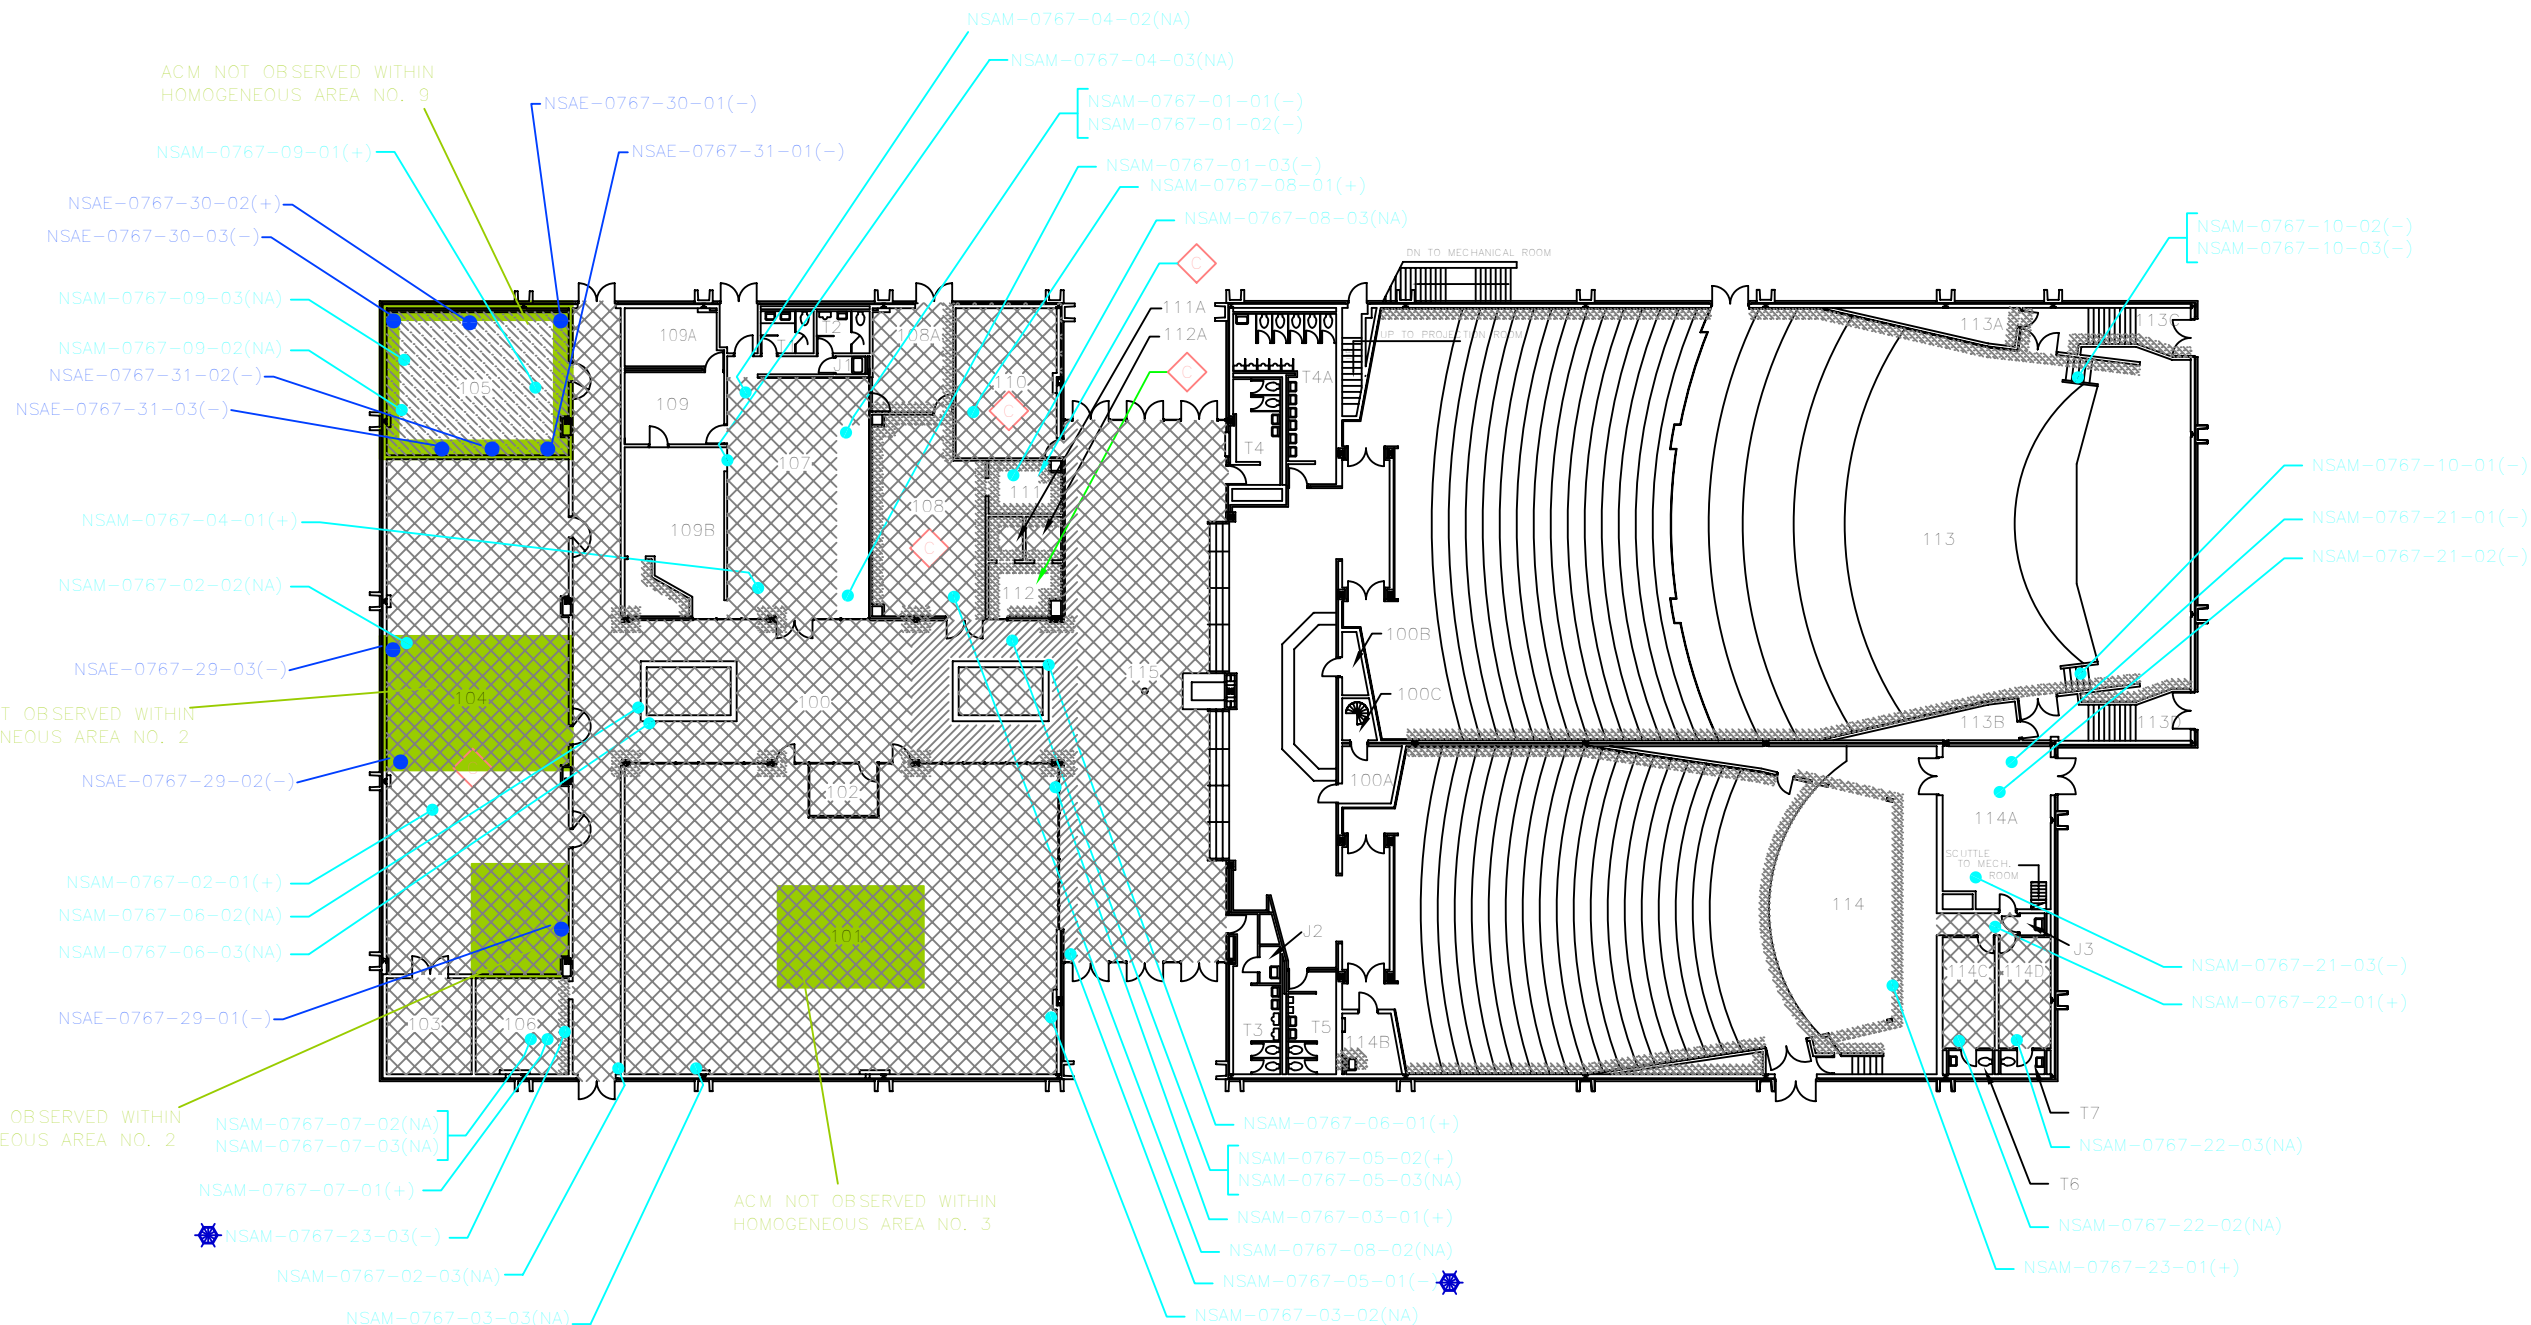

LEGEND

- - LOCATION OF BULK SAMPLES COLLECTED BY ENSAFE
- - ACM WAS NOT OBSERVED DURING ENSAFE'S 2003-2004 RE-INSPECTION

ASBESTOS-CONTAINING MATERIALS (ACM)
IDENTIFIED - FLOORS AND WALLS

⊞ FLOOR COVERING AND MASTIC (+)

⊞ FLOOR COVERING(+), MASTIC(-)

⊞ FLOOR COVERING(-), MASTIC(+)

⊞ JOINT COMPOUND ASSOCIATED WITH GYPSUM WALLBOARD

SYMBOLS


- LOCATION OF SAMPLES COLLECTED
- ⊞ CARPET MASTIC ABOVE ASBESTOS-CONTAINING FLOORING
- (+) ASBESTOS-CONTAINING MATERIAL
- (-) NON-ASBESTOS-CONTAINING MATERIAL
- (NA) INDICATES SAMPLE WAS NOT ANALYZED SINCE AT LEAST ONE SAMPLE RESULT OF THE SAME HOMOGENEOUS AREA (HA) IS POSITIVE. (SAMPLES FOR EACH HA WERE ANALYZED UNTIL POSITIVE).
- ★ THIS SAMPLE'S ANALYSIS RESULT IS NEGATIVE; HOWEVER, AT LEAST ONE OTHER SAMPLE'S ANALYSIS RESULT OF SAME HOMOGENEOUS MATERIAL IS POSITIVE. THEREFORE ENTIRE HOMOGENEOUS MATERIAL IS CONSIDERED POSITIVE FOR ASBESTOS CONTENT.

TYPICAL CAPE SAMPLE I.D. No.

NSAM-XXXX-01-01(+)

- POSITIVE (+) OR NEGATIVE (-) FOR THE PRESENCE OF ASBESTOS OR (NA) FOR NOT ANALYZED
- SAMPLE I.D. No.
- HOMOGENEOUS AREA No.
- BUILDING IDENTIFICATION
- NAVAL SUPPORT ACTIVITY MIDSOUTH

GRAPHIC SCALE



RE-INSPECTION: 767HM01_2004

SOURCE:
CAPE ENVIRONMENTAL MANAGEMENT INC.

ENSAFE

(800) 588-7962
MEMPHIS, TENNESSEE
ARKANSAS FLORIDA KENTUCKY MICHIGAN MISSISSIPPI
OHIO TENNESSEE TEXAS SOUTH CAROLINA
VIRGINIA SLOVAKIA

BUILDING 767
FIRST FLOOR PLAN
FLOORS AND WALLS
2003-2004 ASBESTOS RE-INSPECTION

DWG DATE: 08/03/04

NAME: 3134055B.068