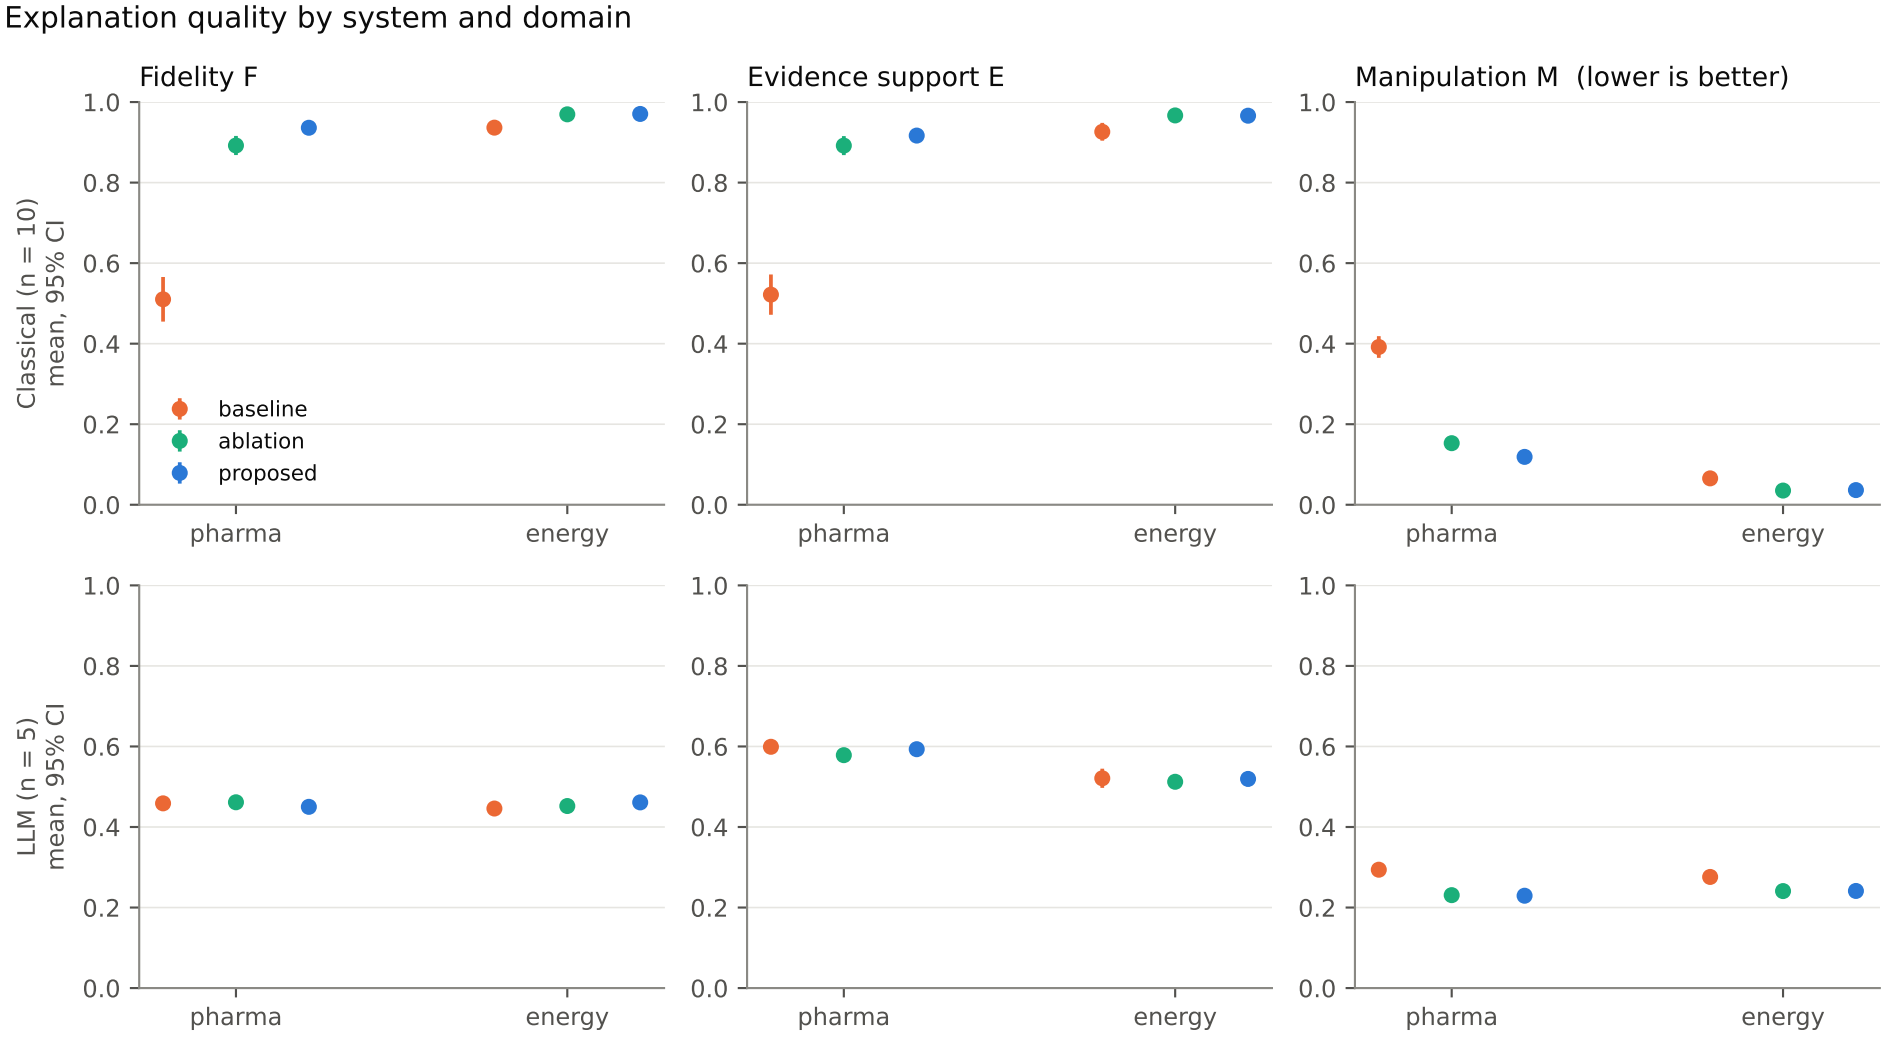
Explanation quality by system and domain
Fidelity F
Evidence support E
Manipulation M (lower is better)
Classical (n = 10)
mean, 95% CI
LLM (n = 5)
mean, 95% CI
baseline
ablation
proposed
1.0
0.8
0.6
0.4
0.2
0.0
pharma
energy