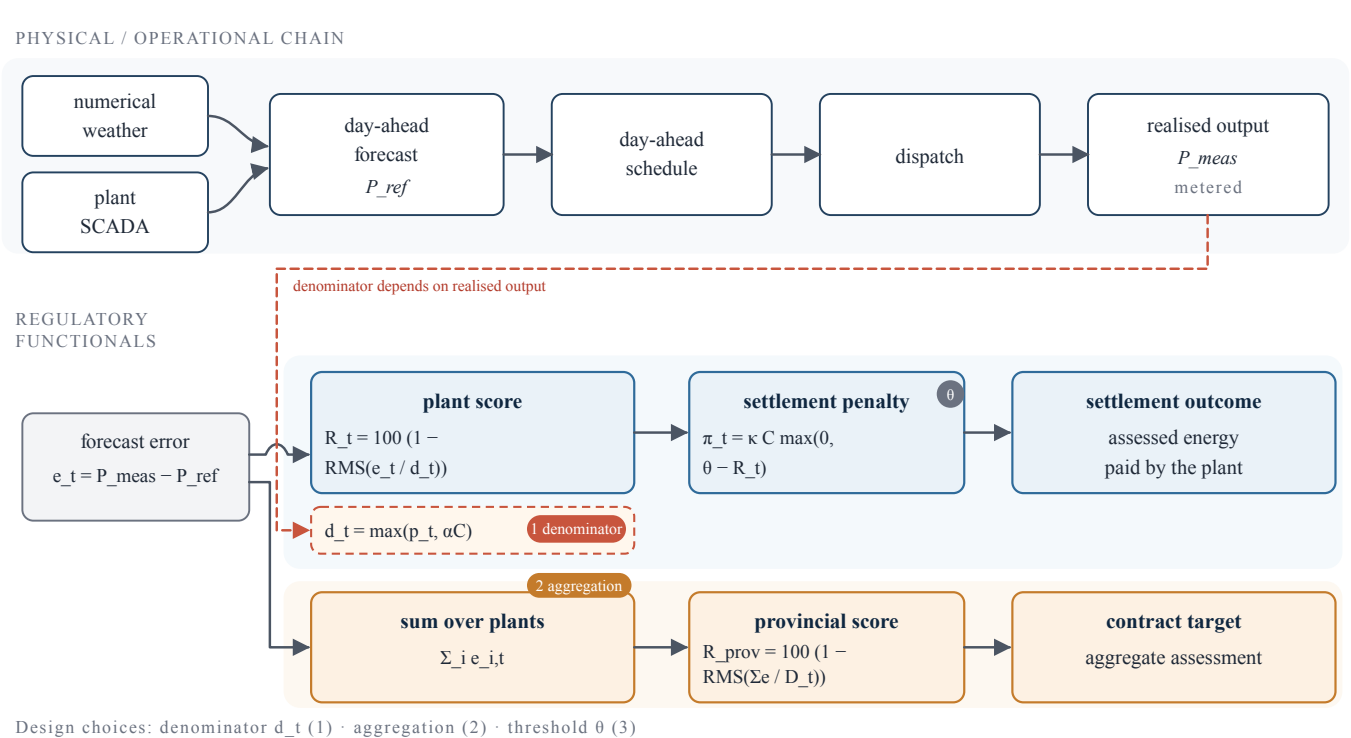

PHYSICAL / OPERATIONAL CHAIN
numerical weather
plant SCADA
day-ahead forecast
P_ref
day-ahead schedule
dispatch
realised output
P_meas
metered
denominator depends on realised output
REGULATORY FUNCTIONALS
forecast error
e_t = P_meas − P_ref
plant score
R_t = 100 (1 − RMS(e_t / d_t))
settlement penalty
θ
π_t = κ C max(0, θ − R_t)
settlement outcome
assessed energy paid by the plant
d_t = max(p_t, αC)
1 denominator
2 aggregation
sum over plants
Σ_i e_i,t
provincial score
R_prov = 100 (1 − RMS(Σe / D_t))
contract target
aggregate assessment
Design choices: denominator d_t (1) · aggregation (2) · threshold θ (3)