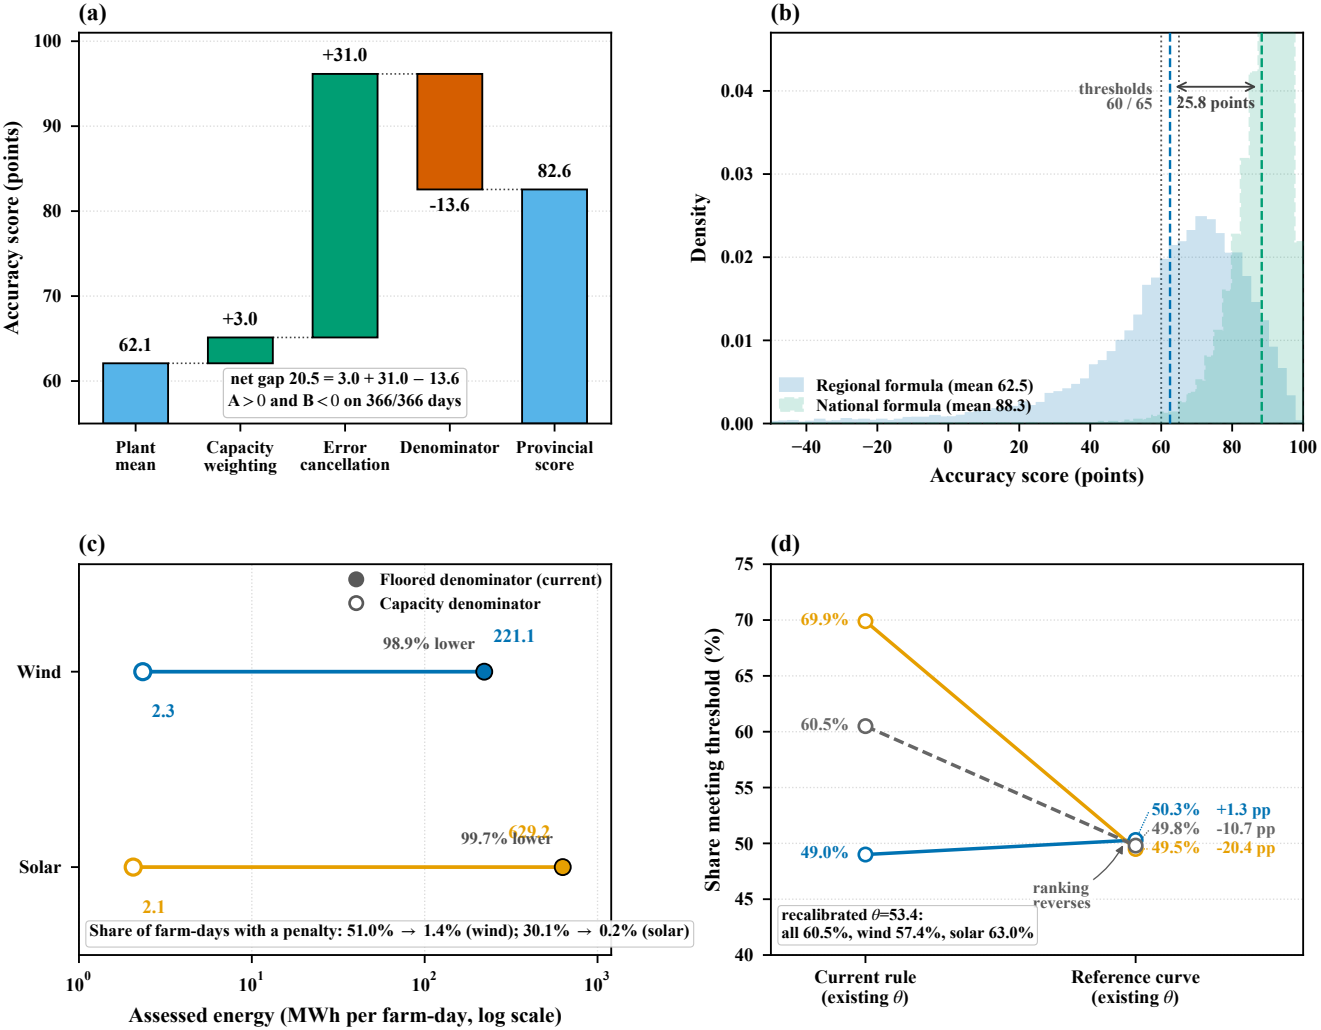

(a)
Accuracy score (points)
100
90
80
70
60
62.1
+3.0
+31.0
-13.6
82.6
net gap 20.5 = 3.0 + 31.0 − 13.6
A > 0 and B < 0 on 366/366 days
Plant mean
Capacity weighting
Error cancellation
Denominator
Provincial score
(b)
Density
0.04
0.03
0.02
0.01
0.00
thresholds 60 / 65
25.8 points
Regional formula (mean 62.5)
National formula (mean 88.3)
−40
−20
0
20
40
60
80
100
Accuracy score (points)
(c)
Floored denominator (current)
Capacity denominator
Wind
98.9% lower
221.1
2.3
Solar
99.7% lower
629.2
2.1
Share of farm-days with a penalty: 51.0% → 1.4% (wind); 30.1% → 0.2% (solar)
10^0
10^1
10^2
10^3
Assessed energy (MWh per farm-day, log scale)
(d)
Share meeting threshold (%)
75
70
65
60
55
50
45
40
69.9%
60.5%
49.0%
50.3% +1.3 pp
49.8% -10.7 pp
49.5% -20.4 pp
ranking reverses
recalibrated θ=53.4:
all 60.5%, wind 57.4%, solar 63.0%
Current rule (existing θ)
Reference curve (existing θ)