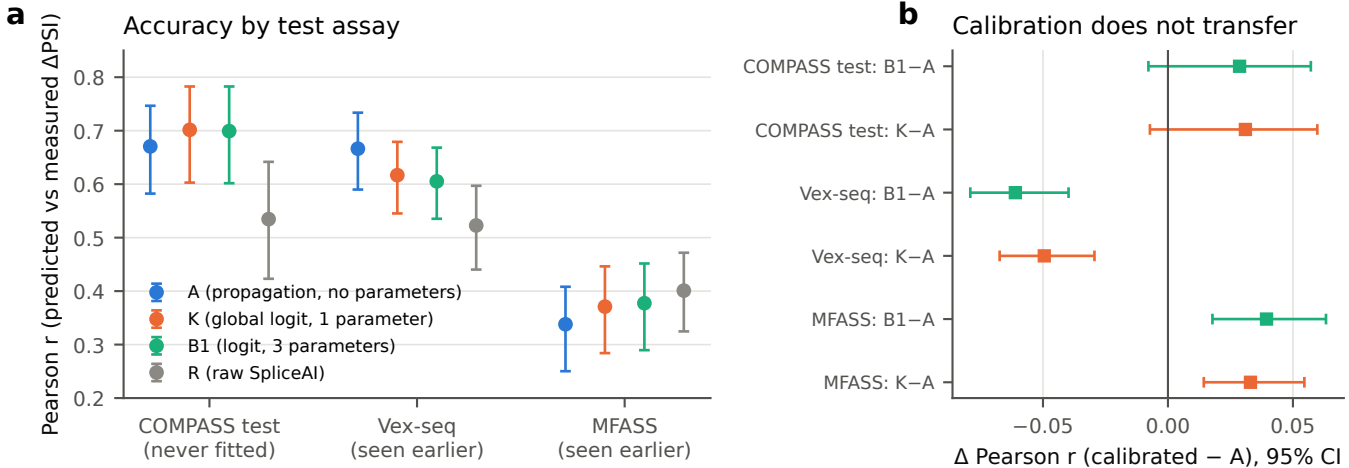
a
Accuracy by test assay
Pearson r (predicted vs measured ΔPSI)
0.8
0.7
0.6
0.5
0.4
0.3
0.2
A (propagation, no parameters)
K (global logit, 1 parameter)
B1 (logit, 3 parameters)
R (raw SpliceAI)
COMPASS test
(never fitted)
Vex-seq
(seen earlier)
MFASS
(seen earlier)
b
Calibration does not transfer
COMPASS test: B1−A
COMPASS test: K−A
Vex-seq: B1−A
Vex-seq: K−A
MFASS: B1−A
MFASS: K−A
−0.05
0.00
0.05
Δ Pearson r (calibrated − A), 95% CI