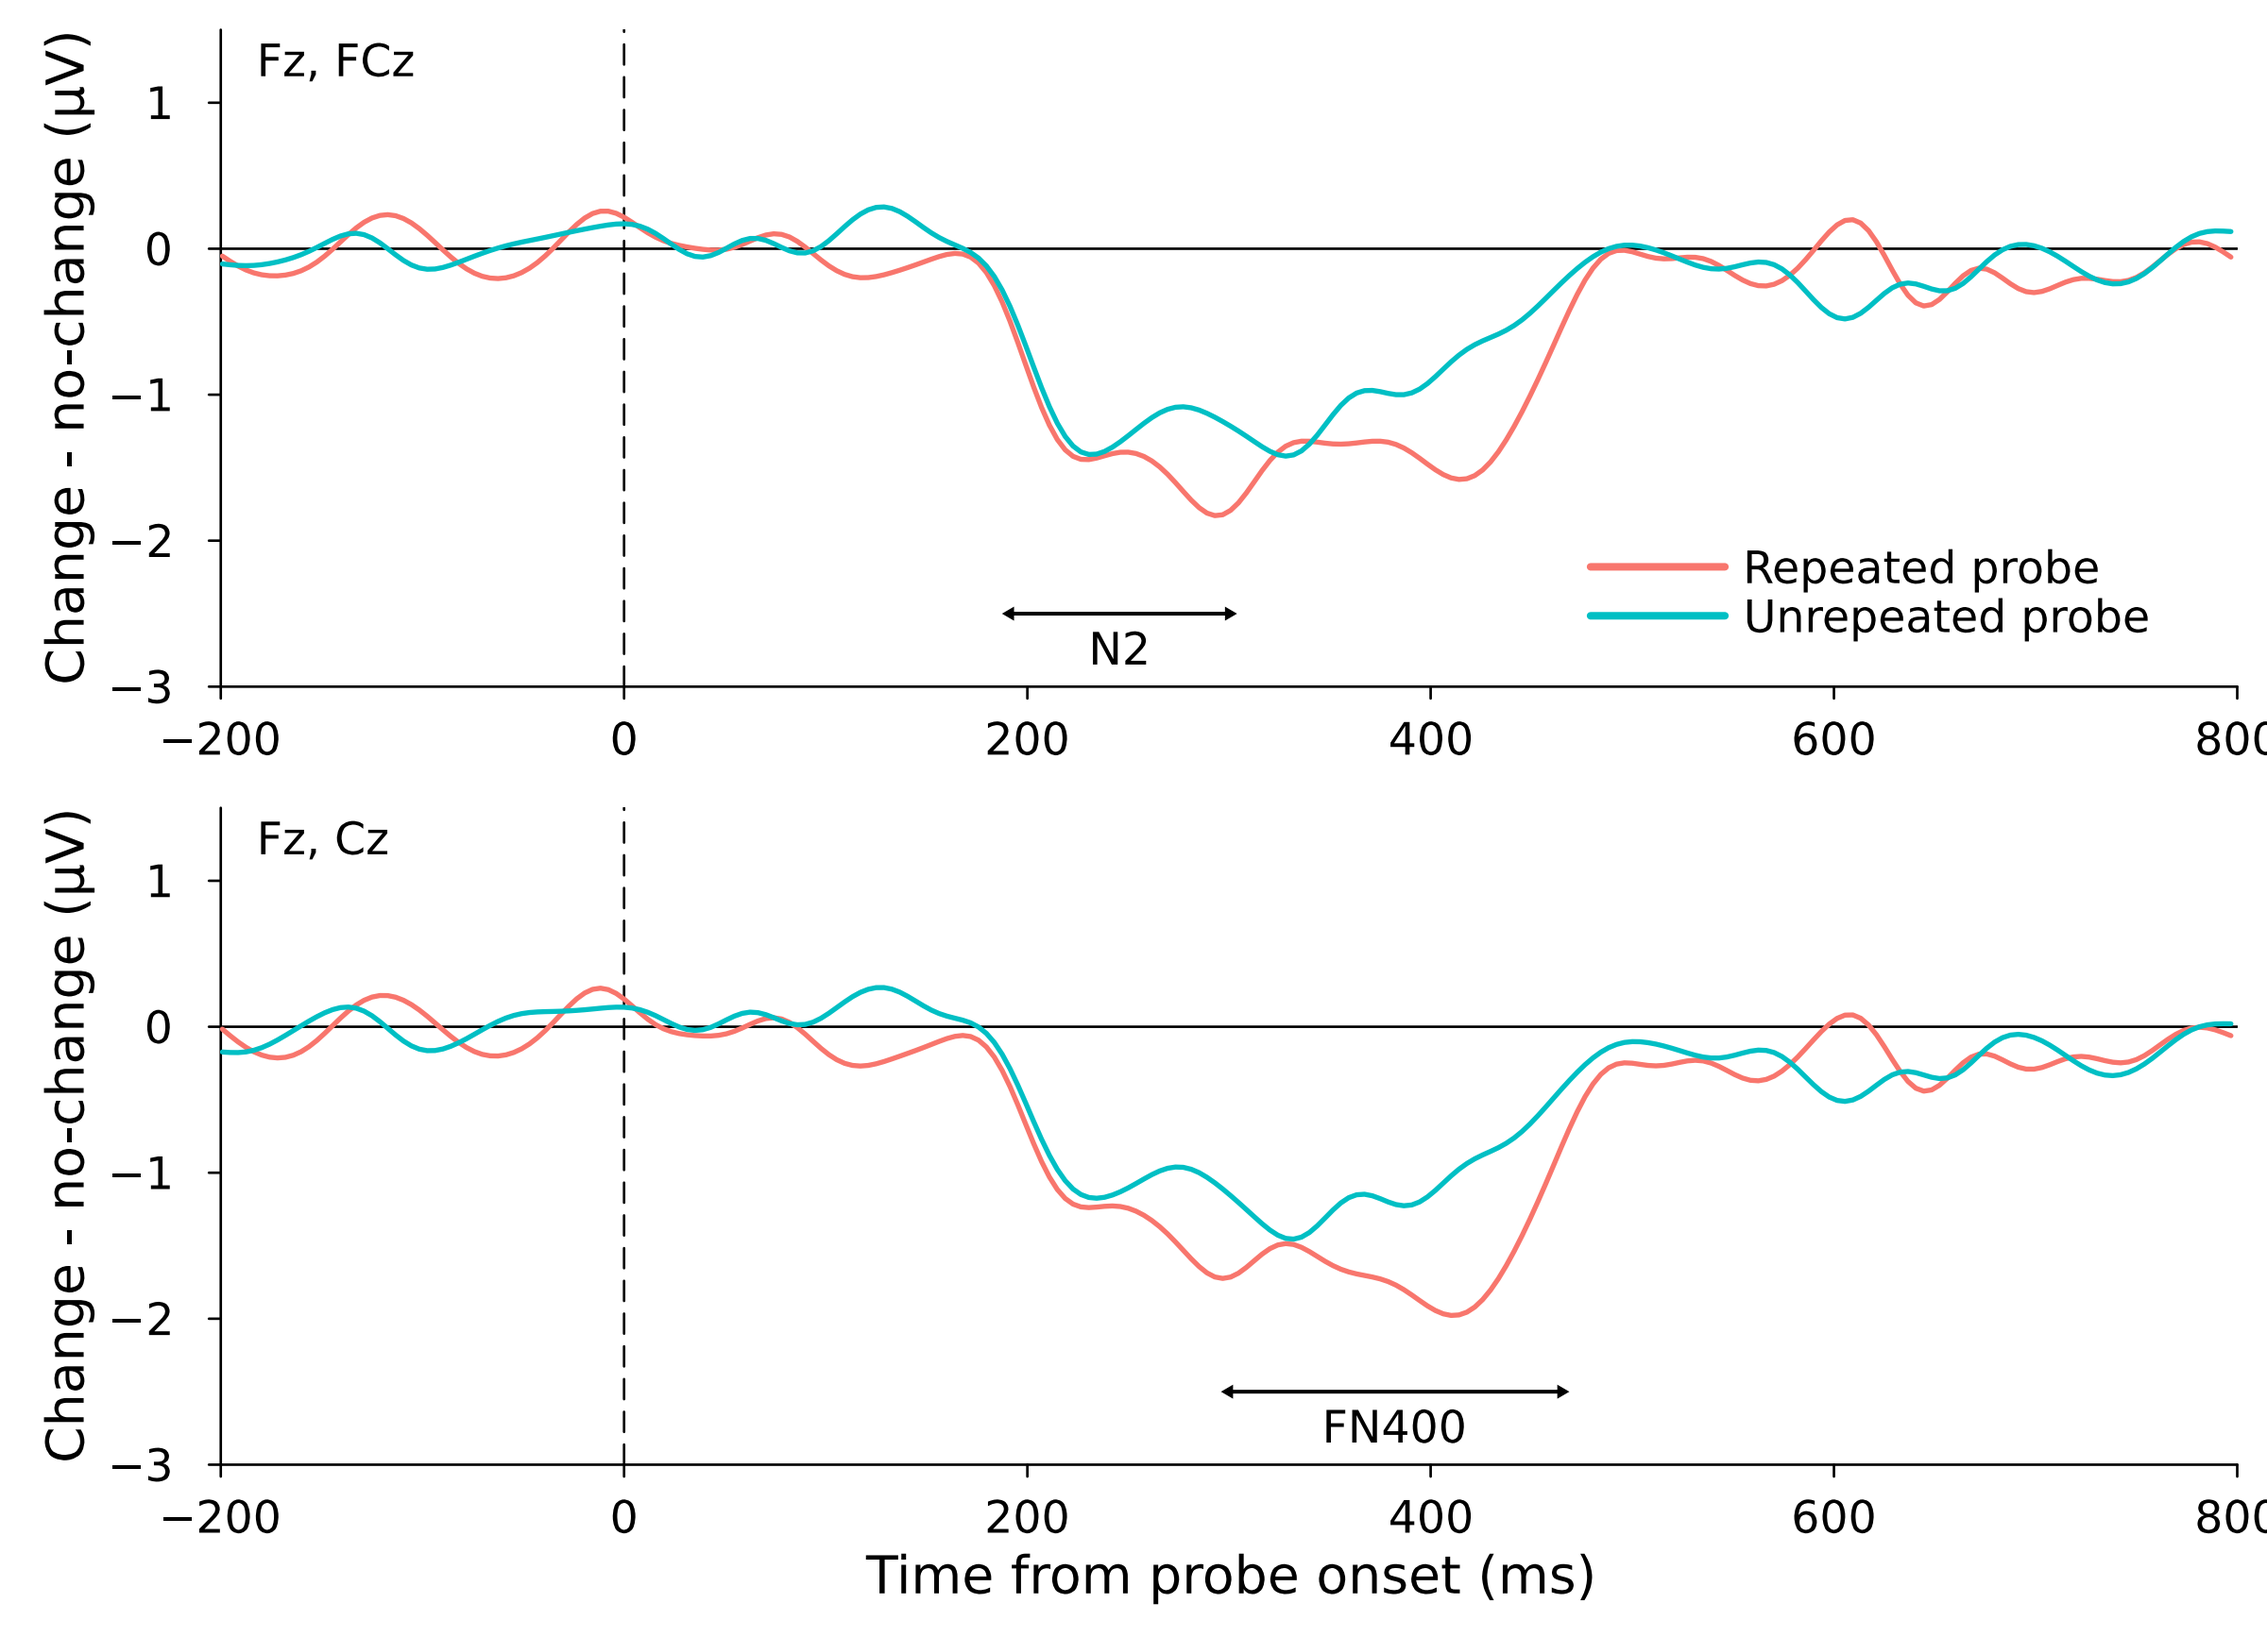
Fz, FCz
Change - no-change (μV)
1
0
−1
−2
−3
N2
Repeated probe
Unrepeated probe
−200
0
200
400
600
800
Fz, Cz
Change - no-change (μV)
FN400
Time from probe onset (ms)