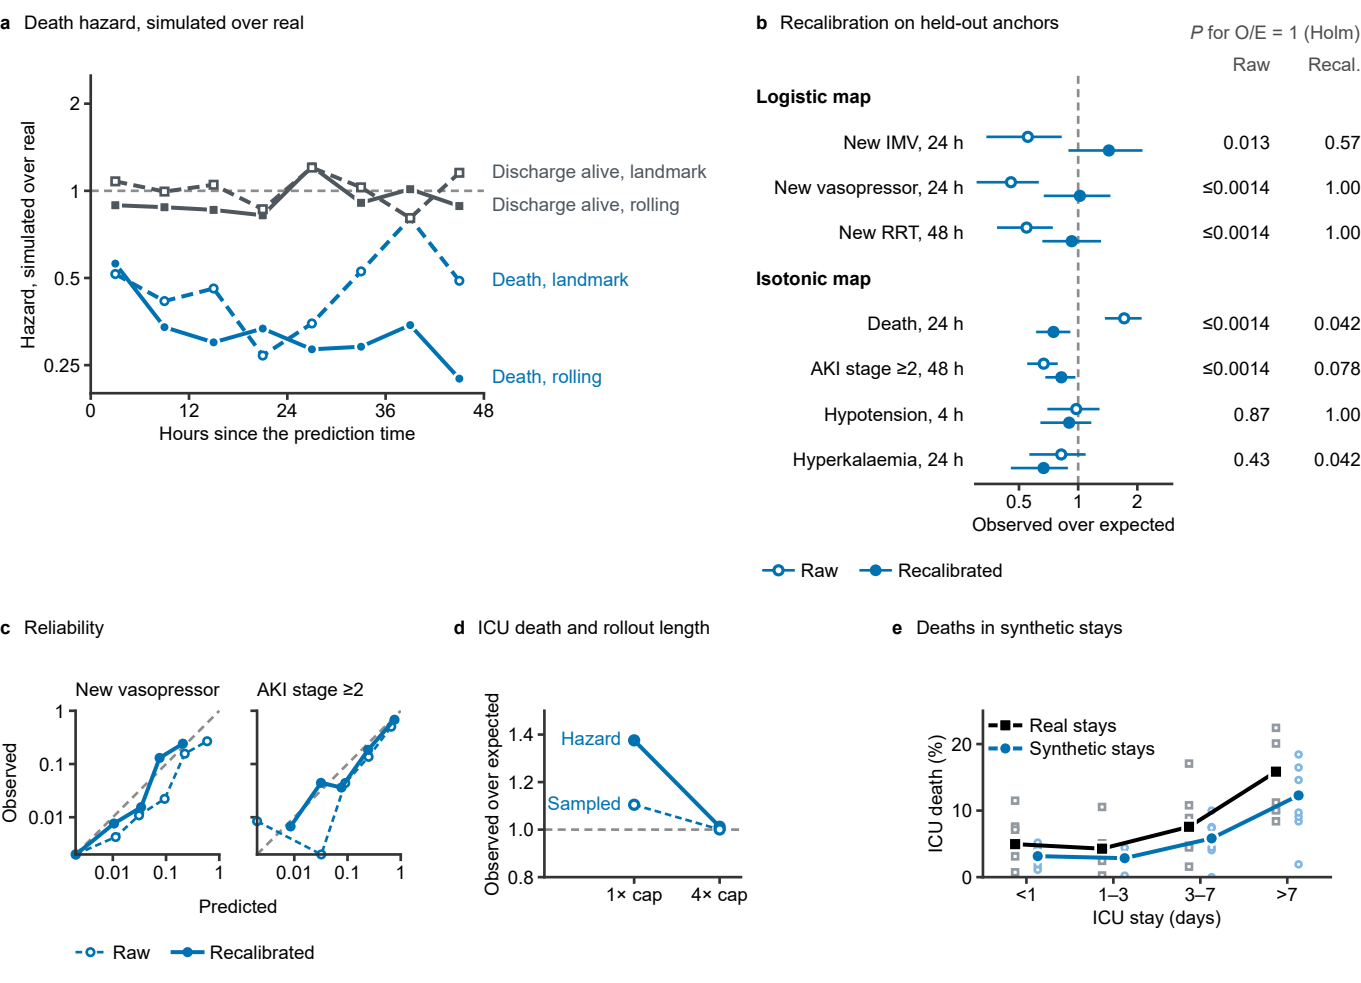

a Death hazard, simulated over real
Hazard, simulated over real
2
1
0.5
0.25
0
12
24
36
48
Hours since the prediction time
Discharge alive, landmark
Discharge alive, rolling
Death, landmark
Death, rolling
b Recalibration on held-out anchors
P for O/E = 1 (Holm)
Raw
Recal.
Logistic map
New IMV, 24 h
0.013
0.57
New vasopressor, 24 h
≤0.0014
1.00
New RRT, 48 h
≤0.0014
1.00
Isotonic map
Death, 24 h
≤0.0014
0.042
AKI stage ≥2, 48 h
≤0.0014
0.078
Hypotension, 4 h
0.87
1.00
Hyperkalaemia, 24 h
0.43
0.042
0.5
1
2
Observed over expected
Raw
Recalibrated
c Reliability
New vasopressor
AKI stage ≥2
Observed
1
0.1
0.01
0.01
0.1
1
Predicted
Raw
Recalibrated
d ICU death and rollout length
Observed over expected
1.4
1.2
1.0
0.8
Hazard
Sampled
1× cap
4× cap
e Deaths in synthetic stays
ICU death (%)
20
10
0
Real stays
Synthetic stays
<1
1–3
3–7
>7
ICU stay (days)