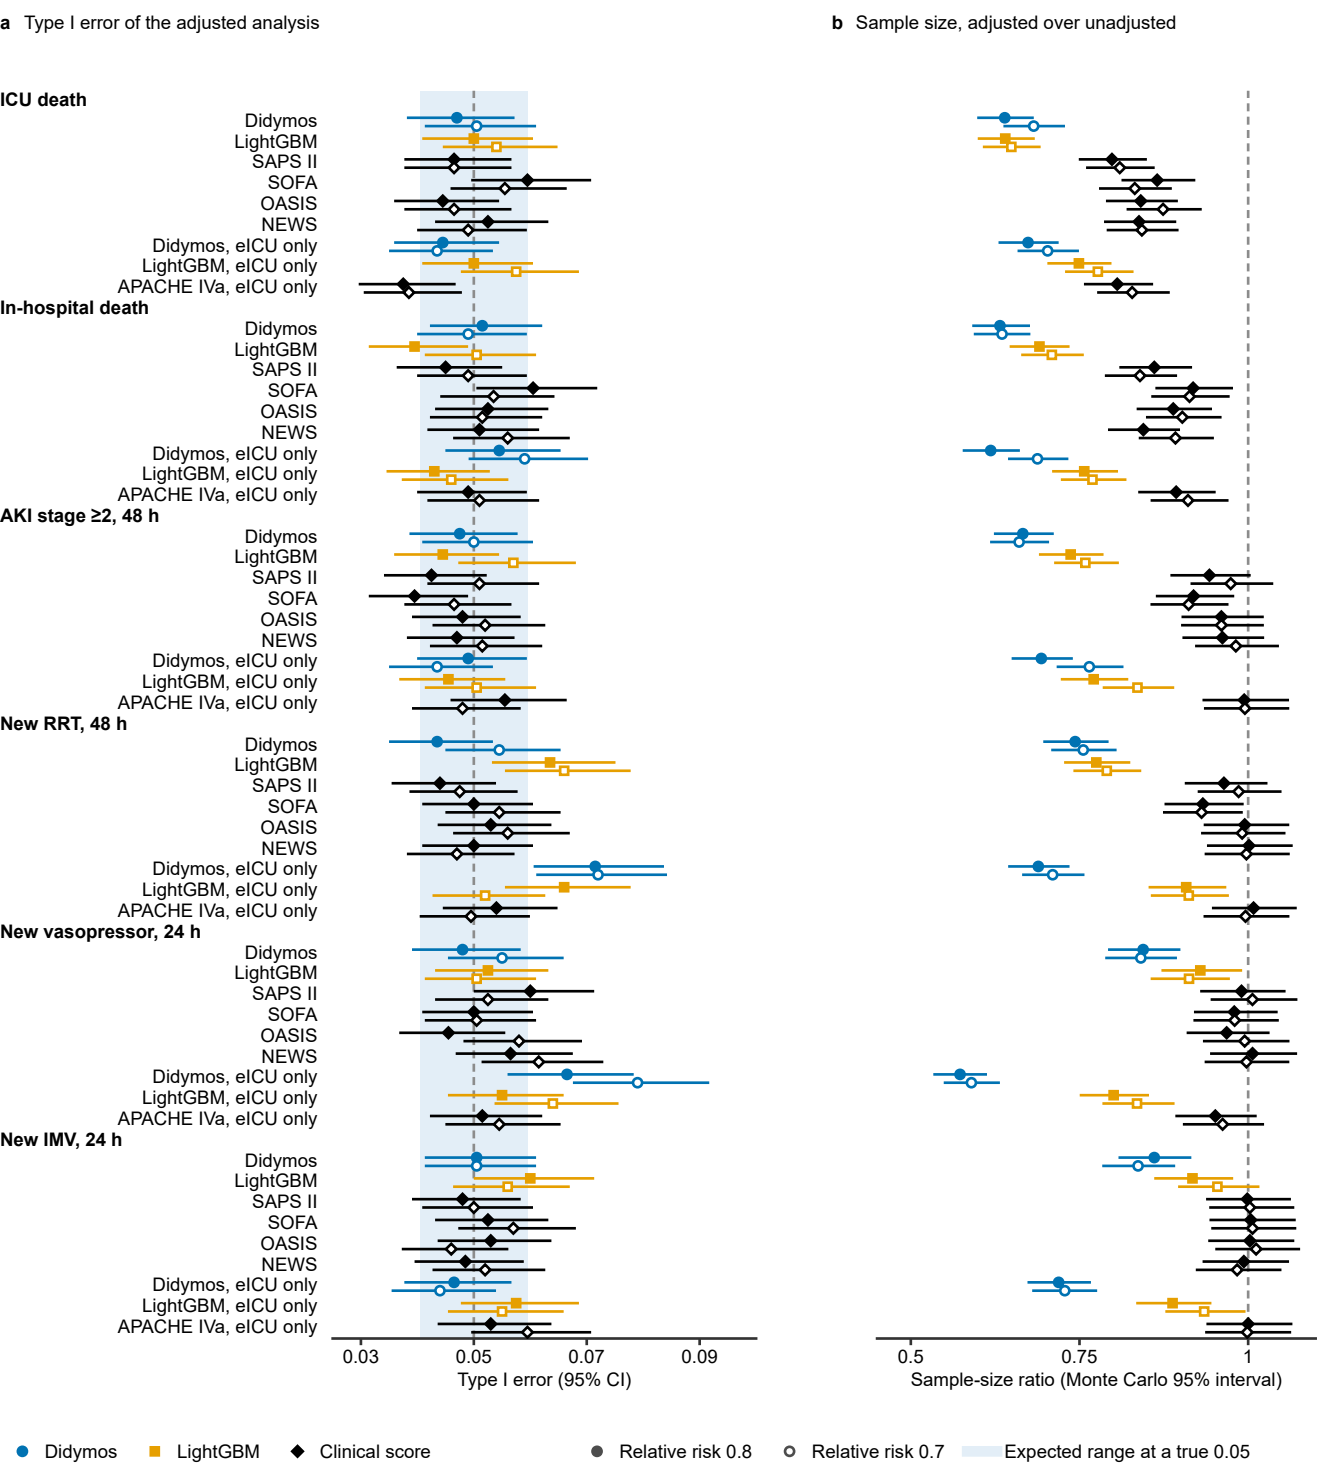

a Type I error of the adjusted analysis
b Sample size, adjusted over unadjusted
ICU death
Didymos
LightGBM
SAPS II
SOFA
OASIS
NEWS
Didymos, eICU only
LightGBM, eICU only
APACHE IVa, eICU only
In-hospital death
Didymos
LightGBM
SAPS II
SOFA
OASIS
NEWS
Didymos, eICU only
LightGBM, eICU only
APACHE IVa, eICU only
AKI stage ≥2, 48 h
Didymos
LightGBM
SAPS II
SOFA
OASIS
NEWS
Didymos, eICU only
LightGBM, eICU only
APACHE IVa, eICU only
New RRT, 48 h
Didymos
LightGBM
SAPS II
SOFA
OASIS
NEWS
Didymos, eICU only
LightGBM, eICU only
APACHE IVa, eICU only
New vasopressor, 24 h
Didymos
LightGBM
SAPS II
SOFA
OASIS
NEWS
Didymos, eICU only
LightGBM, eICU only
APACHE IVa, eICU only
New IMV, 24 h
Didymos
LightGBM
SAPS II
SOFA
OASIS
NEWS
Didymos, eICU only
LightGBM, eICU only
APACHE IVa, eICU only
0.03
0.05
0.07
0.09
Type I error (95% CI)
0.5
0.75
1
Sample-size ratio (Monte Carlo 95% interval)
Didymos
LightGBM
Clinical score
Relative risk 0.8
Relative risk 0.7
Expected range at a true 0.05