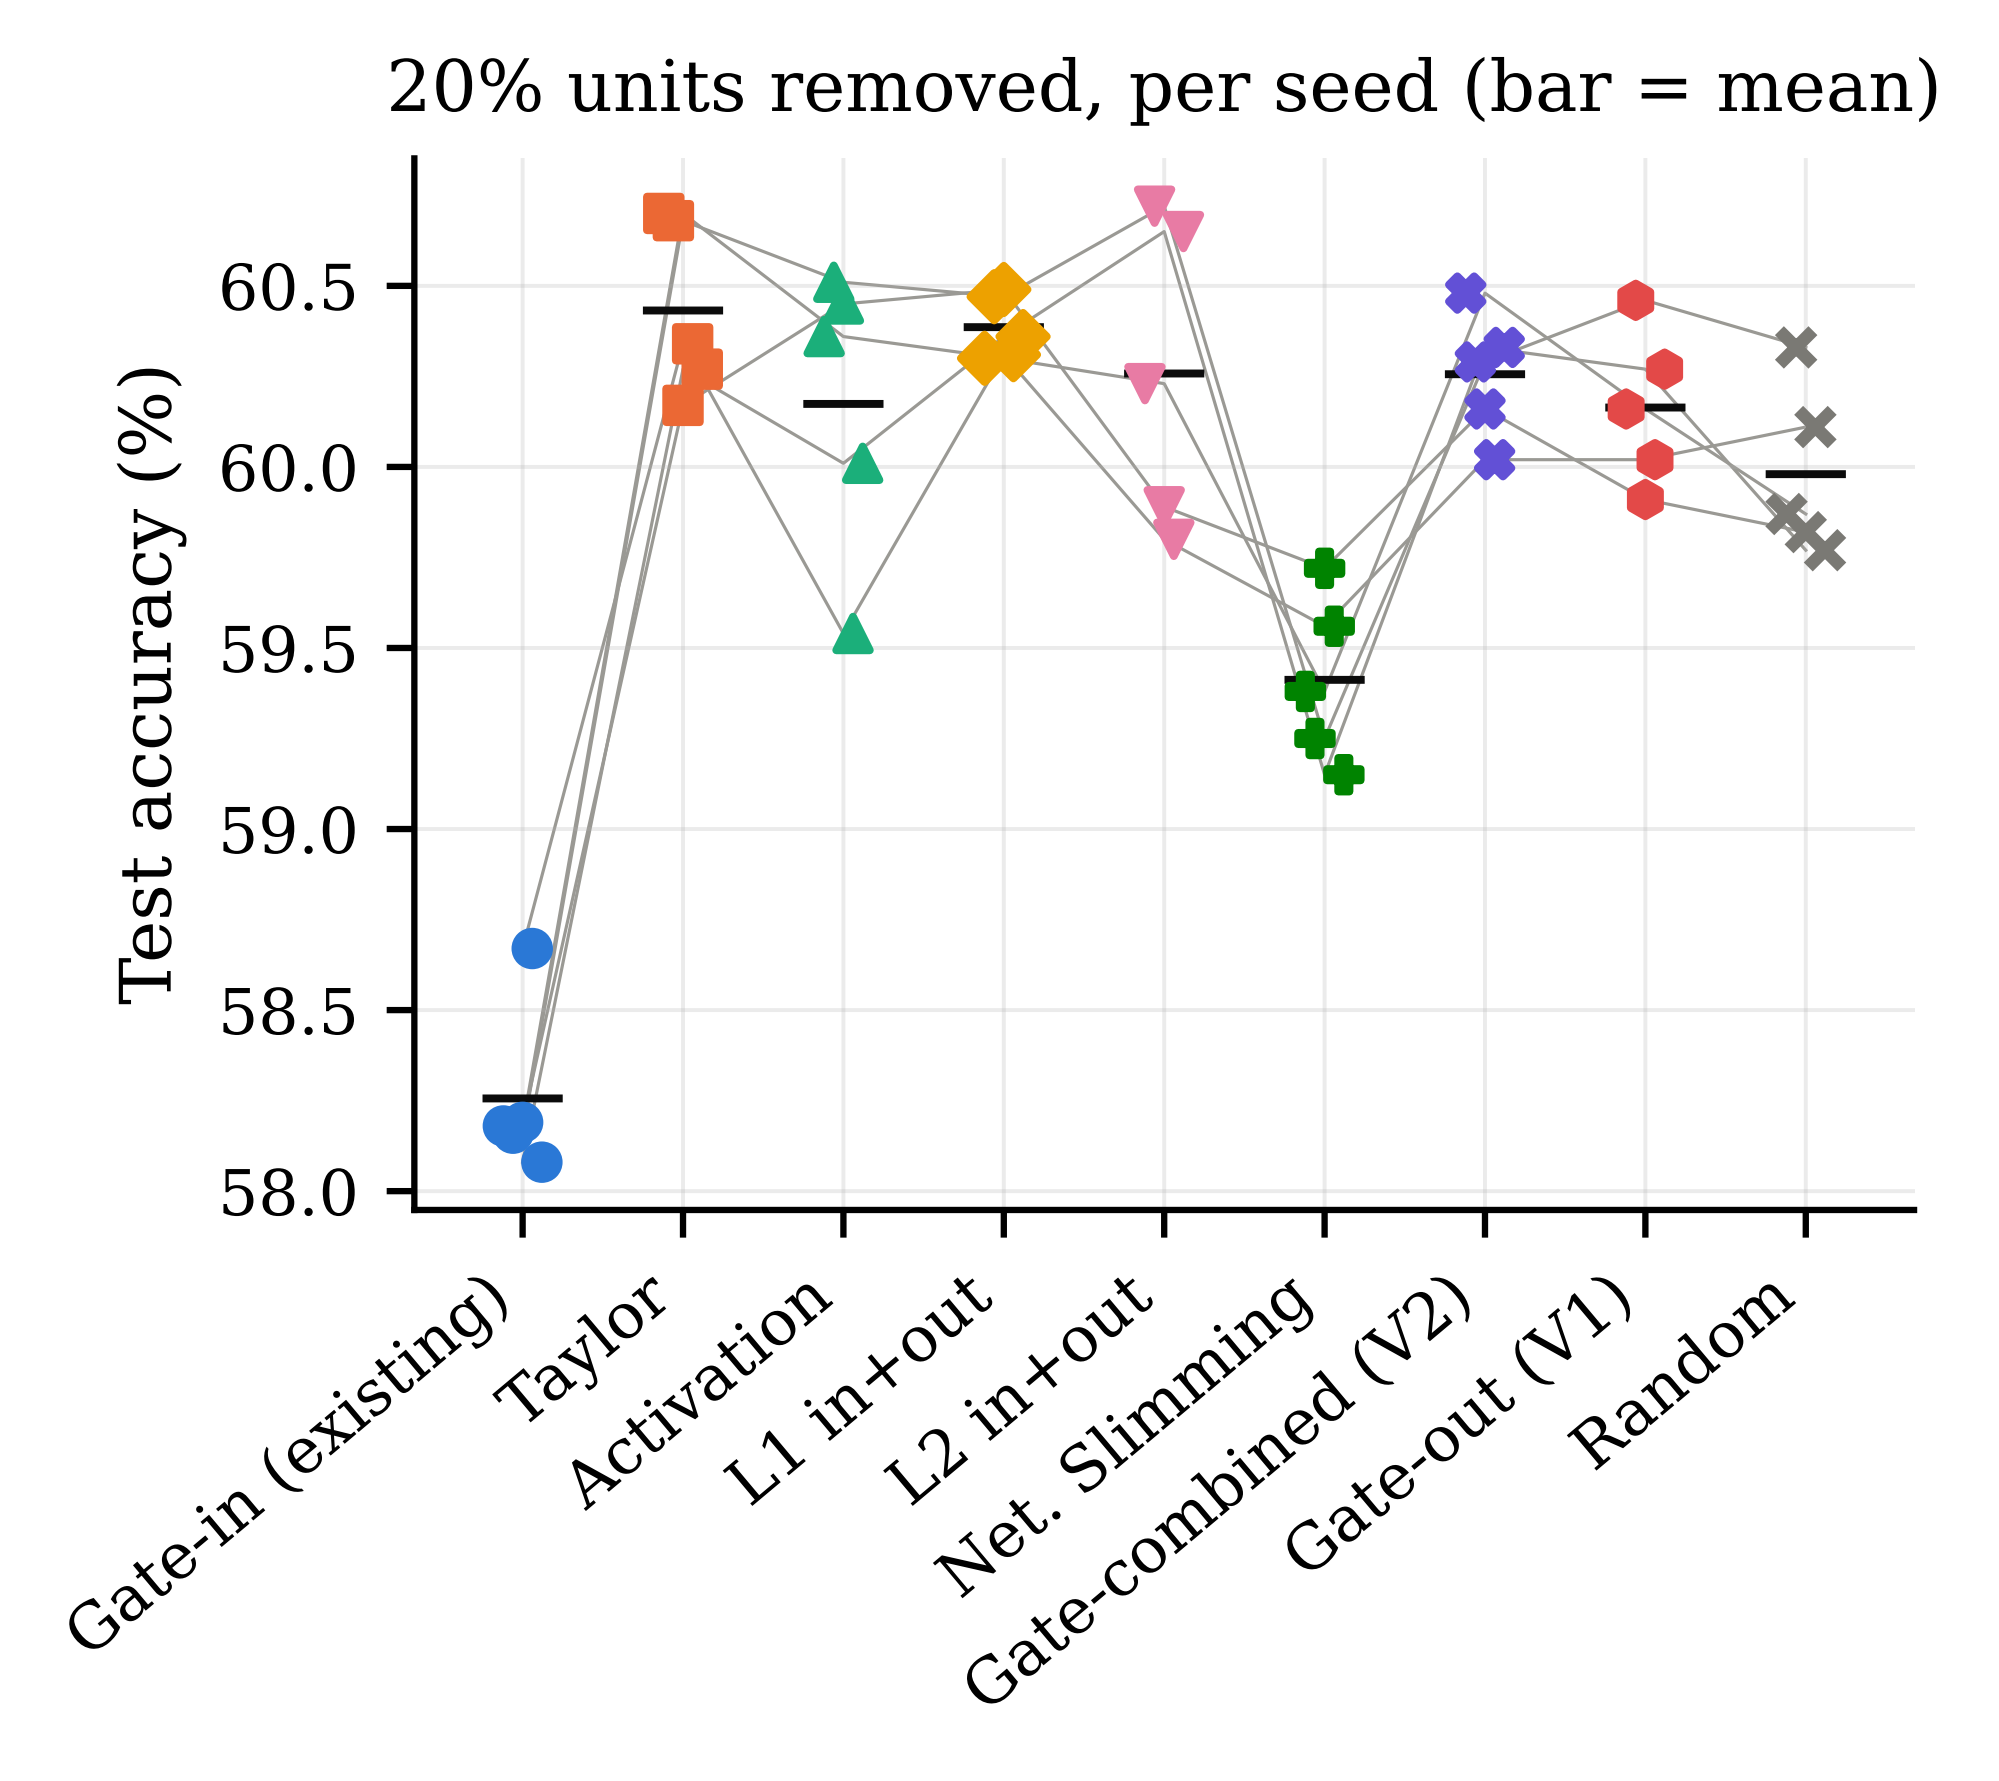
20% units removed, per seed (bar = mean)
Test accuracy (%)
60.5
60.0
59.5
59.0
58.5
58.0
Gate-in (existing)
Taylor
Activation
L1 in+out
L2 in+out
Net. Slimming
Gate-combined (V2)
Gate-out (V1)
Random