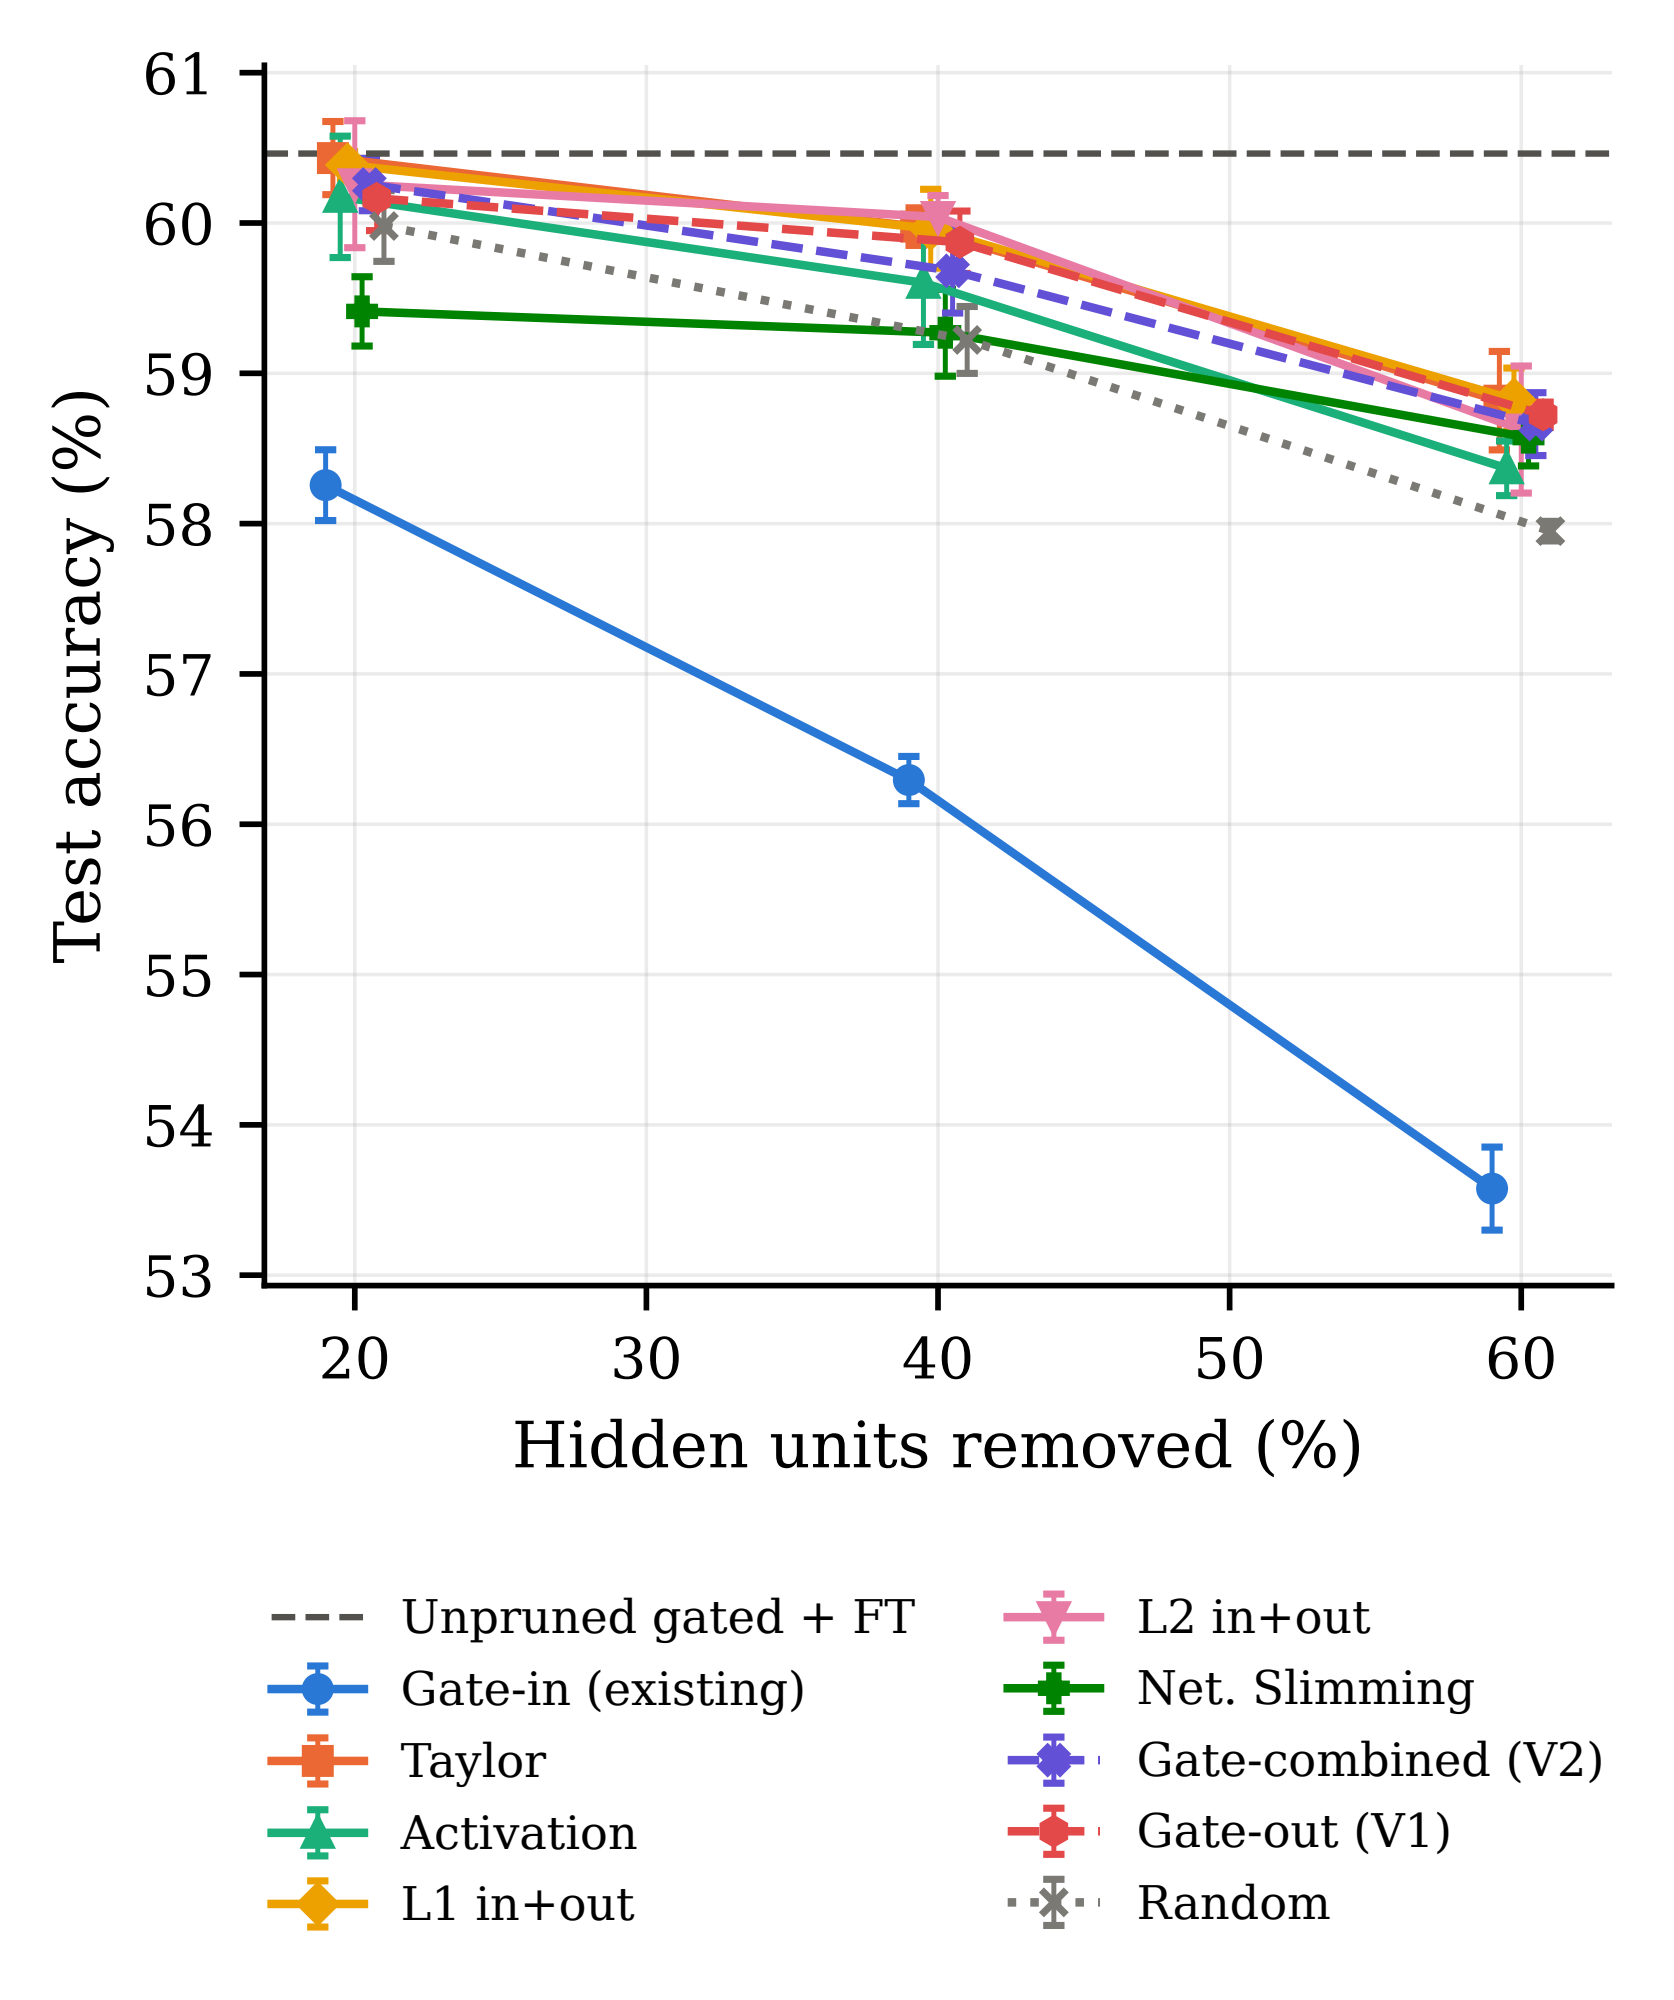
61
60
59
58
57
56
55
54
53
Test accuracy (%)
20
30
40
50
60
Hidden units removed (%)
Unpruned gated + FT
Gate-in (existing)
Taylor
Activation
L1 in+out
L2 in+out
Net. Slimming
Gate-combined (V2)
Gate-out (V1)
Random