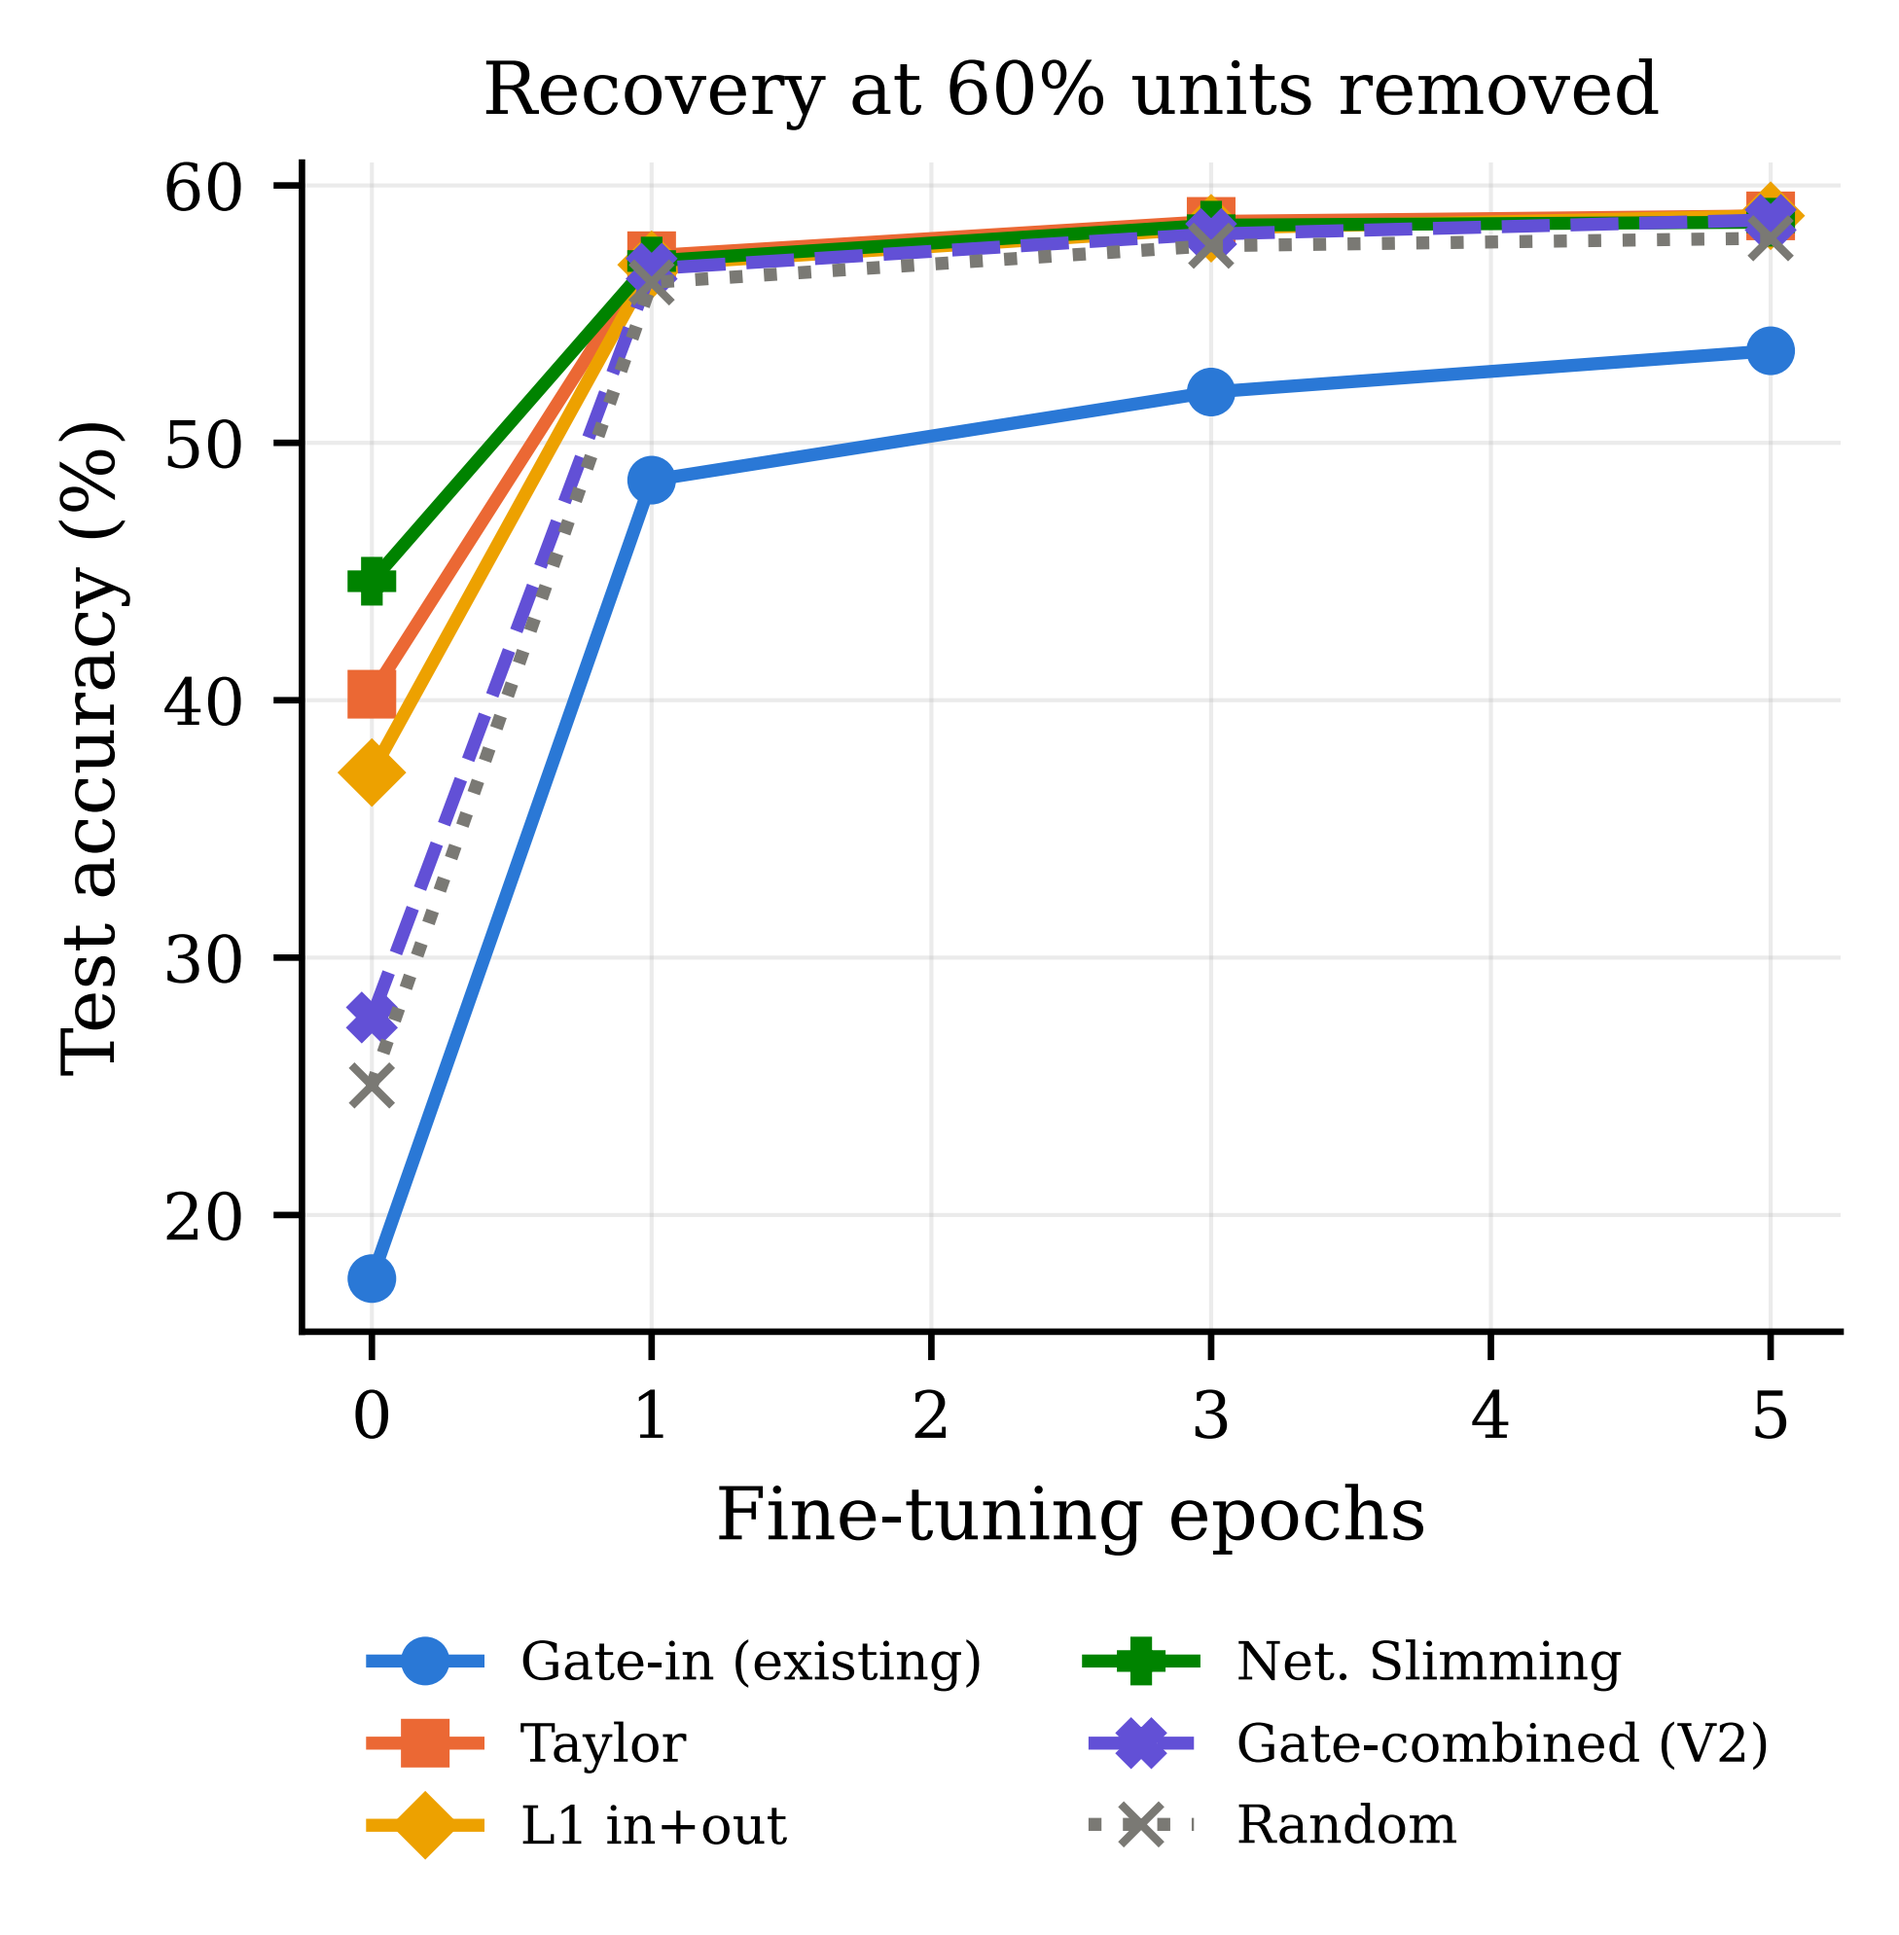
Recovery at 60% units removed
Test accuracy (%)
60
50
40
30
20
0
1
2
3
4
5
Fine-tuning epochs
Gate-in (existing)
Net. Slimming
Taylor
Gate-combined (V2)
L1 in+out
Random