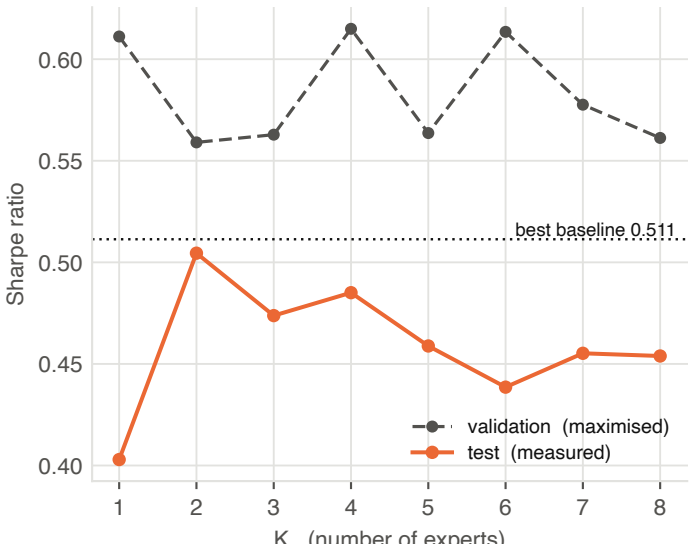
sector11 · reservoir searched inside each K
Sharpe ratio
0.60
0.55
0.50
0.45
0.40
best baseline 0.511
validation (maximised)
test (measured)
1
2
3
4
5
6
7
8
K (number of experts)

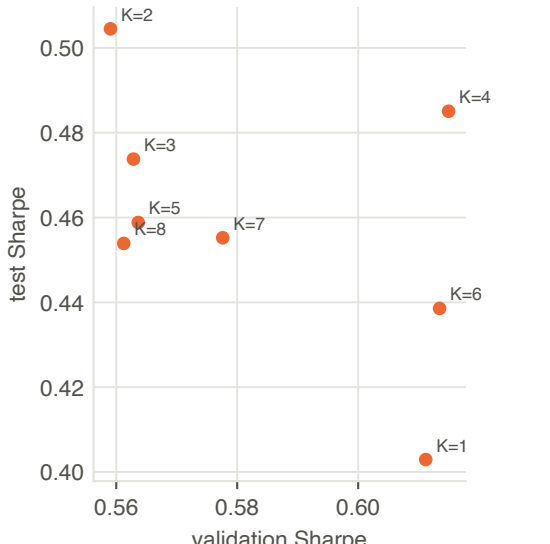
selection points the wrong way r = -0.477
test Sharpe
0.50
0.48
0.46
0.44
0.42
0.40
K=2
K=4
K=3
K=5
K=8
K=7
K=6
K=1
0.56
0.58
0.60
validation Sharpe