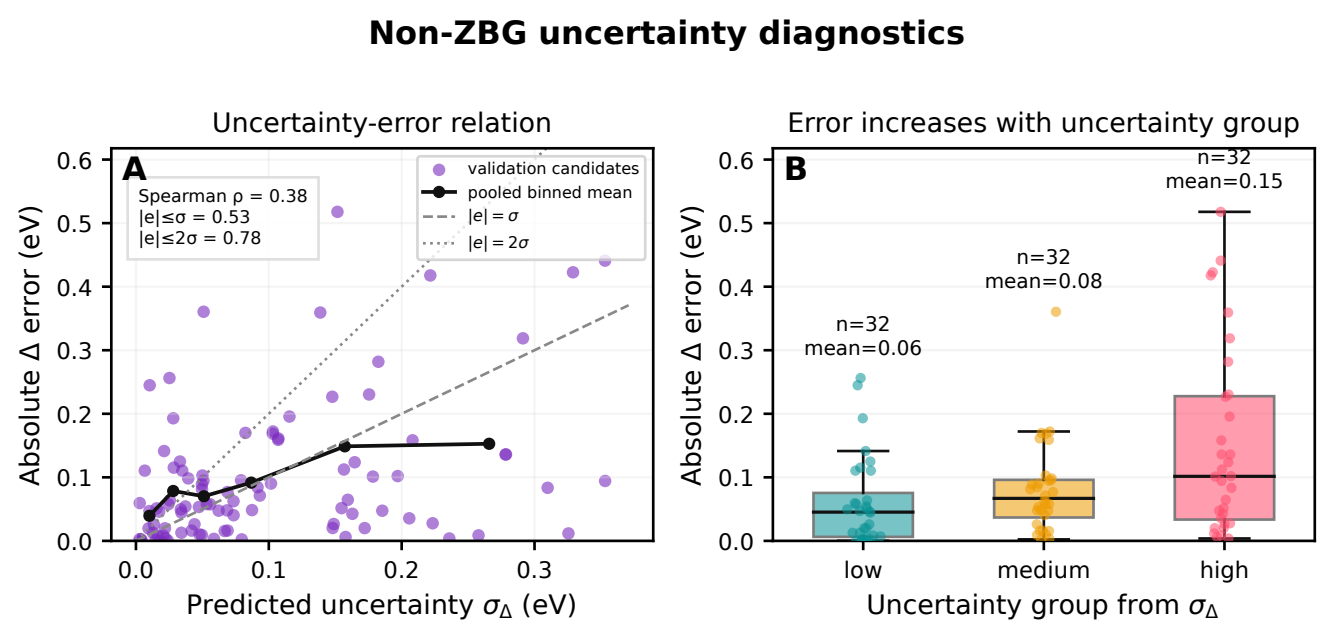
Non-ZBG uncertainty diagnostics
Uncertainty-error relation
A
Spearman ρ = 0.38
|e|≤σ = 0.53
|e|≤2σ = 0.78
validation candidates
pooled binned mean
|e| = σ
|e| = 2σ
Absolute Δ error (eV)
Predicted uncertainty σΔ (eV)
Error increases with uncertainty group
B
n=32
mean=0.06
n=32
mean=0.08
n=32
mean=0.15
low
medium
high
Uncertainty group from σΔ