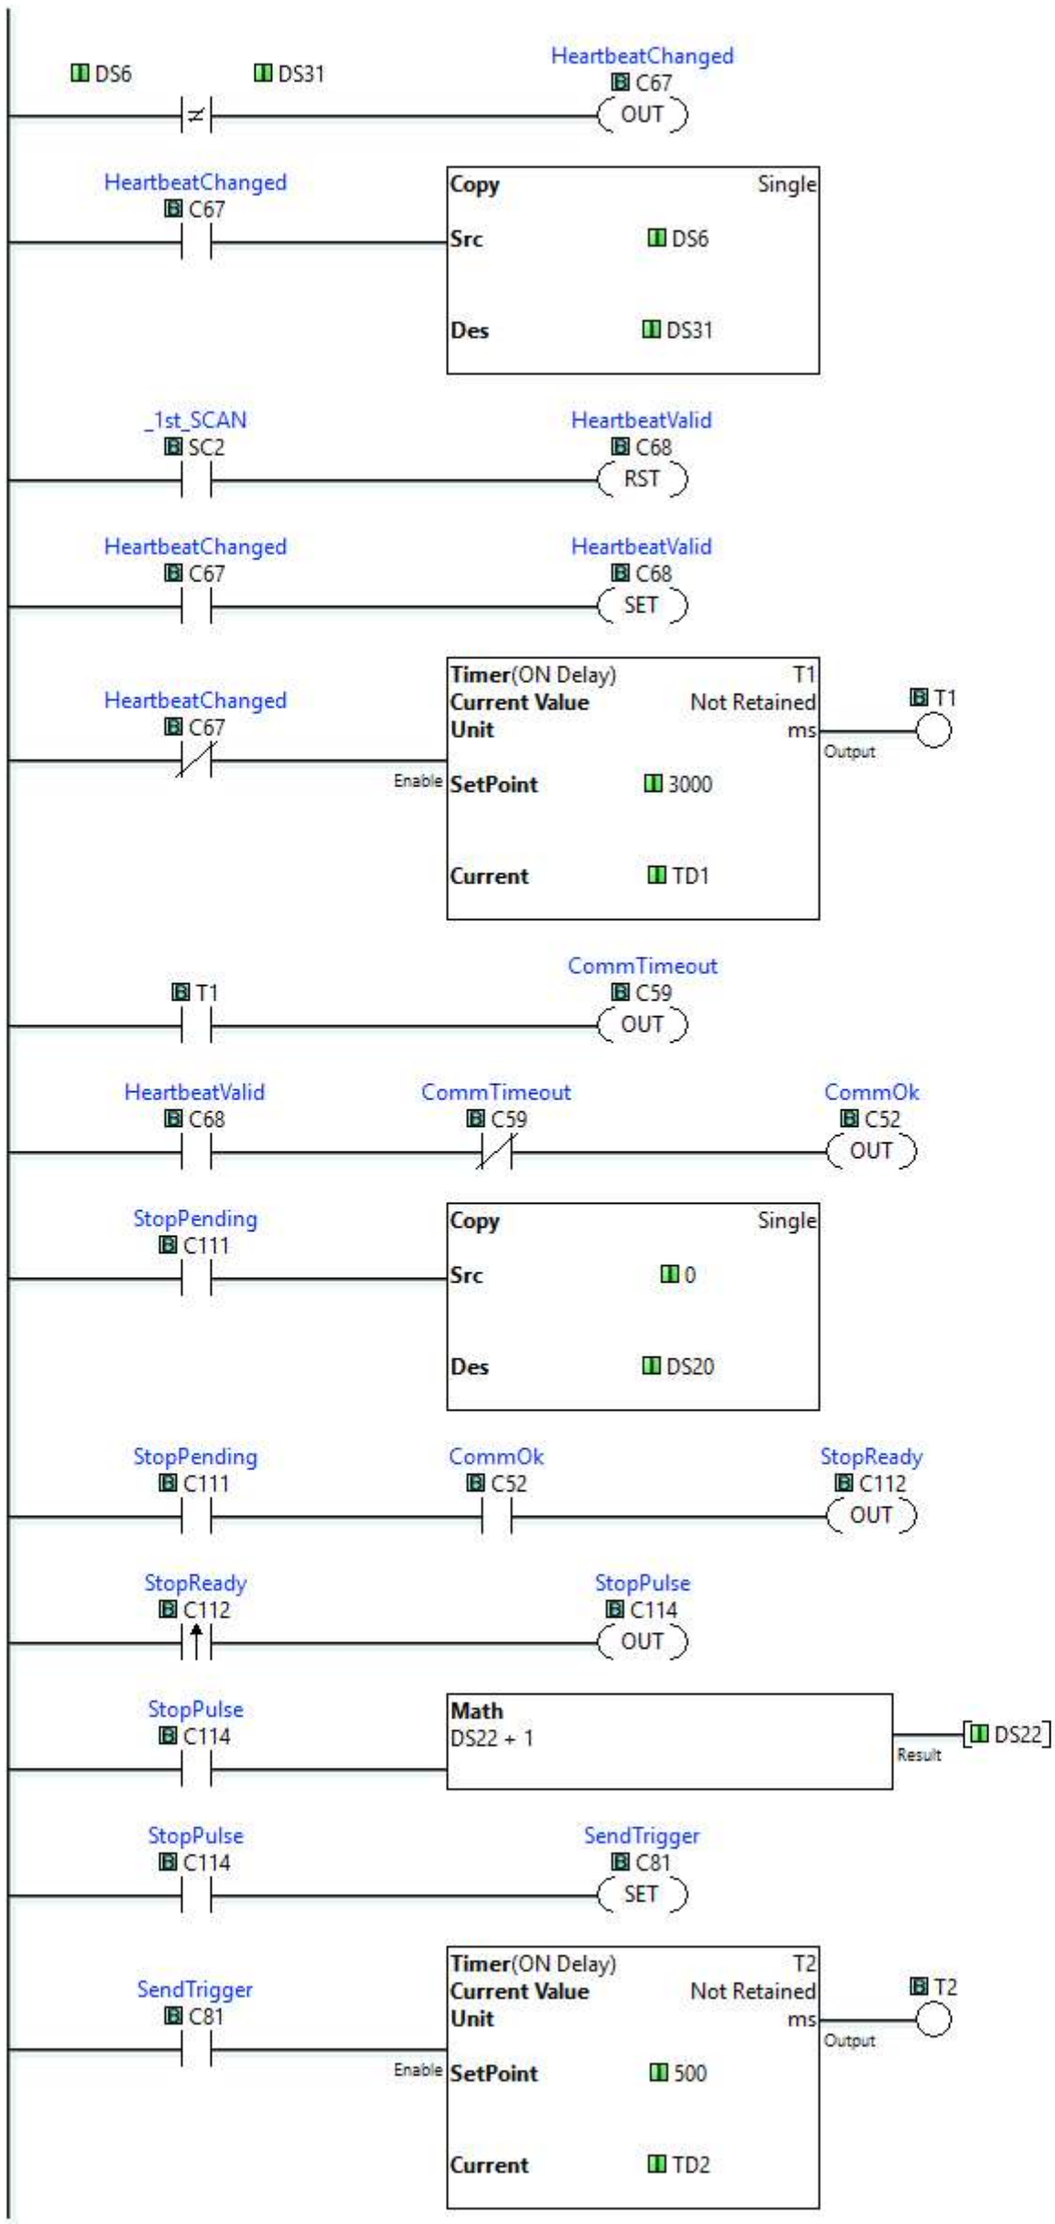
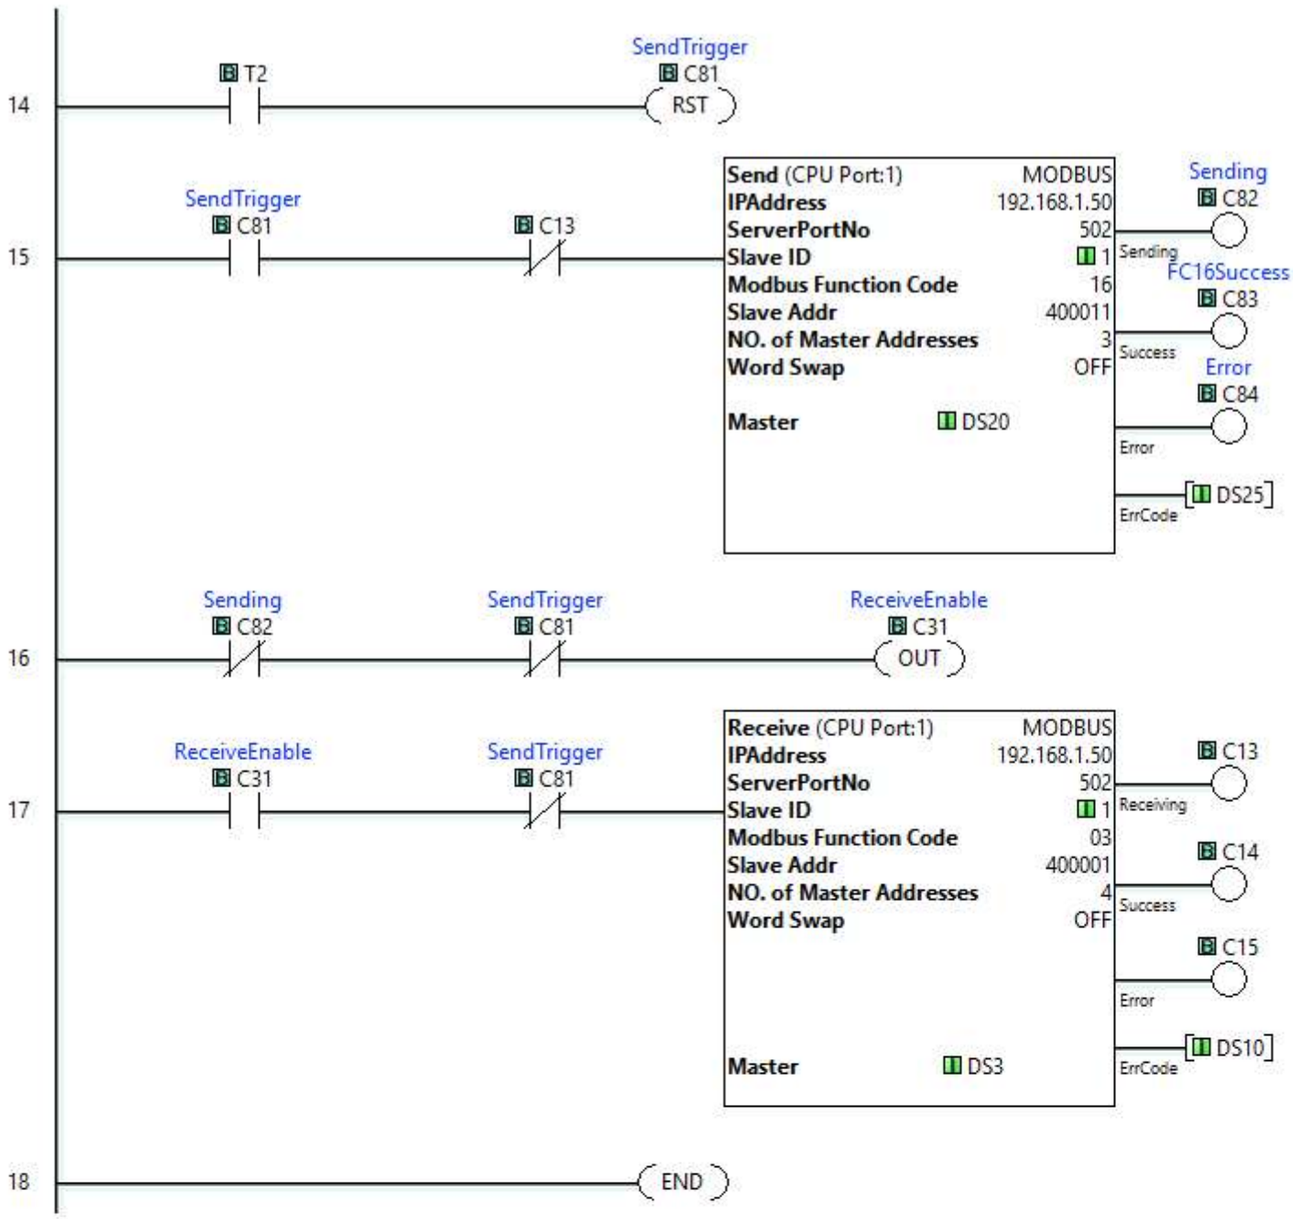

1
DS6
DS31
HeartbeatChanged
C67
OUT
2
HeartbeatChanged
C67
Copy
Single
Src
DS6
Des
DS31
3
_1st_SCAN
SC2
HeartbeatValid
C68
RST
4
HeartbeatChanged
C67
HeartbeatValid
C68
SET
5
HeartbeatChanged
C67
Enable
Timer(ON Delay)
T1
Current Value
Not Retained
Unit
ms
SetPoint
3000
Current
TD1
T1
Output
6
T1
CommTimeout
C59
OUT
7
HeartbeatValid
C68
CommTimeout
C59
CommOk
C52
OUT
8
StopPending
C111
Copy
Single
Src
0
Des
DS20
9
StopPending
C111
CommOk
C52
StopReady
C112
OUT
10
StopReady
C112
StopPulse
C114
OUT
11
StopPulse
C114
Math
DS22 + 1
Result
DS22
12
StopPulse
C114
SendTrigger
C81
SET
13
SendTrigger
C81
Enable
Timer(ON Delay)
T2
Current Value
Not Retained
Unit
ms
SetPoint
500
Current
TD2
T2
Output


14
T2
SendTrigger
C81
RST
15
SendTrigger
C81
C13
Send (CPU Port:1) MODBUS
IPAddress 192.168.1.50
ServerPortNo 502
Slave ID 1
Modbus Function Code 16
Slave Addr 400011
NO. of Master Addresses 3
Word Swap OFF
Master DS20
Sending
C82
Sending
FC16Success
C83
Success
Error
C84
Error
DS25
ErrCode
16
Sending
C82
SendTrigger
C81
ReceiveEnable
C31
OUT
17
ReceiveEnable
C31
SendTrigger
C81
Receive (CPU Port:1) MODBUS
IPAddress 192.168.1.50
ServerPortNo 502
Slave ID 1
Modbus Function Code 03
Slave Addr 400001
NO. of Master Addresses 4
Word Swap OFF
Master DS3
C13
Receiving
C14
Success
C15
Error
DS10
ErrCode
18
END