Minkowski n16, dt=0.0005: all three duration attempts failed
Last diagnostics: V1/V2 0.45, V3 0.50; accepted rollback times: 0.4895 / 0.4850 / 0.5205

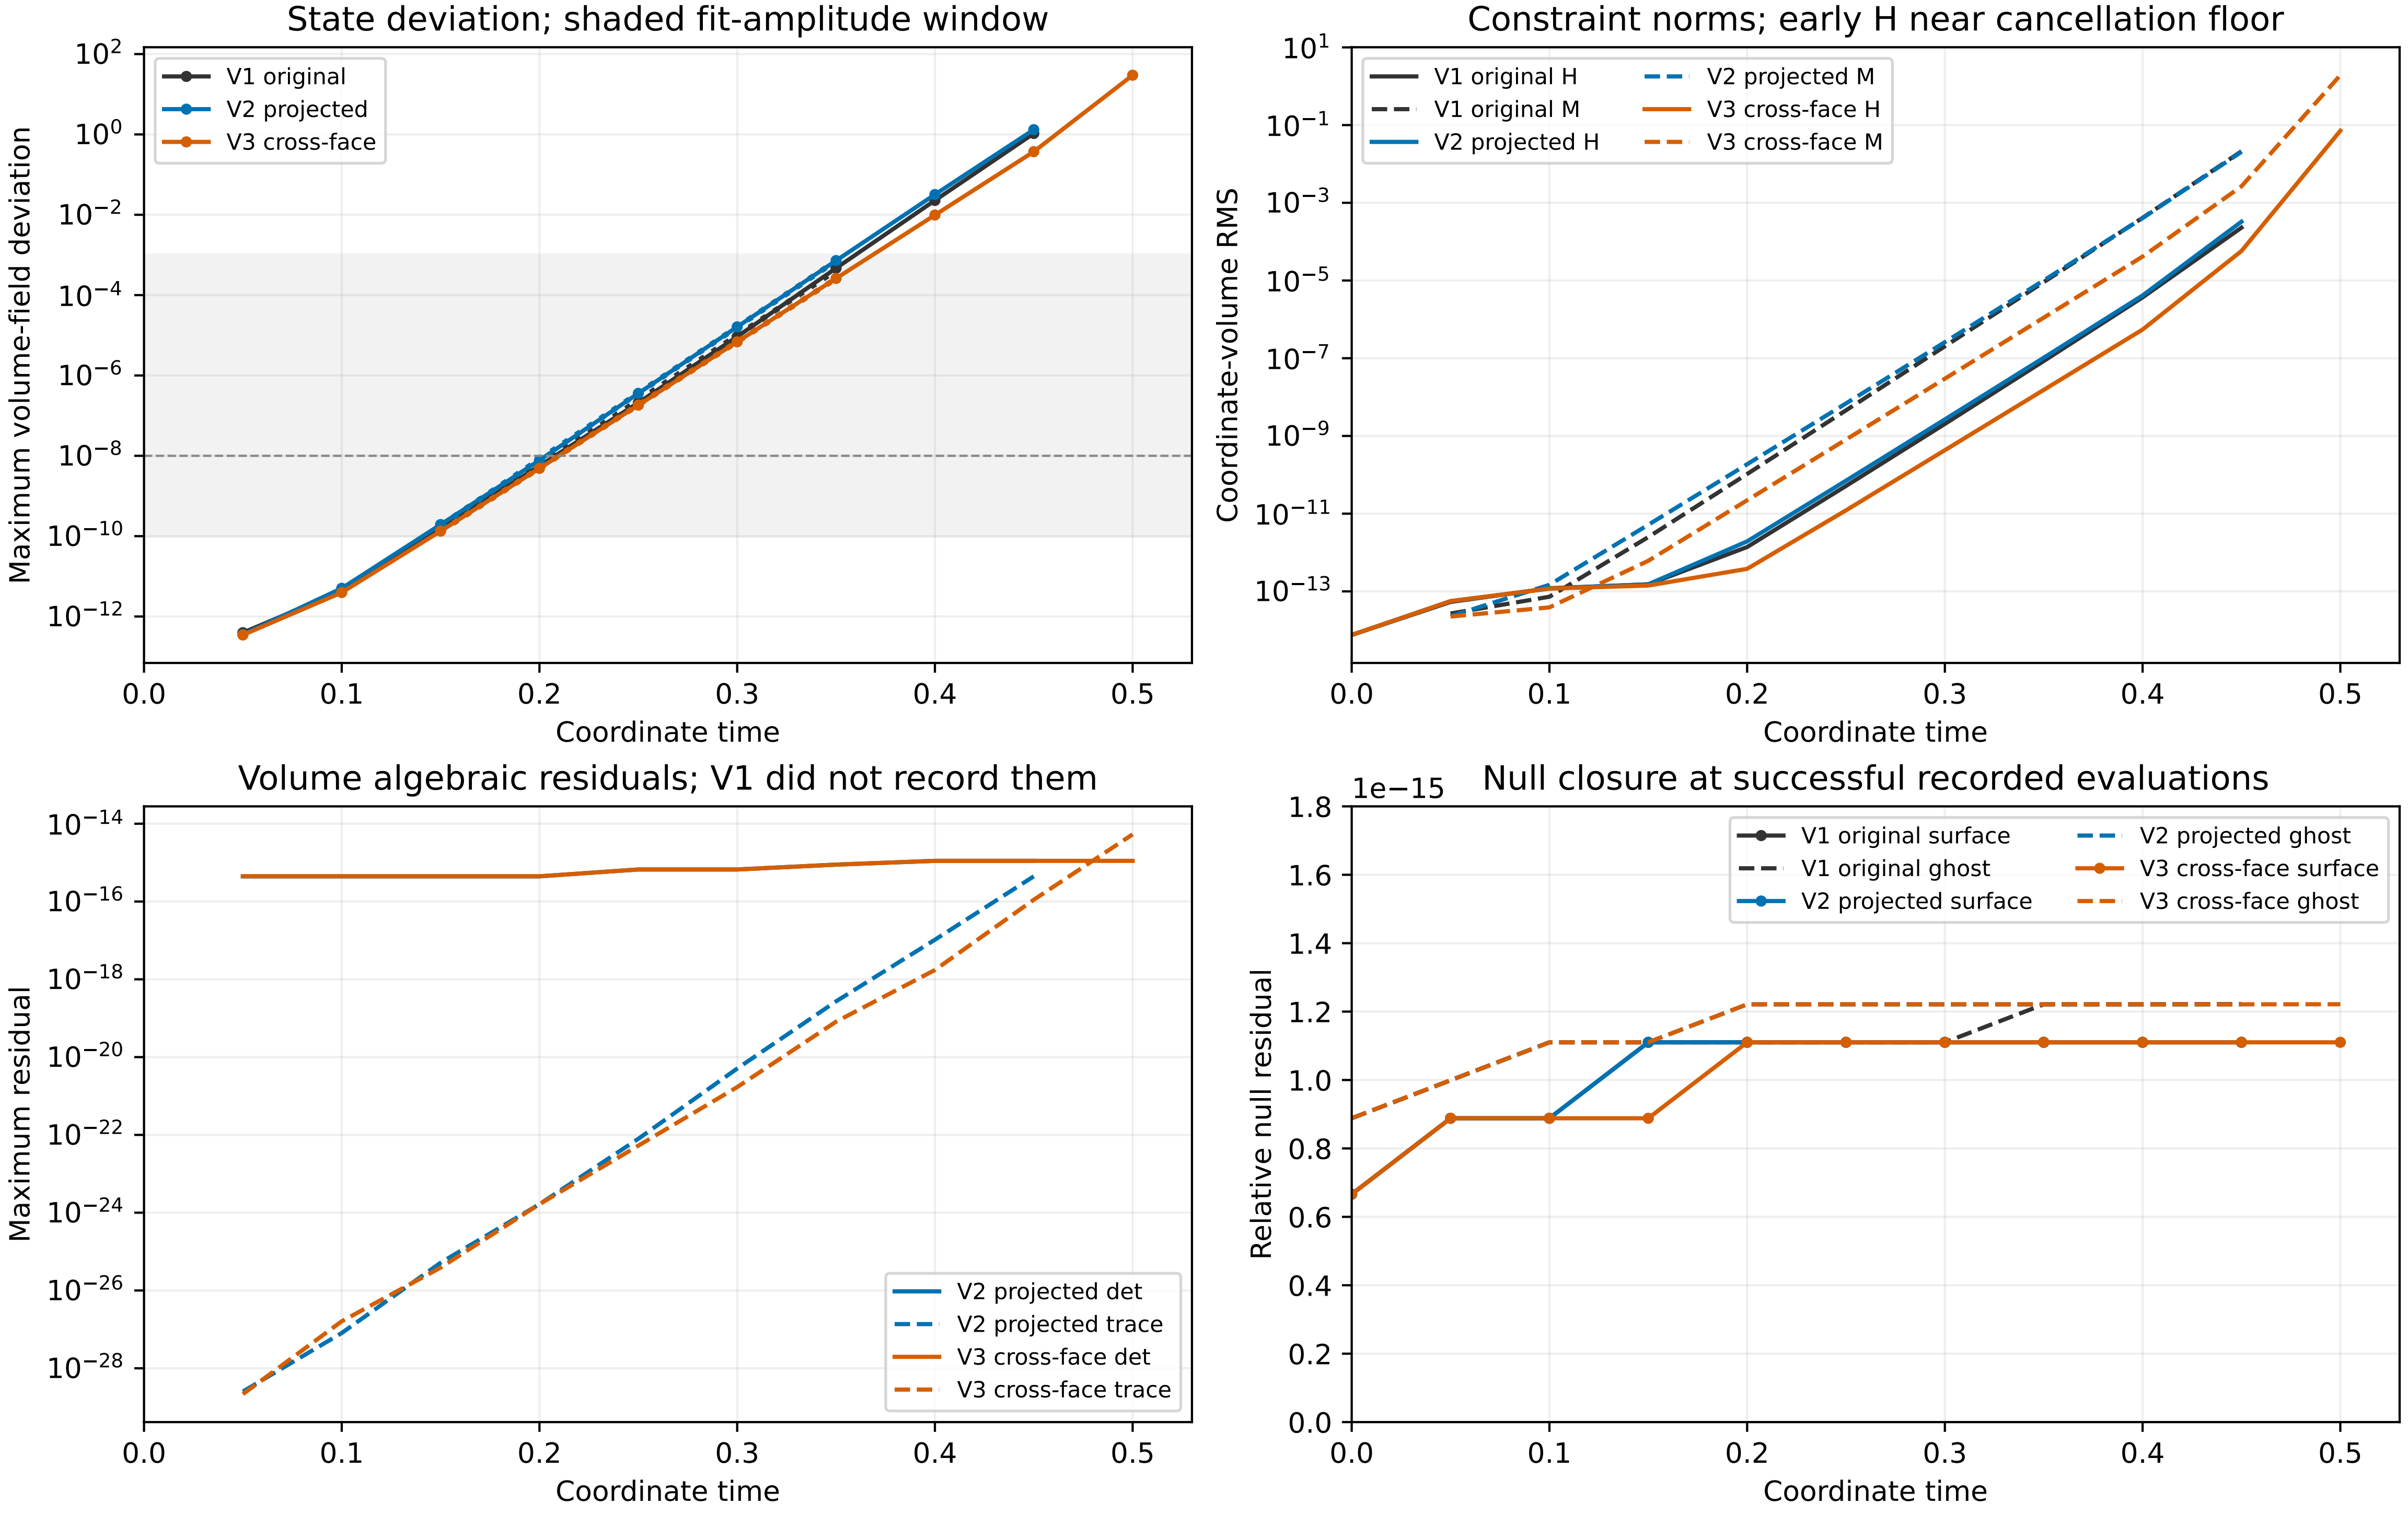

State deviation; shaded fit-amplitude window

Constraint norms; early H near cancellation floor

Volume algebraic residuals; V1 did not record them

Null closure at successful recorded evaluations