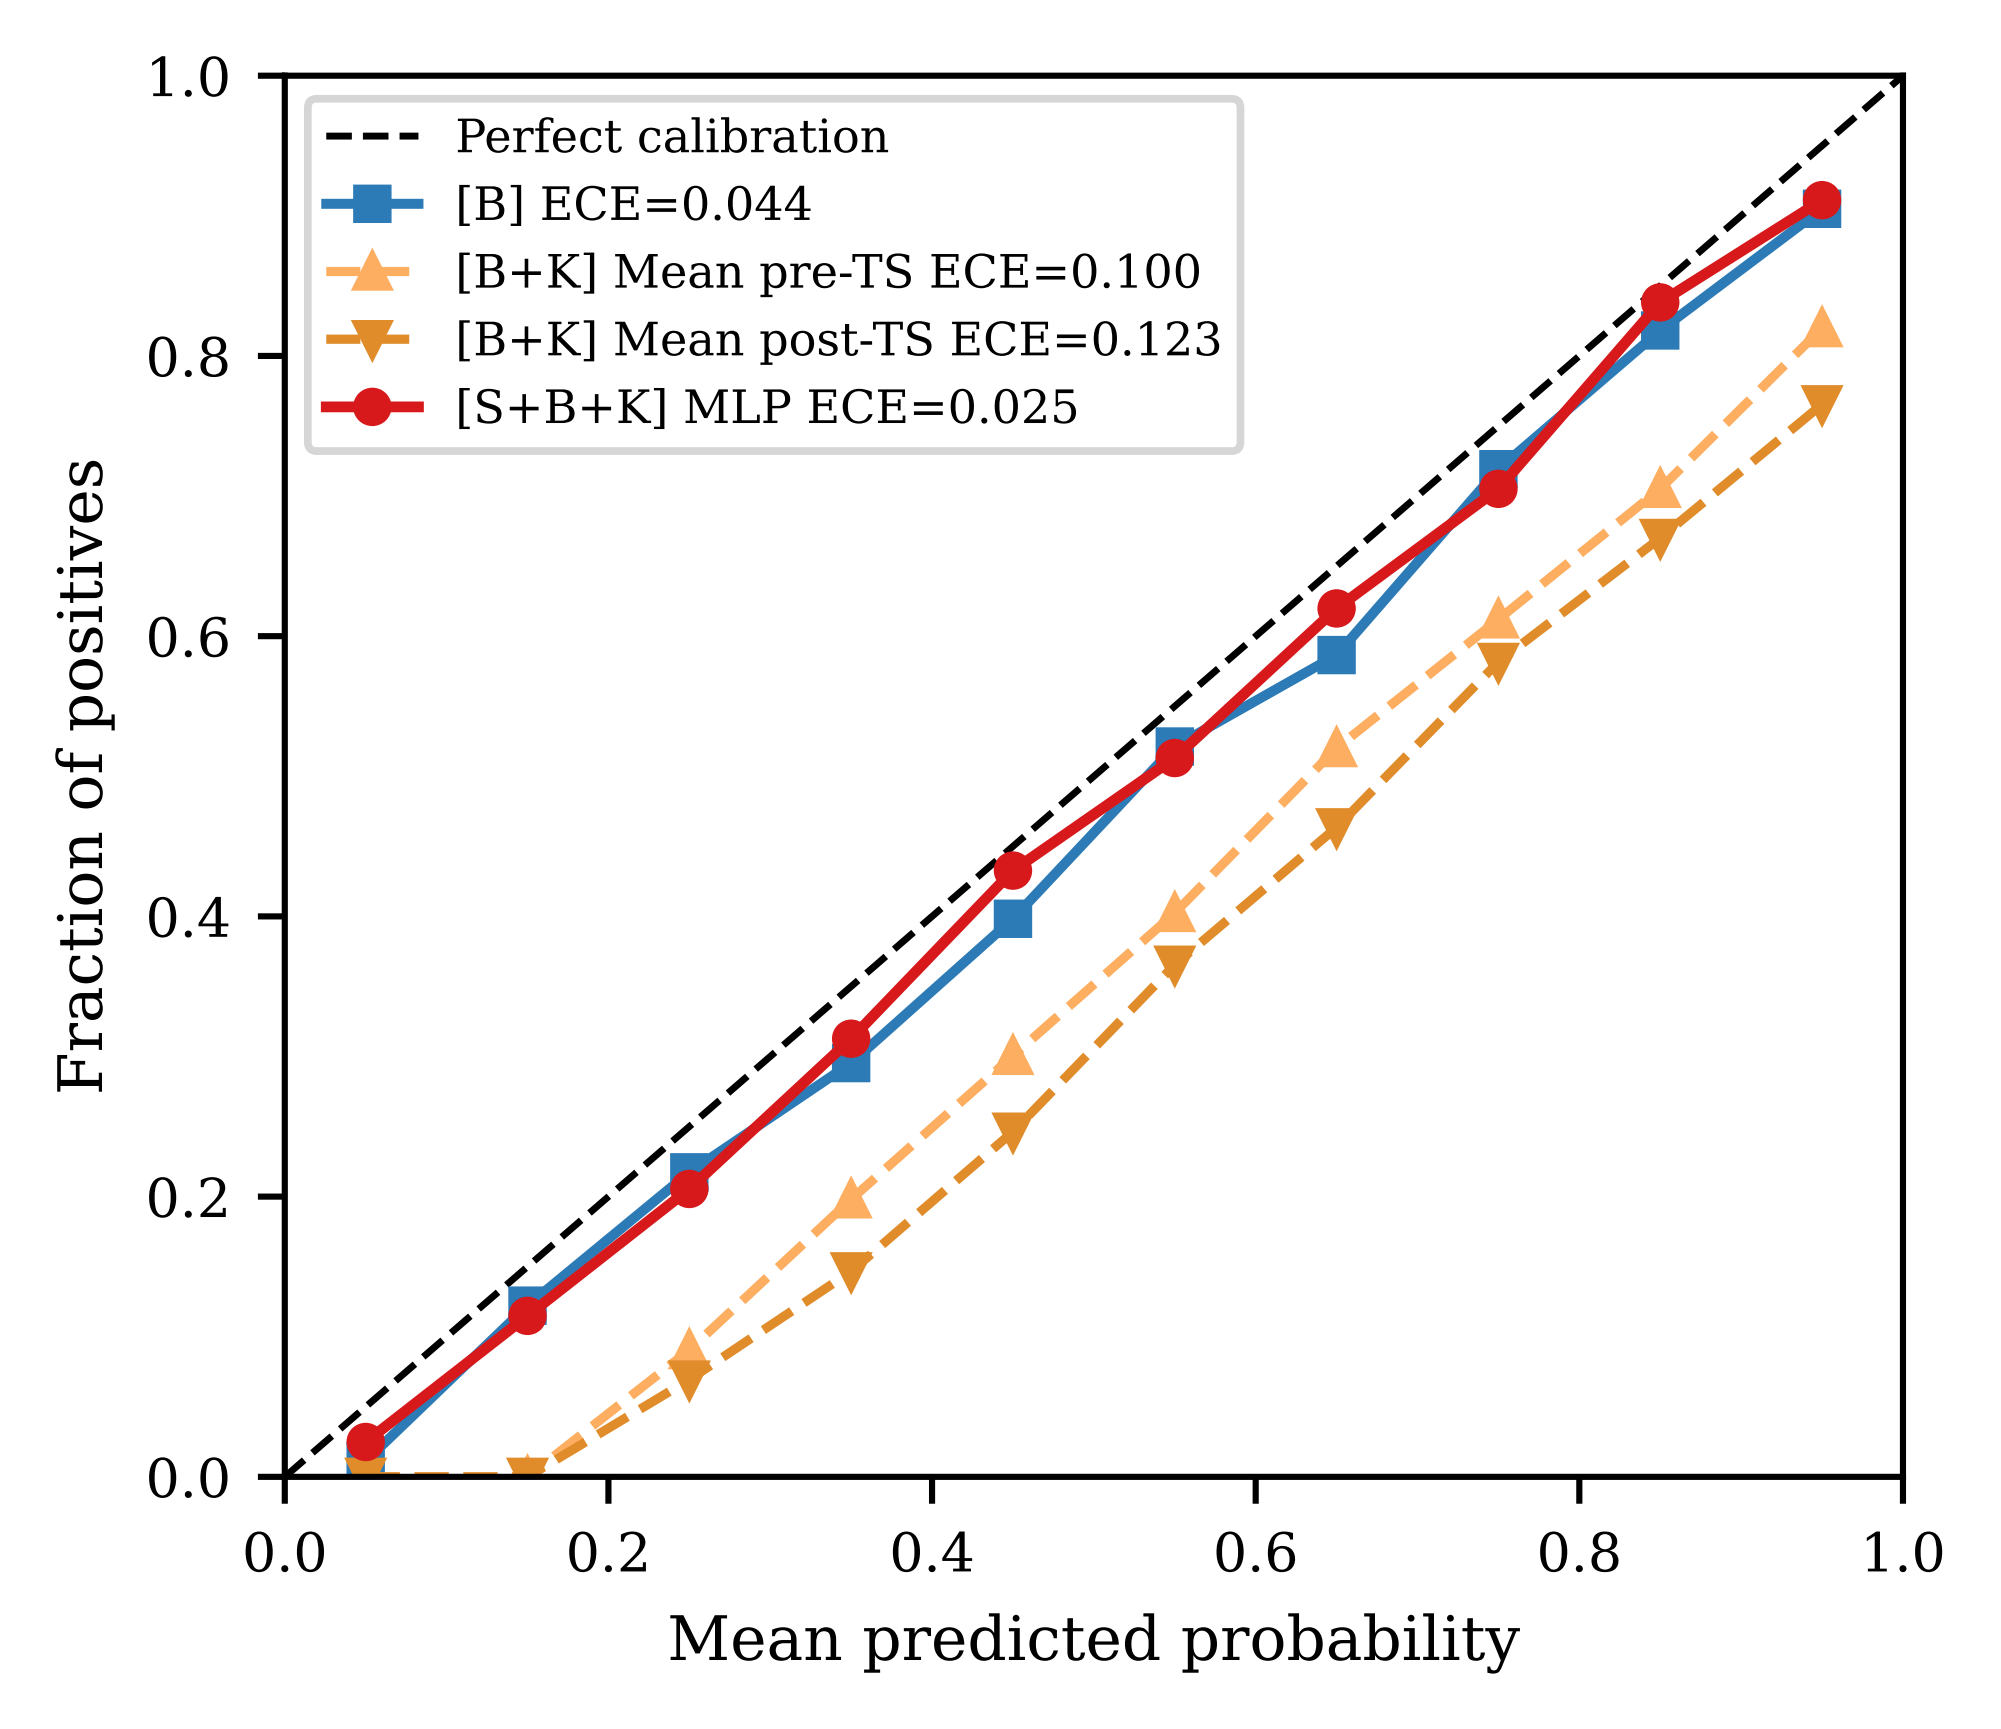
Perfect calibration
[B] ECE=0.044
[B+K] Mean pre-TS ECE=0.100
[B+K] Mean post-TS ECE=0.123
[S+B+K] MLP ECE=0.025
Fraction of positives
Mean predicted probability
0.0
0.2
0.4
0.6
0.8
1.0