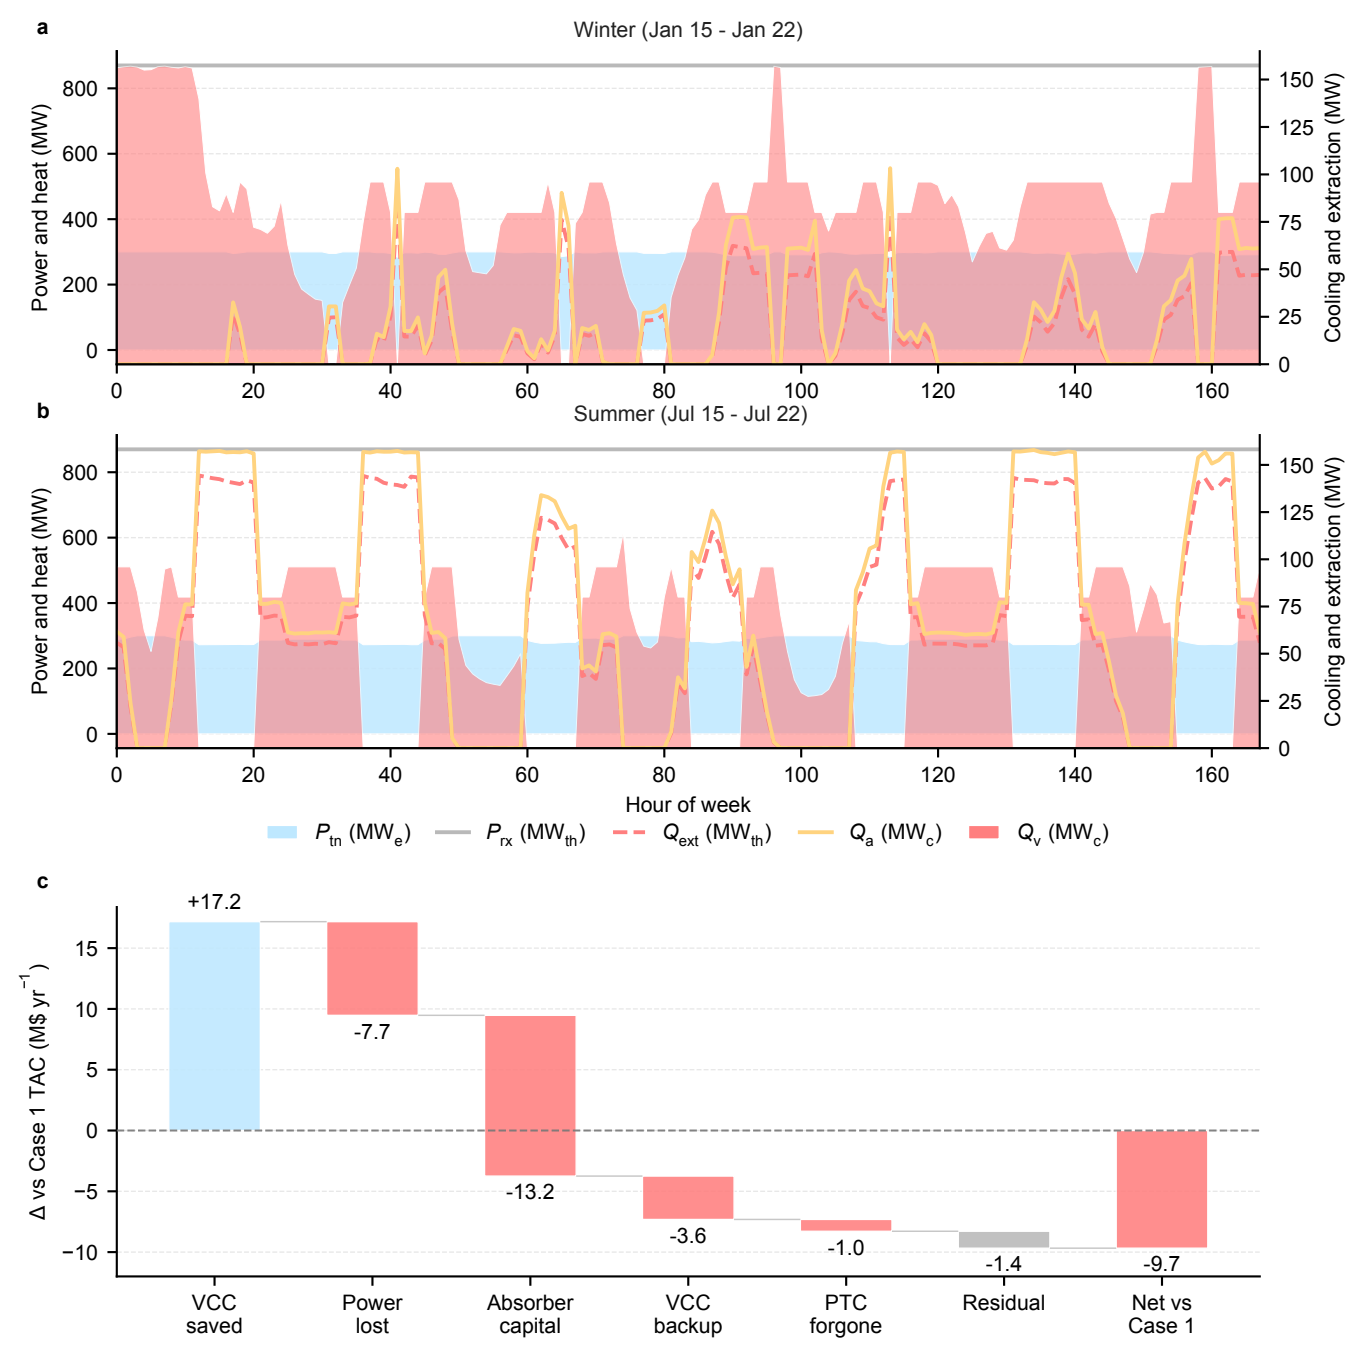
a
Winter (Jan 15 - Jan 22)
Power and heat (MW)
Cooling and extraction (MW)
b
Summer (Jul 15 - Jul 22)
Hour of week
P_{tn} (MW$_e$)
P_{rx} (MW$_{th}$)
Q_{ext} (MW$_{th}$)
Q_a (MW$_c$)
Q_v (MW$_c$)
c
Δ vs Case 1 TAC (M$ yr^{-1})
+17.2
-7.7
-13.2
-3.6
-1.0
-1.4
-9.7
VCC saved
Power lost
Absorber capital
VCC backup
PTC forgone
Residual
Net vs Case 1