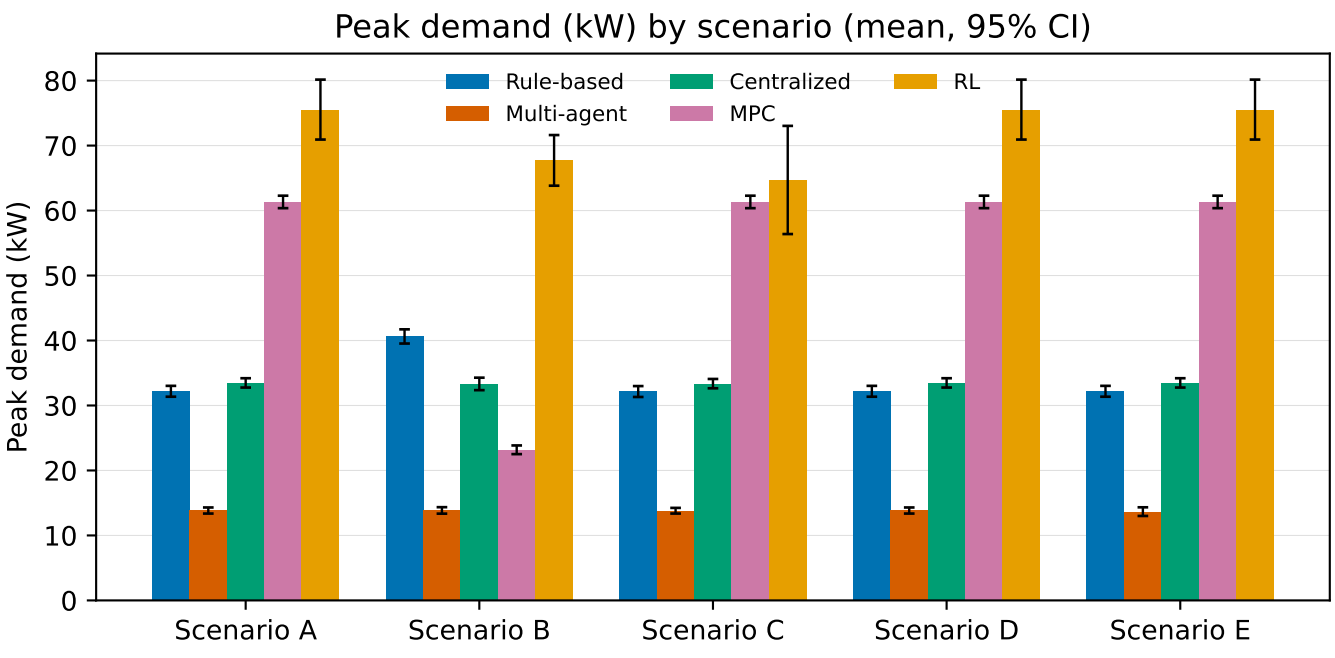
Peak demand (kW) by scenario (mean, 95% CI)
Rule-based
Multi-agent
Centralized
MPC
RL
Peak demand (kW)
0
10
20
30
40
50
60
70
80
Scenario A
Scenario B
Scenario C
Scenario D
Scenario E