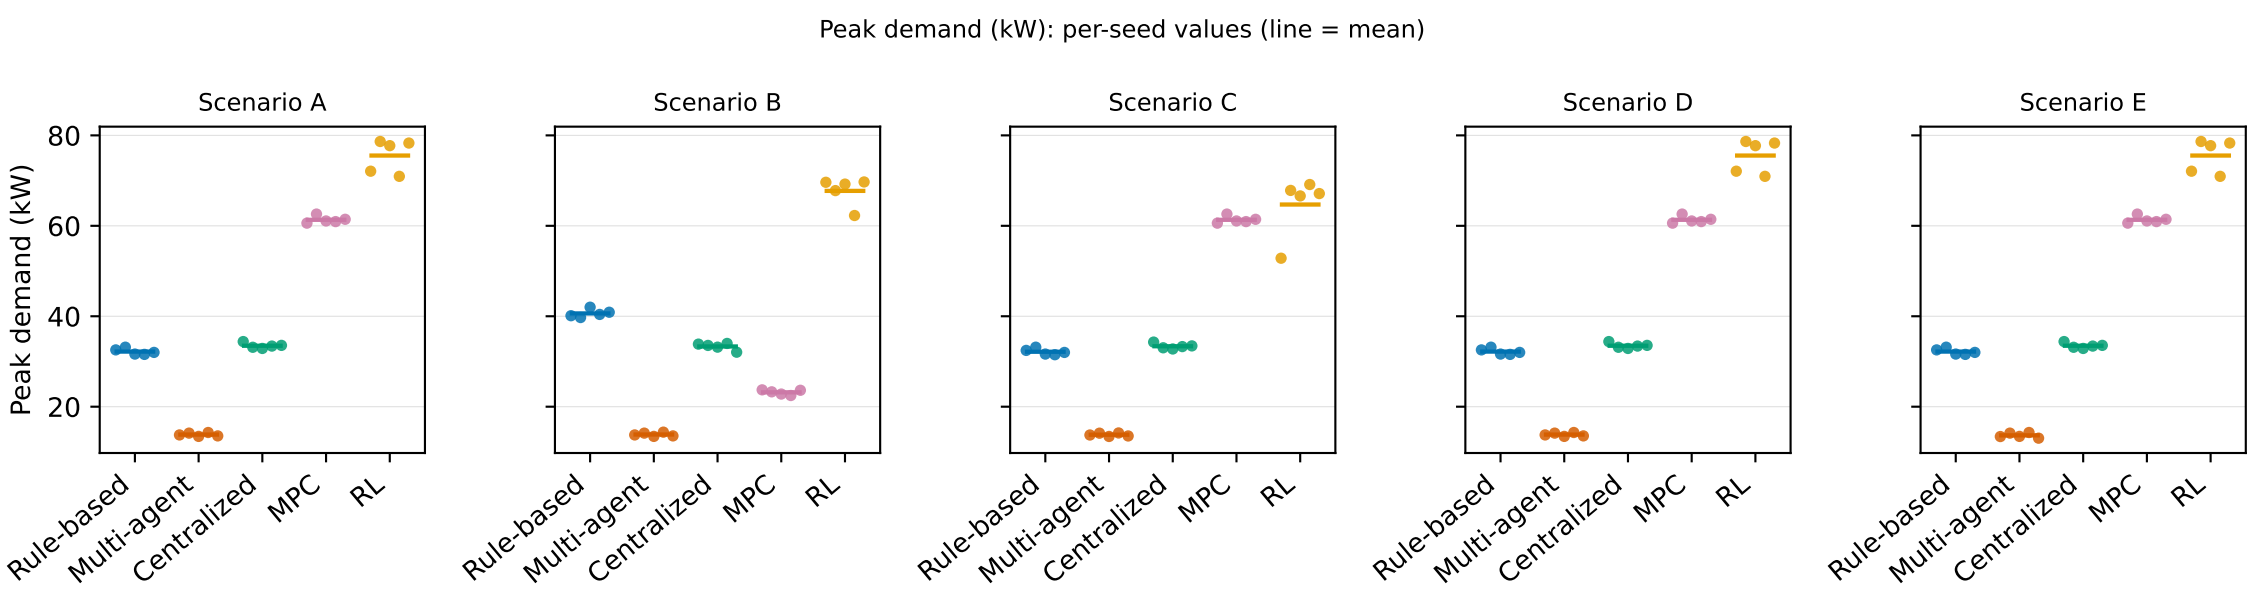
Peak demand (kW): per-seed values (line = mean)
Scenario A
Scenario B
Scenario C
Scenario D
Scenario E
Peak demand (kW)
80
60
40
20
Rule-based
Multi-agent
Centralized
MPC
RL