
AdigunPowerLab · Single-line diagram

Analytical Überprüfung — Àyẹ̀wò Yorùbá

Revision 1 · Tile 1/1 × 1/2 · Entered topology; not installation certification

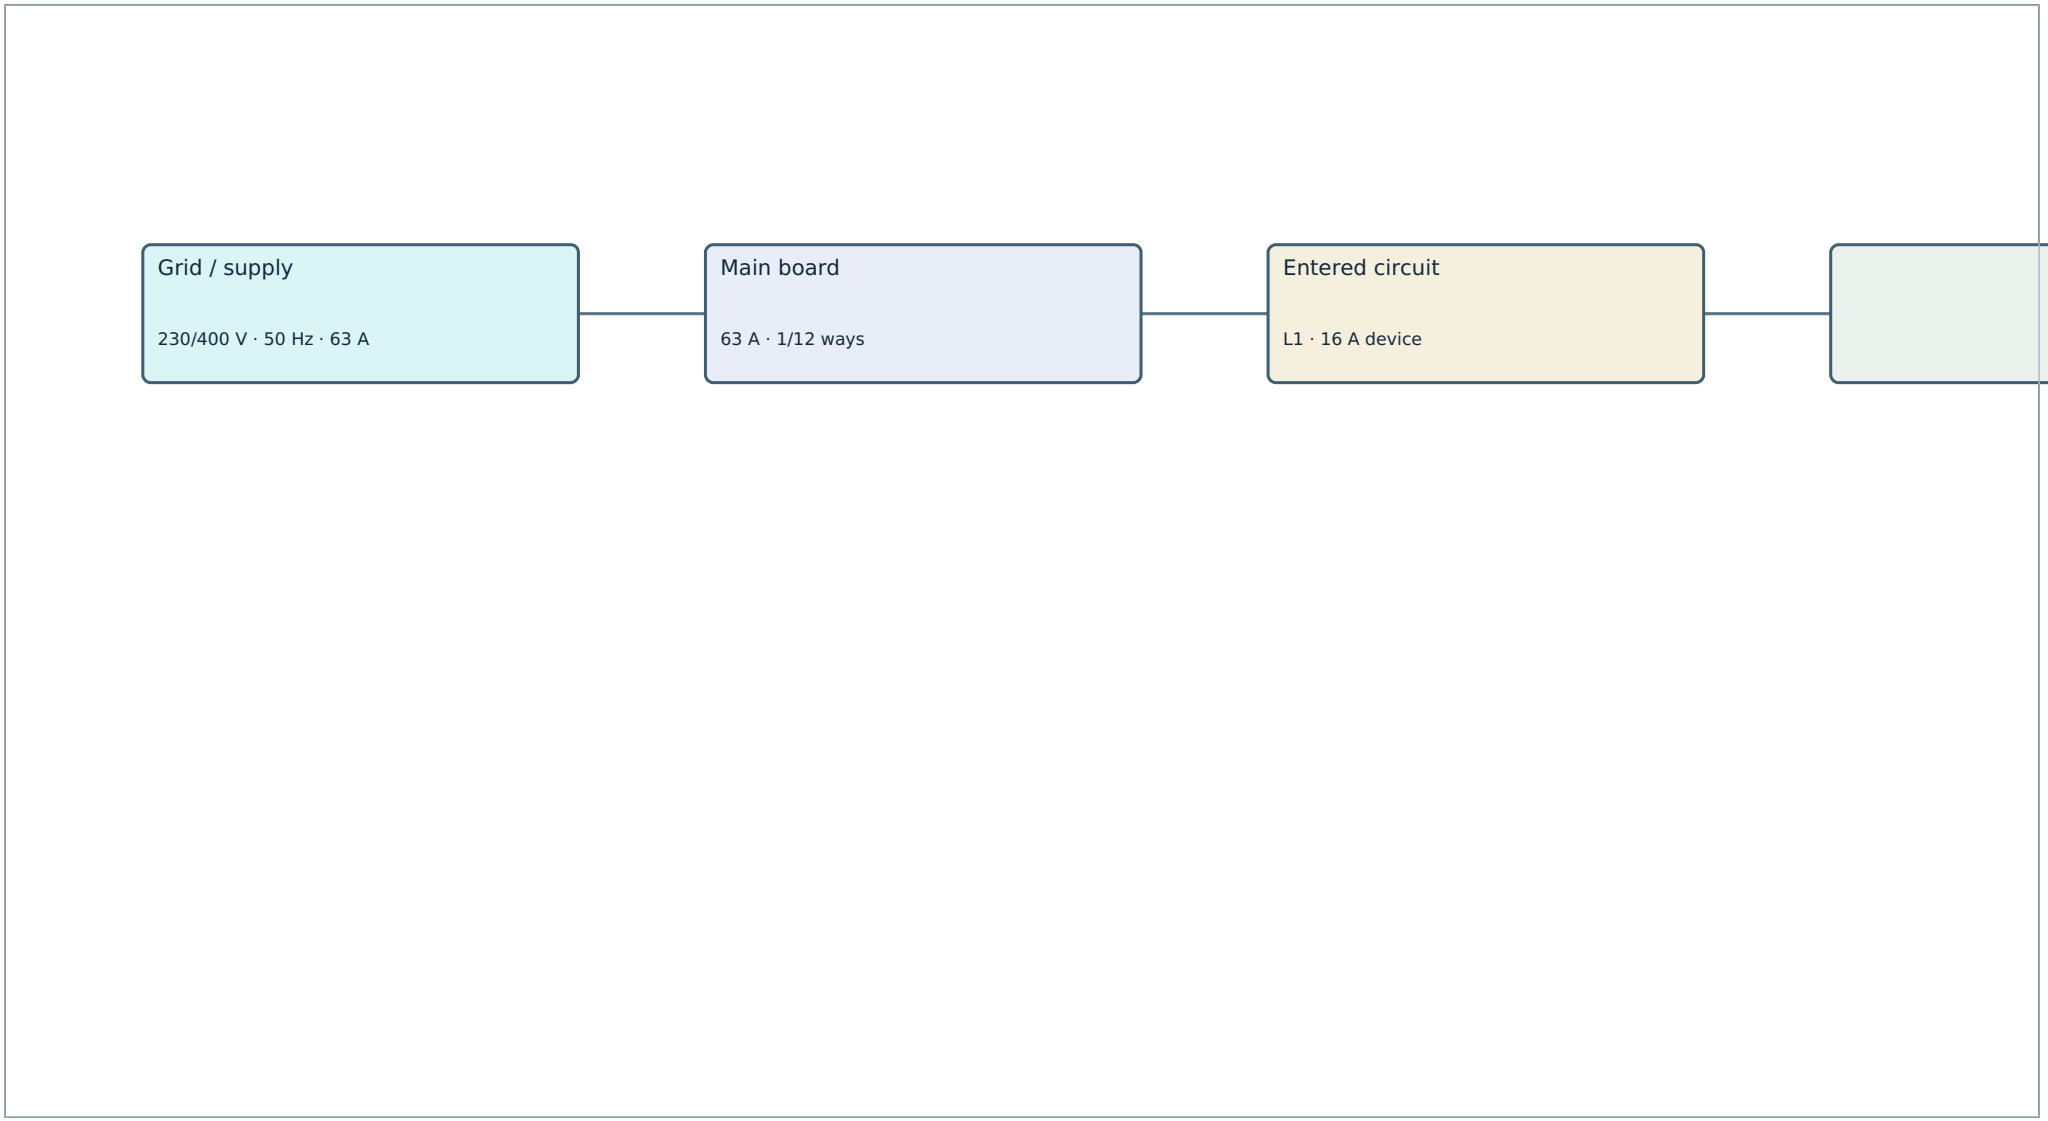


Overlapping vector tiles preserve readable labels. Full connection details and notes follow.

AdigunPowerLab · Single-line diagram

Analytical Überprüfung — Àyẹ̀wò Yorùbá

Revision 1 · Tile 1/1 × 2/2 · Entered topology; not installation certification



Overlapping vector tiles preserve readable labels. Full connection details and notes follow.

Diagram legend & source details

Source → distribution board → circuit → load. Lines represent modeled electrical relationships; they do not measure cable length.

source:project-01c23fd7-58b8-4182-8616-4cb48c5fd956 · source · Grid / supply · 230/400 V · 50 Hz · 63 A

board:board-bc7b561f-e358-49df-8d6f-651f77f0bcb0 · board · Main board · 63 A · 1/12 ways

circuit:circuit-f2778e76-bdf0-4c66-97b6-abe40b3be637 · circuit · Entered circuit · L1 · 16 A device

load:load-bda086cb-4172-4ac5-8bfd-0f82a367b306 · load · =Analytical heater · L1 · 3 × 1 kW · 13.04 A

source:project-01c23fd7-58b8-4182-8616-4cb48c5fd956 → board:board-bc7b561f-e358-49df-8d6f-651f77f0bcb0: 20 m feeder

board:board-bc7b561f-e358-49df-8d6f-651f77f0bcb0 → circuit:circuit-f2778e76-bdf0-4c66-97b6-abe40b3be637: 12.5 m · 2.5 mm²

circuit:circuit-f2778e76-bdf0-4c66-97b6-abe40b3be637 → load:load-bda086cb-4172-4ac5-8bfd-0f82a367b306: Connected load