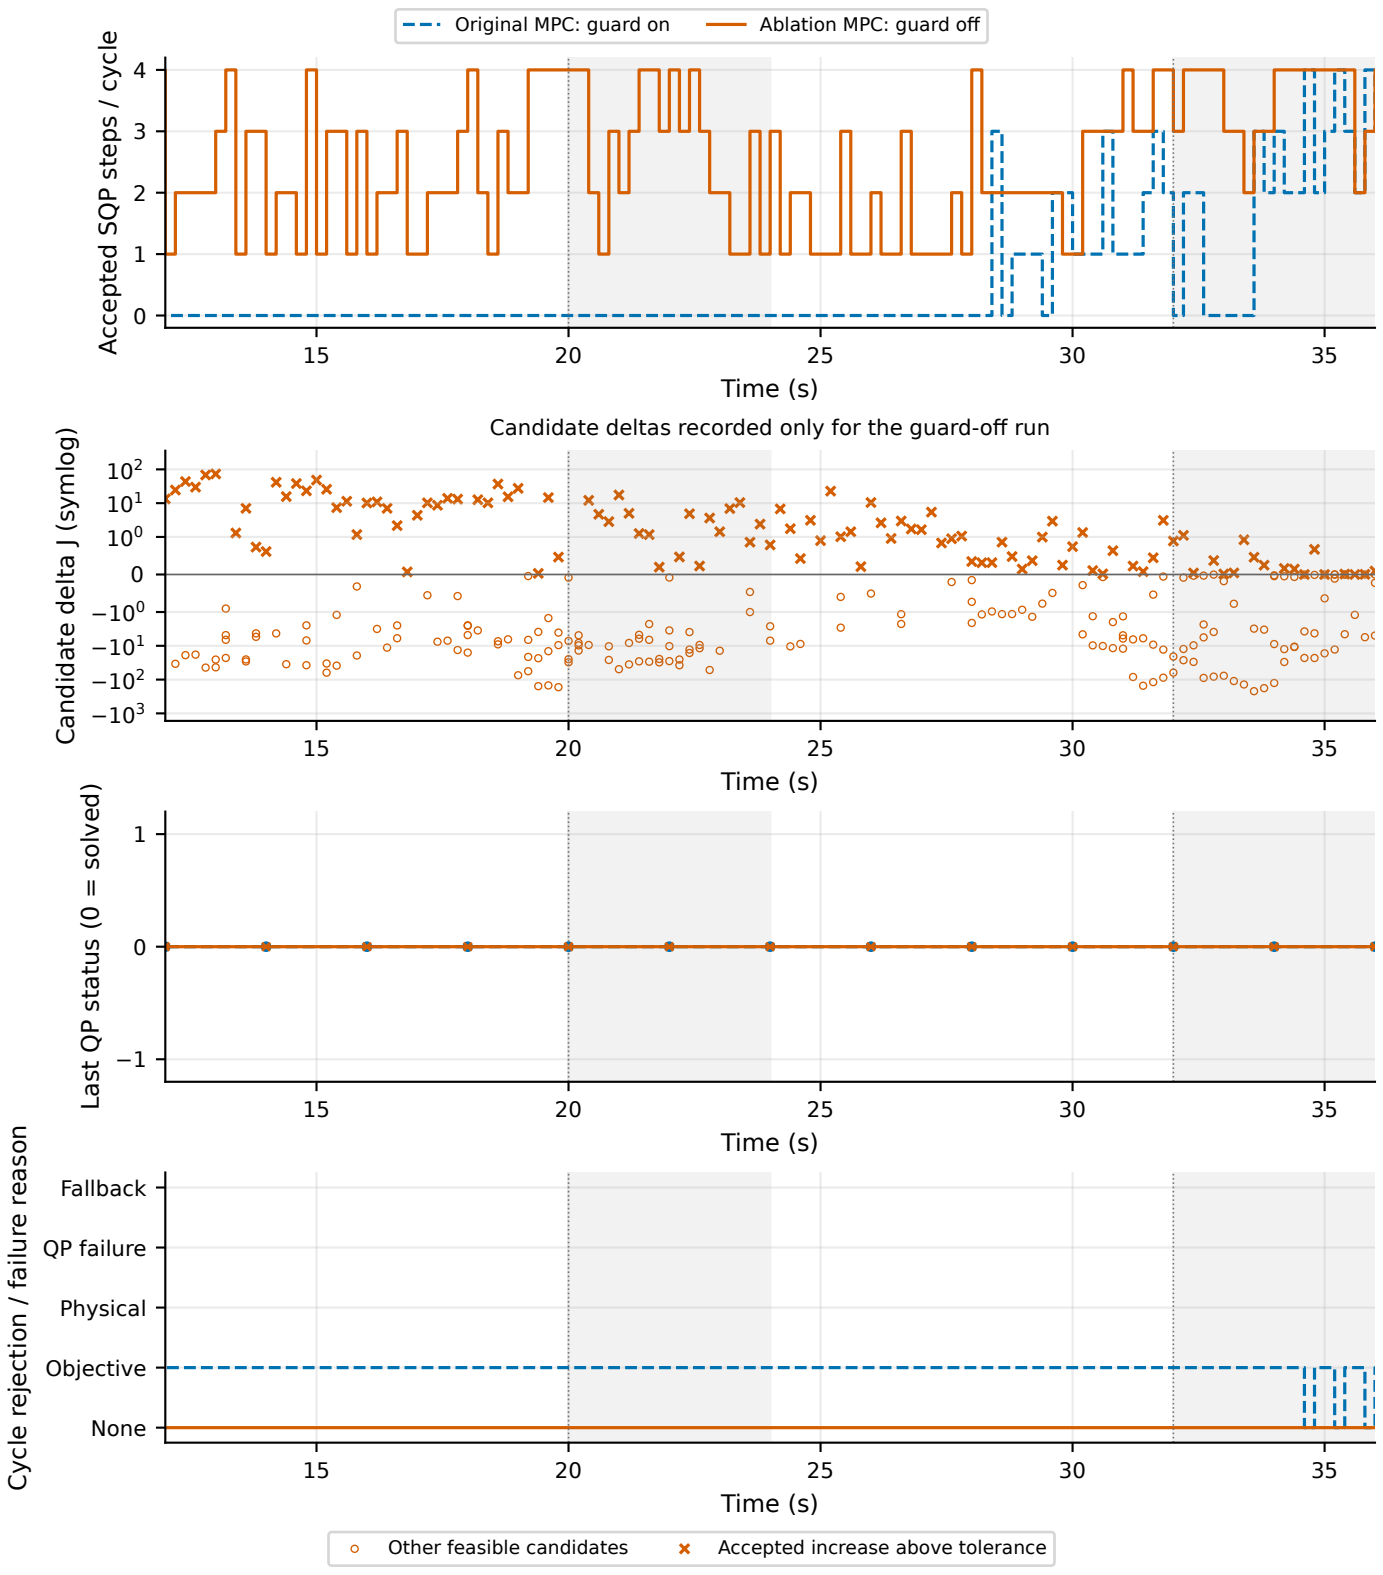
Original MPC: guard on
Ablation MPC: guard off
Accepted SQP steps / cycle
Time (s)
Candidate deltas recorded only for the guard-off run
Candidate delta J (symlog)
Last QP status (0 = solved)
Cycle rejection / failure reason
Fallback
QP failure
Physical
Objective
None
Other feasible candidates
Accepted increase above tolerance