


Subgroup Analysis by Device Type

Type A only

Flap Loss
Type A only
Between-device Q=0.88, df=3, p=0.831 n.s.

Return to Theater
Type A only
Between-device Q=0.61, df=3, p=0.894 n.s.

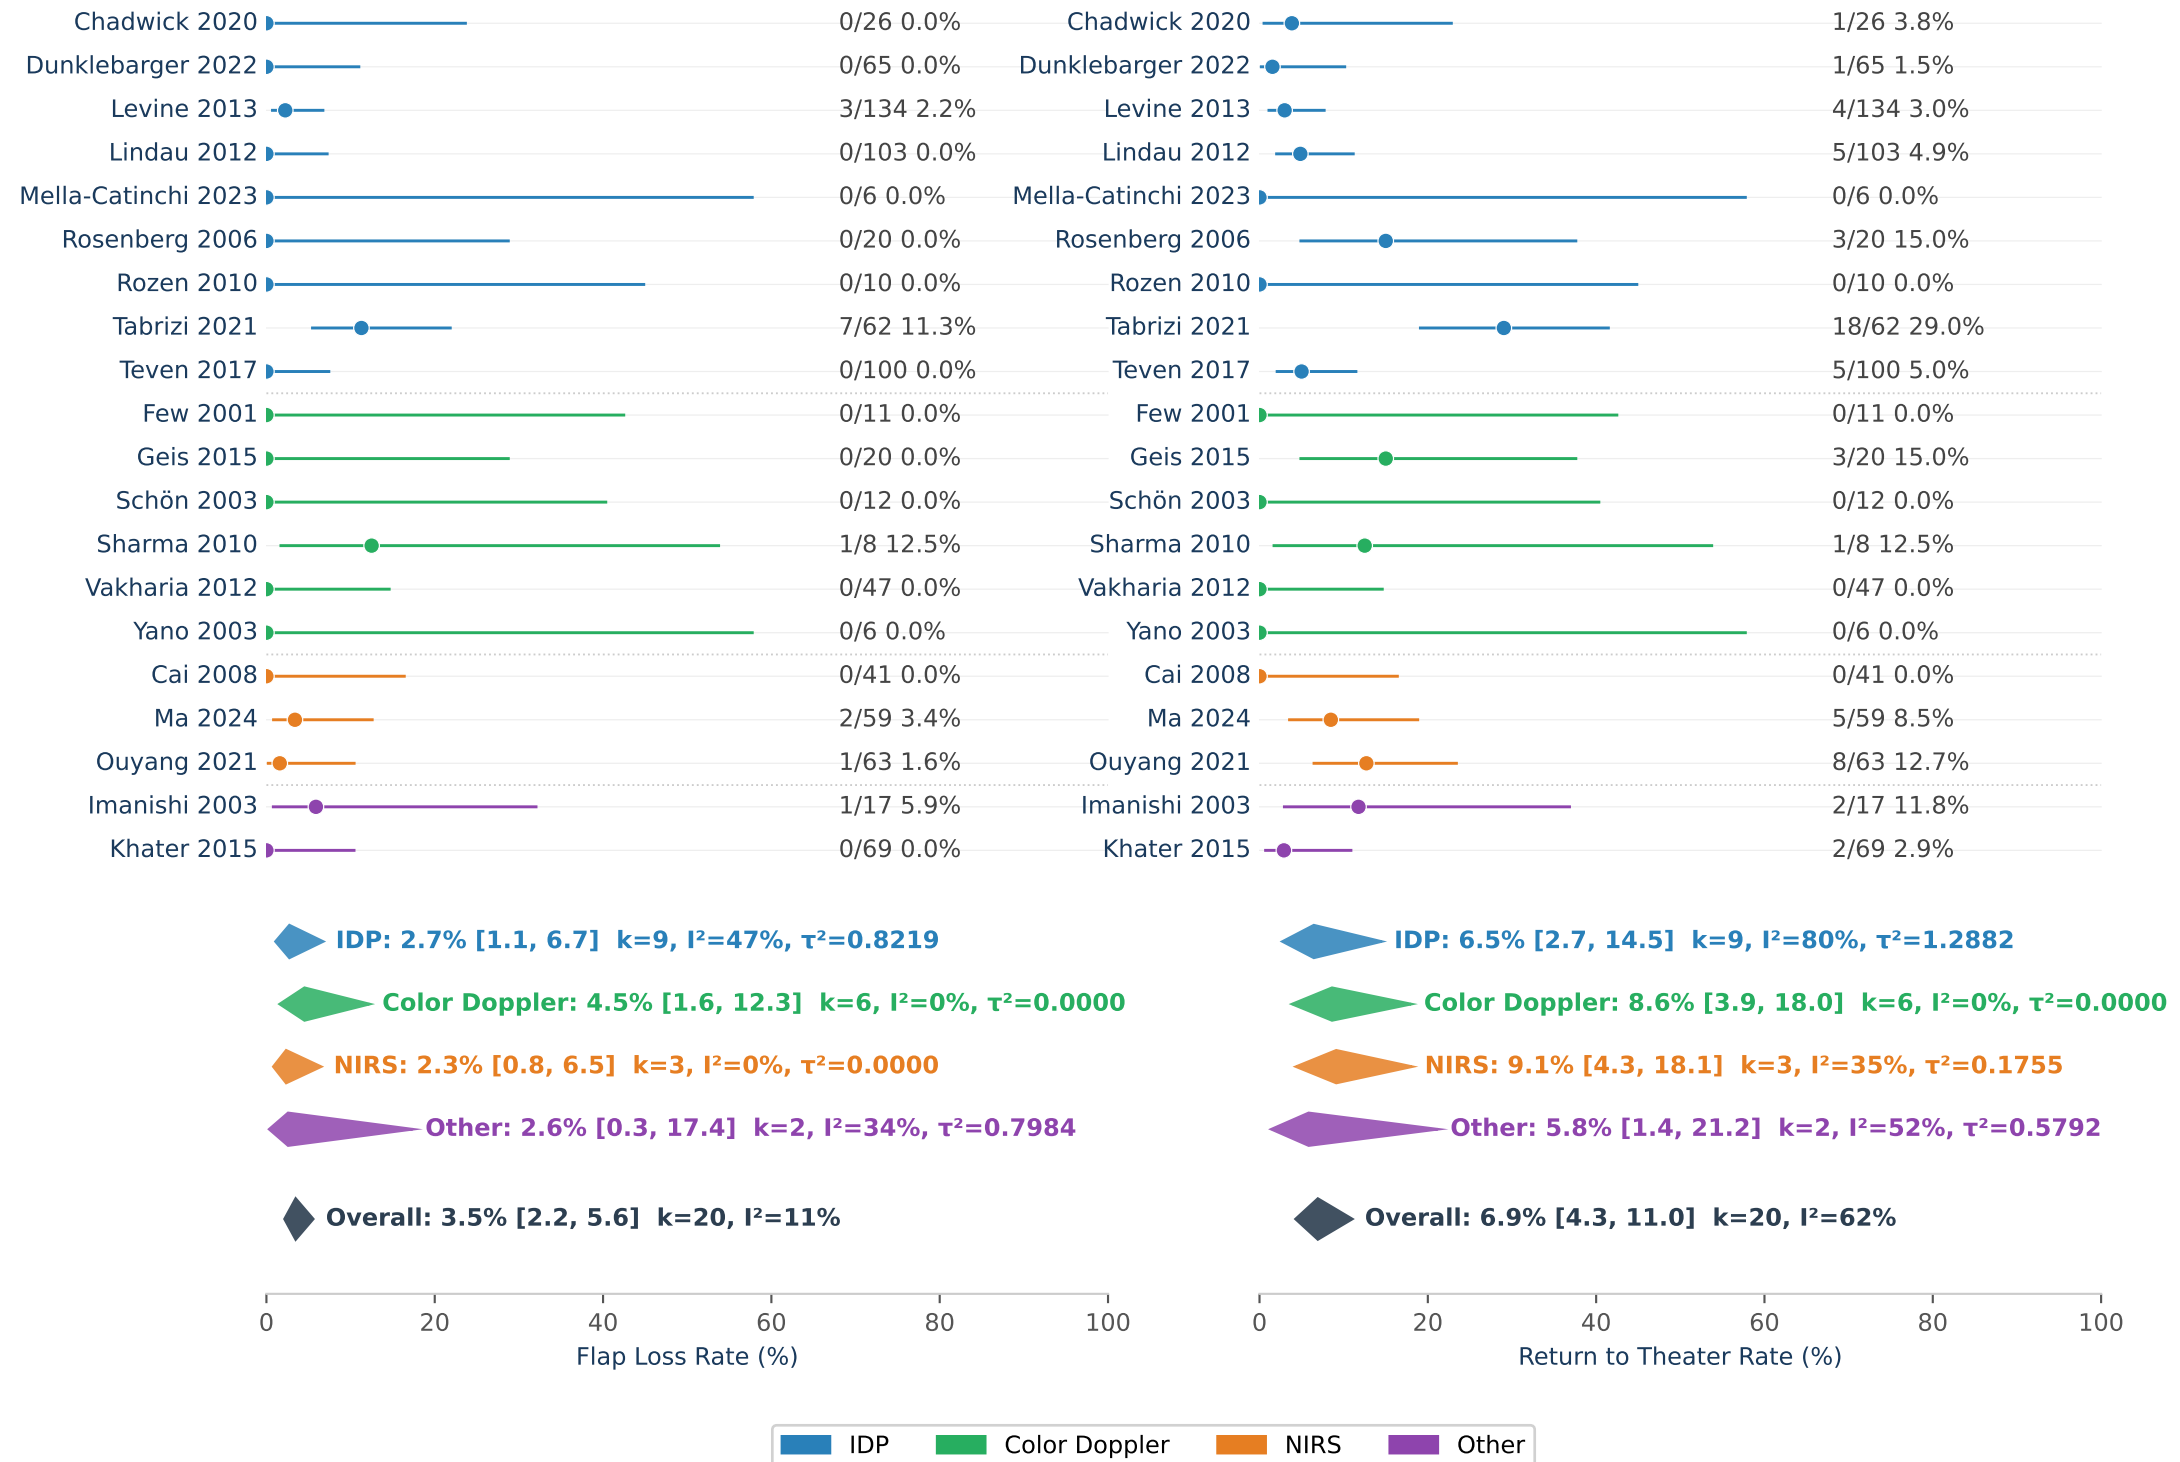

Crude percentages are displayed for individual studies, while continuity correction is applied only to the calculations of pooled estimates and confidence intervals.