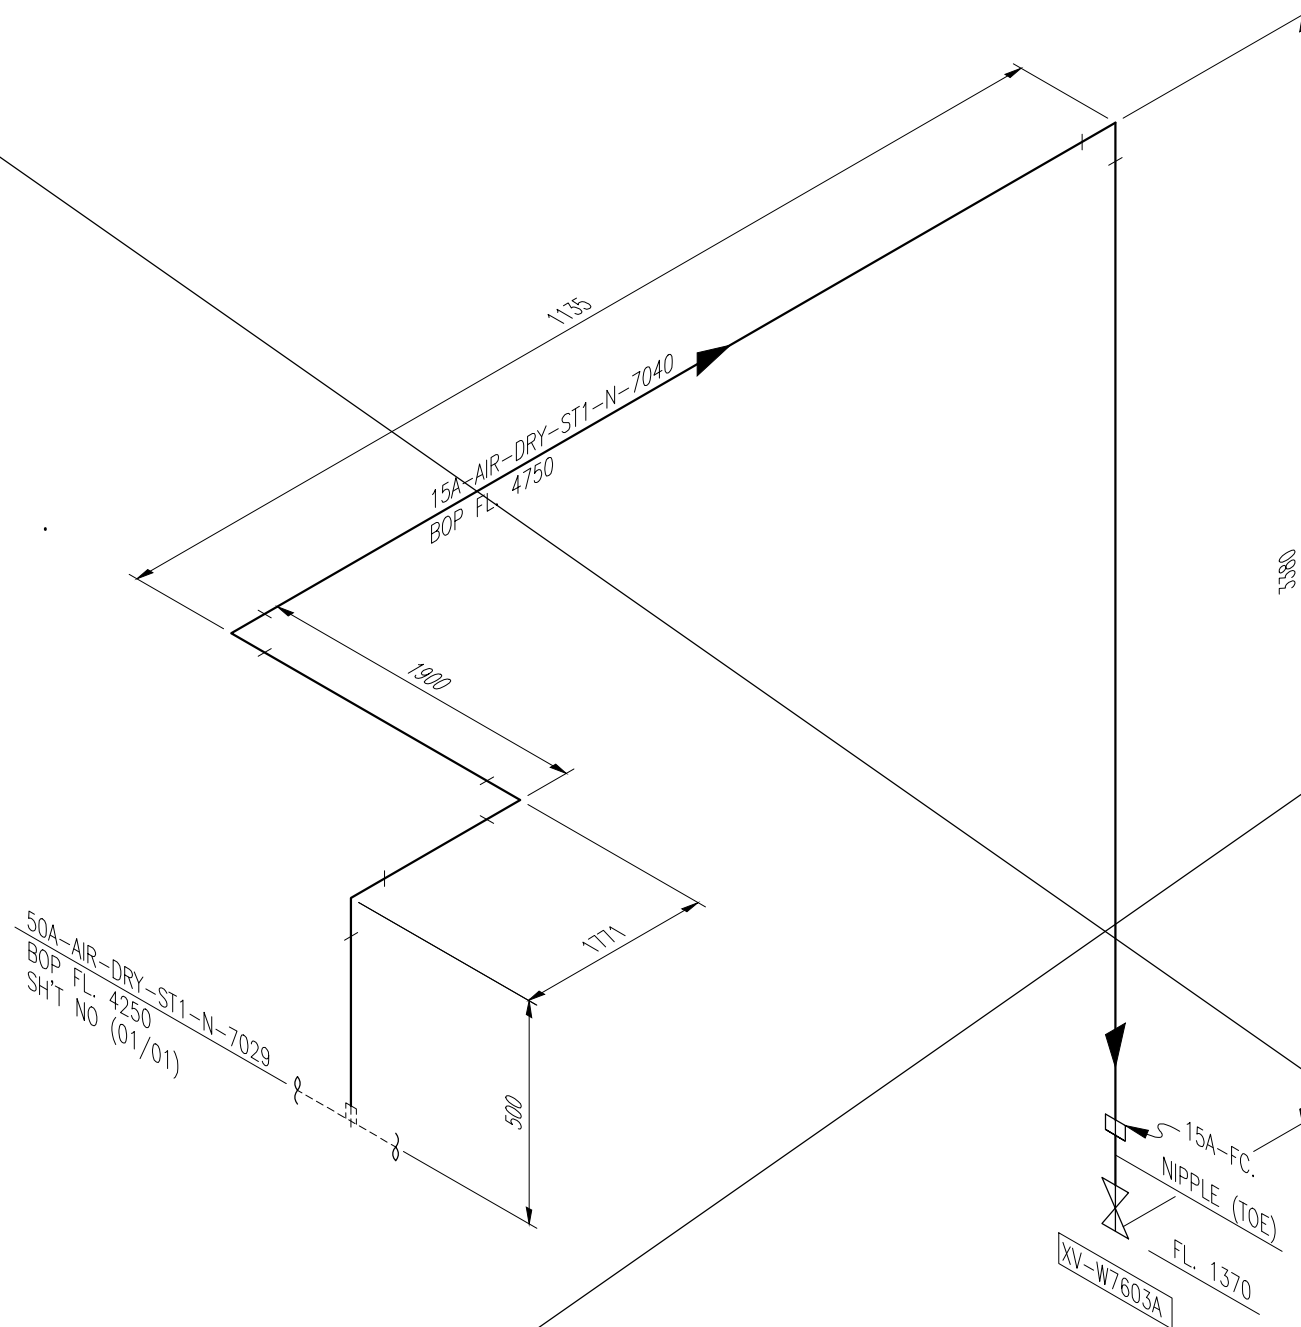


DELETED

<NOTE>
1. (*) FIELD ADJUST

* PIPE : P/P1	* 90° ELBOW : E90	* 45° ELBOW : E45	* TEE : T	* RED.TEE : TR	* STUB-IN : STU	* REINFORCING PAD : RP	* CON.RED : RC	* ECC.RED : RE	* CON.SWAGE : RCS/RCS1	* ECC.SWAGE : RES/RES1	* NIPPLE : NP/NP1/NP2	* CAP : CAP/CAP1	* PLUG : PLG	* FULL COUPLING : FC	* HALF COUPLING : HF/HF1
* STUB-IN : STU	* SOCKET(HDPE/PVC) : SC	* SADD(HDPE) : SD	* FLANGE : F/F1	* GASKET : G/G1/G2	* BOLT & NUT : B/B1	* BLIND FLANGE : FB/FB1	* GATE VA. : VG/VG1/VG2	* BALL VA. : VB/VBLO/VB1/VB1LO/VB2/VB2LO	* BUTTERFLY VA. : VF/VF4	* CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7					
* GLOBE VA. : VL/VL1/VL2	* DIAPHRAGM VA. : VD/VDLO	* DAMPER : VP	* QUICK COUPLING : SQC	* FLEXIBLE JOINT(STEEL) : FLXB	* FLEXIBLE JOINT(RUBBER) : FLXR	* FLEXIBLE JOINT(STEEL-PTFE LINED) : FLXL	* FLEXIBLE HOSE : FLXH	* STEAM TRAP : ST	* SPRAY NOZZLE : SPN	* EMERGENCY SHOWER : SSH					
* STRAINER(Y-TYPE) : YSTR	* STRAINER(T-TYPE) : TSTR	* STRAINER(BUCKET-TYPE) : BSTR	* ANCHOR PLATE : STOP	* BIRD SCREEN : BS	* ISOLATION KIT : IK	* UNLOADING BOX : UB	* AIR TRAP : AT	* LOTO : LOTO	* SIGHT GLASS : SG	* PRESSURE GAUGE : PG	* SHILED : SH	* SPECIAL BOLT & NUT : BL/BL1			

INSULATION	CODE	N	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA	W14							CONTRACTOR	PROJECT NAME
	THICK.	—	DESIGN	10	60	UNIT	R1FA								M15X Ph4 Project
			OPERATING	7.5	AMB	REF. PLAN DWG.								COMMODITY	JOB NO.
						CJ-M15W14-PI-A30-010016-A		25.01.24	APPROVED FOR CONSTRUCTION	황재중	안남후	박동영		AIR-DRY	22330D
						REF. P & ID CJ-M15W14-PR-A20-000082-B	REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D	LINE NO.	SH'T NO.	REV.
													15A-AIR-DRY-ST1-N-7040	01 / 01	0