


DRAWING LIST FOR TEST PACKAGE

PROJECT NO.: 22328D

PROJECT TITLE : M15X Ph2 Project

NaOCI-567

No	PKG No	UNIT	LINE NUMBER			P&ID		REMARK
			ISO DRAWING No	SHEET	REV	P&ID No	REV	
1	567	4FA	OD32-NaOCI-PV3-N-6507-01	1 OF 1	1	CJ-M15W13-PR-A20-000057	2	

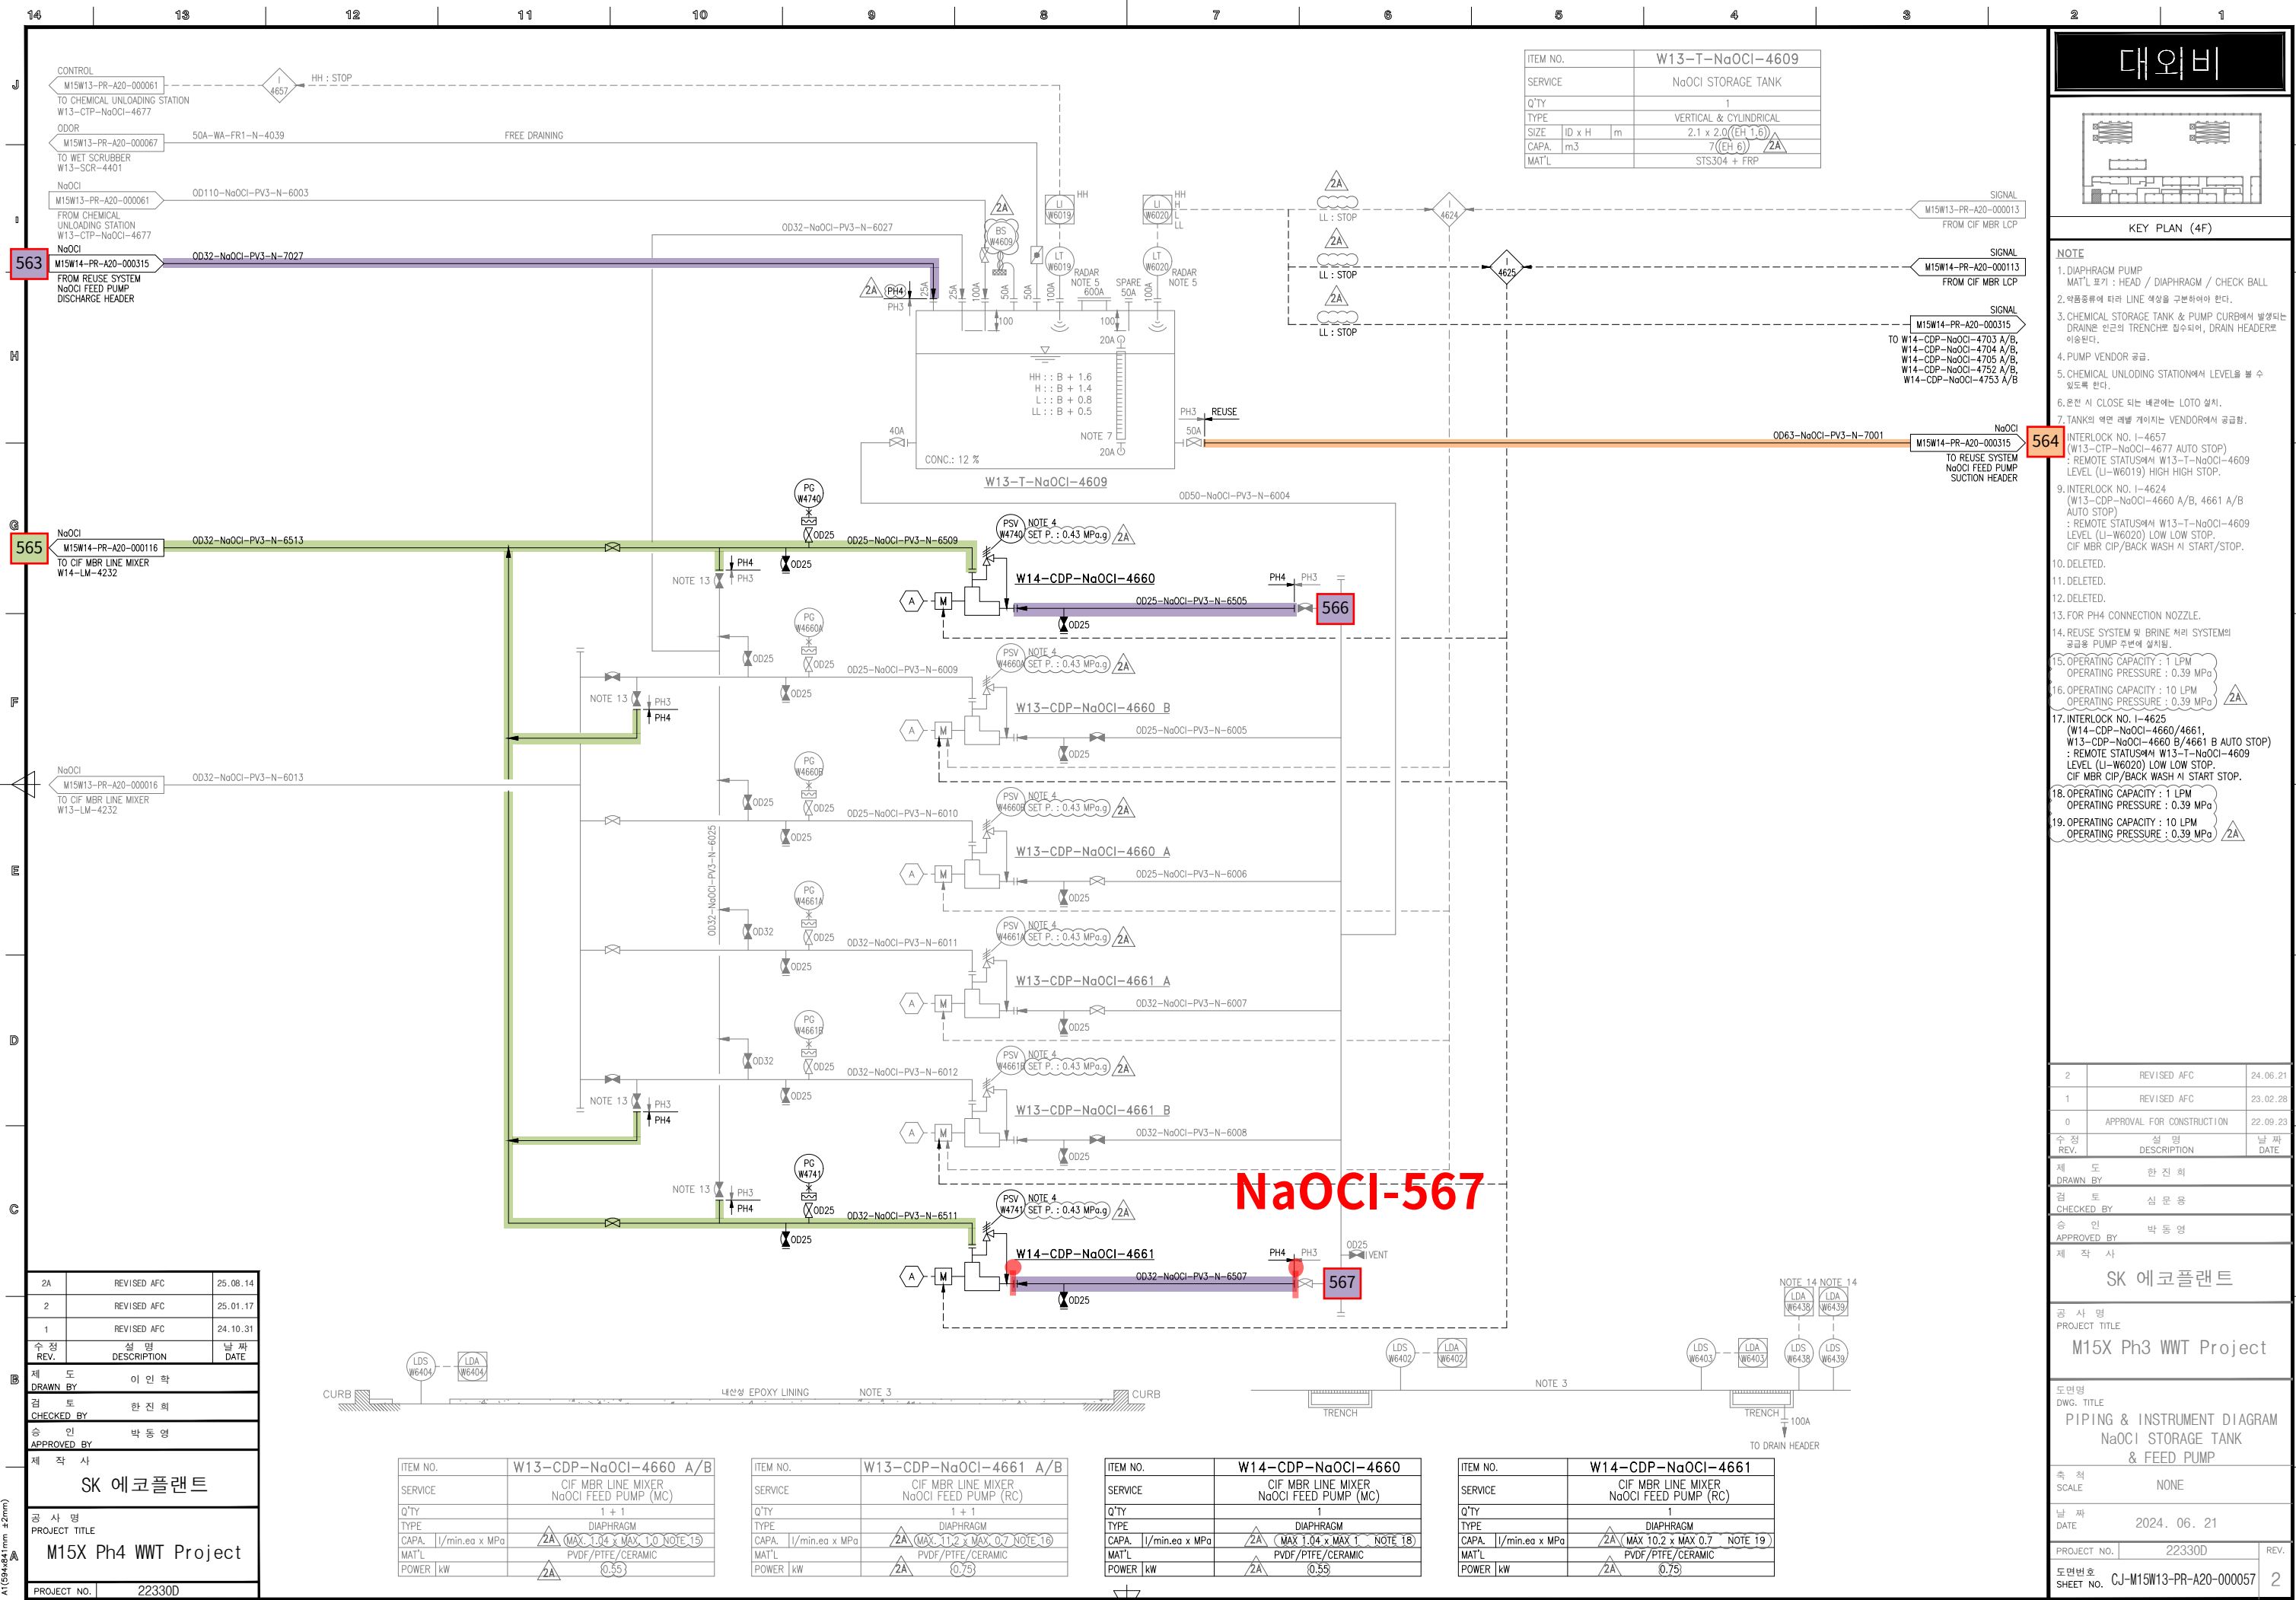

대외비

KEY PLAN (4F)

NOTE

1. DIAPHRAGM PUMP
MAT'L 표기 : HEAD / DIAPHRAGM / CHECK BALL

2. 악용종류에 따라 LINE 색상을 구분하여야 한다.

3. CHEMICAL STORAGE TANK & PUMP CURB에서 발생하는 DRAIN에 인근의 TRENCH로 흡수되어, DRAIN HEADER로 이용된다.

4. PUMP VENDOR 규격.

5. CHEMICAL UNLOADING STATION에서 LEVEL을 볼 수 있도록 한다.

6. 운전 시 CLOSE 되는 배관에는 LOTO 설치.

7. TANK의 역면 레벨 게이지는 VENDOR에서 공급함.

8. INTERLOCK NO. I-4657
(W13-CTP-NaOCl-4677 AUTO STOP)
: REMOTE STATUS에서 W13-T-NaOCl-4609 LEVEL (U-W6019) HIGH HIGH STOP.

9. INTERLOCK NO. I-4624
(W13-CDP-NaOCl-4660 A/B, 4661 A/B AUTO STOP)
: REMOTE STATUS에서 W13-T-NaOCl-4609 LEVEL (U-W6020) LOW LOW STOP.
CIF MBR CIP/BACK WASH 시 START/STOP.

10. DELETED.

11. DELETED.

12. DELETED.

13. FOR PH4 CONNECTION NOZZLE.

14. REUSE SYSTEM 및 BRINE 처리 SYSTEM의 공급용 PUMP 수단에 설치함.

15. OPERATING CAPACITY : 1 LPM
OPERATING PRESSURE : 0.39 MPa

16. OPERATING CAPACITY : 10 LPM
OPERATING PRESSURE : 0.39 MPa

17. INTERLOCK NO. I-4625
(W14-CDP-NaOCl-4660/4661, W13-CDP-NaOCl-4660 B/4661 B AUTO STOP)
: REMOTE STATUS에서 W13-T-NaOCl-4609 LEVEL (U-W6020) LOW LOW STOP.
CIF MBR CIP/BACK WASH 시 START STOP.

18. OPERATING CAPACITY : 1 LPM
OPERATING PRESSURE : 0.39 MPa

19. OPERATING CAPACITY : 10 LPM
OPERATING PRESSURE : 0.39 MPa


2	REVISED AFC	24.06.21
1	REVISED AFC	23.02.28
0	APPROVAL FOR CONSTRUCTION	22.09.23
수정 REV.	설명 DESCRIPTION	날짜 DATE
제 도	한진희	
DRAWN BY	심문용	
검 토	박동영	
CHECKED BY	제 작 사	
승 인	SK 에코플랜트	
APPROVED BY	공 사 명	
제 작 사	PROJECT TITLE	
	M15X Ph3 WWT Project	
	도면명 DWG. TITLE	
	PIPING & INSTRUMENT DIAGRAM NaOCl STORAGE TANK & FEED PUMP	
	축척 SCALE	NONE
	날짜 DATE	2024. 06. 21
	PROJECT NO.	22330D
	도면번호 SHEET NO.	CJ-M15W13-PR-A20-000057
		2

2A	REVISED AFC	25.08.14
2	REVISED AFC	25.01.17
1	REVISED AFC	24.10.31
수정 REV.	설명 DESCRIPTION	날짜 DATE
제 도	이인학	
DRAWN BY	한진희	
검 토	박동영	
CHECKED BY	제 작 사	
승 인	SK 에코플랜트	
APPROVED BY	공 사 명	
제 작 사	PROJECT TITLE	
	M15X Ph4 WWT Project	
	PROJECT NO.	22330D

ITEM NO.	W13-CDP-NaOCl-4660 A/B	ITEM NO.	W13-CDP-NaOCl-4661 A/B	ITEM NO.	W14-CDP-NaOCl-4660	ITEM NO.	W14-CDP-NaOCl-4661
SERVICE	CIF MBR LINE MIXER NaOCl FEED PUMP (MC)	SERVICE	CIF MBR LINE MIXER NaOCl FEED PUMP (RC)	SERVICE	CIF MBR LINE MIXER NaOCl FEED PUMP (MC)	SERVICE	CIF MBR LINE MIXER NaOCl FEED PUMP (RC)
Q'TY	1 + 1	Q'TY	1 + 1	Q'TY	1	Q'TY	1
TYPE	DIAPHRAGM	TYPE	DIAPHRAGM	TYPE	DIAPHRAGM	TYPE	DIAPHRAGM
CAPA.	1/min.ea x MPa	CAPA.	1/min.ea x MPa	CAPA.	1/min.ea x MPa	CAPA.	1/min.ea x MPa
MAT'L	PVDF/PTFE/CERAMIC	MAT'L	PVDF/PTFE/CERAMIC	MAT'L	PVDF/PTFE/CERAMIC	MAT'L	PVDF/PTFE/CERAMIC
POWER kW	0.55	POWER kW	0.75	POWER kW	0.55	POWER kW	0.75



ITEM	SIZE	Q'TY	DESCRIPTION
PV3			
P	OD32	0.8M	PIPE, CPVC, PE, SOCKET FUSION, SDR13.5
P	OD25	0.1M	PIPE, CPVC, PE, SOCKET FUSION, SDR13.5
TR	OD32xOD25	1EA	TEE RED, CPVC, PE, SOCKET FUSION, SDR13.5
F	OD32	2EA	FLG, KS 10K, FF, STUB FLG CPVC /
			BACKING RING(PP)+INSERT(STEEL), SDR13.5
F	OD25	1EA	FLG, KS 10K, FF, STUB FLG CPVC /
			BACKING RING(PP)+INSERT(STEEL), SDR13.5
FB	OD25	1EA	FLG BLIND, KS 10K, FF, CPVC, SDR13.5
G	OD32	2EA	GASKET, KS 10K, FF, PTFE+EPDM, 3.0MM TH'K
G	OD25	2EA	GASKET, KS 10K, FF, PTFE+EPDM, 3.0MM TH'K
B	OD32	2SET	MACHINE BOLT & NYLON NUT :STS 304 / W WASHERS
B	OD25	2SET	MACHINE BOLT & NYLON NUT :STS 304 / W WASHERS
VD	OD25	1EA	DIAPHRAGM VALVE, KS 10K, FF FLG'D, BODY-CPVC /
			TRIM-PDDM, BB, HW
SH	OD32	2EA	SHIELD
SH	OD25	2EA	SHIELD
LOTO	OD25	1EA	LOTO

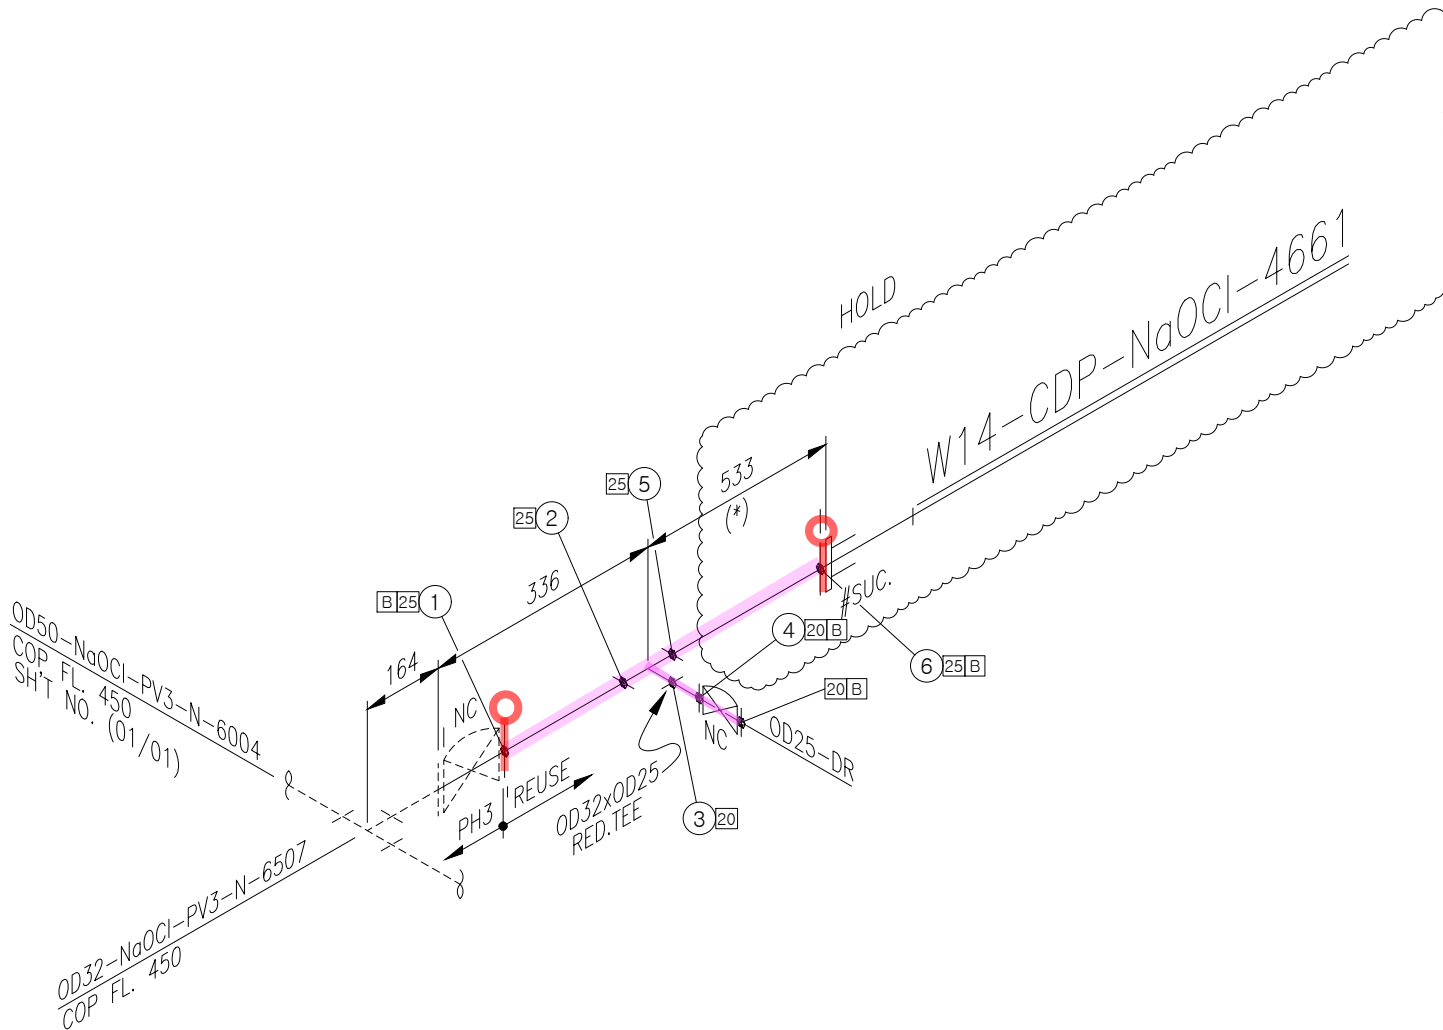

<NOTE>

1. TRAY & ANGLE, CHANNEL SUPPORT가 적용되는 배관 ELEVATION은 현장 맞춤으로 한다.
2. (*) FIELD ADJUST

* PIPE : P/P1	* 90° ELBOW : E90	* 45° ELBOW : E45	* TEE : T	* RED.TEE : TR	* STUB-IN : STU	* REINFORCING PAD : RP	* CON.RED : RC	* ECC.RED : RE	* CON.SWAGE : RCS/RCS1	* ECC.SWAGE : RES/RES1	* NIPPLE : NP/NP1/NP2	* CAP : CAP/CAP1	* PLUG : PLG	* FULL COUPLING : FC	* HALF COUPLING : HF/HF1
* STUB-IN : STU	* SOCKET(HDPE/PVC) : SC	* SADDLE(HDPE) : SD	* FLANGE : F/F1	* GASKET : G/G1/G2	* BOLT & NUT : B/B1	* BLIND FLANGE : FB/FB1	* GATE VA. : VG/VG1/VG2	* BALL VA. : VB/VB0/VB1/VB10/VB2/VB20	* BUTTERFLY VA. : VF/VF4	* CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7					
* GLOBE VA. : VL/VL1/VL2	* DIAPHRAGM VA. : VD/VD0	* DAMPER : VP	* QUICK COUPLING : SQC	* FLEXIBLE JOINT(STEEL) : FLXB	* FLEXIBLE JOINT(RUBBER) : FLXR	* FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL	* FLEXIBLE HOSE : FLXH	* STEAM TRAP : ST	* SPRAY NOZZLE : SPN	* EMERGENCY SHOWER : SSH					
* STRAINER(Y-TYPE) : YSTR	* STRAINER(T-TYPE) : TSTR	* STRAINER(BUCKET-TYPE) : BSTR	* ANCHOR PLATE : STOP	* BIRD SCREEN : BS	* ISOLATION KIT : IK	* UNLOADING BOX : UB	* AIR TRAP : AT	* LOTO : LOTO	* SIGHT GLASS : SG	* PRESSURE GAUGE : PG	* SHILED : SH	* SPECIAL BOLT & NUT : BL/BL1			

INSULATION	CODE	N	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA W14							CONTRACTOR	PROJECT NAME	
	THICK.	—	DESIGN	1.0	60	UNIT 4FA								M15X Ph4 Project	
			OPERATING	ATM	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-040009-A		25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영	COMMODITY	NaOCl	JOB NO.
						REF. P & ID CJ-M15W14-PR-A20-000157							LINE NO.	0D32-NaOCl-PV3-N-6507	SH'T NO. 01 / 01
							REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D			