

DRAWING LIST FOR TEST PACKAGE


PROJECT NO.: 22328D

PROJECT TITLE : M15X Ph2 Project

H3PO4-568

No	PKG No	UNIT	LINE NUMBER			P&ID	REV	REMARK
			ISO DRAWING No	SHEET	REV	P&ID No		
1	568	4FA	OD25-H3PO4-HP2-N-7001-01	1 OF 1	0	CJ-M15W13-PR-A20-000059	2	


ITEM NO.			W13-T-H3P04-4611		
SERVICE			H3P04 STORAGE TANK		
Q'TY			1		
TYPE			VERTICAL CYLINDRICAL		
SIZE	ID x H	m	2.1 x 2.0 (EH 1.6)		
CAPA.	m3		7 (EH 6)		
MAT'L			STS304 + FRP		

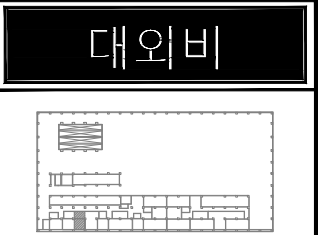

KEY PLAN (4F)

- NOTE
1. DIAPHRAGM PUMP
MAT'L 표기 : HEAD / DIAPHRAGM / CHECK BALL
 2. 약품종류에 따라 LINE 색상을 구분하여야 한다.
 3. CHEMICAL STORAGE TANK & PUMP CURB에서 발생하는 DRAIN은 인근의 TRENCH로 침수되어, DRAIN HEADER로 이동한다.
 4. CHEMICAL UNLOADING STATION에서 LEVEL을 볼 수 있도록 한다.
 5. PUMP VENDOR 공급.
 6. TANK의 역면 레벨 게이지는 VENDOR에서 공급한다.
 7. 운전 시 CLOSE 되는 배관에는 LOTO 설치.
 8. INTERLOCK NO. I-4650
(W13-CTP-H3P04-4670 AUTO STOP)
: REMOTE STATUS에서 W13-T-H3P04-4611 LEVEL (LI-W6023) HIGH HIGH STOP.
 9. INTERLOCK NO. I-4628
(W13-CDP-H3P04-4666 A/B AUTO STOP)
: REMOTE STATUS에서 W13-T-H3P04-4611 LEVEL (LI-W6024) LOW LOW STOP.
 10. FOR REUSE PUMP CONNECTION NOZZLE.
 11. DELETED.
 12. OPERATING CAPACITY : 2 LPM
OPERATING PRESSURE : 0.29 MPa
 13. OPERATING CAPACITY : 0.5 LPM
OPERATING PRESSURE : 0.29 MPa

H3P04-568

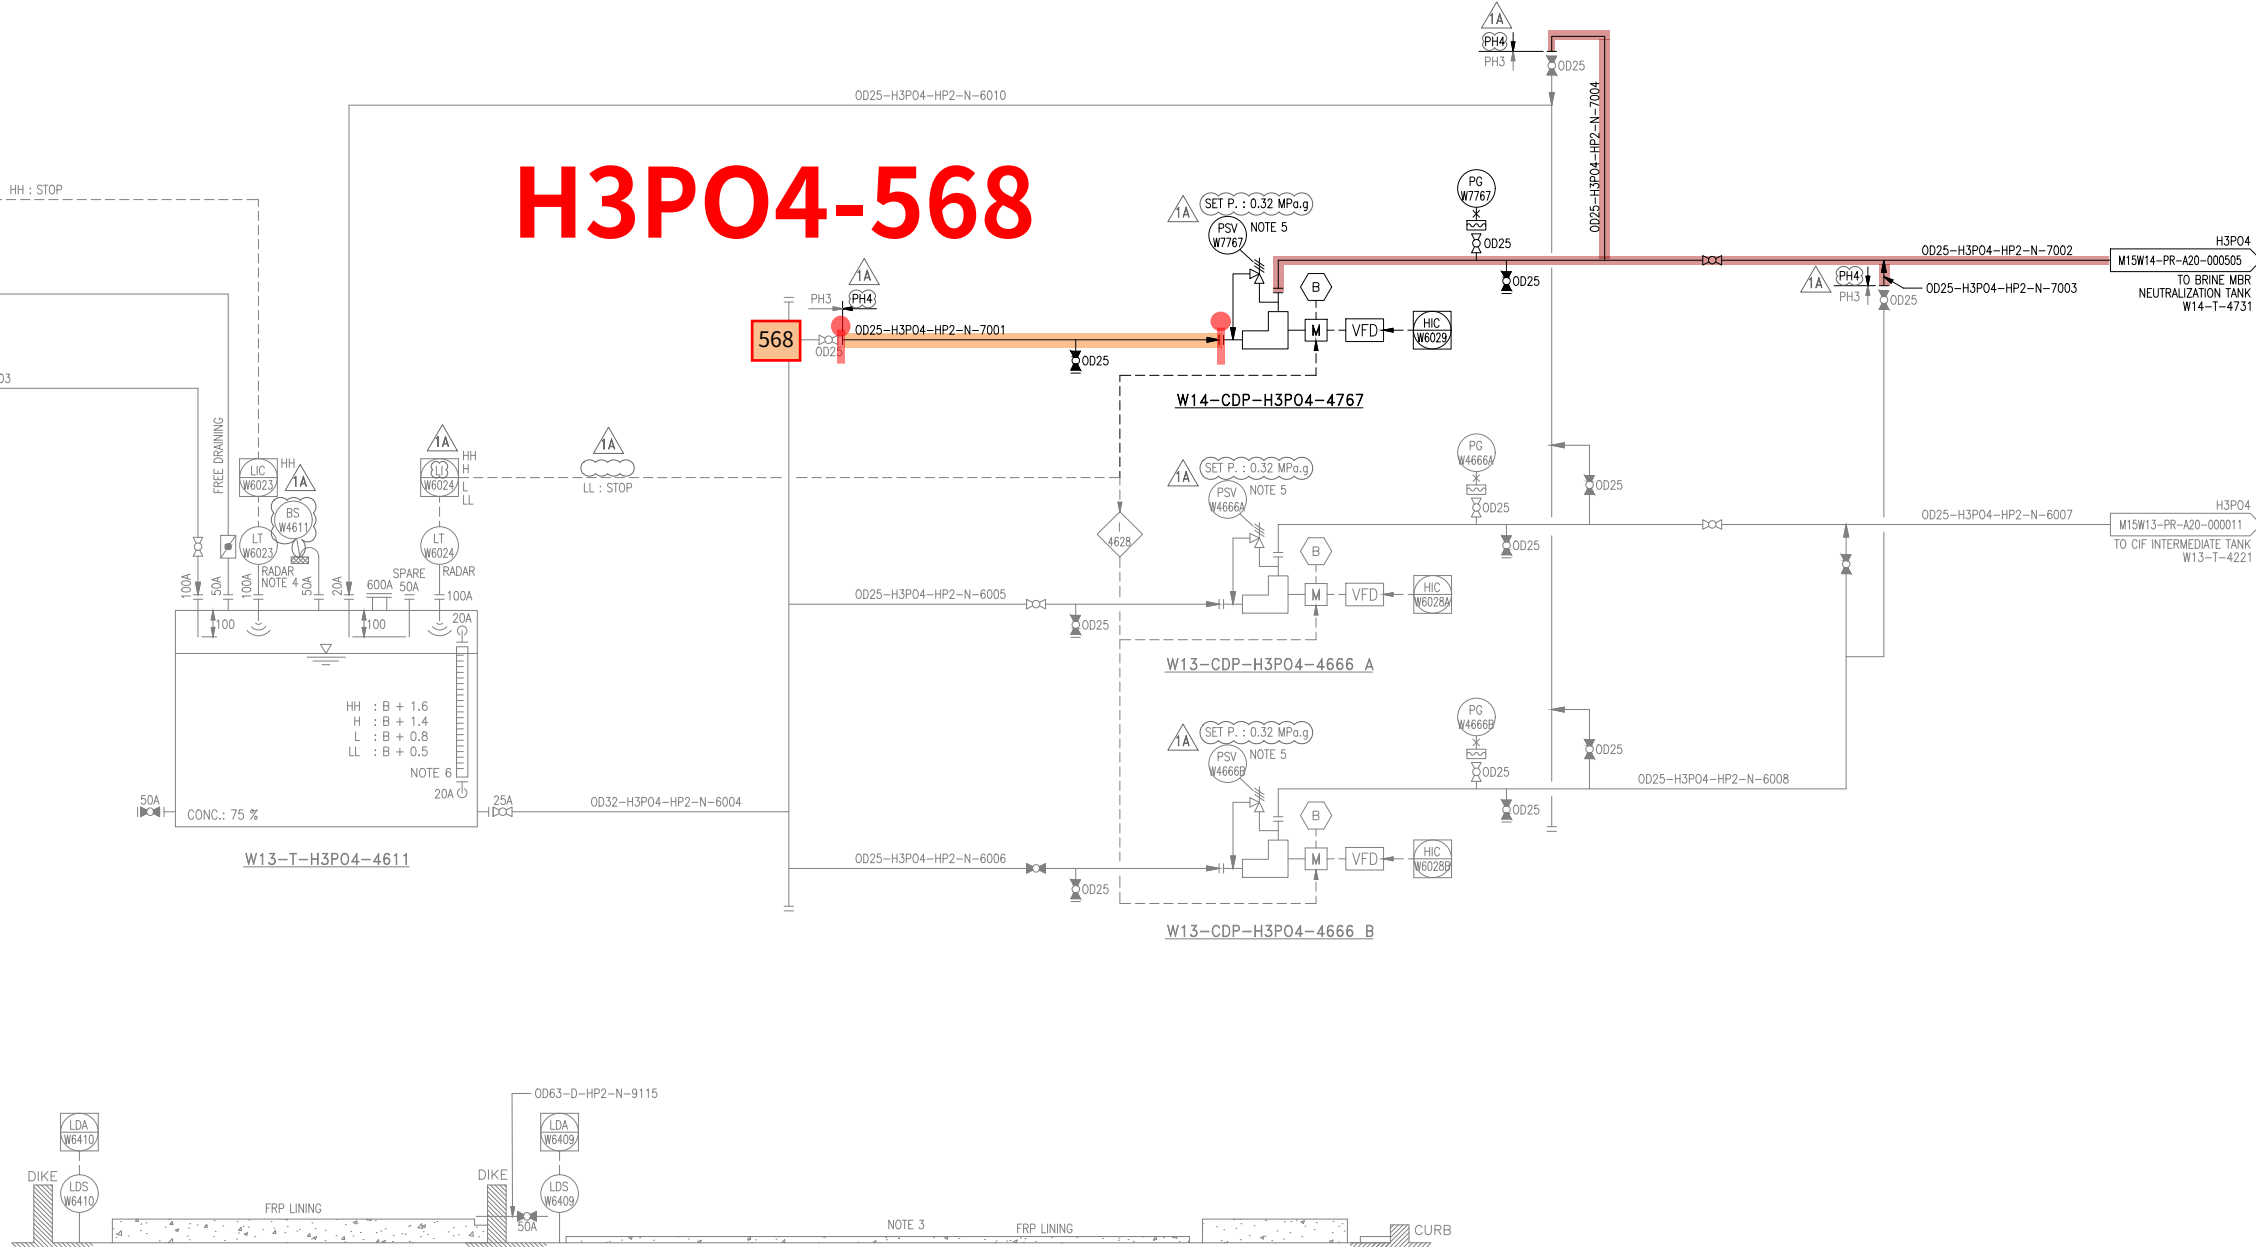

ITEM NO.	W13-CDP-H3P04-4666 A/B
SERVICE	H3P04 FEED PUMP
Q'TY	1 + 1
TYPE	DIAPHRAGM
CAPA.	l/min.ea x MPa 1A (MAX. 2.1 x MAX. 1 NOTE 12)
MAT'L	PVDF/PTEE/CERAMIC
POWER kW	0.4

ITEM NO.	W14-CDP-H3P04-4767
SERVICE	H3P04 FEED PUMP
Q'TY	1
TYPE	DIAPHRAGM
CAPA.	l/min.ea x MPa 1A (MAX. 0.52 x MAX. 1 NOTE 13)
MAT'L	PVDF/PTEE/CERAMIC
POWER kW	0.4

1A	REVISED AFC	25.08.14
1	REVISED AFC	25.01.17
0	APPROVAL FOR CONSTRUCTION	24.10.31
수정 REV.	설명 DESCRIPTION	날짜 DATE

제 도	이 인 학
DRAWN BY	
검 토	한 진 희
CHECKED BY	
승 인	박 동 영
APPROVED BY	
제 작 사	

SK 에코플랜트	
공 사 명	
PROJECT TITLE	
M15X Ph4 WWT Project	
PROJECT NO.	22330D

2	REVISED AFC	24.06.21
1	REVISED AFC	23.02.28
0	APPROVAL FOR CONSTRUCTION	22.09.23
수정 REV.	설명 DESCRIPTION	날짜 DATE

제 도	한 진 희
DRAWN BY	
검 토	심 문 용
CHECKED BY	
승 인	박 동 영
APPROVED BY	
제 작 사	

SK 에코플랜트	
공 사 명	PROJECT TITLE
M15X Ph3 WWT Project	


도면명	DWG. TITLE			
PIPING & INSTRUMENT DIAGRAM				
H3P04 STORAGE TANK & FEED PUMP				

속 척	NONE
SCALE	
날 짜	2024. 06. 21
DATE	

PROJECT NO.	22330D	REV.	
도면번호	CJ-M15W13-PR-A20-000059		
SHEET NO.			2



ITEM	SIZE	Q'TY	DESCRIPTION
HP2			
P	OD25	0.7M	PIPE, HDPE PE100, PE, SOCKET FUSION, PN16/SDR11
T	OD25	1EA	TEE , HDPE PE100, PE, SOCKET FUSION, PN16/SDR11
F	OD25	3 EA	FLG LAP JOINT / STUB END SET, KS 10K, FF,
			LAP JOINT–STS304 / STUB END–HDPE PE100
FB	OD25	1EA	FLG BLIND & LINER SET, KS 10K, FF, BLIND–STS304
			/ LINDER–HDPE PE100 (MIN 5.0MM TH'K)
G	OD25	3EA	GASKET, KS 10K, FF, PTFE+EPDM, 3.0MM TH'K
G2	OD25	1EA	GASKET, KS 10K, FF, PTFE+EPDM, BLIND, 3.0MM TH'K
B	OD25	4SET	MACHINE BOLT & NUTS :STS 304 / W WASHERS
SH	OD25	4EA	SHIELD

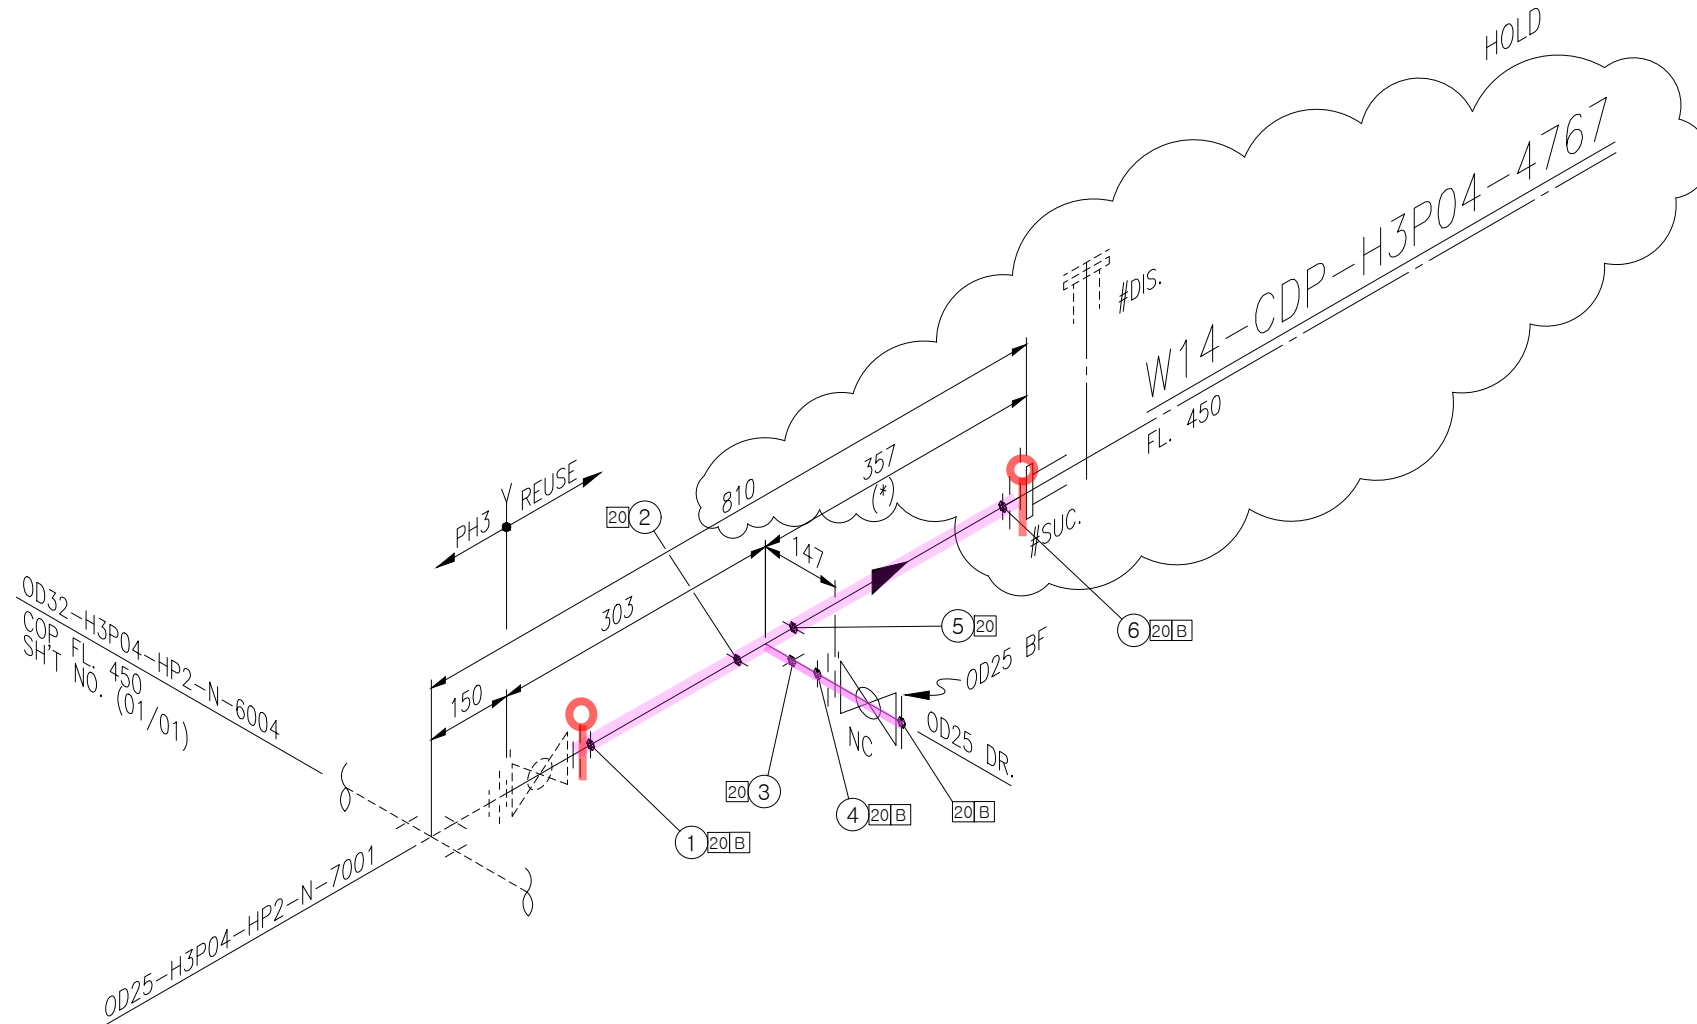

<NOTE>

1. TRAY & ANGLE, CHANNEL SUPPORT가 적용되는 배관 ELEVATION은 현장 맞춤으로 한다.
2. (*) FIELD ADJUST

* PIPE : P/P1	* 90° ELBOW : E90	* 45° ELBOW : E45	* TEE : T	* RED.TEE : TR	* STUB-IN : STU	* REINFORCING PAD : RP	* CON.RED : RC	* ECC.RED : RE	* CON.SWAGE : RCS/RCS1	* ECC.SWAGE : RES/RES1	* NIPPLE : NP/NP1/NP2	* CAP : CAP/CAP1	* PLUG : PLG	* FULL COUPLING : FC	* HALF COUPLING : HF/HF1
* STUB-IN : STU	* SOCKET(HDPE/PVC) : SC	* SADDLE(HDPE) : SD	* FLANGE : F/F1	* GASKET : G/G1/G2	* BOLT & NUT : B/B1	* BLIND FLANGE : FB/FB1	* GATE VA. : VG/VG1/VG2	* BALL VA. : VB/VB1/VB10/VB2/VB210	* BUTTERFLY VA. : VF/VF4	* CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7					
* GLOBE VA. : VL/VL1/VL2	* DIAPHRAGM VA. : VD/VD10	* DAMPER : VP	* QUICK COUPLING : SQC	* FLEXIBLE JOINT(STEEL) : FLXB	* FLEXIBLE JOINT(RUBBER) : FLXR	* FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL	* FLEXIBLE HOSE : FLXH	* STEAM TRAP : ST	* SPRAY NOZZLE : SPN	* EMERGENCY SHOWER : SSH					
* STRAINER(Y-TYPE) : YSTR	* STRAINER(T-TYPE) : TSTR	* STRAINER(BUCKET-TYPE) : BSTR	* ANCHOR PLATE : STOP	* BIRD SCREEN : BS	* ISOLATION KIT : IK	* UNLOADING BOX : UB	* AIR TRAP : AT	* LOTO : LOTO	* SIGHT GLASS : SG	* PRESSURE GAUGE : PG	* SHILED : SH	* SPECIAL BOLT & NUT : BL/BL1			

INSULATION	CODE	N	CONDITION	PRESS. (kg/cm ² g)	TEMP. (°C)	AREA W14							CONTRACTOR 	PROJECT NAME	
	THICK.	-	DESIGN	1	60	UNIT 4FA								M15X Ph4 Project	
			OPERATING	ATM	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-040012-A							COMMODITY H3P04	JOB NO.	
						REF. P & ID CJ-M15W14-PR-A20-000059		25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영	LINE NO. OD25-H3P04-HP2-N-7001	SH'T NO. 01 / 01	REV. 0
							REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D			