

DRAWING LIST FOR TEST PACKAGE


PROJECT NO.: 22328D

PROJECT TITLE : M15X Ph2 Project

POW-577

No	PKG No	UNIT	LINE NUMBER			P&ID		REMARK
			ISO DRAWING No	SHEET	REV	P&ID No	REV	
1	577	3FA	25A-POW-ST1-C-9074-01	1 OF 1	1	CJ-M15W13-PR-A20-000080	2	
2	577	3FA	50A-POW-ST1-C-9507-01	1 OF 1	0	CJ-M15W13-PR-A20-000080	2	

ITEM NO.	W13-T-4910
SERVICE	POTABLE WATER BOOSTER TANK
Q'TY	1
TYPE	CYLINDER
SIZE	ID x H m (0.59 x 0.49 (TL to TL))
CAPA.	m3 0.2
MAT'L	STS304
MAKER PACKAGE	

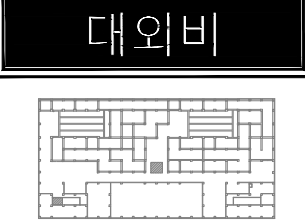

NOTE
1. FOR FUTURE CONNECTION NOZZLE.
2. 비상세척실비 관련 MONITORING SYSTEM 구축할 것.
(VALVE 작동 시 중앙방재실로 신호 전송하여 위치 표시와 ALARM 경보음 발생, SCOPE BY SK HYNIX)

1A	REVISED AFC	25.08.14
1	REVISED AFC	25.01.17
0	APPROVAL FOR CONSTRUCTION	24.09.30
수정 REV.	설명 DESCRIPTION	날짜 DATE

제 도 이 인 학
검 토 한 진 회
승 인 박 동 영
제 작 사 SK 에코플랜트

공 사 명 PROJECT TITLE
M15X Ph4 WWT Project
PROJECT NO. 22330D

2	REVISED AFC	24.06.21
1	REVISED AFC	23.02.28
0	APPROVAL FOR CONSTRUCTION	22.09.23
수정 REV.	설명 DESCRIPTION	날짜 DATE


제 도 한 진 회
검 토 심 문 용
승 인 박 동 영
제 작 사 SK 에코플랜트

공 사 명 PROJECT TITLE
M15X Ph3 WWT Project

도면명 DWG. TITLE
UTILITY DISTRIBUTION DIAGRAM
POTABLE/CHILLED WATER SUPPLY SYSTEM



속 척 SCALE NONE
날 짜 DATE 2024. 06. 21

PROJECT NO.	22330D	REV.	
도면번호 SHEET NO.	CJ-M15W13-PR-A20-000080		2

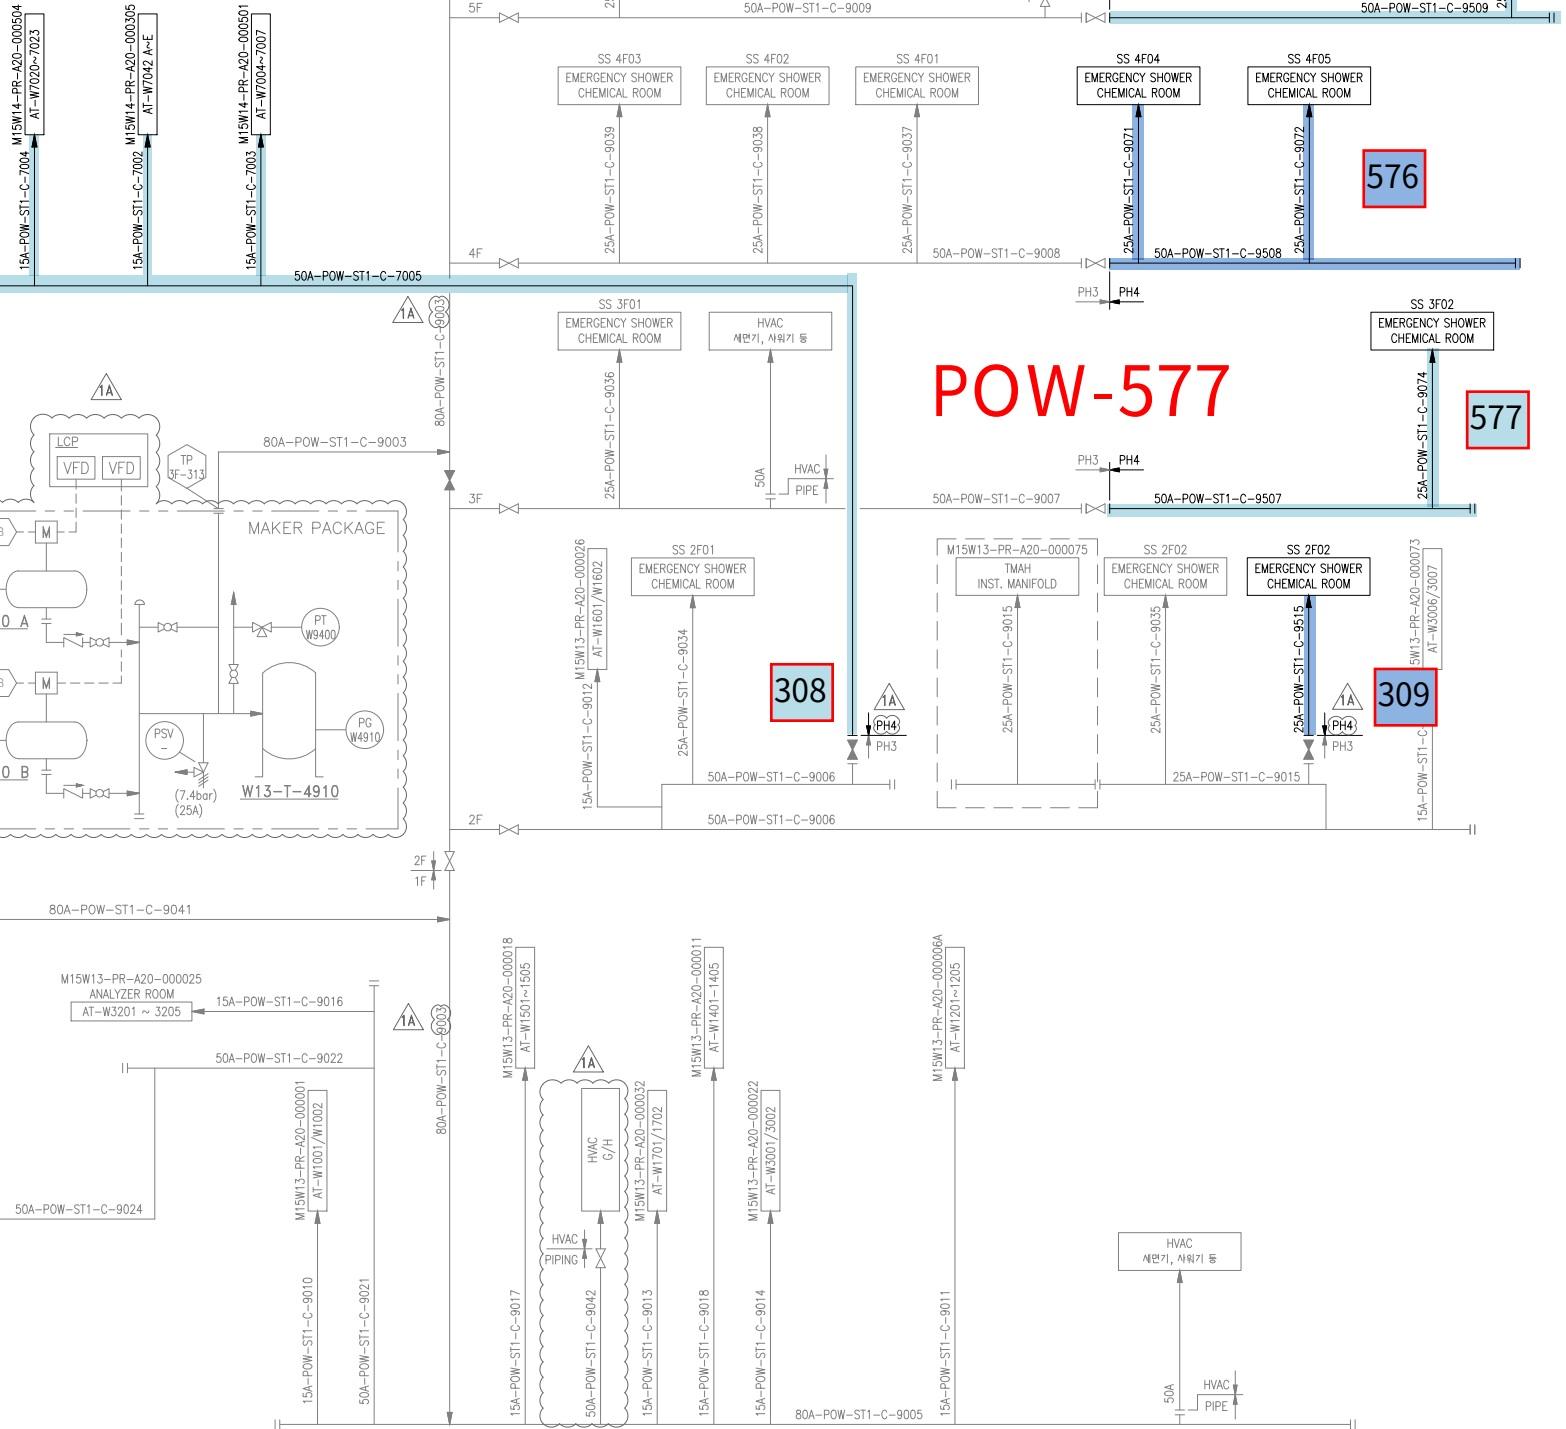

POTABLE WATER
M15W13-PR-A20-000085
FROM UDD FOR POTABLE WATER


NOTE 1
80A

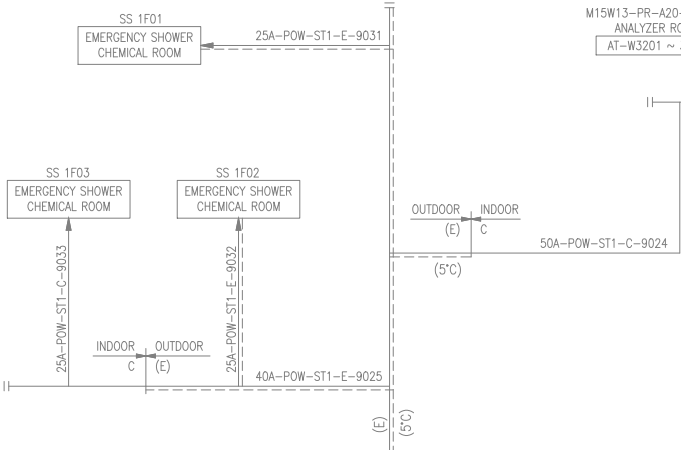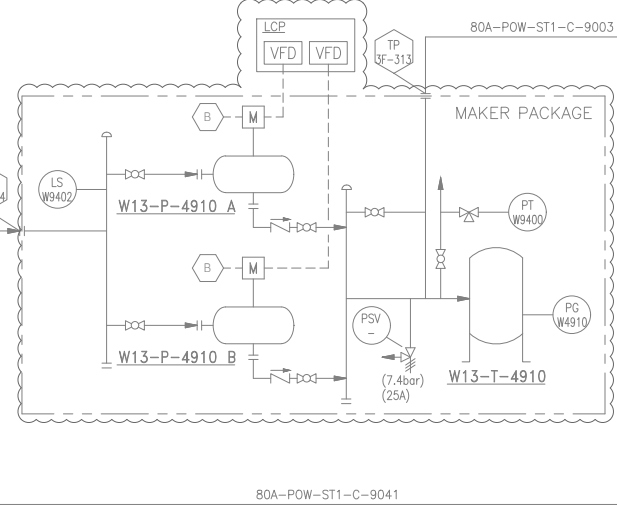

CHILLED WATER
6 °C, 10 kg/cm2.g
M15W13-PR-A20-000085
FROM UDD FOR CHILLED WATER

CHILLED WATER
14 °C, 10 kg/cm2.g
M15W13-PR-A20-000085
TO pH-3 CUB

ITEM NO.	W13-P-4910 A/B
SERVICE	POTABLE WATER BOOSTER PUMP
Q'TY	1 + 1
TYPE	(CENTRIFUGAL (WF))
CAPA.	m3/hr.ea x mH 15 x 50 (0.5 Mpa)
MAT'L	STS316/STS316
DRIVER kW	(5.5 x 2)

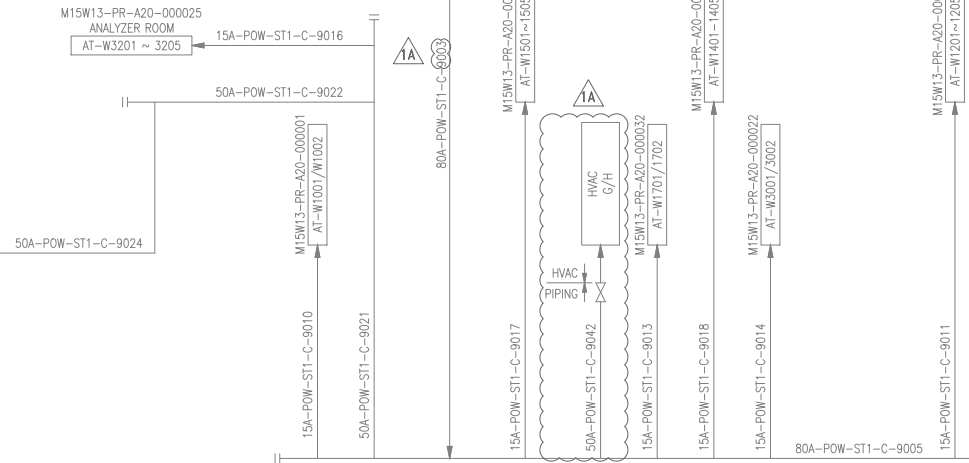


CHILLED WATER SUPPLY
M15W13-PR-A20-000075
TO TMAH MF HEAT EXCHANGER
W13-HEX-4181A

CHILLED WATER RETURN
M15W13-PR-A20-000075
FROM TMAH MF HEAT EXCHANGER
W13-HEX-4181A



INSULATION	CODE	C	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA W14						
	THICK.	25	DESIGN	13	60	UNIT 3FA						
			OPERATING	10	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-030007-A		25.03.31	REVISED AS MARKED	황래중	안남후	박동
								25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동
						REF. P & ID CJ-M15W13-PR-A20-000080	REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'N

CLIENT		 1	
CONTRACTOR 		PROJECT NAME	
COMMODITY		JOB NO.	
POW		22330D	
LINE NO.	25A-P0W-ST1-C-9074	SH'T NO. 01 / 01	REV. 1

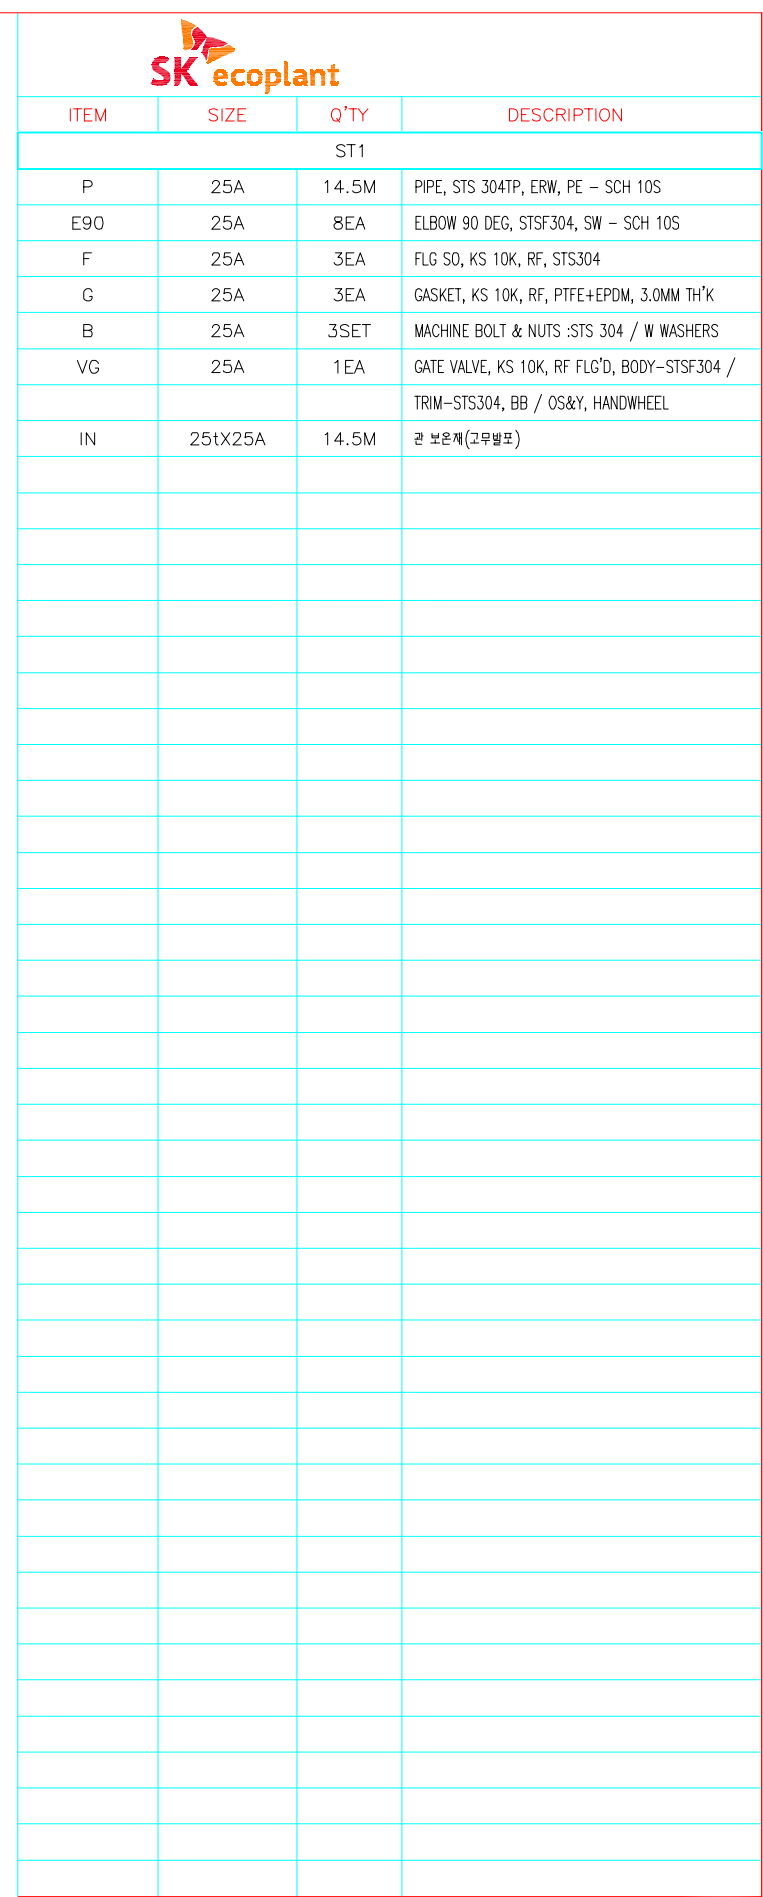


CLIENT  1

CONTRACTOR		PROJECT NAME	
		M15X Ph4 Project	
COMMODITY	POW	JOB NO.	22330D
LINE NO.	25A-POW-ST1-C-9074	SH'T NO.	REV.
		01 / 01	1



ITEM	SIZE	Q'TY	DESCRIPTION
ST1			
P	50A	47.6M	PIPE, STS 304TP, ERW, BE – SCH 10S
NP1	20A	2EA	NIPPLE, STS 304TP, ERW, TOE – SCH 40S
HF	25A	1EA	COUPLING HALF, STSF304, SW – SCH 10S
HF	20A	1EA	COUPLING HALF, STSF304, SW – SCH 10S
PLG	20A	1EA	PLUG ROUND HEAD, STSF304, SCR'D
VB1	20A	1EA	BALL VALVE, KS 10K, SCR'D, BODY-STSF304 /
			TRIM-STS304 / SEAT-PTFE, FB, LEVER
F	50A	3EA	FLG SO, KS 10K, RF, STS304
FB	50A	1EA	FLG BLIND, KS 10K, RF, STS304
G	50A	3EA	GASKET, KS 10K, RF, PTFE+EPDM, 3.0MM TH'K
B	50A	3EA	MACHINE BOLT & NUTS :STS 304 / W WASHERS
IN	25tX50A	47.6M	관 복온재(고무발포)
VG	50A	1EA	GATE VALVE, KS 10K, RF FLG'D, BODY-SSC13 /
			TRIM-STS304, BB / OS&Y, HANDWHEEL
LOTO	50A	1EA	LOTO

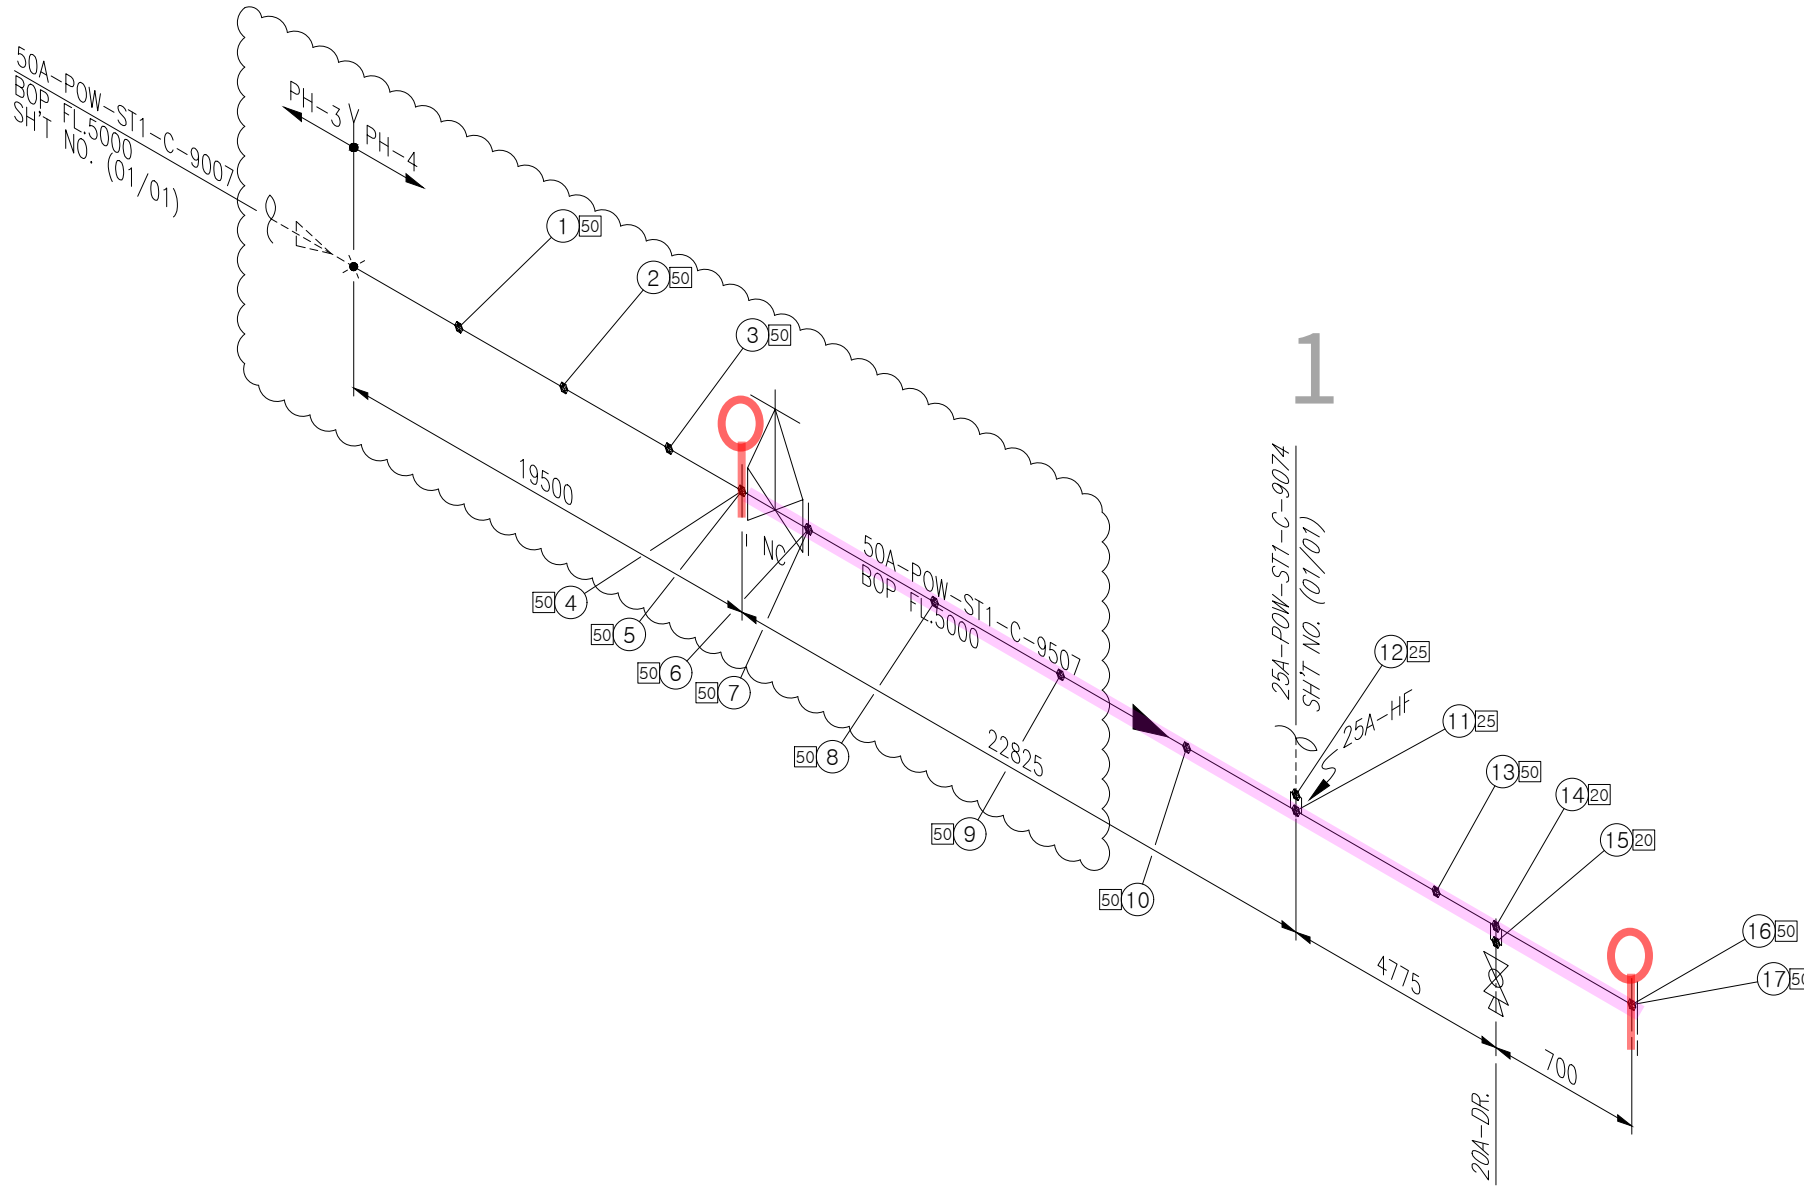

<NOTE>
1. (*) FIELD ADJUST

* PIPE : P/P1	* 90° ELBOW : E90	* 45° ELBOW : E45	* TEE : T	* RED.TEE : TR	* STUB-IN : STU	* REINFORCING PAD : RP	* CON.RED : RC	* ECC.RED : RE	* CON.SWAGE : RCS/RCS1	* ECC.SWAGE : RES/RES1	* NIPPLE : NP/NP1/NP2	* CAP : CAP/CAP1	* PLUG : PLG	* FULL COUPLING : FC	* HALF COUPLING : HF/HF1
* STUB-IN : STU	* SOCKET(HDPE/PVC) : SC	* SADDLE(HDPE) : SD	* FLANGE : F/F1	* GASKET : G/G1/G2	* BOLT & NUT : B/B1	* BLIND FLANGE : FB/FB1	* GATE VA. : VG/VG1/VG2	* BALL VA. : VB/VB0/VB1/VB10/VB2/VB20	* BUTTERFLY VA. : VF/VF4	* CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7					
* GLOBE VA. : VL/VL1/VL2	* DIAPHRAGM VA. : VD/VD0	* DAMPER : VP	* QUICK COUPLING : SQC	* FLEXIBLE JOINT(STEEL) : FLXB	* FLEXIBLE JOINT(RUBBER) : FLXR	* FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL	* FLEXIBLE HOSE : FLXH	* STEAM TRAP : ST	* SPRAY NOZZLE : SPN	* EMERGENCY SHOWER : SSH					
* STRAINER(Y-TYPE) : YSTR	* STRAINER(T-TYPE) : TSTR	* STRAINER(BUCKET-TYPE) : BSTR	* ANCHOR PLATE : STOP	* BIRD SCREEN : BS	* ISOLATION KIT : IK	* UNLOADING BOX : UB	* AIR TRAP : AT	* LOTO : LOTO	* SIGHT GLASS : SG	* PRESSURE GAUGE : PG	* SHILED : SH	* SPECIAL BOLT & NUT : BL/BL1			

INSULATION	CODE	C	CONDITION	PRESS. (kg/cm ² g)	TEMP. (°C)	AREA	W14								CONTRACTOR	PROJECT NAME	
	THICK.	25	DESIGN	13	60	UNIT	3FA									M15X Ph4 Project	
			OPERATING	10	AMB	REF. PLAN DWG.									COMMODITY	JOB NO.	
						CJ-M15W14-PI-A30-030008-A									POW	22330D	
						REF. P & ID									LINE NO.	SH'T REV.	
						CJ-M15W13-PR-A20-000080									50A-POW-ST1-C-9507	01 / 01 0	
									25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영				
								REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D				

경고 : 본 문헌은 SK HYNIX의 기밀정보일 자료로서, 어떠한 경우에도 무단으로 제3자에게 공개, 누설, 유출 또는 기타 방법으로 외부에 알려서는 안 됩니다. 이 문헌을 무단으로 배포하거나 사내에서 사용하지 않는다면 법적 책임을 질 수 있습니다.