

DRAWING LIST FOR TEST PACKAGE


PROJECT NO.: 22328D

PROJECT TITLE : M15X Ph2 Project

WW-SLD-611


No	PKG No	UNIT	LINE NUMBER			P&ID		REMARK
			ISO DRAWING No	SHEET	REV	P&ID No	REV	
1	611	2FA	350A-WW-SLD-ST1-E-7012-01	1 OF 1	1	CJ-M15W14-PR-A20-000505	1A	
2	611	2FA	350A-WW-SLD-ST1-E-7013-01	1 OF 1	1	CJ-M15W14-PR-A20-000505	1A	

ITEM NO.	W14-AD-4734	
SERVICE	BRINE MBR 1 st OXIC TANK AIR DIFFUSER 1	
Q'TY	ea	70
TYPE	MEMBRANE (TUBE) 	
CAPA.	L/min.ea	350
MAT'L	PP + EPDM	

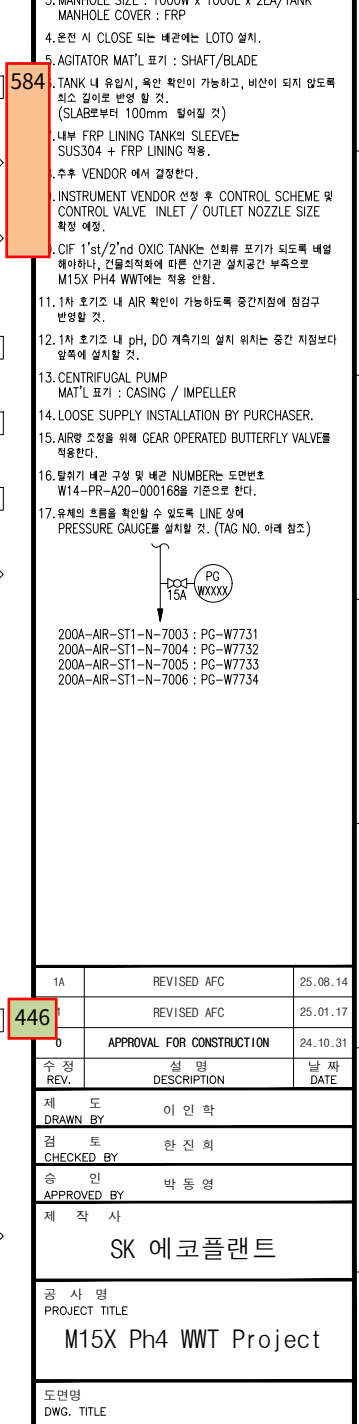

ITEM NO.	W14-MX-4736	
SERVICE	BRINE MBR 2'nd ANOXIC MIXER	
Q'TY	1	
TYPE	SUBMERSIBLE	
SPEED	rpm	(1800) 1A
MAT'L	STS431/STS304	
POWER	kW	(5.5) 1A

날 짜 DATE	2025. 08. 14
PROJECT NO.	22330D
도면번호 DWG. NO.	C-I-M15W14-PR-A20-000505
REV.	1A

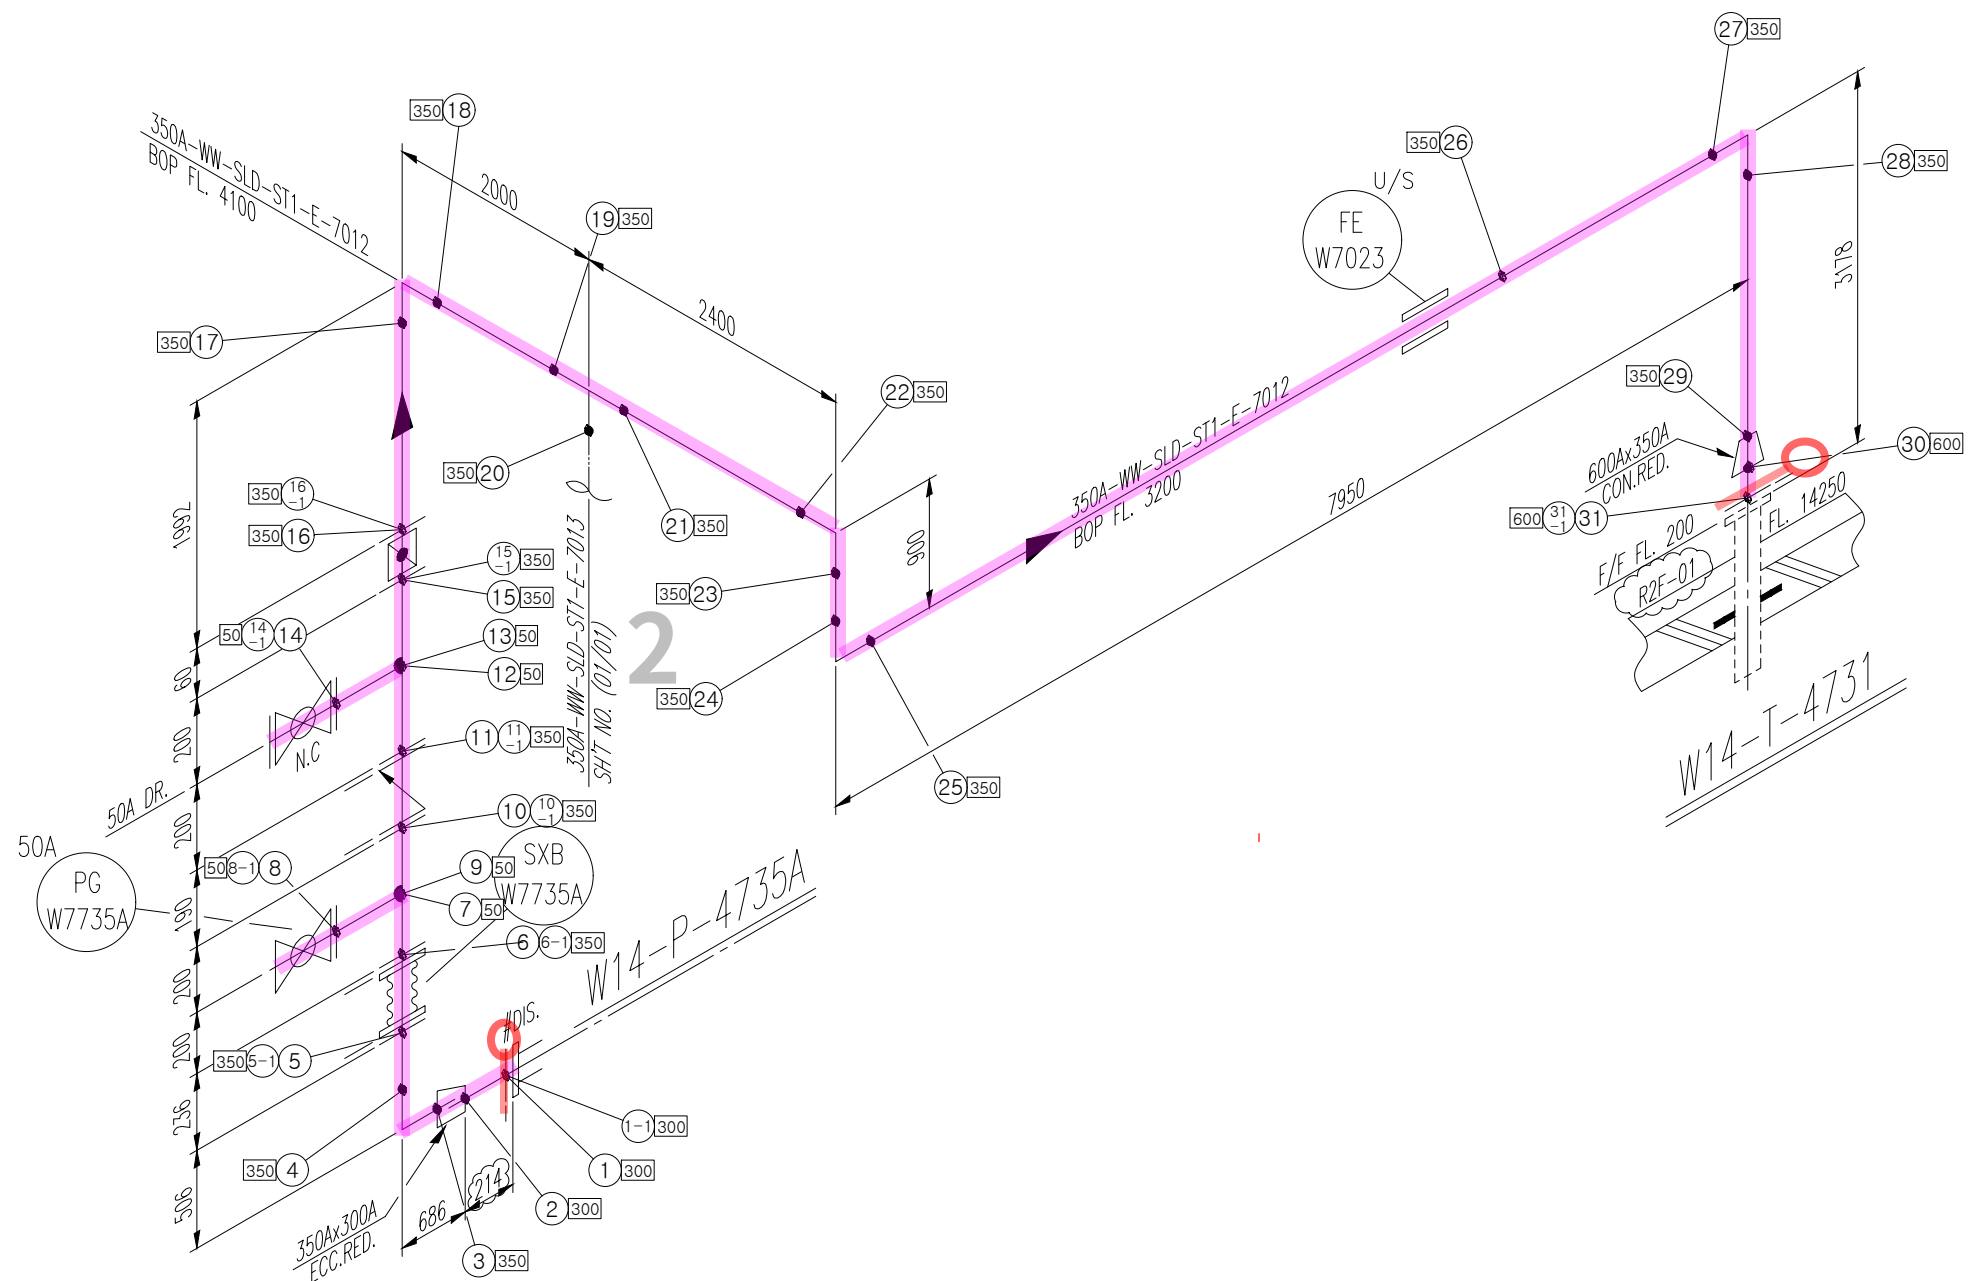

* PIPE : P/P1	* 90° ELBOW : E90	* 45° ELBOW : E45	* TEE : T	* RED.TEE : TR	* SUB-IN : STU	* REINFORCING PAD : RP	* CON.RED : RC	* ECC.RED : RE	* CON.SWAGE : RCS/RCS1	* ECC.SWAGE : RES/RES1	* NIPPLE : NP/NP1/NP2	* CAP : CAP/CAP1	* PLUG : PLG	* FULL COUPLING : FC	* HALF COUPLING : HF/HF1
* SUB-IN : STU	* SOCKET(HDPE/PVC) : SC	* SADDLE(HDPE) : SD	* FLANGE : F/F1	* GASKET : G/G1/G2	* BOLT & NUT : B/B1	* BLIND FLANGE : FB/FB1	* GATE VA. : VG/VG1/VG2	* BALL VA. : VB/VBLO/VB1/VB1LO/VB2/VB2LO	* BUTTERFLY VA. : VF/VF4	* CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7					
* GLOBE VA. : VL/VL1/VL2	* DIAPHRAGM VA. : VD/VDLO	* DAMPER : VP	* QUICK COUPLING : SQC	* FLEXIBLE JOINT(STEEL) : FLXB	* FLEXIBLE JOINT(RUBBER) : FLXR	* FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL	* FLEXIBLE HOSE : FLXH	* STEAM TRAP : ST	* SPRAY NOZZLE : SPN	* EMERGENCY SHOWER : SSH					
* STRAINER(Y-TYPE) : YSTR	* STRAINER(T-TYPE) : TSTR	* STRAINER(BUCKET-TYPE) : BSTR	* ANCHOR PLATE : STOP	* BIRD SCREEN : BS	* ISOLATION KIT : IK	* UNLOADING BOX : UB	* AIR TRAP : AT	* LOTO : LOTO	* SIGHT GLASS : SG	* PRESSURE GAUGE : PG	* SHILED : SH	* SPECIAL BOLT & NUT : BL/BL1			

INSULATION	CODE	E	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA W14							CONTRACTOR	PROJECT NAME
	THICK.	25	DESIGN	6.4	60	UNIT R2FA								M15X Ph4 Project
			OPERATING	4	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-020014-A		25.03.31	REVISED AS MARKED	황래중	안남후	박동영	COMMODITY	JOB NO.
						REF. P & ID CJ-M15W14-PR-A20-000505		25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영	WW-SLD	22330D
							REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D	LINE NO.	SH'T NO. REV.
													350A-WW-SLD-ST1-E-7012	01 / 01 1

CLIENT  1



F	100A	1EA	FLG SO, KS 10K, RF, STS304
G	100A	1EA	GASKET, KS 10K, RF, PTFE+EPDM, 3.0MM TH'K
B	100A	1SET	MACHINE BOLT & NUTS :STS 304 / W WASHERS



1

TOR  SK ecoplant

WW-SLD

350A-WW-SLD-ST1-F-7012

M15X Ph4 Project

22330D

INSULATION	CODE	E	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA	W14						
	THICK.	25	DESIGN	6.4	60	UNIT	R2FA						
			OPERATING	4	AMB	REF. PLAN DWG.			25.03.31	REVISED AS MARKED	황래중	안남후	박동영
						CJ-M15W14-PI-A30-020014-A			25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영
						REF. P. & ID		REV. NO.	DATE	DESCRIPTION	BY	CHK	APP
						CJ-M15W14-PR-A20-000505							



CLIENT



2

INSULATION	CODE	E	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA W14							CONTRACTOR	PROJECT NAME		
	THICK.	25	DESIGN	6.4	60	UNIT R2FA								M15X Ph4 Project		
			OPERATING	4	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-020014-A		25.03.31	REVISED AS MARKED	황래중	안남후	박동영	COMMODITY	WW-SLD	JOB NO.	
						CJ-M15W14-PR-A20-000505		25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영	LINE NO.	350A-WW-SLD-ST1-E-7013	SH'T NO. 01 / 01	REV. 1
							REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D				