

DRAWING LIST FOR TEST PACKAGE PROJECT NO.: 22328D PROJECT TITLE : M15X Ph2 Project		BWW-643
---	--	----------------

PROJECT NO.: 22328D**PROJECT TITLE : M15X Ph2 Project**

BWW-643

[illegible]

ITEM NO.	W14-T-4706
SERVICE	RO CIP TANK
Q'TY	1
TYPE	VERTICAL & CYCINDRICAL
SIZE	ID x H m 2.4 x 4.0 (EH 3.2)
CAPA.	m3 18.1 (EH 14.5)
MAT'L	FRP

ITEM NO.	W14-EJ-4701
SERVICE	RO CIP TANK EJECTOR UNIT
Q'TY	1
CAPA.	NI/s.ea 6
MAT'L	STS304+ETFE

ITEM NO.	W14-STF-4707
SERVICE	RO CIP FILTER
Q'TY	1
TYPE	CARTRIDGE
SIZE	μm 5
CAPA.	m3/hr 360
MAT'L	SSC14 / PP

NOTE 10 1A

대외비



KEY PLAN (2F)

NOTE

1. 2m 이상 높은 곳에 설치된 밸브는 CHAIN VALVE 또는 PLATFORM 구성할 것.
2. 회전식 CLOSE 되는 배관에는 LOTO 설치.
3. CENTRIFUGAL PUMP
MAT'L 표기 : CASING / IMPELLER
4. (DELETED) 1A
5. CURBED AREA 및 내부 TRENCH DRAIN HOLE 적용할 것.
6. DELETED.
7. PORTABLE 계측기 공급 1SET (pH + COND.)
8. VALVE 후단에서 CHEMICAL PAIL 연결 부위는 내압호스를 사용하여 PAIL을 전부 비울 수 있어야 함.
9. 공급 : VENDOR / 설치 : SKEP
10. FILTER ELEMENT 순환 : 130EA 1A

BWW-643

310

643

417

638

358

640

ITEM NO.	W14-EH-4706 A/B
SERVICE	RO CIP TANK ELECTRIC HEATER
Q'TY	2
MAT'L	STS316L
POWER kW	101

ITEM NO.	W14-AG-4706
SERVICE	RO CIP TANK AGITATOR
Q'TY	1
SPEED RPM	125
MAT'L	STS316
POWER kW	2.2

ITEM NO.	W14-P-4710 A/B
SERVICE	RO CIP PUMP
Q'TY	1 + 1
TYPE	CENTRIFUGAL (VWF)
CAPA.	m3/hr.ea x mH 360 x 40 (0.39MPa)
MAT'L	SSC14/SSC14
POWER kW	75

1A	REVISED AFC	25.08.14
1	REVISED AFC	25.01.17
0	APPROVAL FOR CONSTRUCTION	24.10.31
수정 REV.	실명 DESCRIPTION	날짜 DATE

제 DRAWN BY	이인학
검 CHECKED BY	한진희
승 APPROVED BY	박동명
제 작 사	



공 사 명 PROJECT TITLE	M15X Ph4 WWT Project
------------------------------	----------------------

날 DATE	2025. 08. 14
도면번호 SHEET NO.	CJ-M15W14-PR-A20-000312

속 SCALE	NONE
날 DATE	2025. 08. 14
PROJECT NO.	22330D
도면번호 SHEET NO.	CJ-M15W14-PR-A20-000312

REV.


1A

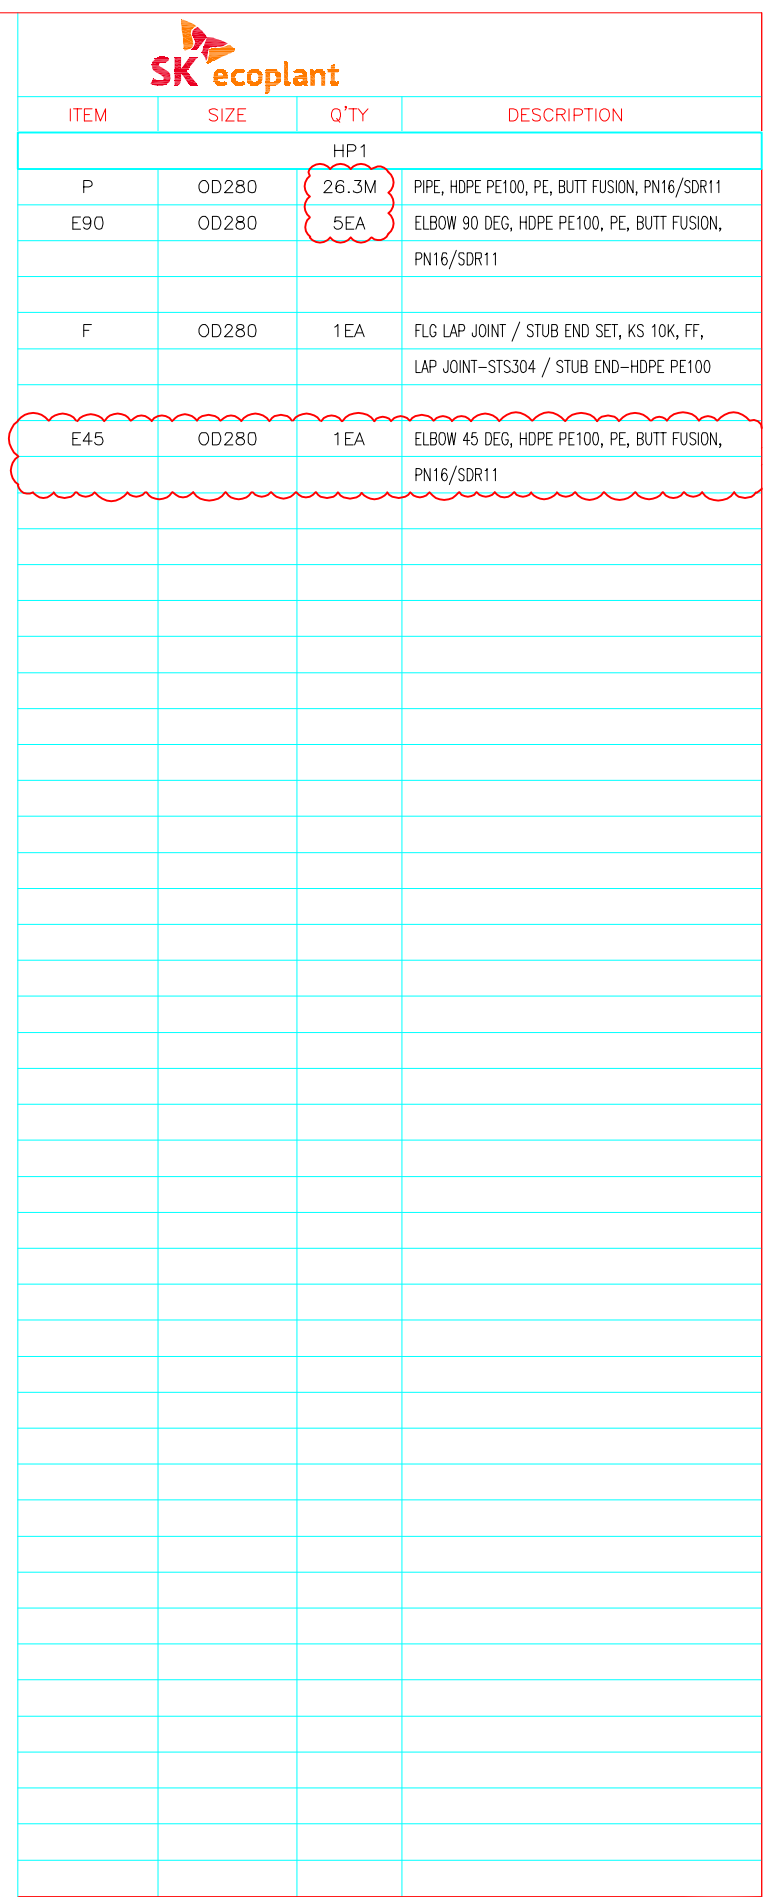

* PIPE : P/P1	* 90° ELBOW : E90	* 45° ELBOW : E45	* TEE : T	* RED.TEE : TR	* STUB-IN : STU	* REINFORCING PAD : RP	* CON.RED : RC	* ECC.RED : RE	* CON.SWAGE : RCS/RCS1	* ECC.SWAGE : RES/RES1	* NIPPLE : NP/NP1/NP2	* CAP : CAP/CAP1	* PLUG : PLG	* FULL COUPLING : FC	* HALF COUPLING : HF/HF1
* STUB-IN : STU	* SOCKET(HDPE/PVC) : SC	* SADDLE(HDPE) : SD	* FLANGE : F/F1	* GASKET : G/G1/G2	* BOLT & NUT : B/B1	* BLIND FLANGE : FB/FB1	* GATE VA. : VG/VG1/VG2	* BALL VA. : VB/VB1/VB10/VB2/VB210	* BUTTERFLY VA. : VF/VF4	* CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7					
* GLOBE VA. : VL/VL1/VL2	* DIAPHRAGM VA. : VD/VD10	* DAMPER : VP	* QUICK COUPLING : SQC	* FLEXIBLE JOINT(STEEL) : FLXB	* FLEXIBLE JOINT(RUBBER) : FLXR	* FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL	* FLEXIBLE HOSE : FLXH	* STEAM TRAP : ST	* SPRAY NOZZLE : SPN	* EMERGENCY SHOWER : SSH					
* STRAINER(Y-TYPE) : YSTR	* STRAINER(T-TYPE) : TSTR	* STRAINER(BUCKET-TYPE) : BSTR	* ANCHOR PLATE : STOP	* BIRD SCREEN : BS	* ISOLATION KIT : IK	* UNLOADING BOX : UB	* AIR TRAP : AT	* LOTO : LOTO	* SIGHT GLASS : SG	* PRESSURE GAUGE : PG	* SHILED : SH	* SPECIAL BOLT & NUT : BL/BL1			

INSULATION	CODE	N	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA	W14						
	THICK.	—	DESIGN	6.4	60	UNIT	R1FA						
			OPERATING	4	AMB	REF. PLAN DWG.			25.03.31	REVISED AS MARKED	황래중	안남 후	박동영
						CJ-M15W14-PI-A30-010016-A/B/C			25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남 후	박동영
						REF. P. & ID		REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D
						CJ-M15W14-PR-A20-000312							

CLIENT	 1	
CONTRACTOR		PROJECT NAME M15X Ph4 Project
COMMODITY	BWW	JOB NO. 22330D
LINE NO.	OD280-BWW-HP1-N-7134	SH'T NO. 01 / 01
		REV. 1



<NOTE>
1. TRAY & ANGLE, CHANNEL SUPPORT가 적용되는
배관 ELEVATION은 현장 맞춤으로 한다.
2. (*) FIELD ADJUST

[illegible]

CLIENT		 	
CONTRACTOR 		PROJECT NAME M15X Ph4 Project	
COMMODITY	BWW	JOB NO. 22330D	
LINE NO.	OD280-BWW-HP1-E-7134	SH'T NO. 01 / 01	REV. 1

* PIPE : P/P1 * 90° ELBOW : E90 * 45° ELBOW : E45 * TEE : T * RED.TEE : TR * SUB-IN : STU * REINFORCING PAD : RP * CON.RED : RC * ECC.RED : RE * CON.SWAGE : RCS/RCS1 * ECC.SWAGE : RES/RES1 * NIPPLE : NP/NP1/NP2 * CAP : CAP1 * PLUG : PLG * FULL COUPLING : FC * HALF COUPLING : HF/HF1 * SUB-IN : STU * SOCKET(HDPE/PVC) : SC * SADDLE(HDPE) : SD * FLANGE : F/F1 * GASKET : G/G1/G2 * BOLT & NUT : B/B1 * BLIND FLANGE : FB/FB1 * GATE VA. : VG/VG1/VG2 * BALL VA. : VB/VBLO/VB1/VB1LO/VB2/VB2LO * BUTTERFLY VA. : VF/VF4 * CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7 * GLOBE VA. : VL/VL1/VL2 * DIAPHRAGM VA. : VD/VDLO * DAMPER : VP * QUICK COUPLING : SQC * FLEXIBLE JOINT(STEEL) : FLXB * FLEXIBLE JOINT(RUBBER) : FLXR * FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL * FLEXIBLE HOSE : FLXH * STEAM TRAP : ST * SPRAY NOZZLE : SPN * EMERGENCY SHOWER : SSH * STRAINER(Y-TYPE) : YSTR * STRAINER(T-TYPE) : TSTR * STRAINER(BUCKET-TYPE) : BSTR * ANCHOR PLATE : STOP * BIRD SCREEN : BS * ISOLATION KIT : IK * UNLOADING BOX : UB * AIR TRAP : AT * LOTO : LOTO * SIGHT GLASS : SG * PRESSURE GAUGE : PG * SHILED : SH * SPECIAL BOLT & NUT : BL/BL1													
INSULATION	CODE	E	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA	W14						
	THICK.	25	DESIGN	6.4	60	UNIT	R2FA						
			OPERATING	4	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-020014-C			25.03.31	REVISED AS MARKED	황래중	안남후	박동영
						REF. P & ID CJ-M15W14-PR-A20-000312			25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영
								REV. NO.	DATE	DESCRIPTION	BY	CHK	APP