


DRAWING LIST FOR TEST PACKAGE

PROJECT NO.: 22328D

PROJECT TITLE : M15X Ph2 Project

WW-REW-644

No	PKG No	UNIT	LINE NUMBER			P&ID		REMARK
			ISO DRAWING No	SHEET	REV	P&ID No	REV	
1	644	1FA	OD400-WW-REW-HP1-N-7026-01	1 OF 1	1	CJ-M15W13-PR-A20-000025	2	
2	644	2FA	OD400-WW-REW-HP1-E-7026-01	1 OF 1	1	CJ-M15W13-PR-A20-000025	2	

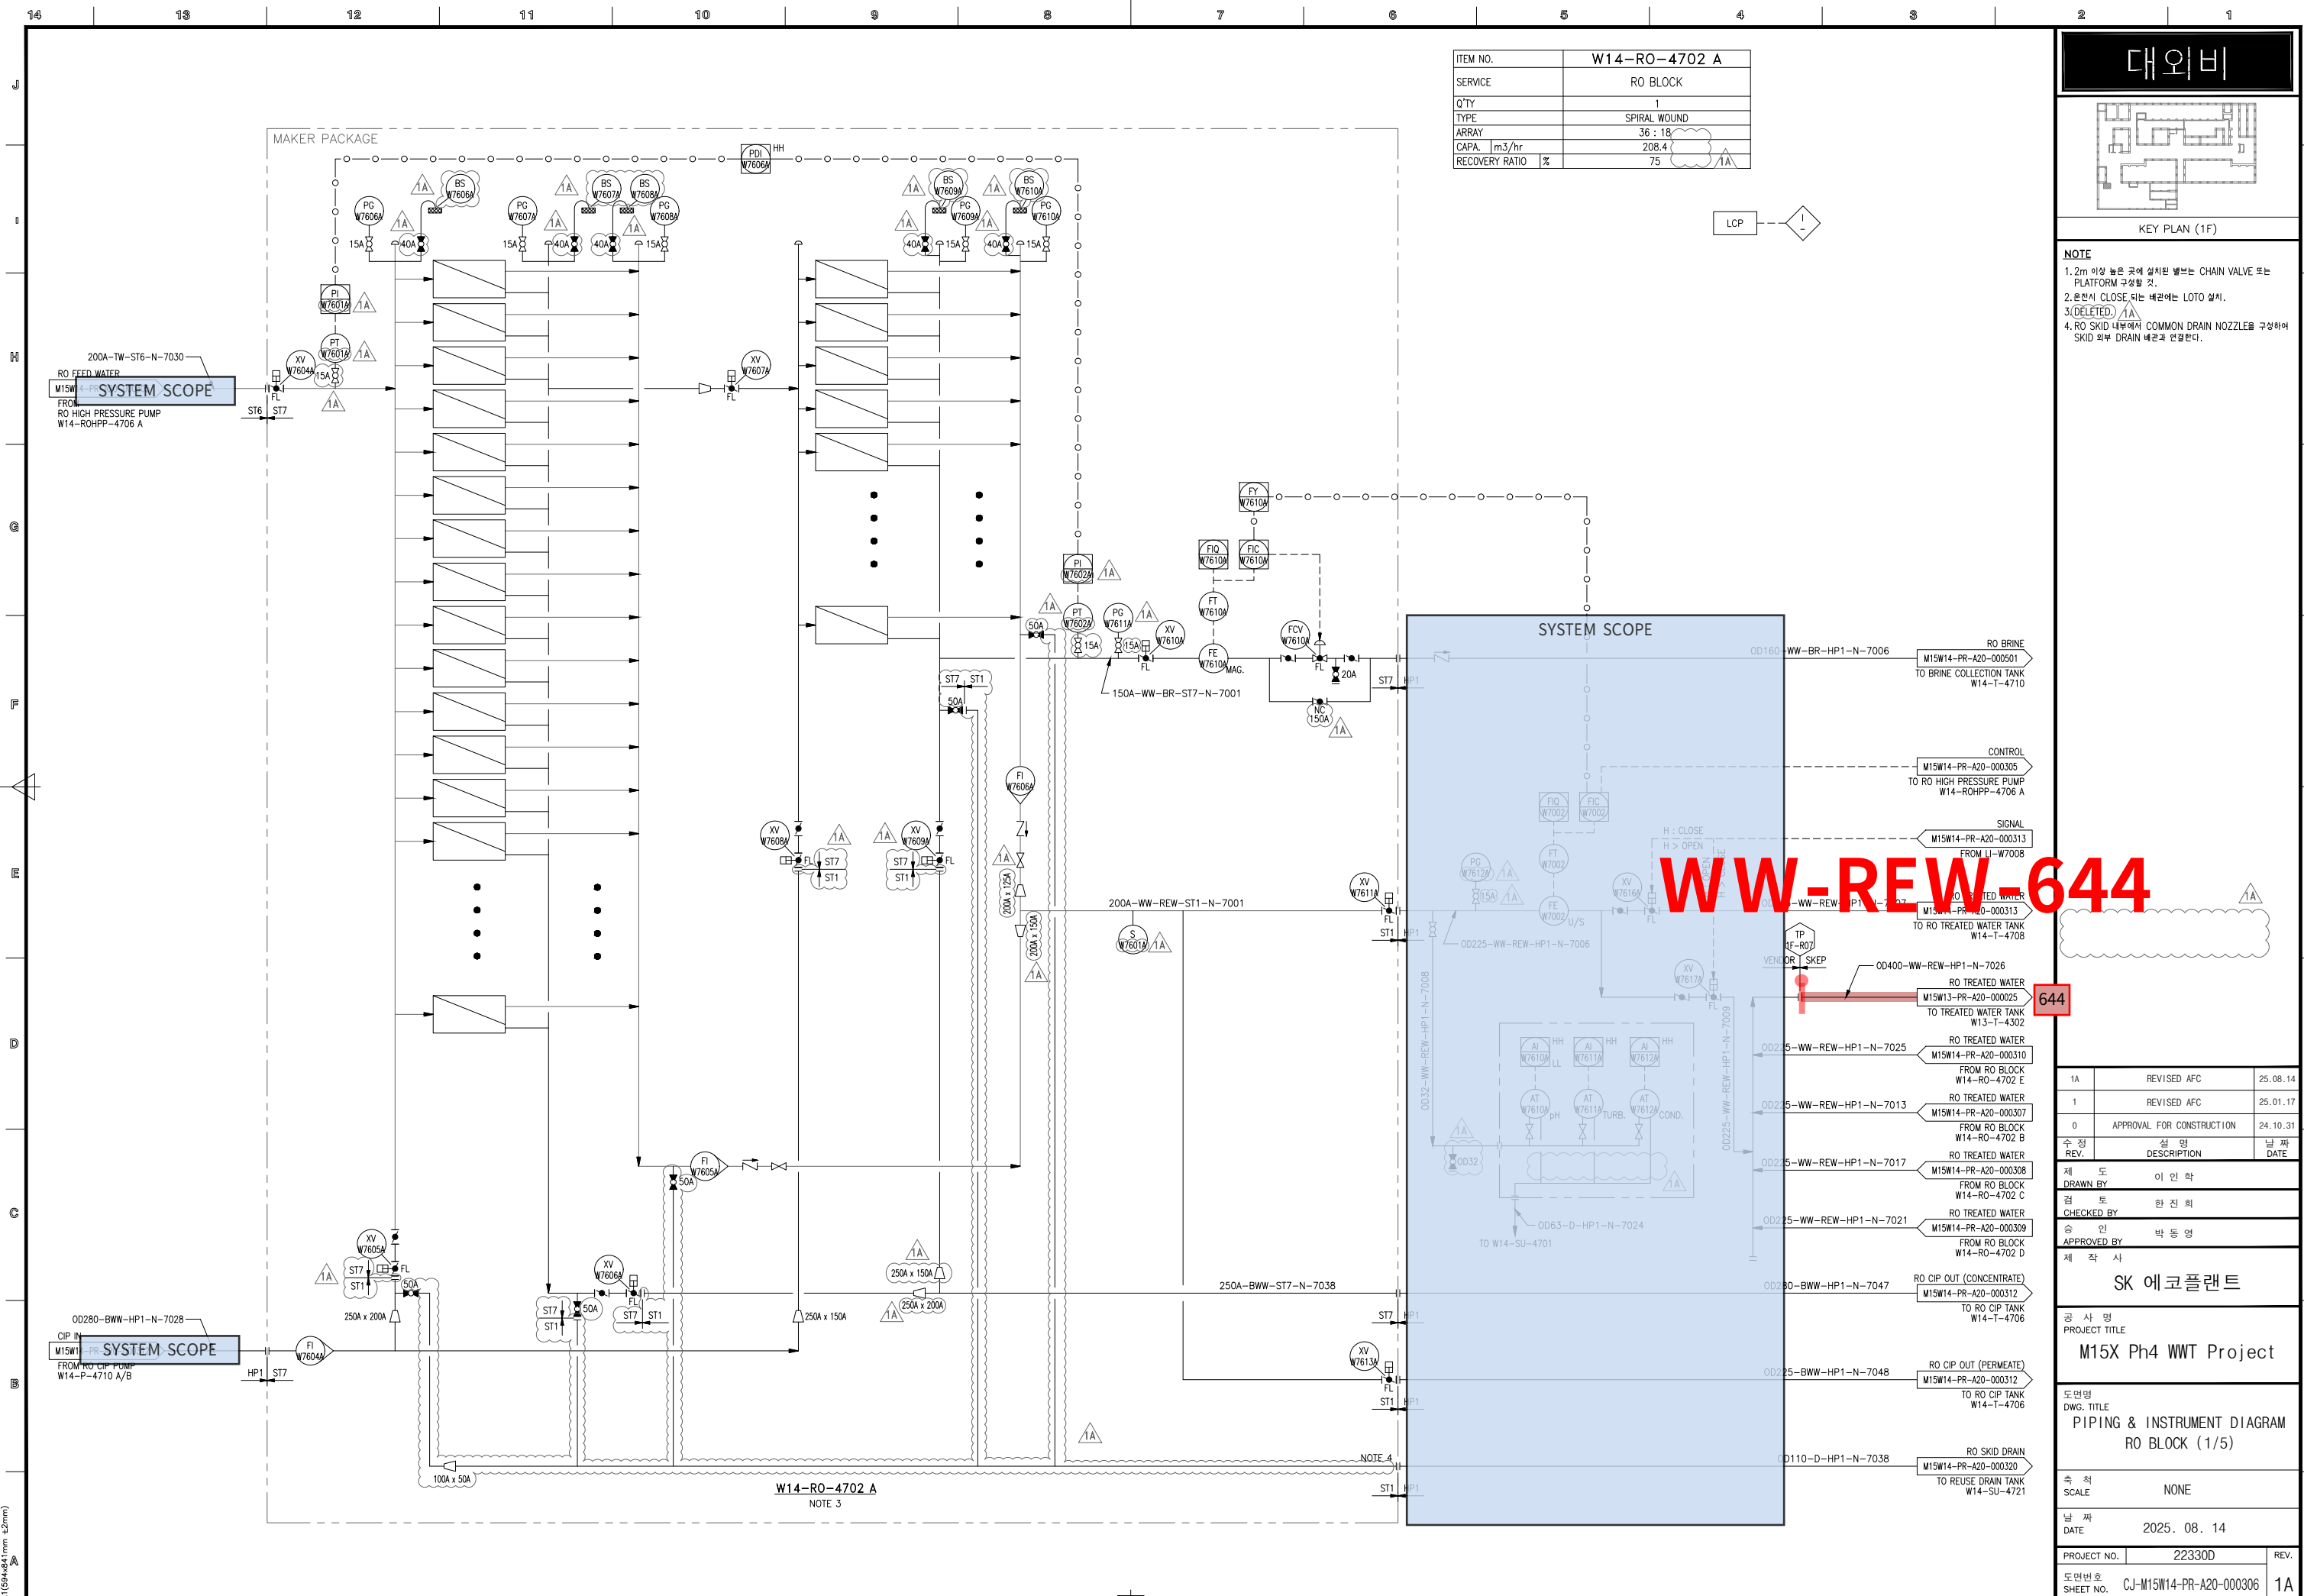

ITEM NO.	W14-RO-4702 A
SERVICE	RO BLOCK
Q'TY	1
TYPE	SPIRAL WOUND
ARRAY	36 : 18
CAPA.	1m3/hr 208.4
RECOVERY RATIO	% 75

대외비

KEY PLAN (1F)

- NOTE
- 1.2m 이상 높은 곳에 설치된 밸브는 CHAIN VALVE 또는 PLATFORM 구성할 것.
 2. 운전시 CLOSE 되는 배관에는 LOTO 설치.
 3. ~~DELETED~~ 1A
 4. RO SKID 내부에서 COMMON DRAIN NOZZLE를 구성하여 SKID 외부 DRAIN 배관과 연결한다.

1A	REVISED AFC	25.08.14
1	REVISED AFC	25.01.17
0	APPROVAL FOR CONSTRUCTION	24.10.31

수정	REV.	설명	DESCRIPTION	날짜	DATE
제	도	이	인	학	
검	토	한	진	희	
승	인	박	동	영	

SK 에코플랜트

공 사 명
PROJECT TITLE

M15X Ph4 WWT Project

도면명
DWG. TITLE

PIPING & INSTRUMENT DIAGRAM
RO BLOCK (1/5)

속 척
SCALE

NONE

날 짜
DATE

2025. 08. 14

PROJECT NO.

22330D

REV.

A

도면번호
SHEET NO.

CJ-M15W14-PR-A20-000306

1A




1. TRAY & ANGLE, CHANNEL SUPPORT가 적용되는 배관 ELEVATION은 현장 맞춤으로 한다.
2. (*) FIELD ADJUST

CLIENT



1

INSULATION	CODE	N	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA W14							CONTRACTOR	PROJECT NAME
	THICK.	-	DESIGN	6.4	60	UNIT R1FA								
			OPERATING	4	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-010017-A		25.03.31	REVISED AS MARKED	황래중	안남후	박동영	COMMODITY	JOB NO.
								25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영	WW-REW	22330D
						REF. P & ID CJ-M15W14-PR-A20-000306	REV. NO.	DATE	DESCRIPTION	BY	CHK	APP'D	LINE NO.	SH'T NO.
													OD400-WW-REW-HP1-N-7026	01 / 01
														REV. 1

[illegible]

CLIENT		 	
CONTRACTOR 		PROJECT NAME M15X Ph4 Project	
COMMODITY WW-REW		JOB NO. 22330D	
LINE NO. OD400-WW-REW-HP1-E-7026		SH'T NO. 01 / 01	REV. 1

* PIPE : P/P1 * 90° ELBOW : E90 * 45° ELBOW : E45 * TEE : T * RED.TEE : TR * STUB-IN : STU * REINFORCING PAD : RP * CON.RED : RC * ECC.RED : RE * CON.SWAGE : RCS/RCS1 * ECC.SWAGE : RES/RES1 * NIPPLE : NP/NP1/NP2 * CAP : CAP/CAP1 * PLUG : PLG * FULL COUPLING : FC * HALF COUPLING : HF/HF1 * STUB-IN : STU * SOCKET(HDPE/PVC) : SC * SADDLE(HDPE) : SD * FLANGE : F/F1 * GASKET : G/G1/G2 * BOLT & NUT : B/B1 * BLIND FLANGE : FB/FB1 * GATE VA. : VG/VG1/VG2 * BALL VA. : VB/VBLO/VB1/VB1LO/VB2/VB2LO * BUTTERFLY VA. : VF/VF4 * CHECK VA. : VC/VC1/VC2/VC3/VC4/VC5/VC6/VC7 * GLOBE VA. : VL/VL1/VL2 * DIAPHRAGM VA. : VD/VDLO * DAMPER : VP * QUICK COUPLING : SQC * FLEXIBLE JOINT(STEEL) : FLXB * FLEXIBLE JOINT(RUBBER) : FLXR * FLEXIBLE JOINT(STEEL PTFE LINED) : FLXL * FLEXIBLE HOSE : FLXH * STEAM TRAP : ST * SPRAY NOZZLE : SPN * EMERGENCY SHOWER : SSH * STRAINER(Y-TYPE) : YSTR * STRAINER(T-TYPE) : TSTR * STRAINER(BUCKET-TYPE) : BSTR * ANCHOR PLATE : STOP * BIRD SCREEN : BS * ISOLATION KIT : IK * UNLOADING BOX : UB * AIR TRAP : AT * LOTO : LOTO * SIGHT GLASS : SG * PRESSURE GAUGE : PG * SHIELD : SH * SPECIAL BOLT & NUT : BL/BL1												
INSULATION	CODE	E	CONDITION	PRESS. (kg/cm2g)	TEMP. (°C)	AREA W14						
	THICK.	25	DESIGN	6.4	60	UNIT R2FA						
			OPERATING	4	AMB	REF. PLAN DWG. CJ-M15W14-PI-A30-020015-A		25.03.31	REVISED AS MARKED	황래중	안남후	박동영
						REF. P & ID CJ-M15W14-PR-A20-000306		25.01.24	APPROVED FOR CONSTRUCTION	황래중	안남후	박동영
						REV. NO.	DATE	DESCRIPTION	BY	CHK	APP	